

# NFPA® 2001

## Standard on Clean Agent Fire Extinguishing Systems

### 2015 Edition



NFPA®, 1 Batterymarch Park, Quincy, MA 02169-7471, USA  
An International Codes and Standards Organization

## **IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS**

### **NOTICE AND DISCLAIMER OF LIABILITY CONCERNING THE USE OF NFPA STANDARDS**

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

### **REMINDER: UPDATING OF NFPA STANDARDS**

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that NFPA Standards may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendment and any Errata then in effect.

In order to determine whether an NFPA Standard has been amended through the issuance of Tentative Interim Amendments or corrected by Errata, visit the Document Information Pages on NFPA’s website. The Document Information Pages provide up-to-date, document specific information including any issued Tentative Interim Amendments and Errata.

To access the Document Information Page for a specific NFPA Standard, go to <http://www.nfpa.org/docinfo> to choose from the list of NFPA Standards or use the search feature on the right to select the NFPA Standard number (e.g., NFPA 101). In addition to posting all existing Tentative Interim Amendments and Errata, the Document Information Page also includes the option to sign-up for an “Alert” feature to receive an email notification when new updates and other information are posted regarding the document.

## IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

### ADDITIONAL NOTICES AND DISCLAIMERS

#### Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of new editions or may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendments and any Errata then in effect. In order to determine whether a given document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments or corrected through the issuance of Errata, consult appropriate NFPA publications such as the National Fire Codes® Subscription Service, visit the NFPA website at [www.nfpa.org](http://www.nfpa.org), or contact the NFPA at the address listed below.

#### Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

#### Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

**NOTICE:** The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

#### Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

#### Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

#### For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: [stds\\_admin@nfpa.org](mailto:stds_admin@nfpa.org)

For more information about NFPA, visit the NFPA website at [www.nfpa.org](http://www.nfpa.org). All NFPA codes and standards can be viewed at no cost at [www.nfpa.org/freecaccess](http://www.nfpa.org/freecaccess).

Copyright © 2014 National Fire Protection Association®. All Rights Reserved.

**NFPA® 2001**

**Standard on**

## **Clean Agent Fire Extinguishing Systems**

**2015 Edition**

This edition of NFPA 2001, *Standard on Clean Agent Fire Extinguishing Systems*, was prepared by the Technical Committee on Aerosol Extinguishing Technology. It was issued by the Standards Council on November 11, 2014, with an effective date of December 1, 2014, and supersedes all previous editions.

This edition of NFPA 2001 was approved as an American National Standard on December 1, 2014.

### **Origin and Development of NFPA 2001**

The Technical Committee on Halon Alternative Protection Options was organized in 1991 and immediately started work to address the new total flooding clean agents that were being developed to replace Halon 1301. A need existed for an explanation of how to design, install, maintain, and operate systems using these new clean agents, and NFPA 2001 was established to address that need. The 1994 edition was the first edition of NFPA 2001. The standard was revised in 1996, 2000, and 2004.

In January 2005, the technical committees responsible for NFPA 12, NFPA 12A, and NFPA 2001 were combined into the Technical Committee on Gaseous Fire Extinguishing Systems to better address and resolve issues among those documents. This action was intended to facilitate correlation and consistency as requested by the U.S. Environmental Protection Agency.

The 2008 edition added requirements for local application systems.

The 2012 edition included a complete rewrite of Annex C. In addition, more information on the environmental impact of clean agents was added to Annex A.

The 2015 edition adds new content regarding recycling and disposal of clean agents and adds new system design criteria for 200 bar and 300 bar IG-01 systems. A sample system acceptance report was added to aid in conformance with commissioning practices. The committee completed an update of all references and reviewed the pipe design criteria against the referenced piping code. This edition also revises the requirements for cylinder location, enclosure integrity, and unoccupied spaces.

## Technical Committee on Gaseous Fire Extinguishing Systems

**Jeffrey L. Harrington**, *Chair*  
Harrington Group, Inc., GA [SE]

**Ronald C. Adcock**, *Secretary*  
Marsh Risk Consulting, AZ [I]

**Katherine Adrian**, Tyco Fire Suppression & Building Products, WI [M]

**Oded Aron**, Port Authority of New York & New Jersey, NJ [U]

**Maurizio Barbuzzi**, North American Fire Guardian Technology, Inc., Italy [M]

**William J. Cary**, Global Risk Consultants, AZ [SE]

**John E. Dellogono**, Liberty Mutual Property, MA [I]

**Todd A. Dillon**, XL Global Asset Protection Services, OH [I]

**William A. Eckholm**, Firetrace International, AZ [M]

**Don A. Enslow**, BP Exploration (Alaska), Inc., AK [U]

**Laurence E. Fisher**, U.S. Coast Guard, DC [E]

**William A. Froh**, U.S. Department of Energy, DC [U]

**Edward S. Goldhammer**, Qualcomm, CA [U]

**Mark E. Herzog**, The Hiller Companies, AL [IM]

**Scott A. Hill**, Hughes Associates, Inc., MD [SE]

**Robert Kasiski**, FM Global, MA [I]

**Gregory T. Linteris**, National Institute of Standards & Technology, MD [RT]

**Norbert W. Makowka**, National Association of Fire Equipment Distributors, IL [IM]

Rep. National Association of Fire Equipment Distributors

**Bella A. Maranion**, U.S. Environmental Protection Agency, DC [E]

**Kevin Murray**, Siemens Industry, Inc., TX [M]

Rep. Automatic Fire Alarm Association, Inc.

**Robert G. Richard**, Honeywell, Inc., NY [M]

**Paul E. Rivers**, 3M Company, MN [M]

**Mark L. Robin**, DuPont Fluoroproducts, DE [M]

**Joseph A. Senecal**, UTC/Kidde-Fenwal, Inc., MA [M]

**Blake M. Shugarman**, UL LLC, IL [RT]

**John C. Spalding**, Healey Fire Protection, Inc., MI [IM]

Rep. Fire Suppression Systems Association

**Louise C. Speitel**, U.S. Federal Aviation Administration, NJ [E]

**Brad T. Stilwell**, Fike Corporation, MO [M]

**Fred K. Walker**, U.S. Department of the Air Force, FL [E]

**Robert T. Wickham**, Wickham Associates, NH [SE]

**Thomas J. Wysocki**, Guardian Services, Inc., IL [SE]

### Alternates

**Charles O. Baurth**, Liberty Mutual Property, MA [I]  
(Alt. to J.E. Dellogono)

**Thomas A. Downey**, Marsh Risk Consulting, CT [I]  
(Alt. to R. C. Adcock)

**Randall Eberly**, U.S. Coast Guard, DC [E]  
(Alt. to L. E. Fisher)

**Brent S. Ehmke**, Ehmke Associates, NC [SE]  
(Alt. to R. T. Wickham)

**Ryan Gamboa**, Firetrace USA, AZ [M]  
(Alt. to W. A. Eckholm)

**Raymond N. Hansen**, U.S. Department of the Air Force, FL [E]  
(Alt. to F. K. Walker)

**Kevin Holly, Jr.**, UL LLC, IL [RT]  
(Alt. to B. M. Shugarman)

**Giuliano Indovino**, North American Fire Guardian Technology, Inc., Italy [M]  
(Alt. to M. Barbuzzi)

**Jonathan G. Ingram**, UTC/Kidde-Fenwal, Inc., MA [M]  
(Alt. to J. A. Senecal)

**Robert H. Kelly**, Fire Defense Equipment Company, Inc., MI [IM]  
(Alt. to J. C. Spalding)

**Jeffrey S. Kidd**, Hiller New England Fire Protection, Inc., MA [IM]

(Alt. to M. E. Herzog)

**Justin D. Merrick**, S&S Sprinkler Company, LLC, AL [M]  
(Alt. to K. Murray)

**Michael Lee Moberly**, BP Exploration (Alaska), Inc., AK [U]

(Alt. to D. A. Enslow)

**Earl D. Nearingth**, Fike Corporation, MO [M]  
(Alt. to B. T. Stilwell)

**John G. Owens**, 3M Company, MN [M]  
(Alt. to P. E. Rivers)

**James M. Rucci**, Harrington Group, Inc., GA [SE]  
(Alt. to J. L. Harrington)

**Raymond A. Stacy**, FM Approvals, MA [I]  
(Alt. to R. Kasiski)

**Alfred J. Thornton**, The DuPont Company, Inc., TX [M]  
(Alt. to M. L. Robin)

**Todd W. VanGorder**, Silco Fire & Security, OH [IM]  
(Alt. to N. W. Makowka)

**Nonvoting**

**Rudolf Klitte**, Kidde Danmark A/S, Denmark [M]  
**Ingeborg Schlosser**, VdS Schadenverhuetung,  
Germany [I]

**Fernando Vigarà**, APICI, Spain [SE]

**Barry D. Chase**, NFPA Staff Liaison

*This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.*

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

**Committee Scope:** This committee shall have primary responsibility for documents on the installation, maintenance, and use of carbon dioxide systems for fire protection. This committee shall also have primary responsibility for documents on fixed fire extinguishing systems utilizing bromotrifluoromethane and other similar halogenated extinguishing agents, covering the installation, maintenance, and use of systems. This committee shall also have primary responsibility for documents on alternative protection options to Halon 1301 and 1211 fire extinguishing systems. It shall not deal with design, installation, operation, testing, and maintenance of systems employing dry chemical, wet chemical, foam, aerosols, or water as the primary extinguishing media.

## Contents

<b>Chapter 1 Administration</b> .....	<b>2001- 5</b>	<b>Chapter 7 Inspection, Testing, Maintenance, and Training</b> .....	<b>2001- 22</b>
1.1 Scope .....	2001- 5	7.1 Inspection and Tests .....	2001- 22
1.2 Purpose .....	2001- 5	7.2 Container Test .....	2001- 22
1.3 Units .....	2001- 5	7.3 Hose Test .....	2001- 22
1.4 General Information .....	2001- 5	7.4 Enclosure Inspection .....	2001- 22
1.5 Safety .....	2001- 6	7.5 Maintenance .....	2001- 23
1.6 Environmental Factors .....	2001- 8	7.6 Training .....	2001- 23
1.7 Retrofitability .....	2001- 9	7.7 Approval of Installations .....	2001- 23
1.8 Compatibility with Other Agents .....	2001- 9	7.8 Safety .....	2001- 25
<b>Chapter 2 Referenced Publications</b> .....	<b>2001- 9</b>	<b>Chapter 8 Marine Systems</b> .....	<b>2001- 25</b>
2.1 General .....	2001- 9	8.1 General .....	2001- 25
2.2 NFPA Publications .....	2001- 9	8.2 Use and Limitations .....	2001- 25
2.3 Other Publications .....	2001- 9	8.3 Hazards to Personnel .....	2001- 25
2.4 References for Extracts in Mandatory Sections .....	2001- 9	8.4 Agent Supply .....	2001- 25
<b>Chapter 3 Definitions</b> .....	<b>2001- 9</b>	8.5 Detection, Actuation, and Control Systems .....	2001- 25
3.1 General .....	2001- 9	8.6 Additional Requirements for Systems Protecting Class B Hazards Greater Than 6000 ft <sup>3</sup> (170 m <sup>3</sup> ) with Stored Cylinders Within the Protected Space .....	2001- 26
3.2 NFPA Official Definitions .....	2001- 9	8.7 Enclosure .....	2001- 26
3.3 General Definitions .....	2001- 10	8.8 Design Concentration Requirements ...	2001- 26
<b>Chapter 4 Components</b> .....	<b>2001- 11</b>	8.9 Distribution System .....	2001- 27
4.1 Agent Supply .....	2001- 11	8.10 Nozzle Choice and Location .....	2001- 27
4.2 Distribution .....	2001- 12	8.11 Inspection and Tests .....	2001- 27
4.3 Detection, Actuation, Alarm, and Control Systems .....	2001- 14	8.12 Approval of Installations .....	2001- 27
<b>Chapter 5 System Design</b> .....	<b>2001- 16</b>	8.13 Periodic Puff Testing .....	2001- 27
5.1 Specifications, Plans, and Approvals .....	2001- 16	8.14 Compliance .....	2001- 27
5.2 System Flow Calculations .....	2001- 17	<b>Annex A Explanatory Material</b> .....	<b>2001- 27</b>
5.3 Enclosure .....	2001- 18	<b>Annex B Cup Burner Method for Determining the Minimum Concentration of Gaseous Agent for Flame Extinguishment</b> .....	<b>2001-101</b>
5.4 Design Concentration Requirements ...	2001- 18	<b>Annex C Enclosure Integrity Procedure</b> .....	<b>2001-111</b>
5.5 Total Flooding Quantity .....	2001- 18	<b>Annex D Enclosure Evaluation</b> .....	<b>2001-118</b>
5.6 Duration of Protection .....	2001- 20	<b>Annex E Informational References</b> .....	<b>2001-119</b>
5.7 Distribution System .....	2001- 20	<b>Index</b> .....	<b>2001-123</b>
5.8 Nozzle Choice and Location .....	2001- 20		
<b>Chapter 6 Local Application Systems</b> .....	<b>2001- 21</b>		
6.1 Description .....	2001- 21		
6.2 Hazard Specifications .....	2001- 21		
6.3 Clean Agent Requirements .....	2001- 21		
6.4 Nozzles .....	2001- 21		
6.5 Location and Number of Nozzles .....	2001- 21		
6.6 Operation .....	2001- 22		

**NFPA 2001**  
**Standard on**  
**Clean Agent Fire Extinguishing Systems**

**2015 Edition**

**IMPORTANT NOTE:** *This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading “Important Notices and Disclaimers Concerning NFPA Standards.” They can also be obtained on request from NFPA or viewed at [www.nfpa.org/disclaimers](http://www.nfpa.org/disclaimers).*

NOTICE: An asterisk (\*) following the number or letter designating a paragraph indicates that explanatory material in the paragraph can be found in Annex A.

A reference in brackets [ ] following a section or paragraph indicates material that has been extracted from another NFPA document. As an aid to the user, the complete title and edition of the source documents for extracts in mandatory sections of the document are given in Chapter 2 and those for extracts in informational sections are given in Annex E. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced publications can be found in Chapter 2 and Annex E.

## Chapter 1 Administration

**1.1 Scope.** This standard contains minimum requirements for total flooding and local application clean agent fire extinguishing systems. It does not cover fire extinguishing systems that use carbon dioxide or water as the primary extinguishing media, which are addressed by other NFPA documents.

### 1.2 Purpose.

**1.2.1** The agents in this standard were introduced in response to international restrictions on the production of certain halon fire extinguishing agents under the Montreal Protocol signed September 16, 1987, as amended. This standard is prepared for the use by and guidance of those charged with purchasing, designing, installing, testing, inspecting, approving, listing, operating, and maintaining engineered or pre-engineered clean agent extinguishing systems, so that such equipment will function as intended throughout its life. Nothing in this standard is intended to restrict new technologies or alternative arrangements provided the level of safety prescribed by this standard is not lowered.

**1.2.2** No standard can be promulgated that will provide all the necessary criteria for the implementation of a total flooding clean agent fire extinguishing system. Technology in this area is under constant development, and this will be reflected in revisions to this standard. The user of this standard must recognize the complexity of clean agent fire extinguishing systems. Therefore, the designer is cautioned that the standard is not a design handbook. The standard does not do away with the need for the engineer or for competent engineering judgment. It is intended that a designer capable of applying a more

complete and rigorous analysis to special or unusual problems shall have latitude in the development of such designs. In such cases, the designer is responsible for demonstrating the validity of the approach.

**1.3 Units.** Metric units of measurement in this standard are in accordance with the modernized metric system known as the International System of Units (SI). Two units outside of but recognized by SI (liter and bar) are commonly used in international fire protection. The SI units and their conversion factors are listed in Table 1.3. If a value for measurement as given in this standard is followed by an equivalent value in other units, the first stated is to be regarded as the requirement. A given equivalent value could be approximate.

**Table 1.3 Metric Conversion Factors**

Name of Unit	Unit Symbol	Conversion Factor
millimeter	mm	1 in. = 25.4 mm
liter	L	1 gal = 3.785 L
cubic meter	m <sup>3</sup>	1 ft <sup>3</sup> = 0.028317 m <sup>3</sup>
kilogram	kg	1 lb = 0.4536 kg
kilograms per cubic meter	kg/m <sup>3</sup>	1 lb/ft <sup>3</sup> = 16.0185 kg/m <sup>3</sup>
pascal	Pa	1 psi = 6895 Pa
bar	bar	1 psi = 0.0689 bar
bar	bar	1 bar = 10 <sup>5</sup> Pa

Notes:

- (1) For additional conversions and information, see ASTM SI10.
- (2) In Canada, refer to CAN/CSA-Z234.1.

## 1.4 General Information.

### 1.4.1\* Applicability of Agents.

**1.4.1.1** The fire extinguishing agents addressed in this standard shall be electrically nonconducting and leave no residue upon evaporation.

**1.4.1.2\*** Agents that meet the criteria of 1.4.1.1 shall be shown in Table 1.4.1.2.

**1.4.1.3** The design, installation, service, and maintenance of clean agent systems shall be performed by those skilled in clean agent fire extinguishing system technology.

### 1.4.2\* Use and Limitations.

**1.4.2.1** All pre-engineered systems shall be installed to protect hazards within the limitations that have been established by the listing. Pre-engineered systems shall be listed to one of the following types:

- (1) Those consisting of system components designed to be installed according to pre-tested limitations by a testing laboratory. These pre-engineered systems shall be permitted to incorporate special nozzles, flow rates, methods of application, nozzle placement, and pressurization levels that could differ from those detailed elsewhere in this standard. All other requirements of the standard shall apply.
- (2) Automatic extinguishing units incorporating special nozzles, flow rates, methods of application, nozzle placement, actuation techniques, piping materials, discharge times, mounting techniques, and pressurization levels that could differ from those detailed elsewhere in this standard.

Table 1.4.1.2 Agents Addressed in NFPA 2001

Agent Designation	Chemical Name	Chemistry
FK-5-1-12	Dodecafluoro-2- methylpentan-3-one	$\text{CF}_3\text{CF}_2\text{C}(\text{O})\text{CF}(\text{CF}_3)_2$
HCFC Blend A	Dichlorotrifluoroethane HCFC-123 (4.75%)	$\text{CHCl}_2\text{CF}_3$
	Chlorodifluoromethane HCFC-22 (82%)	$\text{CHClF}_2$
	Chlorotetrafluoroethane HCFC-124 (9.5%)	$\text{CHClFCF}_3$
	Isopropenyl-1- methylcyclohexene (3.75%)	
HCFC-124	Chlorotetrafluoroethane	$\text{CHClFCF}_3$
HFC-125	Pentafluoroethane	$\text{CHF}_2\text{CF}_3$
HFC-227ea	Heptafluoropropane	$\text{CF}_3\text{CHF}_2\text{CF}_3$
HFC-23	Trifluoromethane	$\text{CHF}_3$
HFC-236fa	Hexafluoropropane	$\text{CF}_3\text{CH}_2\text{CF}_3$
FIC-131I	Trifluoroiodide	$\text{CF}_3\text{I}$
IG-01	Argon	Ar
IG-100	Nitrogen	$\text{N}_2$
IG-541	Nitrogen (52%)	$\text{N}_2$
	Argon (40%)	Ar
	Carbon dioxide (8%)	$\text{CO}_2$
IG-55	Nitrogen (50%)	$\text{N}_2$
	Argon (50%)	Ar
HFC Blend B	Tetrafluoroethane (86%)	$\text{CH}_2\text{FCF}_3$
	Pentafluoroethane (9%)	$\text{CHF}_2\text{CF}_3$
	Carbon dioxide (5%)	$\text{CO}_2$

## Notes:

- (1) Other agents could become available at later dates. They could be added via the NFPA process in future editions or by amendments to the standard.
- (2) Composition of inert gas agents is given in percent by volume. Composition of HCFC Blend A is given in percent by weight.
- (3) The full analogous ASHRAE nomenclature for FK-5-1-12 is FK-5-1-12mmy2.

**1.4.2.2\*** Clean agents shall not be used on fires involving the following materials unless the agents have been tested to the satisfaction of the authority having jurisdiction:

- (1) Certain chemicals or mixtures of chemicals, such as cellulose nitrate and gunpowder, which are capable of rapid oxidation in the absence of air
- (2) Reactive metals such as lithium, sodium, potassium, magnesium, titanium, zirconium, uranium, and plutonium
- (3) Metal hydrides
- (4) Chemicals capable of undergoing autothermal decomposition, such as certain organic peroxides and hydrazine

**1.4.2.3** Where a total flooding system is used, a fixed enclosure shall be provided about the hazard that allows a specified agent concentration to be achieved and maintained for a specified period of time.

**1.4.2.4\*** The effects of agent decomposition on fire protection effectiveness and equipment shall be considered where clean agents are used in hazards with high ambient temperatures (e.g., furnaces and ovens).

## 1.5 Safety.

### 1.5.1\* Hazards to Personnel.

**1.5.1.1\*** Any agent that is to be recognized by this standard or proposed for inclusion in this standard shall first be evaluated in a manner equivalent to the process used by the

U.S. Environmental Protection Agency (EPA) Significant New Alternatives Policy (SNAP) Program for total flooding agents.

### 1.5.1.2\* Halocarbon Agents.

**1.5.1.2.1\*** Unnecessary exposure to halocarbon clean agents — including exposure at and below the no observable adverse effects level (NOAEL) — and halocarbon decomposition products shall be avoided. Means shall be provided to limit exposure to no longer than 5 minutes. Unprotected personnel shall not enter a protected space during or after agent discharge. The following additional provisions shall apply:

- (1) Halocarbon systems for spaces that are normally occupied and designed to concentrations up to the NOAEL [see Table 1.5.1.2.1(a)] shall be permitted. The maximum exposure in any case shall not exceed 5 minutes.
- (2) Halocarbon systems for spaces that are normally occupied and designed to concentrations above the NOAEL [see Table 1.5.1.2.1(a)] shall be permitted if means are provided to limit exposure to the design concentrations shown in Table 1.5.1.2.1(b) through Table 1.5.1.2.1(e) that correspond to an allowable human exposure time of 5 minutes. Higher design concentrations associated with human exposure times less than 5 minutes as shown in Table 1.5.1.2.1(b) through Table 1.5.1.2.1(e) shall not be permitted in normally occupied spaces. An exposure and egress analysis shall be performed and approved.



- (3) In spaces that are not normally occupied and protected by a halocarbon system designed to concentrations above the lowest observable adverse effects level (LOAEL) [see Table 1.5.1.2.1(a)] and where personnel could possibly be exposed, means shall be provided to limit exposure times using Table 1.5.1.2.1(b) through Table 1.5.1.2.1(e).
- (4) In spaces that are not normally occupied and in the absence of the information needed to fulfill the conditions listed in 1.5.1.2.1, the following provisions shall apply:
  - (a) Where egress takes longer than 30 seconds but less than 1 minute, the halocarbon agent shall not be used in a concentration exceeding its LOAEL.
  - (b) Concentrations exceeding the LOAEL shall be permitted provided that any personnel in the area can escape within 30 seconds.
  - (c) A pre-discharge alarm and time delay shall be provided in accordance with the provisions of 4.3.5.6 of this standard.

**Table 1.5.1.2.1(a) Information for Halocarbon Clean Agents**

Agent	NOAEL (% vol.)	LOAEL (% vol.)
FK-5-1-12	10.0	>10.0
HCFC Blend A	10.0	>10.0
HCFC-124	1.0	2.5
HFC-125	7.5	10.0
HFC-227ea	9.0	10.5
HFC-23	30	>30
HFC-236fa	10	15
HFC Blend B*	5.0*	7.5*

\*These values are for the largest component of the blend (HFC 134A).

**Table 1.5.1.2.1(b) Time for Safe Human Exposure at Stated Concentrations for HFC-125**

HFC-125 Concentration		Maximum Permitted Human Exposure Time (min)
% vol.	ppm	
7.5	75,000	5.00
8.0	80,000	5.00
8.5	85,000	5.00
9.0	90,000	5.00
9.5	95,000	5.00
10.0	100,000	5.00
10.5	105,000	5.00
11.0	110,000	5.00
11.5	115,000	5.00
12.0	120,000	1.67
12.5	125,000	0.59
13.0	130,000	0.54
13.5	135,000	0.49

Notes:

- (1) Data derived from the EPA-approved and peer-reviewed physiologically based pharmacokinetic (PBPK) model or its equivalent.
- (2) Based on LOAEL of 10.0 percent in dogs.

**Table 1.5.1.2.1(c) Time for Safe Human Exposure at Stated Concentrations for HFC-227ea**

HFC-227ea Concentration		Maximum Permitted Human Exposure Time (min)
% vol.	ppm	
9.0	90,000	5.00
9.5	95,000	5.00
10.0	100,000	5.00
10.5	105,000	5.00
11.0	110,000	1.13
11.5	115,000	0.60
12.0	120,000	0.49

Notes:

- (1) Data derived from the EPA-approved and peer-reviewed PBPK model or its equivalent.
- (2) Based on LOAEL of 10.5 percent in dogs.

**Table 1.5.1.2.1(d) Time for Safe Human Exposure at Stated Concentrations for HFC-236fa**

HFC-236fa Concentration		Maximum Permitted Human Exposure Time (min)
% vol.	ppm	
10.0	100,000	5.00
10.5	105,000	5.00
11.0	110,000	5.00
11.5	115,000	5.00
12.0	120,000	5.00
12.5	125,000	5.00
13.0	130,000	1.65
13.5	135,000	0.92
14.0	140,000	0.79
14.5	145,000	0.64
15.0	150,000	0.49

Notes:

- (1) Data derived from the EPA-approved and peer-reviewed PBPK model or its equivalent.
- (2) Based on LOAEL of 15.0 percent in dogs.

**Table 1.5.1.2.1(e) Time for Safe Human Exposure at Stated Concentrations for FIC-131I**

FIC-131I Concentration		Maximum Permitted Human Exposure Time (min)
% vol.	ppm	
0.20	2000	5.00
0.25	2500	5.00
0.30	3000	5.00
0.35	3500	4.30
0.40	4000	0.85
0.45	4500	0.49
0.50	5000	0.35

Notes:

- (1) Data derived from the EPA-approved and peer-reviewed PBPK model or its equivalent.
- (2) Based on LOAEL of 0.4 percent in dogs.

**1.5.1.3\* Inert Gas Clean Agents.** Unnecessary exposure to inert gas agent systems resulting in low oxygen atmospheres shall be avoided. The maximum exposure time in any case shall not exceed 5 minutes. See Table 5.5.3.3 for atmospheric correction factors that shall be considered when determining the design concentrations. One objective of pre-discharge alarms and time delays is to prevent human exposure to agents. A pre-discharge alarm and time delay shall be provided in accordance with the provisions of 4.3.5.6 of this standard. Unprotected personnel shall not enter the area during or after agent discharge. The following additional provisions shall apply:

- (1) Inert gas systems designed to concentrations below 43 percent (corresponding to an oxygen concentration of 12 percent, sea level equivalent of oxygen) shall be permitted where means are provided to limit exposure to no longer than 5 minutes.
- (2) Inert gas systems designed to concentrations between 43 and 52 percent (corresponding to between 12 and 10 percent oxygen, sea level equivalent of oxygen) shall be permitted where means are provided to limit exposure to no longer than 3 minutes.
- (3) Inert gas systems designed to concentrations between 52 and 62 percent (corresponding to between 10 and 8 percent oxygen, sea level equivalent of oxygen) shall be permitted given the following:
  - (a) The space is normally unoccupied.
  - (b) Where personnel could possibly be exposed, means are provided to limit the exposure to less than 30 seconds.
- (4) Inert gas systems designed to concentrations above 62 percent (corresponding to 8 percent oxygen or below, sea level equivalent of oxygen) shall be used only in unoccupied areas where personnel are not exposed to such oxygen depletion.

#### 1.5.1.4 Safety Requirements.

**1.5.1.4.1\*** Suitable safeguards shall be provided to ensure prompt evacuation of and prevent entry into hazardous atmospheres and also to provide means for prompt rescue of any trapped personnel. Safety items such as personnel training, warning signs, discharge alarms, self-contained breathing apparatus (SCBA), evacuation plans, and fire drills shall be considered.

**1.5.1.4.2\*** Consideration shall be given to the possibility of a clean agent migrating to adjacent areas outside of the protected space.

**1.5.1.4.3** For systems protecting occupiable enclosures or spaces where the clean agent design concentration exceeds that approved for use in normally occupied spaces (see Section 1.5), systems shall include the following:

- (1) Supervised system lockout valves
- (2) Pneumatic pre-discharge alarms
- (3) Pneumatic time delays
- (4) Warning signs

**1.5.1.4.4\*** Pneumatic pre-discharge alarms shall be operated by an inert gas. For an inert gas clean agent fire extinguishing system, the quantity of inert gas discharged to operate a pneumatic pre-discharge alarm discharging into the protected space shall be considered, together with the quantity of agent discharged, when making a determination of post-discharge

oxygen concentration with respect to compliance with the requirements of 1.5.1.3.

**1.5.1.5** All persons who inspect, test, maintain, or operate fire extinguishing systems shall be trained in all aspects of safety related to the systems.

**1.5.1.5.1** Before system cylinders are handled or moved, the following steps shall be taken:

- (1) Cylinder outlets shall be fitted with anti-recoil devices, cylinder caps, or both whenever the cylinder outlet is not connected to the system pipe inlet.
- (2) Actuators shall be disabled or removed before cylinders are removed from retaining bracketing.

**1.5.1.5.2** Safe handling procedures shall be followed when transporting system cylinders.

**1.5.1.5.2.1** Equipment designed for transporting cylinders shall be used. When dollies or carts are used, cylinders shall be secured.

**1.5.1.5.2.2** The system manufacturer's service procedures shall be followed for specific details on system operation, maintenance, and safety considerations.

#### 1.5.2 Electrical Clearances.

**1.5.2.1** All system components shall be located to maintain no less than minimum clearances from energized electrical parts. The following references shall be considered as the minimum electrical clearance requirements for the installation of clean agent systems:

- (1) ANSI C2
- (2) *NFPA 70*
- (3) 29 CFR 1910, Subpart S

**1.5.2.2** Where the design basic insulation level (BIL) is not available and where nominal voltage is used for the design criteria, the highest minimum clearance listed for this group shall be used.

**1.5.2.3** The selected clearance to ground shall satisfy the greater of the switching surge or BIL duty, rather than being based on nominal voltage.

**1.5.2.4** The clearance between uninsulated, energized parts of the electrical system equipment and any portion of the clean agent system shall not be less than the minimum clearance provided elsewhere for electrical system insulation on any individual component.

**1.5.2.5** Where BIL is not available and where nominal voltage is used for the design criteria, the highest minimum clearance listed for this group shall be used.

**1.6\* Environmental Factors.** When an agent is being selected to protect a hazard area, the effects of the agent on the environment shall be considered. Selection of the appropriate fire suppression agent shall include consideration of the following items:

- (1) Potential environmental effect of a fire in the protected area
- (2) Potential environmental impacts, including, but not limited to, ozone depletion potential (ODP) and global warming potential (GWP) of the clean agents that could be used

**1.7 Retrofitability.** Retrofitting of any clean agent into an existing fire extinguishing system shall result in a system that is listed or approved.

**1.8 Compatibility with Other Agents.**

**1.8.1\*** Mixing of agents in the same container shall be permitted only if the system is listed.

**1.8.2** Systems employing the simultaneous discharge of different agents to protect the same enclosed space shall not be permitted.

## Chapter 2 Referenced Publications

**2.1 General.** The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

**2.2 NFPA Publications.** National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

*NFPA 70<sup>®</sup>, National Electrical Code<sup>®</sup>*, 2014 edition.

*NFPA 72<sup>®</sup>, National Fire Alarm and Signaling Code*, 2013 edition.

**2.3 Other Publications.**

**2.3.1 ANSI Publications.** American National Standards Institute, Inc., 25 West 43rd Street, 4th Floor, New York, NY 10036.

ANSI B1.20.1, *Standard for Pipe Threads, General Purpose*, 1983 (R2006).

ANSI C2, *National Electrical Safety Code*, 2012.

ANSI Z535, *Standard for Environmental and Facility Safety Signs*, 2011.

**2.3.2 ASME Publications.** American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5990.

*Boiler and Pressure Vessel Code*, 2013.

ASME B31.1, *Power Piping*, 2012.

**2.3.3 ASTM Publications.** ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM A120, *Specification for Seamless Carbon Steel Pipe for High Temperature Service*, 1988.

ASTM S110, *American National Standard for Metric Practice*, 2010.

**2.3.4 CGA Publications.** Compressed Gas Association, 14501 George Carter Way, Suite 103, Chantilly, VA 20151-2923.

CGA C-6, *Standard for Visual Inspection of Steel Compressed Gas Cylinders*, 2007.

**2.3.5 CSA Publications.** Canadian Standards Association, 5060 Spectrum Way, Suite 100, Mississauga, ON L4W 5N6, Canada.

CAN/CSA-Z234.1, *Canadian Metric Practice Guide*, 2000 (R2011).

**2.3.6 IMO Publications.** International Maritime Organization, 4 Albert Embankment, London, England, SE1 7SR United Kingdom.

IMO MSC/Circular 848, *Revised Guidelines for the Approval of Equivalent Fixed Gas Fire-Extinguishing Systems as Referred to in SOLAS 74, for Machinery Spaces and Cargo Pump-Rooms*, 1998.

**2.3.7 ISO Publications.** International Organization for Standardization, 1 ch. de la Voie-Creuse, Case postale 56, CH-1211 Geneva 20, Switzerland.

ISO 7-1, *Pipe Threads Where Pressure-Tight Joints Are Made on the Threads — Part 1: Dimensions, Tolerances and Designation*, 1994.

**2.3.8 TC Publications.** Transport Canada, Tower C, Place de Ville, 330 Sparks Street, Ottawa, Ontario, K1A 0N5, Canada.

TP 127 E, *Ship Safety Electrical Standards*, 2008.

**2.3.9 UL Publications.** Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062-2096.

ANSI/UL 2127, *Standard for Inert Gas Clean Agent Extinguishing System Units*, 2012.

ANSI/UL 2166, *Standard for Halocarbon Clean Agent Extinguishing System Units*, 2012.

**2.3.10 ULC Publications.** Underwriters Laboratories of Canada, 7 Underwriters Road, Toronto, ON M1R 3B4, Canada.

CAN/ULC S524-06, *Standard for the Installation of Fire Alarm Systems*, 2011.

CAN/ULC S529-09, *Smoke Detectors for Fire Alarm Systems*, 2009.

**2.3.11 U.S. Government Publications.** U.S. Government Printing Office, Washington, DC 20402.

OSHA, Title 29, Code of Federal Regulations, Part 1910, Subpart S.

USCG Title 46, Code of Federal Regulations, Part 72.

USCG Title 46, Code of Federal Regulations, Subchapter J, "Electrical Engineering."

DOT Title 49, Code of Federal Regulations, Parts 170-190, "Transportation."

**2.3.12 Other Publications.** *Merriam-Webster's Collegiate Dictionary*, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

**2.4 References for Extracts in Mandatory Sections.**

NFPA 12, *Standard on Carbon Dioxide Extinguishing Systems*, 2015 edition.

## Chapter 3 Definitions

**3.1 General.** The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

**3.2 NFPA Official Definitions.**

**3.2.1\* Approved.** Acceptable to the authority having jurisdiction.

**3.2.2\* Authority Having Jurisdiction (AHJ).** An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

**3.2.3\* Listed.** Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

**3.2.4 Shall.** Indicates a mandatory requirement.

**3.2.5 Should.** Indicates a recommendation or that which is advised but not required.

**3.2.6 Standard.** An NFPA Standard, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA Manuals of Style. When used in a generic sense, such as in the phrase “standards development process” or “standards development activities,” the term “standards” includes all NFPA Standards, including Codes, Standards, Recommended Practices, and Guides.

### 3.3 General Definitions.

**3.3.1 Adjusted Minimum Design Quantity (AMDQ).** The minimum design quantity of agent that has been adjusted in consideration of design factors.

**3.3.2 Agent Concentration.** The portion of agent in an agent-air mixture expressed in volume percent.

**3.3.3 Class A Fire.** A fire in ordinary combustibles materials, such as wood, cloth, paper, rubber, and many plastics.

**3.3.4 Class B Fire.** A fire in flammable liquids, combustible liquids, petroleum greases, tars, oils, oil-based paints, solvents, lacquers, alcohols, and flammable gases.

**3.3.5 Class C Fire.** A fire that involves energized electrical equipment.

**3.3.6 Clean Agent.** Electrically nonconducting, volatile, or gaseous fire extinguishant that does not leave a residue upon evaporation. The word *agent* as used in this document means clean agent unless otherwise indicated.

**3.3.7 Clearance.** The air distance between extinguishing system equipment, including piping and nozzles, and unenclosed or uninsulated live electrical components not at ground potential.

**3.3.8 Control Room and Electronic Equipment Space.** A space containing electronic or electrical equipment, such as that found in control rooms or electronic equipment rooms, where only Class A surface fires or Class C electrical hazards are present.

### 3.3.9 Design Concentration.

**3.3.9.1\* Adjusted Minimum Design Concentration (AMDC).** The target minimum design concentration after the safety factor and the design factors have been taken into account.

**3.3.9.2\* Final Design Concentration (FDC).** The actual concentration of agent discharged into the enclosure.

**3.3.10 Design Factor (DF).** A fraction of the agent minimum design quantity (MDQ) added thereto deemed appropriate due to a specific feature of the protection application or design of the suppression system.

**3.3.11 Engineered System.** A system requiring individual calculation and design to determine the flow rates, nozzle pressures, pipe size, area or volume protected by each nozzle, quantity of agent, and the number and types of nozzles and their placement in a specific system.

**3.3.12 Fill Density.** Mass of agent per unit of container volume (the customary units are lb/ft<sup>3</sup> or kg/m<sup>3</sup>).

**3.3.13 Final Design Quantity (FDQ).** The quantity of agent determined from the agent minimum design quantity as adjusted to account for design factors and pressure adjustment.

**3.3.14\* Halocarbon Agent.** An agent that contains as primary components one or more organic compounds containing one or more of the elements fluorine, chlorine, bromine, or iodine.

**3.3.15 Inert Gas Agent.** An agent that contains as primary components one or more of the gases helium, neon, argon, or nitrogen. Inert gas agents that are blends of gases can also contain carbon dioxide as a secondary component.

**3.3.16 Local Application System.** A system consisting of a supply of extinguishing agent arranged to discharge directly on the burning material. [12, 2015]

**3.3.17 Lockout Valve.** A manually operated valve in the discharge pipe between the nozzles and the agent supply that can be locked in the closed position to prevent flow of agent to the protected area.

**3.3.18 Lowest Observable Adverse Effect Level (LOAEL).** The lowest concentration at which an adverse physiological or toxicological effect has been observed.

**3.3.19 Machinery Space.** A space containing the main and auxiliary propulsion machinery.

**3.3.20 Marine Systems.** Systems installed on ships, barges, offshore platforms, motorboats, and pleasure craft.

**3.3.21 Minimum Design Quantity (MDQ).** The quantity of agent required to achieve the minimum design concentration as calculated using the method in 5.5.1 or 5.5.2, as appropriate.

**3.3.22 Minimum Design Temperature.** The minimum anticipated temperature within the protected enclosure.

**3.3.23 No Observed Adverse Effect Level (NOAEL).** The highest concentration at which no adverse toxicological or physiological effect has been observed.

**3.3.24\* Normally Occupied Enclosure or Space.** An enclosure or space where one or more persons are present under normal conditions.

**3.3.25 Occupiable Enclosure or Space.** An enclosure or space that has dimensions and physical characteristics such that it could be entered by a person.

**3.3.26 Pre-Engineered System.** A system having predetermined flow rates, nozzle pressures, and quantities of agent. These systems have the specific pipe size, maximum and minimum pipe lengths, flexible hose specifications, number of fittings, and number and types of nozzles prescribed by a testing laboratory. The hazards protected by these systems are specifically limited as to type and size by a testing laboratory based upon actual fire tests. Limitations on hazards that can be protected by these systems are contained in the manufacturer's installation manual, which is referenced as part of the listing.

**3.3.27 Pump Room.** A space that contains mechanical equipment for handling, pumping, or transferring flammable or combustible liquids as a fuel.

**3.3.28 Recovered Agent.** Agent that has been removed from a system and kept for future use or until it is destroyed, without necessarily testing or processing it in any way.

**3.3.29 Recycled Agent.** Agent that has been recovered, tested, and processed as necessary and found to be in compliance with the quality requirement of 4.1.2.

**3.3.30 Safety Factor (SF).** A multiplier of the agent flame extinguishing or inerting concentration to determine the agent minimum design concentration.

**3.3.31 Sea Level Equivalent of Agent.** The agent concentration (volume percent) at sea level for which the partial pressure of agent matches the ambient partial pressure of agent at a given altitude.

**3.3.32 Sea Level Equivalent of Oxygen.** The oxygen concentration (volume percent) at sea level for which the partial pressure of oxygen matches the ambient partial pressure of oxygen at a given altitude.

**3.3.33 Superpressurization.** The addition of gas to a fire extinguishing agent container to achieve a specified pressure therein.

**3.3.34 Total Flooding.** The act and manner of discharging an agent for the purpose of achieving a specified minimum agent concentration throughout a hazard volume.

**3.3.35 Total Flooding System.** A system consisting of an agent supply and distribution network designed to achieve a total flooding condition in a hazard volume.

**4.1.1.2\* Reserve Agent Supply.** Where required, a reserve agent supply shall consist of as many multiples of the primary agent supply as the authority having jurisdiction considers necessary.

**4.1.1.3 Uninterrupted Protection.** Where uninterrupted protection is required, both the primary and the reserve agent supplies shall be permanently connected to the distribution piping and arranged for easy changeover.

**4.1.2\* Quality.** Agent, including recycled agent, shall meet the standards of quality given in Table 4.1.2(a) through Table 4.1.2(d). Each batch of agent, both recycled and newly manufactured, shall be tested and certified to the specifications given in the tables. Agent blends shall remain homogeneous in storage and use within the listed temperature range and conditions of service that they will encounter.

**Table 4.1.2(a) Halogenated Agent Quality Requirements**

Property	Specification
Agent purity, mole %, minimum	99.0
Acidity, ppm (by weight HCl equivalent), maximum	3.0
Water content, weight %, maximum	0.001
Nonvolatile residues, g/100 ml maximum	0.05

**Table 4.1.2(b) Inert Gas Agent Quality Requirements**

Composition	Gas	IG-01	IG-100	IG-541	IG-55
Composition, % by volume	N <sub>2</sub>		Minimum 99.9%	52% ± 4%	50% ± 5%
	Ar	Minimum 99.9%		40% ± 4%	50% ± 5%
	CO <sub>2</sub>			8% + 1% - 0.0%	
Water content, % by weight		Maximum 0.005%	Maximum 0.005%	Maximum 0.005%	Maximum 0.005%

**Table 4.1.2(c) HCFC Blend A Quality Requirements**

Component	Amount (weight %)
HCFC-22	82% ± 0.8%
HCFC-124	9.50% ± 0.9%
HCFC-123	4.75% ± 0.5%
Isopropenyl-1-methylcyclohexene	3.75% ± 0.5%

## Chapter 4 Components

### 4.1 Agent Supply.

#### 4.1.1 Quantity.

**4.1.1.1 Primary Agent Supply.** The quantity of agent in the system primary agent supply shall be at least sufficient for the largest single hazard to be protected or group of hazards to be protected simultaneously.

**Table 4.1.2(d) HFC Blend B Quality Requirements**

Component	Amount (weight %)
HFC-134a	86% ± 5%
HFC-125	9% ± 3%
CO <sub>2</sub>	5% ± 2%

#### 4.1.3 Storage Container Arrangement.

**4.1.3.1** Storage containers and accessories shall be located and arranged so that inspection, testing, recharging, and other maintenance activities are facilitated and interruption of protection is held to a minimum.

**4.1.3.2\*** Storage containers shall be permitted to be located within or outside the hazard or hazards they protect.

**4.1.3.3** Agent storage containers shall not be located where they can be rendered inoperable or unreliable due to mechanical damage, exposure to chemicals or harsh weather conditions, or any other foreseeable cause. Where container exposure to such conditions is unavoidable, suitable enclosures or protective measures shall be employed.

**4.1.3.4** Storage containers shall be installed and secured according to the manufacturer's listed installation manual and in a manner that provides for convenient individual servicing or content weighing.

**4.1.3.5** Where storage containers are connected to a manifold, automatic means, such as a check valve, shall be provided to prevent agent loss and to ensure personnel safety if the system is operated when any containers are removed for maintenance.

#### 4.1.4 Agent Storage Containers.

**4.1.4.1\*** **Storage Containers.** Agent shall be stored in containers designed to hold that specific agent at ambient temperatures. Containers shall be charged to a fill density or superpressurization level within the range specified in the manufacturer's listed manual.

**4.1.4.2\*** Each agent container shall have a permanent nameplate or other permanent marking that indicates the following:

- (1) For halocarbon agent containers, the agent, tare and gross weights, and superpressurization level (where applicable) of the container
- (2) For inert gas agent containers, the agent, pressurization level of the container, and nominal agent volume

**4.1.4.3** The containers used in these systems shall be designed to meet the requirements of the U.S. Department of Transportation or the Canadian Transport Commission, if used as shipping containers. If not shipping containers, they shall be designed, fabricated, inspected, certified, and stamped in accordance with Section VIII of the ASME *Boiler*

and *Pressure Vessel Code*, independent inspection and certification are recommended. The design pressure shall be suitable for the maximum pressure developed at 130°F (55°C) or at the maximum controlled temperature limit.

**4.1.4.4** A means shall be provided to determine the pressure in containers of inert gas agents, superpressurized liquid agents, and superpressurized liquefied compressed gas agents.

**4.1.4.5** The containers connected to a manifold shall meet the following criteria:

- (1) For halocarbon clean agents in a multiple container system, all containers supplying the same manifold outlet for distribution of the same agent shall be interchangeable and of one select size and charge.
- (2)\*Inert gas agents shall be permitted to utilize multiple storage container sizes connected to a common manifold.

**4.1.4.6\*** The temperature at which agent containers are stored shall be within the manufacturer's listed limits.

#### 4.2 Distribution.

##### 4.2.1\* Pipe.

**4.2.1.1\*** Pipe shall be of material having physical and chemical characteristics such that its integrity under stress can be predicted with reliability. Special corrosion-resistant materials or coatings shall be required in severely corrosive atmospheres. The thickness of the piping shall be calculated in accordance with ASME B31.1. The internal pressure used for this calculation shall not be less than the greater of the following values:

- (1) The normal charging pressure in the agent container at 70°F (21°C)
- (2) Eighty percent of the maximum pressure in the agent container at a maximum storage temperature of not less than 130°F (55°C), using the equipment manufacturer's maximum allowable fill density, if applicable
- (3) For inert gas clean agents, the pressure for this calculation shall be as specified in 4.2.1.1.1 and 4.2.1.1.2

**4.2.1.1.1** In no case shall the value used for the minimum pipe design pressure be less than that specified in Table 4.2.1.1.1(a) and Table 4.2.1.1.1(b) for the conditions shown. For inert gas clean agents that employ the use of a pressure-reducing device, Table 4.2.1.1.1(a) shall be used for piping upstream of the pressure reducer, and 4.2.1.1.2 shall be used to determine minimum pipe design pressure for piping downstream of the pressure reducer. The pressure-reducing device shall be readily identifiable. For halocarbon clean agents, Table 4.2.1.1.1(b) shall be used. If different fill densities, pressurization levels, or higher storage temperatures from those shown in Table 4.2.1.1.1(a) or Table 4.2.1.1.1(b) are approved for a given system, the minimum design pressure for the piping shall be adjusted to the maximum pressure in the agent container at maximum temperature, using the basic design criteria specified in 4.2.1.1 and (2).

Table 4.2.1.1.1(a) Minimum Design Working Pressure for Inert Gas Clean Agent System Piping

Agent	Agent Container Gauge Pressure at 70°F (21°C)		Agent Container Gauge Pressure at 130°F (55°C)		Minimum Design Pressure of Piping Upstream of Pressure Reducer	
	psi	kPa	psi	kPa	psi	kPa
IG-01	2370	16,341	2650	18,271	2370	16,341
	2964	20,436	3304	22,781	2964	20,436
	4510	31,097	5402	37,244	4510	31,097
IG-541	2175	14,997	2575	17,755	2175	14,997
	2900	19,996	3433	23,671	2900	19,996
	4503	31,050	5359	36,950	4503	31,050
IG-55	2175	15,000	2541	17,600	2175	15,000
	2900	20,000	3434	23,700	2900	20,000
	4350	30,000	5222	36,100	4350	30,000
IG-100	2404	16,575	2799	19,299	2404	16,575
	3236	22,312	3773	26,015	3236	22,312
	4061	28,000	4754	32,778	4061	28,000

Table 4.2.1.1.1(b) Minimum Design Working Pressure for Halocarbon Clean Agent System Piping

Agent	Agent Container Maximum Fill Density		Agent Container Charging Pressure at 70°F (21°C)		Agent Container Pressure at 130°F (55°C)		Minimum Piping Design Pressure	
	lb/ft <sup>3</sup>	kg/m <sup>3</sup>	psi	bar	psi	bar	psi	bar
HFC-227ea	79	1265	44*	3	135	9	416	29
	75	1201	150	10	249	17	200	14
	72	1153	360	25	520	36	416	29
	72	1153	600	41	1025	71	820	57
HCFC Blend A	56.2	900	600	41	850	59	680	47
	56.2	900	360	25	540	37	432	30
HFC 23	54	865	608.9†	42	2182	150	1746	120
	48	769	608.9†	42	1713	118	1371	95
	45	721	608.9†	42	1560	108	1248	86
	40	641	608.9†	42	1382	95	1106	76
	35	561	608.9†	42	1258	87	1007	69
	30	481	608.9†	42	1158	80	927	64
HCFC-124	74	1185	240	17	354	24	283	20
HCFC-124	74	1185	360	25	580	40	464	32
HFC-125	54	865	360	25	615	42	492	34
HFC 125	56	897	600	41	1045	72	836	58
HFC-236fa	74	1185	240	17	360	25	280	19
HFC-236fa	75	1201	360	25	600	41	480	33
HFC-236fa	74	1185	600	41	1100	76	880	61
HFC Blend B	58	929	360	25	586	40	469	32
	58	929	600	41	888	61	710	50
FK-5-1-12	90	1442	150	10	175	12	150	10
	90	1442	195	13	225	16	195	13
	90	1442	360	25	413	28	360	25
	75	1201	500	34	575	40	500	34
	90	1442	610	42	700	48	610	42

\*Nitrogen delivered to agent cylinder through a flow restrictor upon system actuation. Nitrogen supply cylinder pressure is 1800 psi (124 bar) at 70°F (21°C).

†Not superpressurized with nitrogen.

**4.2.1.1.2** For systems that employ the use of a pressure-reducing device, the minimum design pressure for piping downstream of the pressure-reducing device shall be determined from the maximum anticipated pressure in the downstream piping as predicted by system flow calculations.

**4.2.1.1.3** Piping for pre-engineered systems shall be designed in accordance with the limitations of the manufacturer's listed installation manual.

**4.2.1.2** Other than as allowed in 4.2.1.4, cast-iron pipe, steel pipe conforming to ASTM A120, or nonmetallic pipe shall not be used.

**4.2.1.3** Stenciled pipe identification shall not be painted over, concealed, or removed prior to approval by the authority having jurisdiction.

**4.2.1.4** Where used, flexible pipe, flexible nonmetallic pipe, tubing, or hoses, including connections, shall be of approved materials and pressure ratings.

**4.2.1.5** Each pipe section shall be cleaned internally after preparation and before assembly by means of swabbing, utilizing a suitable nonflammable cleaner. The pipe network shall be free of particulate matter and oil residue before installation of nozzles or discharge devices.

**4.2.1.6\*** In sections where valve arrangements introduce sections of closed piping, such sections shall be equipped with pressure relief devices, or the valves shall be designed to prevent entrapment of liquid. In systems using pressure-operated container valves, means shall be provided to vent any container leakage that could build up pressure in the pilot system and cause unwanted opening of the container valve. The means of pressure venting shall be arranged so as not to prevent reliable operation of the container valve.

**4.2.1.7** All pressure relief devices shall be designed and located so that the discharge from the device will not injure personnel or pose a hazard.

**4.2.2 Pipe Joints.** Pipe joints other than threaded, welded, brazed, flared, compression, or flanged type shall be listed or approved.

#### **4.2.3 Fittings.**

**4.2.3.1\*** Fittings shall have a minimum rated working pressure equal to or greater than the minimum design working pressure specified in 4.2.1.1, for the clean agent being used, or as otherwise listed or approved. For systems that employ the use of a pressure-reducing device in the distribution piping, the fittings downstream of the device shall have a minimum rated working pressure equal to or greater than the maximum anticipated pressure in the downstream piping.

**4.2.3.2** Cast-iron fittings shall not be used.

**4.2.3.3** Class 150 fittings shall not be used.

**4.2.3.4** All threads used in joints and fittings shall conform to ANSI B1.20.1 or ISO 7-1. Joint compound, tape, or thread lubricant shall be applied only to the male threads of the joint.

**4.2.3.5** Welding and brazing alloys shall have a melting point above 1000°F (538°C).

**4.2.3.6** Welding shall be performed in accordance with Section IX, "Qualification Standard for Welding and Brazing Procedures, Welders, Brazers and Welding and Brazing Operators," of the ASME *Boiler and Pressure Vessel Code*.

**4.2.3.7** Where copper, stainless steel, or other suitable tubing is jointed with compression-type fittings, the manufacturer's pressure and temperature ratings of the fitting shall not be exceeded.

#### **4.2.4 Valves.**

**4.2.4.1** All valves shall be listed or approved for the intended use.

**4.2.4.2** For flanged valves, the class and style of flanges required to match the valve's flanged connection shall be used.

**4.2.4.3\*** All gaskets, O-rings, sealants, and other valve components shall be constructed of materials that are compatible with the agent. Valves shall be protected against mechanical, chemical, or other damage.

**4.2.4.4** Special corrosion-resistant materials or coatings shall be used in severely corrosive atmospheres.

**4.2.4.5** Where directional valves are used for multihazard protection, the directional valves shall be listed or approved for use with the installed suppression system.

**4.2.4.6** Where directional valves are used for multihazard protection, the control equipment shall be specifically listed for the number, type, and operation of those valves.

#### **4.2.5 Discharge Nozzles.**

**4.2.5.1** Discharge nozzles shall be listed for the intended use. Listing criteria shall include flow characteristics, area coverage, height limits, and minimum pressures. Discharge orifices and discharge orifice plates and inserts shall be of a material that is corrosion resistant to the agent used and the atmosphere in the intended application.

**4.2.5.2** Special corrosion-resistant materials or coatings shall be required in severely corrosive atmospheres.

**4.2.5.3** Discharge nozzles shall be permanently marked to identify the manufacturer as well as the type and size of the orifice.

**4.2.5.4** Where clogging by external foreign materials is likely, discharge nozzles shall be provided with frangible discs, blow-off caps, or other suitable devices. These devices shall provide an unobstructed opening upon system operation and shall be located so they will not injure personnel.

**4.2.5.5\*** Nozzles shall be installed so as to be free of obstructions that could interfere with the proper distribution of the discharged agent in accordance with the manufacturer's installation and maintenance manual.

#### **4.3 Detection, Actuation, Alarm, and Control Systems.**

##### **4.3.1 General.**

**4.3.1.1\*** Detection, actuation, alarm, and control systems shall be installed, tested, and maintained in accordance with appropriate NFPA protective signaling systems standards. (*See NFPA 70 and NFPA 72. In Canada refer to CAN/ULC S524-06 and CAN/ULC S529-09.*)

**4.3.1.2** Automatic detection and automatic actuation shall be used.

**4.3.1.2.1** Manual-only actuation shall be permitted if acceptable to the authority having jurisdiction.

**4.3.1.3** Initiating and releasing circuits shall be installed in raceways. Other than as permitted in 4.3.1.3.1, alternating

current (ac) and direct current (dc) wiring shall not be combined in a common conduit or raceway.

**4.3.1.3.1** It shall be permitted to combine ac and dc wiring in a common conduit or raceway where shielded and grounded.

#### **4.3.2 Automatic Detection.**

**4.3.2.1\*** Automatic detection shall be by any listed method or device capable of detecting and indicating heat, flame, smoke, combustible vapors, or an abnormal condition in the hazard, such as process trouble, that is likely to produce fire.

**4.3.2.2** Adequate and reliable primary and 24 hour minimum standby sources of energy shall be used to provide for operation of the detection, signaling, control, and actuation requirements of the system.

**4.3.2.3** Where a new agent system is being installed in a space that has an existing detection system, an analysis shall be made of the detection devices to ensure that the detection system is in good operating condition and will respond promptly to a fire situation. This analysis shall be done to assist in limiting the decomposition products from a suppression event.

#### **4.3.3 Operating Devices.**

**4.3.3.1** Operating devices shall include agent-releasing devices or valves, discharge controls, and shutdown equipment necessary for successful performance of the system.

**4.3.3.2** Operation shall be by listed mechanical, electrical, or pneumatic means. An adequate and reliable source of energy shall be used.

**4.3.3.3** All devices shall be designed for the service they will encounter and shall not readily be rendered inoperative or susceptible to accidental operation. Devices normally shall be designed to function properly from -20°F to 130°F (-29°C to 54°C) or marked to indicate temperature limitations.

**4.3.3.4** All devices shall be located, installed, or suitably protected so that they are not subject to mechanical, chemical, or other damage that would render them inoperative.

**4.3.3.5** A means of manual release of the system shall be provided. Manual release shall be accomplished by a mechanical manual release or by an electrical manual release when the control equipment monitors the battery voltage level of the standby battery supply and provides a low-battery signal. The release shall cause simultaneous operation of automatically operated valves controlling agent release and distribution.

**4.3.3.5.1\*** A discharge pressure switch shall be required where mechanical system actuation is possible.

**4.3.3.5.2** The discharge pressure switch shall provide an alarm-initiating signal to the releasing panel.

**4.3.3.5.3** A means of manual release shall not be required for automatic systems when the hazard being protected is unoccupiable and the hazard is in a remote location where personnel are not normally present.

**4.3.3.6** The normal manual control(s) for actuation shall be located for easy accessibility at all times, including at the time of a fire.

**4.3.3.6.1** The manual control(s) shall be of distinct appearance and clearly recognizable for the purpose intended.

**4.3.3.6.2** Operation of any manual control shall cause the complete system to operate as designed.

**4.3.3.7** Manual controls shall not require a pull of more than 40 lb (178 N) nor a movement of more than 14 in. (356 mm) to secure operation. At least one manual control for activation shall be located not more than 4 ft (1.2 m) above the floor.

**4.3.3.8** Where gas pressure from the system or pilot containers is used as a means for releasing the remaining containers, the supply and discharge rate shall be designed for releasing all the remaining containers.

**4.3.3.9** All devices for shutting down supplementary equipment shall be considered integral parts of the system and shall function with the system operation.

**4.3.3.10** All manual operating devices shall be identified as to the hazard they protect.

#### **4.3.4 Control Equipment.**

**4.3.4.1\*** Removal of an electric actuator from the agent storage container discharge valve that it controls shall result in an audible and visual indication of system impairment at the system releasing control panel.

**4.3.4.1.1** Paragraph 4.3.4.1 shall become effective January 1, 2016.

**4.3.4.1.2** Paragraph 4.3.4.1 shall not apply to systems covered under Chapter 8 of this standard with the exception of those systems included under Section 8.6.

**4.3.4.2** Removal of an electric actuator from the selector valve it controls shall result in an audible and visual indication of system impairment at the system releasing control panel.

**4.3.4.2.1** Paragraph 4.3.4.2 shall become effective January 1, 2016.

**4.3.4.2.2** Paragraph 4.3.4.2 shall not apply to systems covered under Chapter 8 of this standard with the exception of those systems included under Section 8.6.

**4.3.4.3** The control equipment shall supervise the actuating devices and associated wiring and, as required, cause actuation.

**4.3.4.3.1** The control equipment shall be specifically listed for the number and type of actuating devices utilized, and their compatibility shall have been listed.

**4.3.4.3.2** Removal of the primary agent container actuating device from the discharge valve and/or selector valve shall cause a trouble or supervisory signal at the releasing control unit.

**4.3.4.4** Where pneumatic control equipment is used, the lines shall be protected against crimping and mechanical damage. Where installations could be exposed to conditions that could lead to loss of integrity of the pneumatic lines, special precautions shall be taken to ensure that no loss of integrity will occur. The control equipment shall be specifically listed for the number and type of actuating devices utilized, and their compatibility shall have been listed.

#### **4.3.5 Operating Alarms and Indicators.**

**4.3.5.1** Alarms or indicators or both shall be used to indicate the operation of the system, hazards to personnel, or failure of any supervised device. The type (audible, visual, or olfactory), number, and location of the devices shall be such that their purpose is satisfactorily accomplished. The extent and type of alarms or indicator equipment or both shall be approved.

**4.3.5.2** Audible and visual pre-discharge alarms shall be provided within the protected area of occupiable spaces to give positive warning of impending discharge. The operation of the warning devices shall be continued after agent discharge until positive action has been taken to acknowledge the alarm and to proceed with appropriate action.

**4.3.5.3\*** Abort switches, where provided, shall be located within the protected area and shall be located near the means of egress for the area. The abort switch shall be of a type that requires constant manual pressure to cause abort. In all cases, the normal manual control and the manual emergency control shall override the abort function. Operation of the abort function shall result in both audible and distinct visual indication of system impairment. The abort switch shall be clearly recognizable for the purpose intended.

**4.3.5.4** Alarms indicating failure of supervised devices or equipment shall give prompt and positive indication of any failure and shall be distinctive from alarms indicating operation or hazardous conditions.

**4.3.5.5** Warning and instruction signs at entrances to and inside protected areas shall be provided.

**4.3.5.5.1** Warning and safety instruction signs shall be located such that they will be readily visible to personnel in the area where the clean agent design concentration exceeds that approved for use in normally occupied spaces. The safety sign format and color and the letter style of the signal words shall be in accordance with ANSI Z535.

**4.3.5.5.2** Warning and safety instruction signs shall be located outside each entrance to clean agent cylinder storage rooms. The safety sign format and color and the letter style of the signal words shall be in accordance with ANSI Z535.

#### **4.3.5.6 Time Delays.**

**4.3.5.6.1\*** For clean agent extinguishing systems, a pre-discharge alarm and time delay, sufficient to allow personnel evacuation prior to discharge, shall be provided. For hazard areas subject to fast growth fires, where the provision of a time delay would seriously increase the threat to life and property, a time delay shall be permitted to be eliminated.

**4.3.5.6.2** Time delays shall be used only for personnel evacuation or to prepare the hazard area for discharge.

**4.3.5.6.3** Time delays shall not be used as a means of confirming operation of a detection device before automatic actuation occurs.

#### **4.3.6\* Unwanted System Operation.**

**4.3.6.1** To avoid unwanted discharge of an electrically actuated clean agent system, a supervised disconnect switch shall be provided.

**4.3.6.2** The disconnect switch shall interrupt the releasing circuit to the suppression system.

**4.3.6.3** The disconnect switch shall cause a supervisory signal at the releasing control unit.

**4.3.6.4** The disconnect switch shall be located inside a lockable fire alarm control panel, inside a lockable enclosure, or require a key for activation of the switch.

**4.3.6.5** When the disconnect switch requires a key for activation, the access key shall not be removable while disconnected

so the suppression system can be quickly returned to the operational condition in the event of a fire.

**4.3.6.6** Suppression system disconnect achieved via software programming shall not be acceptable for use in lieu of a physical disconnect switch.

**4.3.6.7** The disconnect switch shall be listed.

## **Chapter 5 System Design**

### **5.1 Specifications, Plans, and Approvals.**

**5.1.1 Specifications.** Specifications for total flooding and local application clean agent fire extinguishing systems shall be prepared under the supervision of a person fully experienced and qualified in the design of such systems and with the advice of the authority having jurisdiction. The specifications shall include all pertinent items necessary for the proper design of the system, such as the designation of the authority having jurisdiction, variances from the standard to be permitted by the authority having jurisdiction, design criteria, system sequence of operations, the type and extent of the approval testing to be performed after installation of the system, and owner training requirements.

#### **5.1.2 Working Plans.**

**5.1.2.1** Working plans and calculations shall be submitted for approval to the authority having jurisdiction before system installation or remodeling begins. These documents shall be prepared only by persons fully experienced and qualified in the design of total flooding and local application clean agent fire extinguishing systems. Deviation from these documents shall require permission of the authority having jurisdiction.

**5.1.2.2** Working plans shall be drawn to an indicated scale and shall show the following items that pertain to the design of the system:

- (1) Name of owner and occupant
- (2) Location, including street address
- (3) Point of compass and symbol legend
- (4) Location and construction of protected enclosure walls and partitions
- (5) Location of fire walls
- (6) Enclosure cross section, shown as a full-height or schematic diagram, including location and construction of building floor-ceiling assemblies above and below, raised access floor, and suspended ceiling
- (7) Agent being used
- (8) Agent concentration at the lowest temperature and the highest temperature for which the enclosure is protected
- (9) Description of occupancies and hazards being protected, designating whether the enclosure is normally occupied
- (10) For an enclosure protected by a clean agent fire extinguishing system, an estimate of the maximum positive pressure and the maximum negative pressure, relative to ambient pressure, expected to be developed upon the discharge of agent
- (11) Description of exposures surrounding the enclosure
- (12) Description of the agent storage containers used, including internal volume, storage pressure, and nominal capacity expressed in units of agent mass or volume at standard conditions of temperature and pressure

- (13) Description of nozzle(s) used, including size, orifice port configuration, and equivalent orifice area
- (14) Description of pipe and fittings used, including material specifications, grade, and pressure rating
- (15) Description of wire or cable used, including classification, gauge [American Wire Gauge (AWG)], shielding, number of strands in conductor, conductor material, and color coding schedule; segregation requirements of various system conductors; and required method of making wire terminations
- (16) Description of the method of detector mounting
- (17) Equipment schedule or bill of materials for each piece of equipment or device showing device name, manufacturer, model or part number, quantity, and description
- (18) Plan view of protected area showing enclosure partitions (full and partial height); agent distribution system, including agent storage containers, piping, and nozzles; type of pipe hangers and rigid pipe supports; detection, alarm, and control system, including all devices and schematic of wiring interconnection between them; end-of-line device locations; location of controlled devices such as dampers and shutters; and location of instructional signage
- (19) Isometric view of agent distribution system showing the length and diameter of each pipe segment; node reference numbers relating to the flow calculations; fittings, including reducers, strainers, and orientation of tees; and nozzles, including size, orifice port configuration, flow rate, and equivalent orifice area
- (20) Scale drawing showing the layout of the annunciator panel graphics if required by the authority having jurisdiction
- (21) Details of each unique rigid pipe support configuration showing method of securement to the pipe and to the building structure
- (22) Details of the method of container securement showing method of securement to the container and to the building structure
- (23) Complete step-by-step description of the system sequence of operations, including functioning of abort and maintenance switches, delay timers, and emergency power shutdown
- (24) Point-to-point wiring schematic diagrams showing all circuit connections to the system control panel and graphic annunciator panel
- (25) Point-to-point wiring schematic diagrams showing all circuit connections to external or add-on relays
- (26) Complete calculations to determine enclosure volume, quantity of clean agent, and size of backup batteries; method used to determine number and location of audible and visual indicating devices; and number and location of detectors
- (27) Details of any special features
- (28)\*Pressure relief vent area, or equivalent leakage area, for the protected enclosure to prevent development, during system discharge, of a pressure difference across the enclosure boundaries that exceeds a specified enclosure pressure limit

**5.1.2.3** The detail on the system shall include information and calculations on the quantity of agent; container storage pressure; internal volume of the container; the location, type, and flow rate of each nozzle, including equivalent orifice area; the location, size, and equivalent lengths of pipe, fittings, and hose; and the location and size of the storage facility. Pipe size

reduction and orientation of tees shall be clearly indicated. Information shall be submitted pertaining to the location and function of the detection devices, operating devices, auxiliary equipment, and electrical circuitry, if used. Apparatus and devices used shall be identified. Any special features shall be adequately explained.

**5.1.2.3.1** Pre-engineered systems shall not be required to specify an internal volume of the container, nozzle flow rates, equivalent lengths of pipe, fittings, and hose, or flow calculations, when used within their listed limitations. The information required by the listed system design manual, however, shall be made available to the authority having jurisdiction for verification that the system is within its listed limitations.

**5.1.2.4** An “as-built” instruction and maintenance manual that includes a full sequence of operations and a full set of drawings and calculations shall be maintained on site.

#### **5.1.2.5 Flow Calculations.**

**5.1.2.5.1** Flow calculations along with the working plans shall be submitted to the authority having jurisdiction for approval. The version of the flow calculation program shall be identified on the computer calculation printout.

**5.1.2.5.2** Where field conditions necessitate any material change from approved plans, the change shall be submitted for approval.

**5.1.2.5.3** When such material changes from approved plans are made, corrected “as-installed” plans shall be provided.

#### **5.1.3 Approval of Plans.**

**5.1.3.1** Plans and calculations shall be approved prior to installation.

**5.1.3.2** Where field conditions necessitate any significant change from approved plans, the change shall be approved prior to implementation.

**5.1.3.3** When such significant changes from approved plans are made, the working plans shall be updated to accurately represent the system as installed.

#### **5.2\* System Flow Calculations.**

**5.2.1\*** System flow calculations shall be performed using a calculation method listed or approved by the authority having jurisdiction. The system design shall be within the manufacturer’s listed limitations.

**5.2.1.1** Designs involving pre-engineered systems shall not be required to be provided with flow calculations in accordance with 5.1.2.5 where used within their listed limitations.

**5.2.2** Valves and fittings shall be rated for equivalent length in terms of pipe or tubing sizes with which they will be used. The equivalent length of the container valve shall be listed and shall include siphon tube, valve, discharge head, and flexible connector.

**5.2.3** Piping lengths and orientation of fittings and nozzles shall be in accordance with the manufacturer’s listed limitations.

**5.2.4** If the final installation varies from the prepared drawings and calculations, new drawings and calculations representing the “as-built” installation shall be prepared.

### 5.3\* Enclosure.

**5.3.1** In the design of a total flooding system, the characteristics of the protected enclosure shall be considered.

**5.3.2** The area of unclosable openings in the protected enclosure shall be kept to a minimum.

**5.3.3** The authority having jurisdiction shall be permitted to require pressurization/depressurization of the protected enclosure or other tests to ensure performance that meets the requirements of this standard. (See Annex C.)

**5.3.4** To prevent loss of agent through openings to adjacent hazards or work areas, openings shall be permanently sealed or equipped with automatic closures. Where reasonable confinement of agent is not practicable, protection shall be expanded to include the adjacent connected hazards or work areas, or additional agent shall be introduced into the protected enclosure using an extended discharge configuration.

**5.3.5** Where a clean agent total flooding system is being provided for the protection of a room with a raised or sunken floor, the room and raised or sunken floor shall be simultaneously protected.

**5.3.5.1\*** If only the space under the raised floor is to be protected by a total flooding system, an inert gas shall be used to protect that space.

**5.3.5.2** Each volume, room, and raised or sunken floor to be protected shall be provided with detectors, piping network, and nozzles.

**5.3.6\*** Other than the ventilation systems identified in 5.3.6.2, forced-air ventilating systems, including self-contained air recirculation systems, shall be shut down or closed automatically where their continued operation would adversely affect the performance of the fire extinguishing system or result in propagation of the fire.

**5.3.6.1** If not shut down or closed automatically, the volume of the self-contained recirculating undamped ventilation system ducts and components mounted below the ceiling height of the protected space shall be considered as part of the total hazard volume when determining the quantity of agent.

**5.3.6.2** Ventilation systems necessary to ensure safety shall not be required to be shut down upon activation of the fire suppression system. An extended agent discharge shall be provided to maintain the design concentration for the required duration of protection.

**5.3.7\*** The protected enclosure shall have the structural strength and integrity necessary to contain the agent discharge. If the developed pressures present a threat to the structural strength of the enclosure, venting shall be provided to prevent excessive pressures. Designers shall consult the system manufacturer's recommended procedures relative to enclosure venting. [For pressure relief vent area or equivalent leakage area, see 5.1.2.2(28).]

### 5.4 Design Concentration Requirements.

**5.4.1** The flame extinguishing or inerting concentrations shall be used in determining the agent design concentration for a particular fuel. For combinations of fuels, the flame extinguishment or inerting value for the fuel requiring the greatest concentration shall be used unless tests are made on the actual mixture.

### 5.4.2\* Flame Extinguishment.

**5.4.2.1** The flame extinguishing concentration for Class B fuels shall be determined by the cup burner method described in Annex B.

**CAUTION:** Under certain conditions, it can be dangerous to extinguish a burning gas jet. As a first measure, the gas supply shall be shut off.

**5.4.2.1.1** Measurement equipment used in applying the cup burner method shall be calibrated.

**5.4.2.2\*** The flame extinguishing concentration for Class A fuels shall be determined by test as part of a listing program. As a minimum, the listing program shall conform to ANSI/UL 2127 or ANSI/UL 2166 or equivalent.

**5.4.2.3** The minimum design concentration for a Class B fuel hazard shall be the extinguishing concentration, as determined in 5.4.2.1, times a safety factor of 1.3.

**5.4.2.4\*** The minimum design concentration for a Class A surface-fire hazard shall be determined by the greater of the following:

- (1) The extinguishing concentration, as determined in 5.4.2.2, times a safety factor of 1.2
- (2) Equal to the minimum extinguishing concentration for heptane as determined from 5.4.2.1

**5.4.2.5** The minimum design concentration for a Class C hazard shall be the extinguishing concentration, as determined in 5.4.2.2, times a safety factor of 1.35.

**5.4.2.5.1** The minimum design concentration for spaces containing energized electrical hazards supplied at greater than 480 volts that remain powered during and after discharge shall be determined by testing, as necessary, and a hazard analysis.

**5.4.2.6\*** The minimum design concentration for a smoldering combustion hazard (deep-seated fire hazard) shall be determined by an application-specific test.

### 5.4.3\* Inerting.

**5.4.3.1** The inerting concentration shall be determined by test.

**5.4.3.2\*** The inerting concentration shall be used in determining the agent design concentration where conditions for subsequent reflash or explosion exist.

**5.4.3.3** The minimum design concentration used to inert the atmosphere of an enclosure where the hazard is a flammable liquid or gas shall be the inerting concentration times a safety factor of 1.1.

### 5.5 Total Flooding Quantity.

**5.5.1\*** The quantity of halocarbon agent required to achieve the design concentration shall be calculated from the following equation:

$$W = \frac{V}{S} \left( \frac{C}{100 - C} \right) \quad [5.5.1]$$

where:

W = quantity of clean agent [lb (kg)]

V = net volume of hazard, calculated as the gross volume minus the volume of fixed structures impervious to clean agent vapor [ft<sup>3</sup> (m<sup>3</sup>)]

C = agent design concentration (vol%)

$s$  = specific volume of the superheated agent vapor at 1 atm and the minimum anticipated temperature [ $^{\circ}\text{F}$  ( $^{\circ}\text{C}$ )] of the protected volume [ $\text{ft}^3/\text{lb}$  ( $\text{m}^3/\text{kg}$ )]

**5.5.1.1** The concentration of halocarbon clean agent that will be developed in the protected enclosure shall be calculated at both the minimum and maximum design temperature using the following equation:

$$C = 100 \frac{\left(\frac{W \times s}{V}\right)}{\left(\frac{W \times s}{V}\right) + 1} \quad [5.5.1.1]$$

where:

$C$  = agent concentration [vol %]

$W$  = installed quantity of agent [lb (kg)]

$s$  = specific volume of the gaseous agent at the minimum/maximum design temperature of the hazard [ $\text{ft}^3/\text{lb}$  ( $\text{m}^3/\text{kg}$ )]

$V$  = volume of the as-built enclosure [ $\text{ft}^3$  ( $\text{m}^3$ )]

**5.5.1.2** Agent concentrations calculated based on as-built and as-installed data and the lowest and highest design temperatures of the protected space shall be recorded in accordance with the requirements of 5.1.2.4 and 5.2.4.

**5.5.2\*** The quantity of inert gas agent required to achieve the design concentration shall be calculated using Equation 5.5.2, 5.5.2.1a, or 5.5.2.1b:

$$X = 2.303 \left(\frac{s_o}{s}\right) \log_{10} \left(\frac{100}{100 - C}\right) \quad [5.5.2]$$

where:

$X$  = volume of inert gas added at standard conditions of 14.7 psi absolute, 70 $^{\circ}\text{F}$  (1.013 bar absolute, 21 $^{\circ}\text{C}$ ) per volume of hazard space [ $\text{ft}^3/\text{ft}^3$  ( $\text{m}^3/\text{m}^3$ )]

$s_o$  = specific volume of inert gas agent at 70 $^{\circ}\text{F}$  (21 $^{\circ}\text{C}$ ) and 14.7 psi absolute (1.013 bar absolute)

$s$  = specific volume of inert gas at 14.7 psi absolute and the minimum design temperature [ $^{\circ}\text{F}$  ( $^{\circ}\text{C}$ )] of the protected volume [ $\text{ft}^3/\text{lb}$  ( $\text{m}^3/\text{kg}$ )]

$C$  = inert gas design concentration (vol %)

**5.5.2.1** An alternative equation for calculating the inert gas clean agent concentrations shall be permitted, as follows:

$$X = 2.303 \left(\frac{530}{460 + t}\right) \log_{10} \left(\frac{100}{100 - C}\right) \quad [5.5.2.1a]$$

where:

$t$  = minimum anticipated temperature of the protected volume ( $^{\circ}\text{F}$ )

$$X = 2.303 \left(\frac{294}{273 + t}\right) \log_{10} \left(\frac{100}{100 - C}\right) \quad [5.5.2.1b]$$

where:

$t$  = minimum anticipated temperature of the protected volume ( $^{\circ}\text{C}$ )

**5.5.2.2** Total flooding quantities based on Equations 5.5.2.1a and 5.5.2.1b are given in Table A.5.5.2(a) through Table A.5.5.2(h).

**5.5.2.3** The design quantity of inert gas agent in mass units shall be calculated as follows:

$$W = 2.303 \left(\frac{V}{s}\right) \log_{10} \left(\frac{100}{100 - C}\right) \quad [5.5.2.3a]$$

or

$$W = \left(\frac{V}{s}\right) \ln \left(\frac{100}{100 - C}\right) \quad [5.5.2.3b]$$

where:

$W$  = quantity of inert gas agent [lb (kg)]

$V$  = volume of the hazard [ $\text{ft}^3$  ( $\text{m}^3$ )]

$s$  = specific volume of the gaseous agent at the temperature of the hazard [ $\text{ft}^3/\text{lb}$  ( $\text{m}^3/\text{kg}$ )]

$C$  = inert gas agent concentration [vol%]

**5.5.2.4** The concentration of an inert gas clean agent that will be developed in the protected enclosure shall be calculated at both the minimum and maximum design temperature, using one of the following equations:

$$C = 100 \frac{10^{\left(\frac{W s}{2.303 V}\right)} - 1}{10^{\left(\frac{W s}{2.303 V}\right)}} \quad [5.5.2.4a]$$

or

$$C = 100 \frac{e^{\left(\frac{W s}{V}\right)} - 1}{e^{\left(\frac{W s}{V}\right)}} \quad [5.5.2.4b]$$

where:

$C$  = agent concentration [vol%]

$W$  = installed quantity of agent [lb (kg)]

$s$  = specific volume of the gaseous agent at the minimum/maximum design temperature of the hazard [ $\text{ft}^3/\text{lb}$  ( $\text{m}^3/\text{kg}$ )]

$V$  = volume of the as-built enclosure [ $\text{ft}^3$  ( $\text{m}^3$ )]

**5.5.3\* Design Factors.** In addition to the concentration requirements, additional quantities of agent are required through the use of design factors to compensate for any special conditions that would affect the extinguishing efficiency.

**5.5.3.1\* Tee Design Factor.** Other than as identified in 5.5.3.1.3, where a single agent supply is used to protect multiple hazards, a design factor from Table 5.5.3.1 shall be applied.

**5.5.3.1.1** For the application of Table 5.5.3.1, the design factor tee count shall be determined for each hazard the system protects, using the following guidelines:

- (1) Starting from the point where the pipe system enters the hazard, the number of tees in the flow path returning to the agent supply shall be included (do not include tees used in a manifold) in the design factor tee count for the hazard.
- (2) Any tee within the hazard that supplies agent to another hazard shall be included in the design factor tee count for the hazard.

**5.5.3.1.2** The hazard with the greatest design factor tee count shall be used in Table 5.5.3.1 to determine the design factor.

Table 5.5.3.1 Design Factors for Piping Tees

Design Factor Tee Count	Halocarbon Design Factor	Inert Gas Design Factor
0-4	0.00	0.00
5	0.01	0.00
6	0.02	0.00
7	0.03	0.00
8	0.04	0.00
9	0.05	0.01
10	0.06	0.01
11	0.07	0.02
12	0.07	0.02
13	0.08	0.03
14	0.09	0.03
15	0.09	0.04
16	0.10	0.04
17	0.11	0.05
18	0.11	0.05
19	0.12	0.06

**5.5.3.1.3** For systems that pass a discharge test, this design factor shall not apply.

**5.5.3.2\* Additional Design Factors.** The designer shall assign and document additional design factors for each of the following:

- (1) Unclosable openings and their effects on distribution and concentration (*see also* 5.8.2)
- (2) Control of acid gases
- (3) Re-ignition from heated surfaces
- (4) Fuel type, configurations, scenarios not fully accounted for in the extinguishing concentration, enclosure geometry, and obstructions and their effects on distribution

**5.5.3.3\* Design Factor for Enclosure Pressure.** The design quantity of the clean agent shall be adjusted to compensate for ambient pressures that vary more than 11 percent [equivalent to approximately 3000 ft (915 m) of elevation change] from standard sea level pressures [29.92 in. Hg at 70°F (760 mm Hg at 0°C)]. (*See Table 5.5.3.3.*)

Table 5.5.3.3 Atmospheric Correction Factors

Equivalent Altitude		Enclosure Pressure (Absolute)		Atmospheric Correction Factor
ft	km	psi	mm Hg	
-3,000	-0.92	16.25	840	1.11
-2,000	-0.61	15.71	812	1.07
-1,000	-0.30	15.23	787	1.04
0	0.00	14.70	760	1.00
1,000	0.30	14.18	733	0.96
2,000	0.61	13.64	705	0.93
3,000	0.91	13.12	678	0.89
4,000	1.22	12.58	650	0.86
5,000	1.52	12.04	622	0.82
6,000	1.83	11.53	596	0.78
7,000	2.13	11.03	570	0.75

Table 5.5.3.3 Continued

Equivalent Altitude		Enclosure Pressure (Absolute)		Atmospheric Correction Factor
ft	km	psi	mm Hg	
8,000	2.45	10.64	550	0.72
9,000	2.74	10.22	528	0.69
10,000	3.05	9.77	505	0.66

**5.6\* Duration of Protection.** A minimum concentration of 85 percent of the adjusted minimum design concentration shall be held at the highest height of protected content within the hazard for a period of 10 minutes or for a time period sufficient to allow for response by trained personnel.

**5.6.1\*** It is important that the adjusted minimum design concentration of agent not only shall be achieved but also shall be maintained for the specified period of time to allow effective emergency action by trained personnel.

## 5.7 Distribution System.

### 5.7.1 Rate of Application.

#### 5.7.1.1\* Discharge Time.

**5.7.1.1.1\*** For halocarbon agents, the discharge time required to achieve 95 percent of the minimum design concentration for flame extinguishment based on a 20 percent safety factor shall not exceed 10 seconds or as otherwise required by the authority having jurisdiction.

**5.7.1.1.2\*** For inert gas agents, the discharge time required to achieve 95 percent of the minimum design concentration for flame extinguishment shall not exceed 60 seconds for Class B fuel hazards, 120 seconds for Class A surface fire hazards or Class C hazards, or as otherwise required by the authority having jurisdiction.

**5.7.1.1.3\*** The discharge time period is defined as the time required to discharge from the nozzles 95 percent of the agent mass [at 70°F (21°C)] necessary to achieve the minimum design concentration based on a 20 percent safety factor for flame extinguishment.

**5.7.1.1.4** Flow calculations performed in accordance with Section 5.2 or in accordance with the listed pre-engineered systems instruction manuals shall be used to demonstrate compliance with 5.7.1.1.

**5.7.1.1.5** For explosion prevention systems, the discharge time for agents shall ensure that the minimum inerting design concentration is achieved before concentration of flammable vapors reach the flammable range.

**5.7.2\* Extended Discharge.** When an extended discharge is necessary to maintain the design concentration for the specified period of time, additional agent quantities can be applied at a reduced rate. The initial discharge shall be completed within the limits specified in 5.7.1.1. The performance of the extended discharge system shall be confirmed by test.

## 5.8 Nozzle Choice and Location.

**5.8.1** Nozzles shall be of the type listed for the intended purpose and shall be placed within the protected enclosure in

compliance with listed limitations with regard to spacing, floor coverage, and alignment.

**5.8.2** The type of nozzles selected, their number, and their placement shall be such that the design concentration will be established in all parts of the hazard enclosure and such that the discharge will not unduly splash flammable liquids or create dust clouds that could extend the fire, create an explosion, or otherwise adversely affect the contents or integrity of the enclosure.

## Chapter 6 Local Application Systems

**6.1 Description.** A local application system shall consist of a fixed supply of clean agent permanently connected to a system of fixed piping with nozzles arranged to discharge directly into the fire.

**6.1.1 Uses.** Local application systems shall be used for the extinguishment of surface fires in flammable liquids, gases, and shallow solids where the hazard is not enclosed or where the enclosure does not conform to the requirements for total flooding.

**6.1.2 General Requirements.** Local application systems shall be designed, installed, tested, and maintained in accordance with the applicable requirements of this standard.

**6.1.3\* Safety Requirements.** The safety requirements of Section 1.5 shall apply. During agent discharge, locally high concentrations of the agent will be developed; therefore the requirements of Section 1.5 shall be followed to prevent exposure of personnel to high concentrations of agent.

### 6.2 Hazard Specifications.

**6.2.1 Extent of Hazard.** The hazard shall be so isolated from other hazards or combustibles that fire will not spread outside the protected area.

**6.2.1.1** The entire hazard shall be protected.

**6.2.1.2** The hazard shall include all areas that are or can become coated by combustible liquids or shallow solid coatings, such as areas subject to spillage, leakage, dripping, splashing, or condensation.

**6.2.1.3** The hazard shall also include all associated materials or equipment, such as freshly coated stock, drain boards, hoods, ducts, and so forth, that could extend fire outside or lead fire into the protected area.

**6.2.1.4** A series of interexposed hazards shall be permitted to be subdivided into smaller groups or sections with the approval of the authority having jurisdiction.

**6.2.1.4.1** Systems for such hazards shall be designed to give immediate independent protection to adjacent groups or sections as needed.

### 6.2.2 Location of Hazard.

**6.2.2.1** The hazard shall be permitted to be indoors, partly sheltered, or completely out of doors.

**6.2.2.2** The clean agent discharge shall be such that winds or strong air currents do not impair the protection. It shall be the responsibility of the system designer to show that such conditions have been taken into account in the design of a system.

**6.3 Clean Agent Requirements.** The quantity of clean agent required for local application systems shall be based on the rate of discharge and the time that the discharge must be maintained to ensure complete extinguishment. The minimum design quantity shall be no less than 1.5 times the minimum quantity required for extinguishment at any selected system discharge rate.

### 6.4 Nozzles.

**6.4.1 Nozzle Selection.** The basis for nozzle selection shall be listed performance data that clearly depict the interrelationship of agent quantity, discharge rate, discharge time, area coverage, and the distance of the nozzle from the protected surface.

**6.4.1.1\*** The maximum permitted time to extinguish a fire with a halocarbon agent shall be 10 seconds.

**6.4.1.2\*** The maximum permitted time to extinguish a fire with an inert gas agent shall be 30 seconds.

**6.4.1.3\*** Where flammable liquid fires of appreciable depth [over ¼ in. (6 mm)] are to be protected, a minimum free-board of 6 in. (152 mm) shall be provided unless otherwise noted in approvals or listings of nozzles.

**6.4.2 Nozzle Discharge Rates.** The design discharge rate through individual nozzles shall be determined on the basis of location or projection distance in accordance with specific approvals or listings.

**6.4.2.1** The system discharge rate shall be the sum of the individual rates of all the nozzles and discharge devices used in the system.

**6.4.3 Discharge Time.** The minimum design discharge time shall be determined by dividing the design quantity by the design rate.

**6.4.3.1** The discharge time shall be increased to compensate for any hazard condition that would require a longer cooling period or for mechanical rundown time associated with ventilation equipment present to prevent re-ignition.

**6.4.3.2** Where there is a possibility that metal or other material can become heated above the ignition temperature of the fuel, the effective discharge time shall be increased to allow adequate cooling time.

**6.4.3.3\*** Where the fuel has an auto-ignition point below its boiling point, such as paraffin wax and cooking oils, the effective discharge time shall be increased to permit cooling of the fuel to prevent re-ignition.

### 6.5 Location and Number of Nozzles.

**6.5.1\*** A sufficient number of nozzles shall be used to cover the entire hazard area on the basis of the unit areas protected by each nozzle.

**6.5.2\*** Local application nozzles shall be located in accordance with spacing and discharge rate limitations stated in nozzle listings.

**6.5.3** Linear detection tubing shall be permitted to be used for agent discharge within the limitations of its listing.

**6.5.4** Nozzles shall be located so as to protect coated stock or other hazards extending above a protected surface.

**6.6\* Operation.** The system shall be designed for automatic operation except where the authority having jurisdiction permits manual operation.

## Chapter 7 Inspection, Testing, Maintenance, and Training

### 7.1 Inspection and Tests.

**7.1.1** At least annually, all systems shall be inspected and tested for proper operation by personnel qualified in the installation and testing of clean agent extinguishing systems. Discharge tests shall not be required.

**7.1.2\*** The inspection report with recommendations shall be filed with the owner of the system, and shall be permitted to be stored and accessed using paper or electronic media.

**7.1.3** At least semiannually, the agent quantity and pressure of refillable containers shall be checked.

**7.1.3.1** For halocarbon clean agents, if a container shows a loss in agent quantity of more than 5 percent or a loss in pressure (adjusted for temperature) of more than 10 percent, it shall be refilled or replaced.

**7.1.3.2** For inert gas clean agents that are not liquefied, pressure is an indication of agent quantity. If an inert gas clean agent container shows a loss in pressure (adjusted for temperature) of more than 5 percent, it shall be refilled or replaced. Where container pressure gauges are used for this purpose, they shall be compared to a separate calibrated device at least annually.

**7.1.3.3** Where the quantity of agent in the container is determined by special measuring devices, these devices shall be listed.

**7.1.4\*** Halocarbon clean agent removed from refillable containers during service or maintenance procedures shall be recovered and recycled or disposed of in accordance with any applicable laws and regulations.

**7.1.5** Factory-charged, nonrefillable containers that do not have a means of pressure indication shall have the agent quantity checked at least semiannually. If a container shows a loss in agent quantity of more than 5 percent, it shall be replaced. Halocarbon clean agent in factory-charged, nonrefillable containers removed from useful service shall be recovered and recycled or disposed of in accordance with any applicable laws and regulations.

**7.1.6** Recovered halocarbon clean agents shall not be released into the atmosphere. Halocarbon clean agent containers shall not be disposed of in any manner that could result in eventual agent release.

**7.1.7** For halocarbon clean agents, the date of inspection, gross weight of cylinder plus agent or net weight of agent, type of agent, person performing the inspection, and, where applicable, the pressure at a recorded temperature shall be recorded on a tag attached to the container. For inert gas clean agents, the date of inspection, type of agent, person performing the inspection, and the pressure at a recorded temperature shall be recorded on a tag attached to the container.

### 7.2\* Container Test.

**7.2.1\*** U.S. Department of Transportation (DOT), Canadian Transport Commission (CTC), or similar design clean agent

containers shall not be recharged without retesting if more than 5 years have elapsed since the date of the last test and inspection. For halocarbon agent storage containers, the retest shall be permitted to consist of a complete visual inspection as described in 49 CFR.

**7.2.2\*** Cylinders continuously in service without discharging shall be given a complete external visual inspection every 5 years or more frequently if required. The visual inspection shall be in accordance with Section 3 of CGA C-6, except that the cylinders need not be emptied or stamped while under pressure. Inspections shall be made only by competent personnel, and the results recorded on both of the following:

- (1) A record tag permanently attached to each cylinder
- (2) A suitable inspection report

**7.2.2.1** A completed copy of the inspection report shall be furnished to the owner of the system or an authorized representative. These records shall be retained by the owner for the life of the system.

**7.2.3** Where external visual inspection indicates that the container has been damaged, additional strength tests shall be required.

### 7.3 Hose Test.

**7.3.1 General.** All system hose shall be examined annually for damage. If visual examination shows any deficiency, the hose shall be immediately replaced or tested as specified in 7.3.2.

#### 7.3.2 Testing.

**7.3.2.1** All hose shall be tested every 5 years.

**7.3.2.2** All hose shall be tested at 1½ times the maximum container pressure at 130°F (54.4°C). The testing procedure shall be as follows:

- (1) The hose is removed from any attachment.
- (2) The hose assembly is then placed in a protective enclosure designed to permit visual observation of the test.
- (3) The hose must be completely filled with water before testing.
- (4) Pressure then is applied at a rate-of-pressure rise to reach the test pressure within 1 minute. The test pressure is then maintained for 1 full minute. Observations are then made to note any distortion or leakage.
- (5) If the test pressure has not dropped or if the couplings have not moved, the pressure is released. The hose assembly is considered to have passed the hydrostatic test if no permanent distortion has taken place.
- (6) Hose assembly passing the test must be completely dried internally. If heat is used for drying, the temperature must not exceed the manufacturer's specifications.
- (7) Hose assemblies failing a hydrostatic test must be marked and destroyed and be replaced with new assemblies.
- (8) Each hose assembly passing the hydrostatic test is marked to show the date of test.

**7.4 Enclosure Inspection.** Other than as identified in 7.4.1, the enclosure protected by the clean agent shall be inspected at least every 12 months to determine if penetrations have occurred that could lead to agent leakage, if other changes have occurred that could change volume of hazard, or both. Where the inspection indicates conditions that could result in the inability of the enclosure to maintain the clean agent concentration, the conditions shall be corrected. If uncertainty still exists, the enclosure shall be retested for integrity in accordance with 7.7.2.5.

**7.4.1** An enclosure inspection shall not be required every 12 months if a documented administrative control program exists that addresses barrier integrity.

#### **7.5\* Maintenance.**

**7.5.1** These systems shall be maintained in full operating condition at all times. Actuation, impairment, and restoration of this protection shall be reported promptly to the authority having jurisdiction.

**7.5.2** Any troubles or impairments shall be corrected in a timely manner consistent with the hazard protected.

**7.5.3\*** Any penetrations made through the enclosure protected by the clean agent shall be sealed immediately. The method of sealing shall restore the original fire resistance rating of the enclosure.

#### **7.6 Training.**

**7.6.1** All persons who could be expected to inspect, test, maintain, or operate fire extinguishing systems shall be trained and kept trained in the functions they are expected to perform.

**7.6.2\*** Personnel working in an enclosure protected by a clean agent shall receive training regarding agent safety issues.

#### **7.7\* Approval of Installations.**

**7.7.1 General.** The completed system shall be reviewed and tested by qualified personnel to meet the approval of the authority having jurisdiction. Only listed equipment and devices shall be used in the systems. To determine that the system has been properly installed and will function as specified, the following tests shall be performed.

##### **7.7.2 Installation Acceptance.**

**7.7.2.1\*** The acceptance testing required by 7.7.1 shall be documented in a test report.

**7.7.2.2** The acceptance test report shall be maintained by the system owner for the life of the system.

**7.7.2.3 General.** It shall be determined that the protected enclosure is in general conformance with the construction documents.

##### **7.7.2.4 Review Mechanical Components.**

**7.7.2.4.1** The piping distribution system shall be inspected to determine that it is in compliance with the design and installation documents.

**7.7.2.4.2** Nozzles and pipe size shall be in accordance with system drawings. Means of pipe size reduction and attitudes of tees shall be checked for conformance to the design.

**7.7.2.4.3** Piping joints, discharge nozzles, and piping supports shall be securely fastened to prevent unacceptable vertical or lateral movement during discharge. Discharge nozzles shall be installed in such a manner that piping cannot become detached during discharge.

**7.7.2.4.4** During assembly, the piping distribution system shall be inspected internally to detect the possibility of any oil or particulate matter soiling the hazard area or affecting the agent distribution due to a reduction in the effective nozzle orifice area.

**7.7.2.4.5** The discharge nozzle shall be oriented in such a manner that optimum agent dispersal can be effected.

**7.7.2.4.6** If nozzle deflectors are installed, they shall be positioned to obtain maximum benefit.

**7.7.2.4.7** The discharge nozzles, piping, and mounting brackets shall be installed in such a manner that they will not potentially cause injury to personnel. Agent shall not directly impinge on areas where personnel could be found in the normal work area. Agent shall not directly impinge on any loose objects or shelves, cabinet tops, or similar surfaces where loose objects could be present and become missiles.

**7.7.2.4.8** All agent storage containers shall be properly located in accordance with an approved set of system drawings.

**7.7.2.4.9** All containers and mounting brackets shall be fastened securely in accordance with the manufacturer's requirements.

**7.7.2.4.10\*** If a discharge test is to be conducted, containers for the agent to be used shall be weighed before and after discharge. Fill weight of containers shall be verified by weighing or other approved methods. For inert gas clean agents, container pressure shall be recorded before and after discharge.

**7.7.2.4.11** Adequate quantity of agent to produce the desired specified concentration shall be provided. The actual room volumes shall be checked against those indicated on the system drawings to ensure the proper quantity of agent. Fan coastdown and damper closure time shall be taken into consideration.

**7.7.2.4.12** The pipe system shall be pressure-tested in a closed circuit using nitrogen or other dry gas.

**7.7.2.4.12.1** The pipe shall be pressurized to at least 40 psi (276 kPa).

**7.7.2.4.12.2** After removing the source of pressurizing gas, the pressure in the pipe shall not be less than 80 percent of the test pressure after 10 minutes.

**7.7.2.4.12.3** The pressure test shall be permitted to be omitted if the total piping contains no more than one change in direction fitting between the storage container and the discharge nozzle and if all piping has been physically checked for tightness.

**7.7.2.4.13\*** A flow test using nitrogen or an inert gas shall be performed on the piping network to verify that flow is continuous and that the piping and nozzles are unobstructed.

**7.7.2.5\* Review of Enclosure Integrity.** All total flooding systems shall have the enclosure examined and tested to locate and then effectively seal any significant air leaks that could result in a failure of the enclosure to hold the specified agent concentration level for the specified holding period. Quantitative results shall be obtained and recorded to indicate that the specified agent concentration for the specified duration of protection is in compliance with Section 5.6, using an approved blower fan unit or other means as approved by the authority having jurisdiction. (*For guidance, see Annex C.*)

##### **7.7.2.6 Review of Electrical Components.**

**7.7.2.6.1** All wiring systems shall be properly installed in compliance with local codes and the system drawings. Alternating current (ac) and direct current (dc) wiring shall not be combined in a common conduit or raceway unless properly shielded and grounded.

**7.7.2.6.2** All field circuits shall be free of ground faults and short circuits. Where field circuitry is being measured, all electronic components, such as smoke and flame detectors or special electronic equipment for other detectors or their mounting bases, shall be removed and jumpers shall be properly installed to prevent the possibility of damage within these devices. Components shall be replaced after measuring.

**7.7.2.6.3** Power shall be supplied to the control unit from a separate dedicated source that will not be shut down upon system operation.

**7.7.2.6.4** Adequate and reliable primary and 24 hour minimum standby sources of energy shall be used to provide for operation of the detection, signaling, control, and actuation requirements of the system.

**7.7.2.6.5** All auxiliary functions such as alarm-sounding or displaying devices, remote annunciators, air-handling shutdown, and power shutdown shall be checked for proper operation in accordance with system requirements and design specifications. If possible, all air-handling and power-cutoff controls shall be of the type that, once interrupted, require manual restart to restore power.

**7.7.2.6.6** Silencing of alarms, if desirable, shall not affect other auxiliary functions such as air handling or power cutoff if required in the design specification.

**7.7.2.6.7** The detection devices shall be checked for proper type and location as specified on the system drawings.

**7.7.2.6.8** Detectors shall not be located near obstructions or air ventilation and cooling equipment that would appreciably affect their response characteristics. Where applicable, air changes for the protected area shall be taken into consideration. (*Refer to NFPA 72 and the manufacturer's recommended guidelines.*)

**7.7.2.6.9** The detectors shall be installed in a professional manner and in accordance with technical data regarding their installation.

**7.7.2.6.10** Manual pull stations shall be properly installed, readily accessible, accurately identified, and properly protected to prevent damage.

**7.7.2.6.11** All manual stations used to release agents shall require two separate and distinct actions for operation. They shall be properly identified. Particular care shall be taken where manual release devices for more than one system are in close proximity and could be confused or the wrong system actuated. Manual stations in this instance shall be clearly identified as to which zone or suppression area they affect.

**7.7.2.6.12** For systems with a main/reserve capability, the main/reserve switch shall be properly installed, readily accessible, and clearly identified.

**7.7.2.6.13** For systems using abort switches, the switches shall be of the deadman type requiring constant manual pressure, properly installed, readily accessible within the hazard area, and clearly identified. Switches that remain in the abort position when released shall not be used for this purpose. Manual pull stations shall always override abort switches.

**7.7.2.6.14** The control unit shall be properly installed and readily accessible.

#### **7.7.2.7 Functional Testing.**

**7.7.2.7.1 Preliminary Functional Tests.** The following preliminary functional tests shall be performed:

- (1) If the system is connected to an alarm receiving office, notify the alarm receiving office that the fire system test is to be conducted and that an emergency response by the fire department or alarm station personnel is not desired. Notify all concerned personnel at the end user's facility that a test is to be conducted and instruct personnel as to the sequence of operation.
- (2)\*Disable each agent storage container release mechanism so that activation of the release circuit will not release agent. Reconnect the release circuit with a functional device in lieu of each agent storage container release mechanism.
- (3) Check each detector for proper response.
- (4) Check that polarity has been observed on all polarized alarm devices and auxiliary relays.
- (5) Check that all end-of-line resistors have been installed across the detection and alarm bell circuits, where required.
- (6) Check all supervised circuits for proper trouble response.

**7.7.2.7.2 System Functional Operational Test.** The following system functional operational tests shall be performed:

- (1) Operate detection initiating circuit(s). Verify that all alarm functions occur according to design specifications.
- (2) Operate the necessary circuit to initiate a second alarm circuit, if present. Verify that all second alarm functions occur according to design specifications.
- (3) Operate manual release. Verify that manual release functions occur according to design specifications.
- (4) Operate abort switch circuit, if supplied. Verify that abort functions occur according to design specifications. Confirm that visual and audible supervisory signals are received at the control panel.
- (5) Test all automatic valves, unless testing the valve will release agent or damage the valve (destructive testing).
- (6) Check pneumatic equipment, where required, for integrity to ensure proper operation.

**7.7.2.7.3 Remote Monitoring Operations.** The following testing of remote monitoring operations, if applicable, shall be performed:

- (1) Operate one of each type of input device while on standby power. Verify that an alarm signal is received at remote panel after device is operated. Reconnect primary power supply.
- (2) Operate each type of alarm condition on each signal circuit and verify receipt of trouble condition at the remote station.

**7.7.2.7.4 Control Panel Primary Power Source.** The following testing of the control panel primary power source shall be performed:

- (1) Verify that the control panel is connected to a dedicated circuit and labeled properly. This panel shall be readily accessible, yet restricted from unauthorized personnel.
- (2) Test a primary power failure in accordance with the manufacturer's specification with the system fully operated on standby power.

**7.7.2.7.5 Return of System to Operational Condition.** When all pre-discharge work is completed, each agent storage container shall be reconnected so that activation of the release circuit will release the agent. The system shall be returned to its fully operational design condition. The alarm-receiving office and all concerned personnel at the end user's facility shall be notified

that the fire system test is complete and that the system has been returned to full service condition.

**7.8\* Safety.** Safe procedures shall be observed during installation, servicing, maintenance, testing, handling, and recharging of clean agent systems and agent containers.

## Chapter 8 Marine Systems

**8.1 General.** This chapter outlines the deletions, modifications, and additions that are necessary for marine applications. All other requirements of NFPA 2001 shall apply to shipboard systems except as modified by this chapter. Where the provisions of Chapter 8 conflict with the provisions of Chapters 1 through 7, the provisions of Chapter 8 shall take precedence.

**8.1.1 Scope.** This chapter is limited to marine applications of clean agent fire extinguishing systems on commercial and government vessels. Explosion inerting systems were not considered during development of this chapter.

### 8.2 Use and Limitations.

**8.2.1\*** Total flooding clean agent fire extinguishing systems shall be used primarily to protect hazards that are in enclosures or equipment that, in itself, includes an enclosure to contain the agent.

**8.2.2\*** In addition to the limitations given in 1.4.2.2, clean agent fire extinguishing systems shall not be used to protect the following:

- (1) Dry cargo holds
- (2) Bulk cargo

**8.2.3** The effects of agent decomposition products and combustion products on fire protection effectiveness and equipment shall be considered where using clean agents in hazards with high ambient temperatures (e.g., incinerator rooms, hot machinery and piping).

### 8.3 Hazards to Personnel.

**8.3.1** Other than the engine rooms identified in 8.3.1.1, all other main machinery spaces shall be considered normally occupied spaces.

**8.3.1.1** Engine rooms of 6000 ft<sup>3</sup> (170 m<sup>3</sup>) or less that are accessed for maintenance only shall not be required to comply with 8.3.1.

**8.3.2\*** For marine systems, electrical clearances shall be in accordance with 46 CFR, Subchapter J, "Electrical Engineering."

### 8.4 Agent Supply.

**8.4.1** Reserve quantities of agent shall not be required by this standard.

**8.4.2\*** Storage container arrangement shall be in accordance with 4.1.3.1 and 4.1.3.3 through 4.1.3.5. Where equipment is subject to extreme weather conditions, the system shall be installed in accordance with the manufacturer's design and installation instructions.

**8.4.2.1** Except in the case of systems with storage cylinders located within the protected space, pressure containers required for the storage of the agent shall be in accordance with 8.4.2.2.

**8.4.2.2** Where the agent containers are located outside a protected space, they shall be stored in a room that shall be situated in a safe and readily accessible location and shall be effectively ventilated so that the agent containers are not exposed to ambient temperatures in excess of 130°F (55°C). Common bulkheads and decks located between clean agent container storage rooms and protected spaces shall be protected with A-60 class structural insulation as defined by 46 CFR 72. Agent container storage rooms shall be accessible without having to pass through the space being protected. Access doors shall open outward, and bulkheads and decks, including doors and other means of closing any opening therein, that form the boundaries between such rooms and adjoining spaces shall be gastight.

**8.4.3** Where agent containers are stored in a dedicated space, doors at exits shall swing outward.

**8.4.4** Where subject to moisture, containers shall be installed such that a space of at least 2 in. (51 mm) between the deck and the bottom of the container is provided.

**8.4.5** In addition to the requirements of 4.1.3.4, containers shall be secured with a minimum of two brackets to prevent movement from vessel motion and vibration.

**8.4.6\*** For marine applications, all piping, valves, and fittings of ferrous materials shall be protected inside and out against corrosion except as permitted in 8.4.6.1.

**8.4.6.1** Closed sections of pipe and valves and fittings within closed sections of pipe shall be required to be protected against corrosion only on the outside.

**8.4.6.2** Other than as permitted in 8.4.6.1, prior to acceptance testing, the inside of the piping shall be cleaned without compromising its corrosion resistance.

**8.4.7\*** Pipes, fittings, nozzles, and hangers, including welding filling materials, within the protected space shall have a melting temperature greater than 1600°F (871°C). Aluminum components shall not be used.

**8.4.8** Piping shall extend at least 2 in. (51 mm) beyond the last nozzle in each branch line to prevent clogging.

### 8.5 Detection, Actuation, and Control Systems.

#### 8.5.1 General.

**8.5.1.1** Detection, actuation, alarm, and control systems shall be installed, tested, and maintained in accordance with the requirements of the authority having jurisdiction.

**8.5.1.2\*** For spaces greater than 6000 ft<sup>3</sup> (170 m<sup>3</sup>), automatic release of the fire extinguishing agent shall not be permitted where actuation of the system can interfere with the safe navigation of the vessel. Automatic release of the fire extinguishing agent shall be permitted for any space where actuation of the system will not interfere with the safe navigation of the vessel.

**8.5.1.2.1** Automatic release shall be permitted for any space of 6000 ft<sup>3</sup> (170 m<sup>3</sup>) or less.

#### 8.5.2 Automatic Detection.

**8.5.2.1** Electrical detection, signaling, control, and actuation system(s) shall have at least two sources of power. The primary source shall be from the vessel's emergency bus. For vessels with an emergency bus or battery, the backup source shall be either the vessel's general alarm battery or an internal battery

within the system. Internal batteries shall be capable of operating the system for a minimum of 24 hours. All power sources shall be supervised.

**8.5.2.1.1** For vessels without an emergency bus or battery, the primary source shall be permitted to be the main electrical supply.

**8.5.2.2** In addition to the requirements set forth in 4.3.3.5, actuation circuits shall not be routed through the protected space where manual electrical actuation is used in marine systems.

**8.5.2.2.1** For systems complying with 8.5.2.4, actuation circuits shall be permitted to be routed through the protected space.

**8.5.2.3\*** Manual actuation for systems shall not be capable of being put into operation by any single action. Other than as identified in 8.5.2.3.1, manual actuation stations shall be housed in an enclosure.

**8.5.2.3.1** Manual actuation shall be permitted to be local manual actuation at the cylinder(s) location.

**8.5.2.4** Systems protecting spaces larger than 6000 ft<sup>3</sup> (170 m<sup>3</sup>) shall have a manual actuation station located in the main egress route outside the protected space. In addition, systems protecting spaces larger than 6000 ft<sup>3</sup> (170 m<sup>3</sup>) having cylinders within the protected space and systems protecting unattended main machinery spaces shall have an actuation station in a continuously monitored control station outside the protected space.

**8.5.2.4.1** Systems protecting spaces of 6000 ft<sup>3</sup> (170 m<sup>3</sup>) or less shall be permitted to have a single actuation station at either of the locations described in 8.5.2.4.

**8.5.2.5** Emergency lighting shall be provided for remote actuation stations serving systems protecting main machinery spaces. All manual operating devices shall be labeled to identify the hazards they protect. In addition, the following information shall be provided:

- (1) Operating instructions
- (2) Length of time delay
- (3) Actions to take if system fails to operate
- (4) Other actions to take such as closing vents and taking a head count

**8.5.2.5.1** For systems having cylinders within the protected space, a means of indicating system discharge shall be provided at the remote actuation station.

## **8.6 Additional Requirements for Systems Protecting Class B Hazards Greater Than 6000 ft<sup>3</sup> (170 m<sup>3</sup>) with Stored Cylinders Within the Protected Space.**

**8.6.1\*** An automatic fire detection system shall be installed in the protected space to provide early warning of fire to minimize potential damage to the fire extinguishing system before it can be manually actuated. The detection system shall initiate audible and visual alarms in the protected space and on the navigating bridge upon detection of fire. All detection and alarm devices shall be electrically supervised for continuity, and trouble indication shall be annunciated on the navigating bridge.

**8.6.2\*** Electrical power circuits connecting the containers shall be monitored for fault conditions and loss of power. Visual and

audible alarms shall be provided to indicate this, and the alarms shall be annunciated on the navigating bridge.

**8.6.3\*** Within the protected space, electrical circuits essential for the release of the system shall be heat resistant, such as mineral-insulated cable compliant with Article 332 of *NFPA 70*, or the equivalent. Piping systems essential for the release of systems designed to be operated hydraulically or pneumatically shall be of steel or other equivalent heat-resistant material.

**8.6.4\*** The arrangements of containers and the electrical circuits and piping essential for the release of any system shall be such that in the event of damage to any one power release line through fire or explosion in a protected space (i.e., a single-fault concept) the entire fire extinguishing charge required for that space can still be discharged.

**8.6.5\*** The containers shall be monitored for decrease in pressure due to leakage and discharge. Visual and audible signals in the protected area and either on the navigating bridge or in the space where the fire control equipment is centralized shall be provided to indicate a low-pressure condition.

**8.6.6\*** Within the protected space, electrical circuits essential for the release of the system shall be Class A rated in accordance with *NFPA 72*.

## **8.7 Enclosure.**

**8.7.1\*** To prevent loss of agent through openings to adjacent hazards or work areas, openings shall be one of the following designs:

- (1) Permanently sealed
- (2) Equipped with automatic closures
- (3) Equipped with manual closures outfitted with an alarm circuit to indicate when these closures are not sealed upon activation of the system

**8.7.1.1** Where confinement of agent is not practical, or if the fuel can drain from one compartment to another, such as via a bilge, protection shall be extended to include the adjacent connected compartment or work areas.

**8.7.2\*** Prior to agent discharge, all ventilating systems shall be closed and isolated to preclude passage of agent to other compartments or the vessel exterior. Automatic shutdowns or manual shutdowns capable of being closed by one person from a position co-located with the agent discharge station shall be used.

## **8.8 Design Concentration Requirements.**

**8.8.1 Combinations of Fuels.** For combinations of fuels, the design concentration shall be derived from the flame extinguishment value for the fuel requiring the greatest concentration.

**8.8.2 Design Concentration.** For a particular fuel, the design concentration referred to in 8.8.3 shall be used.

**8.8.3 Flame Extinguishment.** The minimum design concentration for Class B flammable and combustible liquids shall be as determined following the procedures described in IMO MSC/Circular 848.

**8.8.4\* Total Flooding Quantity.** The quantity of agent shall be based on the net volume of the space and shall be in accordance with the requirements of paragraph 5 of IMO MSC/Circular 848, Annex.

**8.8.5\* Duration of Protection.** It is important that the agent design concentration not only shall be achieved, but also shall be maintained for a sufficient period of time to allow effective emergency action by trained ship's personnel. In no case shall the hold time be less than 15 minutes.

## 8.9 Distribution System.

**8.9.1 Rate of Application.** The minimum design rate of application shall be based on the quantity of agent required for the desired concentration and the time allowed to achieve the desired concentration.

## 8.9.2 Discharge Time.

**8.9.2.1** The discharge time for halocarbon agents shall not exceed 10 seconds or as otherwise required by the authority having jurisdiction.

**8.9.2.2** For halocarbon agents, the discharge time period shall be defined as the time required to discharge from the nozzles 95 percent of the agent mass [at 70°F (21°C)] necessary to achieve the minimum design concentration.

**8.9.2.3** The discharge time for inert gas agents shall not exceed 120 seconds for 85 percent of the design concentration or as otherwise required by the authority having jurisdiction.

**8.10 Nozzle Choice and Location.** For spaces other than those identified in 8.10.1, nozzles shall be of the type listed for the intended purpose. Limitations shall be determined based on testing in accordance with IMO MSC/Circular 848. Nozzle spacing, area coverage, height, and alignment shall not exceed the limitations.

**8.10.1** For spaces having only Class A fuels, nozzle placement shall be in accordance with the nozzles' listed limitations.

**8.11 Inspection and Tests.** At least annually, all systems shall be inspected and tested for proper operation by competent personnel. Discharge tests shall not be required.

**8.11.1** An inspection report with recommendations shall be filed with the vessel's master and the owner's agent. The report shall be available for inspection by the authority having jurisdiction.

**8.11.2** At least annually, the agent quantity of refillable containers shall be checked by competent personnel. The container pressure shall be verified and logged at least monthly by the vessel's crew.

**8.11.3\*** For halocarbon clean agents, if a container shows a loss in agent of more than 5 percent or a loss in pressure, adjusted for temperature, of more than 10 percent, it shall be refilled or replaced.

**8.11.3.1\*** If an inert gas clean agent container shows a loss in pressure, adjusted for temperature, of more than 5 percent, it shall be refilled or replaced. Where container pressure gauges are used for this purpose, they shall be compared to a separate calibrated device at least annually.

**8.11.4** The installing contractor shall provide instructions for the operational features and inspection procedures specific to the clean agent system installed on the vessel.

**8.12 Approval of Installations.** Prior to acceptance of the system, technical documentation, such as the system design manual, test reports, or the listing report, shall be presented to the authority having jurisdiction. This documentation shall show that the system and its individual components are compatible, employed within tested limitations, and suitable for marine use.

**8.12.1** The listing organization shall perform the following functions:

- (1) Verify that fire tests were conducted in accordance with a predetermined standard
- (2) Verify that component tests were conducted in accordance with a predetermined standard
- (3) Review the component quality assurance program
- (4) Review the design and installation manual
- (5) Identify system and component limitations
- (6) Verify flow calculations
- (7) Verify the integrity and the reliability of system as a whole
- (8) Have a follow-up program
- (9) Publish a list of equipment

**8.13 Periodic Puff Testing.** A test in accordance with 7.7.2.4.13 shall be performed at 24 month intervals. The periodic test program shall include a functional test of all alarms, controls, and time delays.

**8.14 Compliance.** Electrical systems shall be in accordance with 46 CFR Subchapter J. For Canadian vessels, electrical installations shall be in accordance with TP 127 E.

## Annex A Explanatory Material

*Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.*

**A.1.4.1** The agents currently listed possess the physical properties as detailed in Table A.1.4.1(a) through Table A.1.4.1(d). These data will be revised from time to time as new information becomes available. Additional background information and data on these agents can be found in several references: Fernandez (1991), Hanauska (1991), Robin (1991), and Sheinson (1991).

**A.1.4.1.2** The designations for perfluorocarbons (FCs), hydrochlorofluorocarbons (HCFCs), hydrofluorocarbons (HFCs), fluoroiodocarbons (FICs), and fluoroketones (FKs) are an extension of halocarbon designations in ANSI/ASHRAE 34, prepared by the American National Standards Institute, Inc. (ANSI) and the American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc. (ASHRAE). HCFC Blend A is a designation for a blend of HCFCs and a hydrocarbon. The designation IG-541 is used in this standard for a blend of three inert gases — nitrogen, argon, and carbon dioxide (52 percent, 40 percent, and 8 percent, respectively). The designation IG-01 is used in this standard for argon, an unblended inert gas. The designation IG-100 is used in this standard for nitrogen, an unblended inert gas. The designation IG-55 is used in this standard for a blend of two inert gases — nitrogen and argon (50 percent and 50 percent, respectively).

**Table A.1.4.1(a) Physical Properties of Clean Halocarbon Agents (U.S. Units)**

Physical Property	Units	HCFC		HFC		HCFC-124	HFC-125	HFC-227ea	HFC-23	HFC-236fa
		FIC-131I	FK-5-1-12	Blend A	Blend B					
Molecular weight	N/A	195.9	316.04	92.9	99.4	136.5	120.0	170	70.01	152
Boiling point at 760 mm Hg	°F	-8.5	120.2	-37	-14.9	10.5	-54	2.4	-115.6	29.5
Freezing point	°F	-166	-162.4	161	-153.9	-326	-153	-204	-247.4	-153.4
Critical temperature	°F	252	335.6	256	219.9	252.5	150.8	214	79.1	256.9
Critical pressure	psi	586	270.44	964	588.9	527	525	424	700	464.1
Critical volume	ft <sup>3</sup> /lbm	0.0184	0.0251	0.028	0.031	0.0286	0.0279	0.0280	0.0304	0.02905
Critical density	lbm/ft <sup>3</sup>	54.38	39.91	36	32.17	34.96	35.81	35.77	32.87	34.42
Specific heat, liquid at 77°F	Btu/lb-°F	0.141	0.2634	0.3	0.339	0.271	0.354	0.281	0.987 at 68°F	0.3012
Specific heat, vapor at constant pressure (1 atm) and 77°F	Btu/lb-°F	0.86	0.2127	0.16	0.203	0.18	0.19	0.193	0.175 at 68°F	0.201
Heat of vaporization at boiling point	Btu/lb	48.1	37.8	97	93.4	71.3	70.5	56.6	103	68.97
Thermal conductivity of liquid at 77°F	Btu/hr-ft-°F	0.04	0.034	0.052	0.0478	0.0395	0.0343	0.034	0.0305	0.0421
Viscosity, liquid at 77°F	lb/ft-hr	0.473	1.27	0.508	0.485	0.622	0.338	0.579	0.107	0.6906
Relative dielectric strength at 1 atm at 734 mm Hg, (N <sub>2</sub> = 1)	N/A	1.41 at 77°F	2.3 at 77°F	1.32 at 77°F	1.014 at 77°F	1.55 at 77°F	0.955 at 70°F	2 at 77°F	1.04 at 77°F	1.0166 at 77°F
Solubility of water in agent	wt%	0.01 at 70°F	<0.001 at 70°F	0.12 at 70°F	0.11 at 70°F	770 at 77°F	770 at 77°F	0.06 at 70°F	500 at 50°F	740 at 68°F

**Table A.1.4.1(b) Physical Properties of Inert Gas Agents (U.S. Units)**

Physical Property	Units	IG-01	IG-100	IG-541	IG-55
Molecular weight	N/A	39.9	28.0	34.0	33.95
Boiling point at 760 mm Hg	°F	-302.6	-320.4	-320	-310.2
Freezing point	°F	-308.9	-346.0	-109	-327.5
Critical temperature	°F	-188.1	-232.4	N/A	-210.5
Critical pressure	psia	711	492.9	N/A	602
Specific heat, vapor at constant pressure (1 atm) and 77°F	Btu/lb °F	0.125	0.445	0.195	0.187
Heat of vaporization at boiling point	Btu/lb	70.1	85.6	94.7	77.8
Relative dielectric strength at 1 atm at 734 mm Hg, 77°F (N <sub>2</sub> = 1.0)	N/A	1.01	1.0	1.03	1.01
Solubility of water in agent at 77°F	N/A	0.006%	0.0013%	0.015%	0.006%



Table A.1.4.1(c) Physical Properties of Clean Halocarbon Agents (SI Units)

Physical Property	Units	FIC-131I	FK-5-1-12	HCFC Blend A	HFC Blend B	HCFC-124	HFC-125	HFC-227ea	HFC-23	HFC-236fa
Molecular weight	N/A	195.91	316.04	92.90	99.4	136.5	120	170	70.01	152
Boiling point at 760 mm Hg	°C	-22.5	49	-38.3	-26.1	-12.0	-48.1	-16.4	-82.1	-1.4
Freezing point	°C	-110	-108	<107.2	-103	-198.9	-102.8	-131	-155.2	-103
Critical temperature	°C	122	168.66	124.4	101.1	122.6	66	101.7	26.1	124.9
Critical pressure	kPa	4041	1865	6647	4060	3620	3618	2912	4828	3200
Critical volume	cc/mole	225	494.5	162	198	243	210	274	133	276*
Critical density	kg/m <sup>3</sup>	871	639.1	577	515.3	560	574	621	527	551.3
Specific heat, liquid at 25°C	kJ/kg - °C	0.592 at 25°C	1.103 at 25°C	1.256 at 25°C	1.44 at 25°C	1.153 at 25°C	1.407 at 25°C	1.184 at 25°C	4.130 at 20°C	1.264 at 25°C
Specific heat, vapor at constant pressure (1 atm) and 25°C	kJ/kg - °C	0.3618 at 25°C	0.891 at 25°C	0.67 at 25°C	0.848 at 25°C	0.742 at 25°C	0.797 at 25°C	0.808 at 25°C	0.731 at 20°C	0.840 at 25°C
Heat of vaporization at boiling point	kJ/kg	112.4	88	225.6	217.2	165.9	164.1	132.6	239.3	160.4
Thermal conductivity of liquid at 25°C	W/m - °C	0.07	0.059	0.09	0.082	0.0684	0.0592	0.069	0.0534	0.0729
Viscosity, liquid at 25°C	centipoise	0.196	0.524	0.21	0.202	0.257	0.14	0.184	0.044	0.286
Relative dielectric strength at 1 atm at 734 mm Hg (N <sub>2</sub> = 1.0)	N/A	1.41 at 25°C	2.3 at 25°C	1.32 at 25°C	1.014 at 25°C	1.55 at 25°C	0.955 at 21°C	2 at 25°C	1.04 at 25°C	1.0166 at 25°C
Solubility of water in agent	ppm	1.0062% by weight	<0.001	0.12% by weight	0.11% by weight	700 at 25°C	700 at 25°C	0.06% by weight	500 at 10°C	740 at 20°C

Table A.1.4.1(d) Physical Properties of Inert Gas Agents (SI Units)

Physical Property	Units	IG-01	IG-100	IG-541	IG-55
Molecular weight	N/A	39.9	28.0	34.0	33.95
Boiling point at 760 mm Hg	°C	-189.85	-195.8	-196	-190.1
Freezing point	°C	-189.35	-210.0	-78.5	-199.7
Critical temperature	°C	-122.3	-146.9	N/A	-134.7
Critical pressure	kPa	4,903	3,399	N/A	4,150
Specific heat, vapor at constant pressure (1 atm) and 25°C	kJ/kg °C	0.519	1.04	0.574	0.782
Heat of vaporization at boiling point	kJ/kg	163	199	220	181
Relative dielectric strength at 1 atm at 734 mm Hg, 25°C (N <sub>2</sub> = 1.0)	N/A	1.01	1.0	1.03	1.01
Solubility of water in agent at 25°C	N/A	0.006%	0.0013%	0.015%	0.006%

**A.1.4.2** Clean agent fire extinguishing systems are useful within the limits of this standard for extinguishing fires in specific hazards or equipment and in occupancies where an electrically non-conductive medium is essential or desirable or where cleanup of other media presents a problem.

Total flooding clean agent fire extinguishing systems are used primarily to protect hazards that are in enclosures or equipment that, in itself, includes an enclosure to contain the agent. Some typical hazards that could be suitable include, but are not limited to, the following:

- (1) Electrical and electronic hazards
- (2) Subfloors and other concealed spaces
- (3) Flammable and combustible liquids and gases
- (4) Other high-value assets
- (5) Telecommunications facilities

Clean agent systems could also be used for explosion prevention and suppression where flammable materials could collect in confined areas.

**A.1.4.2.2** Electrostatic charging of ungrounded conductors could occur during the discharge of liquefied gases. These conductors could discharge to other objects, causing an electric arc of sufficient energy to initiate an explosion.

While an attractive feature of these agents is their suitability for use in environments containing energized electrical equipment without damaging that equipment, in some instances the electrical equipment could be the source of ignition. In such cases, the energized equipment should be de-energized prior to or during agent discharge.

See NFPA 77.

**A.1.4.2.4** The provision of an enclosure can create an unnecessary explosion hazard where otherwise only a fire hazard exists. A hazard analysis should be conducted to determine the relative merits of differing design concepts — for example, with and without enclosures — and the most relevant means of fire protection.

This provision provides consideration for using a clean agent in an environment that could result in an inordinate amount of products of decomposition (e.g., within an oven).

**A.1.5.1** Potential hazards to be considered for individual systems are the following:

- (1) *Noise.* Discharge of a system can cause noise loud enough to be startling but ordinarily insufficient to cause traumatic injury.
- (2) *Turbulence.* High-velocity discharge from nozzles could be sufficient to dislodge substantial objects directly in the path. System discharge can cause enough general turbulence in the enclosures to move unsecured paper and light objects.
- (3) *Cold temperature.* Direct contact with the vaporizing liquid being discharged from a system will have a strong chilling effect on objects and can cause frostbite burns to the skin. The liquid phase vaporizes rapidly when mixed with air and thus limits the hazard to the immediate vicinity of the discharge point. In humid atmospheres, minor reduction in visibility can occur for a brief period due to the condensation of water vapor.

**A.1.5.1.1** The discharge of clean agent systems to extinguish a fire could create a hazard to personnel from the natural form of the clean agent or from the products of decomposition that result from exposure of the agent to the fire or hot surfaces. Unnecessary exposure of personnel either to the natural agent or to the decomposition products should be avoided.

The SNAP Program was originally outlined in the *Federal Register*, “EPA SNAP Program.”

**A.1.5.1.2** Table A.1.5.1.2(a) provides information on the toxicological effects of halocarbon agents covered by this standard. The no observable adverse effect level (NOAEL) is the highest concentration at which no adverse physiological or

toxicological effect has been observed. The lowest observable adverse effect level (LOAEL) is the lowest concentration at which an adverse physiological or toxicological effect has been observed.

An appropriate protocol measures the effect in a stepwise manner such that the interval between the LOAEL and NOAEL is sufficiently small to be acceptable to the competent regulatory authority. The EPA includes in its SNAP evaluation this aspect (of the rigor) of the test protocol.

**Table A.1.5.1.2(a) Toxicity Information for Halocarbon Clean Agents**

Agent	LC <sub>50</sub> or ALC (%)	NOAEL (%)	LOAEL (%)
FIC-1311	>12.8	0.2	0.4
FK-5-1-12	>10.0	10	>10.0
HCFC Blend A	64	10	>10.0
HCFC-124	23–29	1	2.5
HFC-125	>70	7.5	10
HFC-227ea	>80	9	10.5
HFC-23	>65	30	>30
HFC-236fa	>45.7	10	15
HFC Blend B	56.7*	5.0*	7.5*

Notes:

(1) LC<sub>50</sub> is the concentration lethal to 50 percent of a rat population during a 4 hour exposure. The ALC is the approximate lethal concentration.

(2) The cardiac sensitization levels are based on the observance or nonobservance of serious heart arrhythmias in a dog. The usual protocol is a 5 minute exposure followed by a challenge with epinephrine.

(3) High concentration values are determined with the addition of oxygen to prevent asphyxiation.

\*These values are for the largest component of the blend (HFCB 134A).

For halocarbons covered in this standard, the NOAEL and LOAEL are based on the toxicological effect known as cardiac sensitization. Cardiac sensitization occurs when a chemical causes an increased sensitivity of the heart to adrenaline, a naturally occurring substance produced by the body during times of stress, leading to the sudden onset of irregular heart beats and possibly heart attack. Cardiac sensitization is measured in dogs after they have been exposed to a halocarbon agent for 5 minutes. At the 5 minute time period, an external dose of adrenaline (epinephrine) is administered and an effect is recorded if the dog experiences cardiac sensitization. The cardiac sensitization potential as measured in dogs is a highly conservative indicator of the potential in humans. The conservative nature of the cardiac sensitization test stems from several factors; the two most pertinent are as follows:

- (1) Very high doses of adrenaline are given to the dogs during the testing procedure (doses are more than 10 times higher than the highest levels secreted by humans under maximum stress).
- (2) Four to ten times more halocarbon is required to cause cardiac sensitization in the absence of externally administered adrenaline, even in artificially created situations of stress or fright in the dog test.

Because the cardiac sensitization potential is measured in dogs, a means of providing human relevance to the concentration at which this cardiac sensitization occurs (LOAEL) has been established through the use of physiologically based pharmacokinetic (PBPK) modeling.

A PBPK model is a computerized tool that describes time-related aspects of a chemical's distribution in a biological system. The PBPK model mathematically describes the uptake of the halocarbon into the body and the subsequent distribution of the halocarbon to the areas of the body where adverse effects can occur. For example, the model describes the breathing rate and uptake of the halocarbon from the exposure atmosphere into the lungs. From there, the model uses the blood flow bathing the lungs to describe the movement of the halocarbon from the lung space into the arterial blood that directly feeds the heart and vital organs of the body.

It is the ability of the model to describe the halocarbon concentration in human arterial blood that provides its primary utility in relating the dog cardiac sensitization test results to a human who is unintentionally exposed to the halocarbon. The concentration of halocarbon in the dog arterial blood at the time the cardiac sensitization event occurs (5 minute exposure) is the critical arterial blood concentration, and this blood parameter is the link to the human system. Once this critical arterial blood concentration has been measured in dogs, the EPA-approved PBPK model simulates how long it will take the human arterial blood concentration to reach the critical arterial blood concentration (as determined in the dog test) during human inhalation of any particular concentration of the halocarbon agent. As long as the simulated human arterial concentration remains below the critical arterial blood concentration, the exposure is considered safe. Inhaled halocarbon concentrations that produce human arterial blood concentrations equal to or greater than the critical arterial blood concentration are considered unsafe because they represent inhaled concentrations that potentially yield arterial blood concentrations where cardiac sensitization events occur in the dog test. Using these critical arterial blood concentrations of halocarbons as the ceiling for allowable human arterial concentrations, any number of halocarbon exposure scenarios can be evaluated using this modeling approach.

For example, in the dog cardiac sensitization test on Halon 1301, a measured dog arterial blood concentration of 25.7 mg/L is measured at the effect concentration (LOAEL) of 7.5 percent after a 5 minute exposure to Halon 1301 and an external intravenous adrenaline injection. The PBPK model predicts the time at which the human arterial blood concentration reaches 25.7 mg/L for given inhaled Halon 1301 concentrations. Using this approach, the model also predicts that at some inhaled halocarbon concentrations, the critical arterial blood concentration is never reached; thus, cardiac sensitization will not occur. Accordingly, in the tables in 1.5.1.2.1, the time is arbitrarily truncated at 5 minutes, because the dogs were exposed for 5 minutes in the original cardiac sensitization testing protocols.

The time value, estimated by the EPA-approved and peer-reviewed PBPK model or its equivalent, is that required for the human arterial blood level for a given halocarbon to equal the arterial blood level of a dog exposed to the LOAEL for 5 minutes.

For example, if a system is designed to achieve a maximum concentration of 12.0 percent HFC-125, means should be provided such that personnel are exposed for no longer than 1.67 minutes. Examples of suitable exposure-limiting mechanisms include self-contained breathing apparatuses and planned and rehearsed evacuation routes.

The requirement for pre-discharge alarms and time delays is intended to prevent human exposure to agents during fire fighting. However, in the unlikely circumstance that an accidental discharge occurs, restrictions on the use of certain halocarbon agents covered in this standard are based on the availability of PBPK modeling information. For those halocarbon agents in which modeling information is available, means should be provided to limit the exposure to those concentrations and times specified in the tables in 1.5.1.2.1. The concentrations and times given in the tables are those that have been predicted to limit the human arterial blood concentration to below the critical arterial blood concentration associated with cardiac sensitization. For halocarbon agents where the needed data are unavailable, the agents are restricted based on whether the protected space is normally occupied or unoccupied and how quickly egress from the area can be effected. Normally occupied areas are those intended for human occupancy. Normally unoccupied areas are those in which personnel can be present from time to time. Therefore, a comparison of the cardiac sensitization values to the intended design concentration would determine the suitability of a halocarbon for use in normally occupied or unoccupied areas.

Clearly, longer exposure of the agent to high temperatures would produce greater concentrations of these gases. The type and sensitivity of detection, coupled with the rate of discharge, should be selected to minimize the exposure time of the agent to the elevated temperature if the concentration of the breakdown products must be minimized. In most cases the area would be untenable for human occupancy due to the heat and breakdown products of the fire itself.

These decomposition products have a sharp, acrid odor, even in minute concentrations of only a few parts per million. This characteristic provides a built-in warning system for the agent but at the same time creates a noxious, irritating atmosphere for those who must enter the hazard following a fire.

*Background and toxicology of hydrogen fluoride.* Hydrogen fluoride (HF) vapor can be produced in fires as a breakdown product of fluorocarbon fire extinguishing agents and in the combustion of fluoropolymers.

The significant toxicological effects of HF exposure occur at the site of contact. By the inhalation route, significant deposition is predicted to occur in the most anterior (front part) region of the nose and extending back to the lower respiratory tract (airways and lungs) if sufficient exposure concentrations are achieved. The damage induced at the site of contact with HF is characterized by extensive tissue damage and cell death (necrosis) with inflammation. One day after a single, 1 hour exposure of rats to HF concentrations of 950 ppm to 2600 ppm, tissue injury was limited exclusively to the anterior section of the nose (DuPont, 1990). No effects were seen in the trachea or lungs.

At high concentrations of HF (about 200 ppm), human breathing patterns would be expected to change primarily from nose breathing to primarily mouth breathing. This change in breathing pattern determines the deposition pattern of HF into the respiratory tract, either upper respiratory tract (nose breathing) or lower respiratory tract (mouth breathing). In studies conducted by Dalby (1996), rats were exposed by nose-only or mouth-only breathing. In the mouth-only breathing model, rats were exposed to various concentrations of HF through a tube placed in the trachea, thereby bypassing the upper respiratory tract. This exposure method is considered to be a conservative approach for estimating a "worst case" exposure in which a person would not breathe through the nose but inhale through the mouth, thereby

maximizing the deposition of HF into the lower respiratory tract.

In the nose-only breathing model, 2 minute or 10 minute exposures of rats to about 6400 or 1700 ppm, respectively, produced similar effects; that is, no mortality resulted but significant cell damage in the nose was observed. In contrast, marked differences in toxicity were evident in the mouth-only breathing model. Indeed, mortality was evident following a 10 minute exposure to a concentration of about 1800 ppm and a 2 minute exposure to about 8600 ppm. Significant inflammation of the lower respiratory tract was also evident. Similarly, a 2 minute exposure to about 4900 ppm produced mortality and significant nasal damage. However, at lower concentrations (950 ppm) following a 10 minute exposure or 1600 ppm following a 2 minute exposure, no mortality and only minimal irritation were observed.

Numerous other toxicology studies have been conducted in experimental animals for longer durations, such as 15, 30, or 60 minutes. In nearly all of these studies, the effects of HF were generally similar across all species; that is, severe irritation of the respiratory tract was observed as the concentration of HF was increased.

In humans, an irritation threshold appears to be at about 3 ppm, where irritation of the upper airways and eyes occurs. In prolonged exposure at about 5 ppm, redness of the skin has also resulted. In controlled human exposure studies, humans are reported to have tolerated mild nasal irritation (subjective response) at 32 ppm for several minutes (Machle et al., 1934). Exposure of humans to about 3 ppm for an hour produced slight eye and upper respiratory tract irritation. Even with an increase in exposure concentration (up to 122 ppm) and a decrease in exposure duration to about 1 minute, skin, eye, and respiratory tract irritation occurs (Machle and Kitzmiller, 1935).

Meldrum (1993) proposed the concept of the dangerous toxic load (DTL) as a means of predicting the effects of, for example, HF in humans. Meldrum developed the argument that the toxic effects of certain chemicals tend to follow Haber's law:

$$C \times t = k \quad [\text{A.1.5.1.2}]$$

where:

$C$  = concentration

$t$  = time

$k$  = constant

The available data on the human response to inhalation of HF were considered insufficient to provide a basis for establishing a DTL. Therefore, it was necessary to use the available animal lethality data to establish a model for the response in humans. The DTL is based on an estimate of 1 percent lethality in an exposed population of animals. Based on the analysis of animal lethality data, the author determined that the DL for HF is 12,000 ppm/min. Although this approach appears reasonable and consistent with mortality data in experimental animals, the predictive nature of this relationship for nonlethal effects in humans has not been demonstrated.

*Potential human health effects and risk analysis in fire scenarios.* It is important for a risk analysis to distinguish between normally healthy individuals, such as fire fighters, and those with compromised health. Exposure to higher concentrations of HF would be expected to be tolerated more in healthy

individuals, whereas equal concentrations can have escape-impairing effects in those with compromised health. The following discussion assumes that the effects described at the various concentrations and durations are for the healthy individual.

Inflammation (irritation) of tissues represents a continuum from “no irritation” to “severe, deep penetrating” irritation. Use of the terms *slight*, *mild*, *moderate*, and *severe* in conjunction with irritation represents an attempt to quantify this effect. However, given the large variability and sensitivity of the human population, differences in the degree of irritation from exposure to HF are expected to occur. For example, some individuals can experience mild irritation to a concentration that results in moderate irritation in another individual.

At concentrations of <50 ppm for up to 10 minutes, irritation of upper respiratory tract and the eyes would be expected to occur. At these low concentrations, escape-impairing effects would not be expected in the healthy individual. As HF concentrations increase to 50 ppm to 100 ppm, an increase in irritation is expected. For short duration (10 to 30 minutes), irritation of the skin, eyes, and respiratory tract would occur. At 100 ppm for 30 to 60 minutes, escape-impairing effects would begin to occur, and continued exposure at 200 ppm and greater for an hour could be lethal in the absence of medical intervention. As the concentration of HF increases, the severity of irritation increases, and the potential for delayed systemic effects also increases. At about 100 to 200 ppm of HF, humans would also be expected to shift their breathing pattern to mouth breathing. Therefore, deeper lung irritation is expected. At greater concentrations (>200 ppm), respiratory discomfort, pulmonary (deep lung) irritation, and systemic effects are possible. Continued exposure at these higher concentrations can be lethal in the absence of medical treatment.

Generation of HF from fluorocarbon fire extinguishing agents represents a potential hazard. In the foregoing discussion, the duration of exposure was indicated for 10 to 60 minutes. In fire conditions in which HF would be generated, the actual exposure duration would be expected to be less than 10 minutes and in most cases less than 5 minutes. As Dalby (1996) showed, exposing mouth-breathing rats to HF concentrations of about 600 ppm for 2 minutes was without effect. Similarly, exposing mouth-breathing rats to a HF concentration of about 300 ppm for 10 minutes did not result in any mortality or respiratory effects. Therefore, one could surmise that humans exposed to similar concentrations for less than 10 minutes would be able to survive such concentrations. However, caution needs to be employed in interpreting these data. Although the toxicity data would suggest that humans could survive these large concentrations for less than 10 minutes, those individuals with compromised lung function or those with cardiopulmonary disease can be more susceptible to the effects of HF. Furthermore, even in the healthy individual, irritation of the upper respiratory tract and eyes would be expected, and escape could be impaired.

Table A.1.5.1.2(b) provides potential human health effects of hydrogen fluoride in healthy individuals.

Occupational exposure limits have been established for HF. The limit set by the American Conference of Governmental Industrial Hygienists (ACGIH), the Threshold Limit Value (TLV®), represents exposure of normally healthy workers for an 8 hour workday or a 40 hour workweek. For HF, the limit established is 3 ppm, which represents a ceiling limit; that is,

the airborne concentration that should not be exceeded at any time during the workday. This limit is intended to prevent irritation and possible systemic effects with repeated, long-term exposure. This and similar time-weighted average limits are not considered relevant for fire extinguishing use of fluorocarbons during emergency situations. However, these limits may need to be considered in clean-up procedures where high levels of HF were generated. (More information can be obtained from the American Conference of Governmental Industrial Hygienists, 1330 Kemper Meadow Drive, Cincinnati, OH 45240, 513-742-2020.)

**Table A.1.5.1.2(b) Potential Human Health Effects of Hydrogen Fluoride in Healthy Individuals**

Exposure Time	Concentration of Hydrogen Fluoride (ppm)	Reaction
2 minutes	<50	Slight eye and nasal irritation
	50–100	Mild eye and upper respiratory tract irritation
	100–200	Moderate eye and upper respiratory tract irritation; slight skin irritation
	>200	Moderate irritation of all body surfaces; increasing concentration may be escape impairing
5 minutes	<50	Mild eye and nasal irritation
	50–100	Increasing eye and nasal irritation; slight skin irritation
	100–200	Moderate irritation of skin, eyes, and respiratory tract
	>200	Definite irritation of tissue surfaces; will cause escape-impairing effects at increasing concentrations
10 minutes	<50	Definite eye, skin, and upper respiratory tract irritation
	50–100	Moderate irritation of all body surfaces
	100–200	Moderate irritation of all body surfaces; escape-impairing effects likely
	>200	Escape-impairing effects will occur; increasing concentrations can be lethal without medical intervention

In contrast to the ACGIH TLV, the American Industrial Hygiene Association (AIHA) Emergency Response Planning Guideline (ERPG) represents limits established for emergency release of chemicals. These limits are established to also account for sensitive populations, such as those with compromised health. The ERPG limits are designed to assist emergency response personnel in planning for catastrophic releases of chemicals. These limits are not developed to be used as “safe” limits for routine operations. However, in the case of fire extinguishing use and generation of HF, these limits are more relevant than time-weighted average limits such as the TLV. The ERPG limits consist of three levels for use in emergency planning and are typically 1 hour values; 10 minute values have also been established for HF. For the 1 hour limits, the ERPG 1 (2 ppm) is based on odor perception and is below the concentration at which mild sensory irritation has been reported (3 ppm). ERPG 2 (20 ppm) is the most important guideline value set and is the concentration at which mitigating steps should be taken, such as evacuation, sheltering, and donning masks. This level should not impede escape or cause irreversible health effects and is based mainly on the human irritation data obtained by Machle et al. (1934) and Largent (1960). ERPG 3 (50 ppm) is based on animal data and is the maximum nonlethal level for nearly all individuals. This level could be lethal to some susceptible people. The 10-minute values established for HF and used in emergency planning in fires where HF vapor is generated are ERPG 3 = 170 ppm, ERPG 2 = 50 ppm, and ERPG 1 = 2 ppm. (More information can be obtained from the American Industrial Hygiene Association, 2700 Prosperity Ave., Suite 250, Fairfax, VA 22031, 703-849-8888, fax 703-207-3561.)

**A.1.5.1.2.1** One objective of pre-discharge alarms and time delays is to prevent human exposure to agents.

**A.1.5.1.3** Paragraph 1.5.1.3 makes reference to limiting concentrations of inert gas agents corresponding to certain values of “sea level equivalent” of oxygen. The mean atmospheric pressure of air at sea level is 760 mm Hg. Atmo-

spheric air is 21 volume percent oxygen. The partial pressures of oxygen in ambient air and air diluted agent to the limiting sea level concentrations corresponding to permissible exposure times of 5 minutes, 3 minutes, and ½ minute are given in Table A.1.5.1.3(a).

**Table A.1.5.1.3(a) Oxygen Partial Pressure at Sea Level Corresponding to Exposure Limits Given in 1.5.1.3**

Exposure Time (min)	Agent Concentration (vol %)	O <sub>2</sub> % at Sea Level	Partial Pressure of O <sub>2</sub> (mm Hg)
Air reference	0	21	159.6
5	43	12.0	91.0
3	52	10.1	76.6
½	62	8.0	60.6

Note: Mean atmospheric pressure at sea level is 760 mm Hg.

In 3.3.32, *sea level equivalent of oxygen* is defined in terms of the partial pressure at sea level. The mean atmospheric pressure decreases with increasing altitude, as shown in Table 5.5.3.3. The partial pressure of oxygen is 21 percent of the atmospheric pressure. The concentration of added agent, which dilutes air to the sea level limiting partial pressure of oxygen, is given by

[A.1.5.1.3]

$$\text{Vol. \% agent} = (0.21P_{\text{ATM}} - P_{\text{O}_2, \text{LIM}}) / (0.21P_{\text{ATM}}) \times 100$$

where:

$P_{\text{ATM}}$  = local mean atmospheric pressure

$P_{\text{O}_2, \text{LIM}}$  = limiting partial pressure of oxygen corresponding to a sea level exposure time limit

The effect of altitude on limiting agent concentrations is given in Table A.1.5.1.3(b).

**Table A.1.5.1.3(b) Relationship of Altitude to Atmospheric Pressure, Oxygen Partial Pressure in Air, and Limiting Agent Concentration**

Altitude Above Sea Level (ft)	$P_{\text{ATM}}$ (mm Hg)	O <sub>2</sub> Partial Pressure in Air (mm Hg)	Limiting Agent Concentration (% vol.)		
			5 min Exposure $P(\text{O}_2) = 91 \text{ mm Hg}$	3 min Exposure $P(\text{O}_2) = 76.6 \text{ mm Hg}$	30 sec Exposure $P(\text{O}_2) = 60.6 \text{ mm Hg}$
-3,000	840	176.4	48.4	56.6	65.6
-2,000	812	170.5	46.6	55.1	64.5
-1,000	787	165.3	44.9	53.7	63.3
0	760	159.6	43.0	52.0	62.0
1,000	733	153.9	40.9	50.2	60.6
2,000	705	148.1	38.5	48.3	59.1
3,000	679	142.6	36.2	46.3	57.5
4,000	650	136.5	33.3	43.9	55.6
5,000	622	130.6	30.3	41.4	53.6
6,000	596	125.2	27.3	38.8	51.6
7,000	570	119.7	24.0	36.0	49.4
8,000	550	115.5	21.2	33.7	47.5
9,000	528	110.9	17.9	30.9	45.3
10,000	505	106.1	14.2	27.8	42.9



Table A.1.5.1.3(c) provides information on physiological effects of inert gas agents covered by this standard. The health concern for inert gas clean agents is asphyxiation due to the lowered oxygen levels. With inert gas agents, an oxygen concentration of no less than 10 percent (sea level equivalent) is required for normally occupied areas. This corresponds to an agent concentration of no more than 52 percent.

**Table A.1.5.1.3(c) Physiological Effects of Inert Gas Agents**

Agent	No Effect Level* (%)	Low Effect Level* (%)
IG-01	43	52
IG-100	43	52
IG-55	43	52
IG-541	43	52

\*Based on physiological effects in humans in hypoxic atmospheres. These values are the functional equivalents of NOAEL and LOAEL values and correspond to 12 percent minimum oxygen for the no effect level and 10 percent minimum oxygen for the low effect level.

IG-541 uses carbon dioxide to promote breathing characteristics intended to sustain life in the oxygen-deficient environment for protection of personnel. Care should be used not to design inert gas-type systems for normally occupied areas using design concentrations higher than that specified in the system manufacturer's listed design manual for the hazard being protected.

Inert gas agents do not decompose measurably in extinguishing a fire. As such, toxic or corrosive decomposition products are not found. However, heat and breakdown products of the fire itself can still be substantial and could make the area untenable for human occupancy.

**A.1.5.1.4.1** The steps and safeguards necessary to prevent injury or death to personnel in areas whose atmospheres will be made hazardous by the discharge or thermal decomposition of clean agents can include the following:

- (1) Provision of adequate aiseways and routes of exit and procedures to keep them clear at all times.
- (2) Provision of emergency lighting and directional signs as necessary to ensure quick, safe evacuation.
- (3) Provision of alarms within such areas that will operate immediately upon detection of the fire.
- (4) Provision of only outward-swinging, self-closing doors at exits from hazardous areas and, where such doors are latched, provision of panic hardware.
- (5) Provision of continuous alarms at entrances to such areas until the atmosphere has been restored to normal.
- (6) Provision of warning and instruction signs at entrances to and inside such areas. These signs should inform persons in or entering the protected area that a clean agent system is installed and should contain additional instructions pertinent to the conditions of the hazard.
- (7) Provision for the prompt discovery and rescue of persons rendered unconscious in such areas. This should be accomplished by having such areas searched immediately by trained personnel equipped with proper breathing equipment. Self-contained breathing equipment and personnel trained in its use and in rescue practices, including artificial respiration, should be readily available.

- (8) Provision of instruction and drills for all personnel within or in the vicinity of such areas, including maintenance or construction people who could be brought into the area, to ensure their correct action when a clean agent system operates.
- (9) Provision of means for prompt ventilation of such areas. Forced ventilation will often be necessary. Care should be taken to readily dissipate hazardous atmospheres and not merely move them to another location.
- (10) Prohibition against smoking by persons until the atmosphere has been determined to be free of the clean agent.
- (11) Provision of such other steps and safeguards that a careful study of each particular situation indicates is necessary to prevent injury or death.

**A.1.5.1.4.2** A certain amount of leakage from a protected space to adjacent areas is anticipated during and following agent discharge. Consideration should be given to agent concentration (when above NOAEL), decomposition products, products of combustion, and relative size of adjacent spaces. Additional consideration should be given to exhaust paths when opening or venting the enclosure after a discharge.

**A.1.5.1.4.4** Inert gases used to operate pre-discharge alarms include inert gas clean agents, nitrogen, and carbon dioxide.

**A.1.6** Many factors impact the environmental acceptability of a fire suppression agent. Uncontrolled fires pose significant impact by themselves. All extinguishing agents should be used in ways that eliminate or minimize the potential environmental impact (see Table A.1.6). General guidelines to be followed to minimize this impact include the following:

- (1) Not performing unnecessary discharge testing
- (2) Considering the ozone depletion and global warming impact of the agent under consideration and weighing those impacts against the fire safety concerns
- (3) Recycling all agents where possible
- (4) Consulting the most recent environmental regulations on each agent

The unnecessary emission of clean extinguishing agents with non-zero ODP, non-zero GWP, or both should be avoided. All phases of design, installation, testing, and maintenance of systems using these agents should be performed with the goal of no emission into the environment.

GWP is a measure of how much a given mass of greenhouse gas is estimated to contribute to global warming. It is a relative scale that compares the gas in question to the same mass of carbon dioxide whose GWP is by convention equal to 1.

It is important to understand that the impact of a gas on climate change is a function of both the GWP of the gas and the amount of the gas emitted.

The ODP of an agent provides a relative comparison of the ability to react with ozone at altitudes within the stratosphere. ODP values are reported relative to the same mass CFC-11, which has an ODP equal to 1. When the environmental profile of a compound is considered, both the ODP and the GWP values should be considered to ensure that the agent selected complies with all local and regional regulations balanced with end user specifications. Good independent resources for environmental properties in terms of GWP and ODP of clean agent alternatives are available from the Montreal Protocol and the Intergovernmental Panel on Climate Change (IPCC).

**Table A.1.6 Potential Environmental Impacts**

Agent	GWP (IPCC 2013)	ODP
FIC-131I	≤1	0*
FK-5-1-12	≤1	0
HCFC Blend A	1500	0.048
HFC Blend B	1400	0
HCFC-124	527	0.022
HFC-125	3170	0
HFC-227ea	3350	0
HFC-23	12,400	0
HFC-236fa	8060	0
IG-01	0	0
IG-100	0	0
IG-541	0	0
IG-55	0	0

Note: GWP is reported over a 100-year integrated time horizon.

\*Agent might have a nonzero ODP if released at altitudes high above ground level.

**A.1.8.1** It is generally believed that, because of the highly stable nature of the compounds that are derived from the families that include halogenated hydrocarbons and inert gases, incompatibility will not be a problem. These materials tend to behave in a similar fashion, and, as far as is known, the reactions that could occur as the result of the mixing of these materials within the container is not thought to be a real consideration with regard to their application to a fire protection hazard.

It clearly is not the intent of 1.8.1 to deal with compatibility of the agents with components of the extinguishing hardware nor to deal with the subject of storability or storage life of individual agents or mixtures of those agents. Each of these concerns is addressed elsewhere in this standard.

**A.3.2.1 Approved.** The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

**A.3.2.2 Authority Having Jurisdiction (AHJ).** The phrase “authority having jurisdiction,” or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated

agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

**A.3.2.3 Listed.** The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

**A.3.3.9.1 Adjusted Minimum Design Concentration (AMDC).** This term is also referred to as simply *design concentration* throughout this document. When determining the duration of protection it is 85 percent of the AMDC that must be held for the duration of the retention time (*see Section 5.6*).

**A.3.3.9.2 Final Design Concentration (FDC).** The FDC is equal to or greater than the adjusted minimum design concentration.

**A.3.3.14 Halocarbon Agent.** Examples are hydrofluorocarbons (HFCs), hydrochlorofluorocarbons (HCFCs), perfluorocarbons (PFCs or FCs), fluoroiodocarbons (FICs), and fluoroketones (FKs).

**A.3.3.24 Normally Occupied Enclosure or Space.** Areas considered not normally occupied include spaces occasionally visited by personnel, such as transformer bays, switch houses, pump rooms, vaults, engine test stands, cable trays, tunnels, microwave relay stations, flammable liquid storage areas, and enclosed energy systems.

**A.4.1.1.2** An extra-full complement of charged cylinders (connected reserve) manifolded and piped to feed into the automatic system should be considered on all installations. The reserve supply is normally actuated by manual operation of the main/reserve switch on either electrically operated or pneumatically operated systems. A connected reserve is desirable for the following reasons:

- (1) It provides protection should a reflash occur.
- (2) It provides reliability should the main bank malfunction.
- (3) It provides protection during impaired protection when main tanks are being replaced.
- (4) It provides protection of other hazards if selector valves are involved and multiple hazards are protected by the same set of cylinders.

If a full complement of charged cylinders cannot be obtained or if the empty cylinder cannot be recharged, delivered, and reinstalled within 24 hours, a third complement of fully charged, nonconnected spare cylinders should be considered and made available on the premises for emergency use. The need for spare cylinders could depend on whether the hazard is under the protection of automatic sprinklers.

**A.4.1.2** The normal and accepted procedures for making these quality measurements are provided in international standards (e.g., ASTM, Air-conditioning Heating and Refrigeration Institute) or by the chemical manufacturer. Refer to the *Code of Practice for Use of Recycled Halogenated Clean Agents* for additional information.


**A.4.1.3.2** Storage containers should not be exposed to a fire in a manner likely to impair system performance.

**A.4.1.4.1** Containers used for agent storage should be fit for the purpose. Materials of construction of the container, closures, gaskets, and other components should be compatible with the agent and designed for the anticipated pressures. Each container is equipped with a pressure relief device to protect against excessive pressure conditions.

The variations in vapor pressure with temperature for the various clean agents are shown in Figure A.4.1.4.1(a) through Figure A.4.1.4.1(m).


For halocarbon clean agents, the pressure in the container is significantly affected by fill density and temperature. At elevated temperatures, the rate of increase in pressure is very sensitive to fill density. If the maximum fill density is exceeded, the pressure will increase rapidly with temperature increase and present a hazard to personnel and property. Therefore, it is important that the maximum fill density limit specified for each liquefied clean agent not be exceeded. Adherence to the limits for fill density and pressurization levels specified in Table A.4.1.4.1 should prevent excessively high pressures from occurring if the agent container is exposed to elevated temperatures. Adherence to the limits will also minimize the possibility of an inadvertent discharge of agent through the pressure relief device. The manufacturer should be consulted for superpressurization levels other than those shown in Table A.4.1.4.1.

With the exception of inert gas-type systems, all the other clean agents are classified as liquefied compressed gases at 70°F (21°C). For these agents, the pressure in the container is significantly affected by fill density and temperature. At elevated temperatures, the rate of increase in pressure is very sensitive to fill density. If the maximum fill density is exceeded, the pressure will increase rapidly with temperature increase and present a hazard to personnel and property. Therefore, it is important that the maximum fill density limit specified for each liquefied clean agent not be exceeded. Adherence to the limits for fill density and pressurization levels specified in Table A.4.1.4.1 should prevent excessively high pressures from occurring if the agent container is exposed to elevated temperatures. Adherence to the limits will also minimize the possibility of an inadvertent discharge of agent through the pressure relief device. The manufacturer should be consulted for superpressurization levels other than those shown in Table A.4.1.4.1.

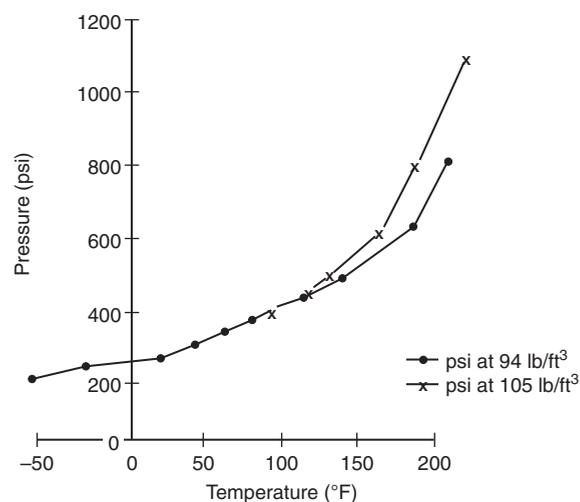

Note: CF3I pressure versus temperature at 94 lb/ft<sup>3</sup> and 105 lb/ft<sup>3</sup>


(1) U.S.

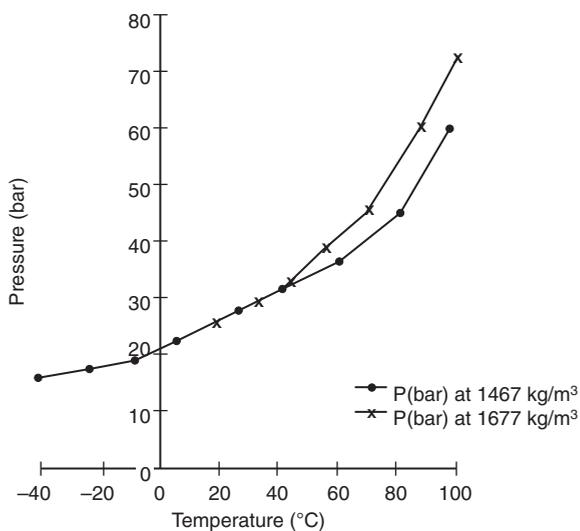


Note: CF3I pressure versus temperature at 1467 kg/m<sup>3</sup> and 1677 kg/m<sup>3</sup>

(2) SI


**FIGURE A.4.1.4.1(a) Isometric Diagram of FIC-131I.**

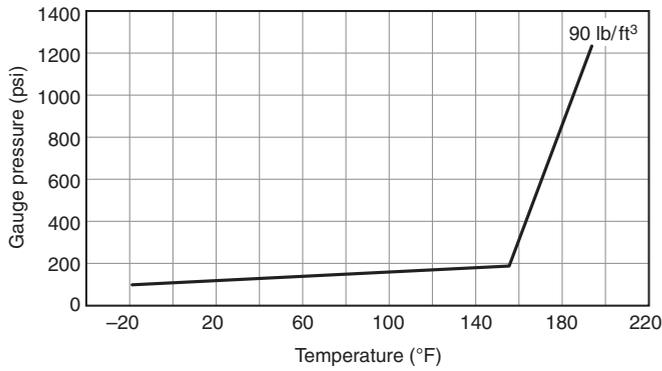


(1) For 150 psi containers

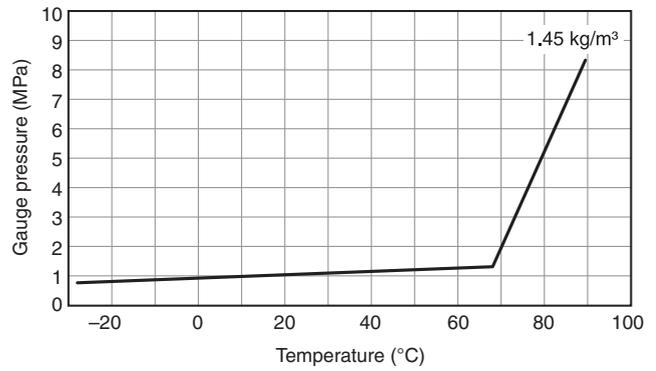


(2) For 1.0 MPa containers

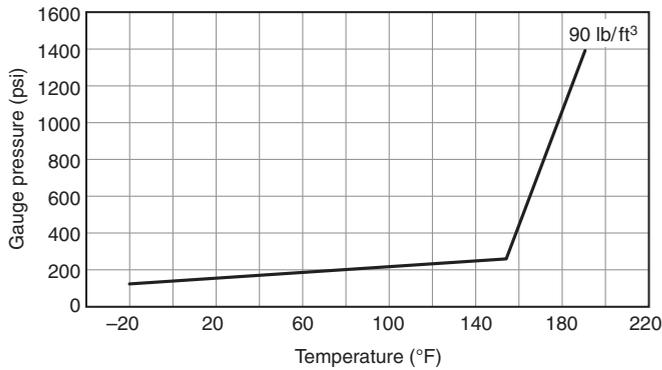


(3) For 195 psi containers

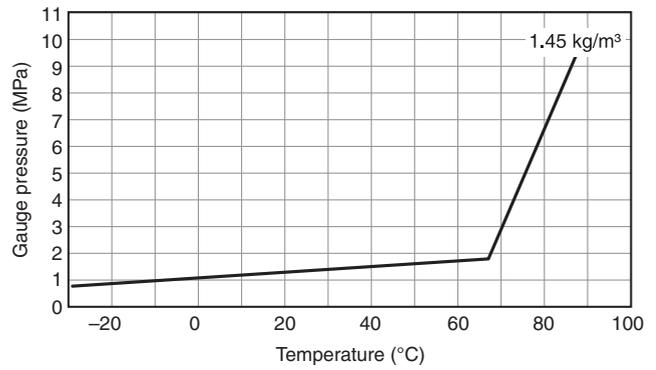


(4) For 1.3 MPa containers

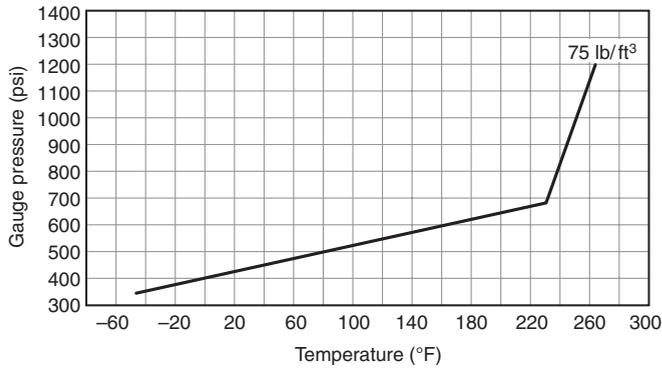


(5) For 500 psi containers

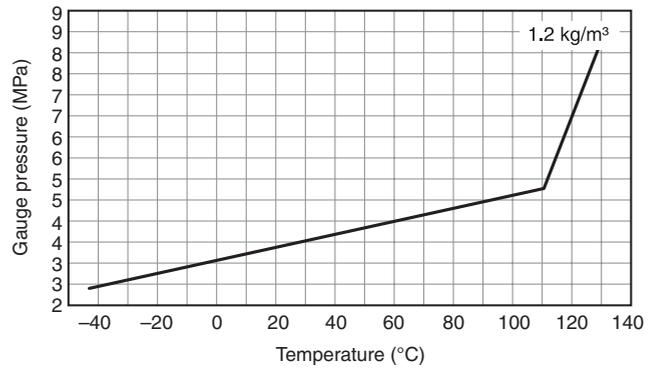

(6) For 3.4 MPa containers




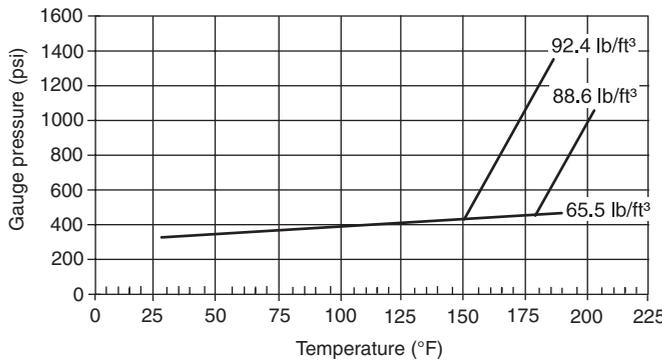


(7) To 360 psi at 70°F

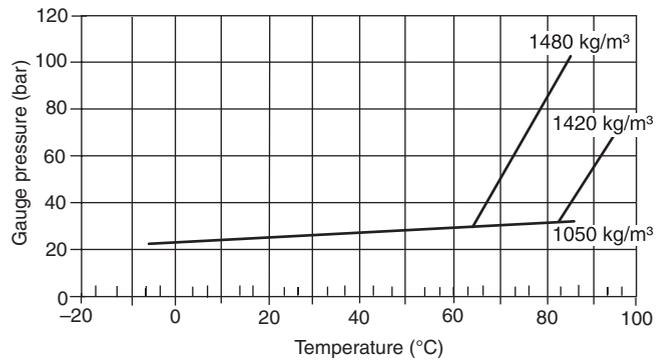


(8) To 25 bar at 20°C


FIGURE A.4.1.4.1(b) Isometric Diagram of FK-5-1-12.

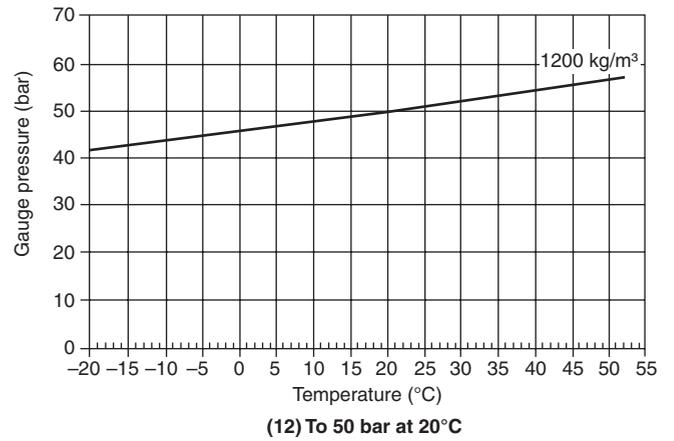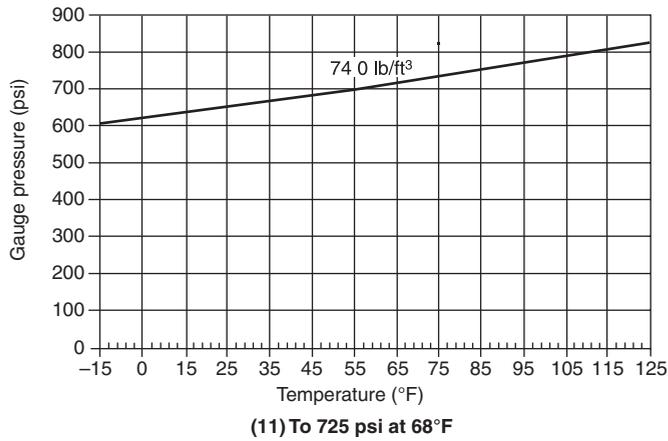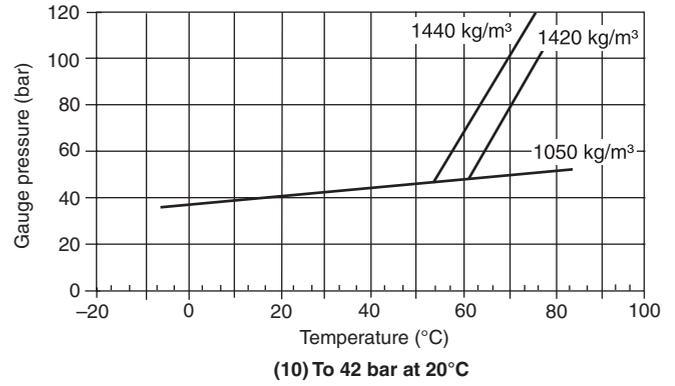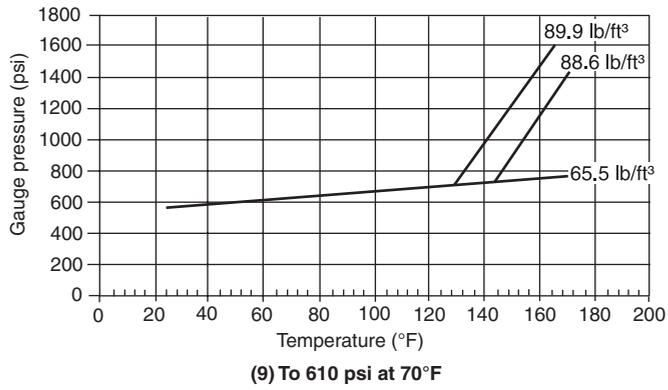


**FIGURE A.4.1.4.1(b)** *Continued*

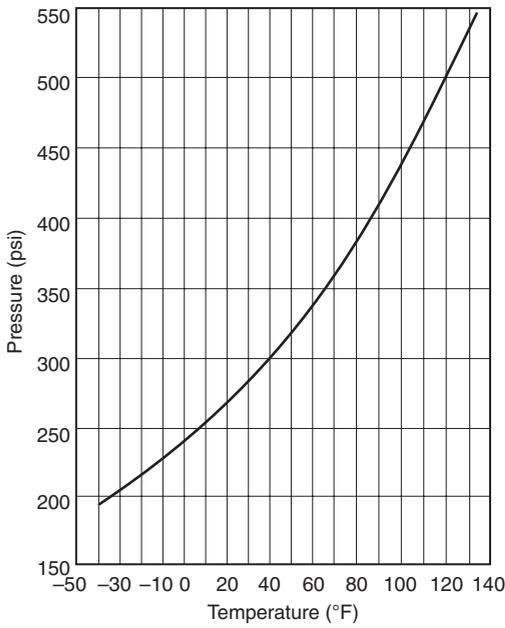


(1) Pressurized with nitrogen to 360 psi at 70°C

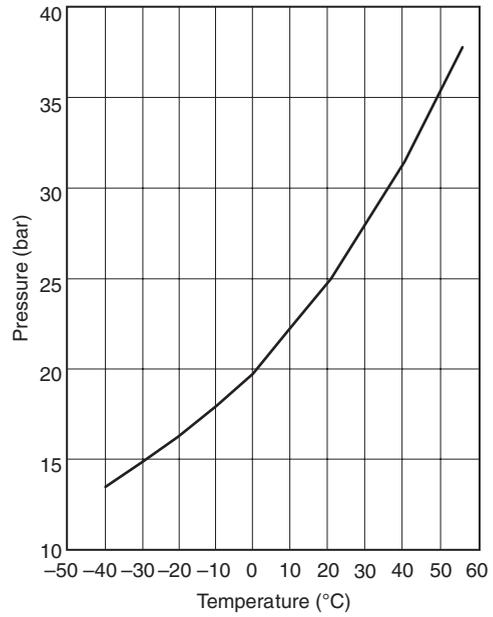

(2) Pressurized with nitrogen to 25 bar at 20°C

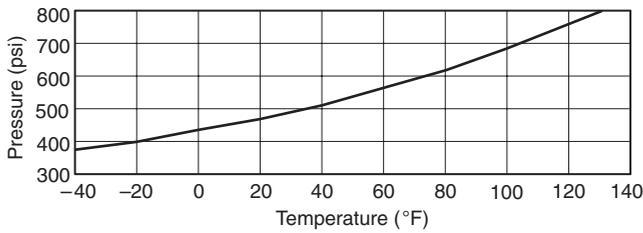


(3) Pressurized with nitrogen to 600 psi at 70°F for fill densities of 31.2 to 56.2 lb/ft<sup>3</sup>

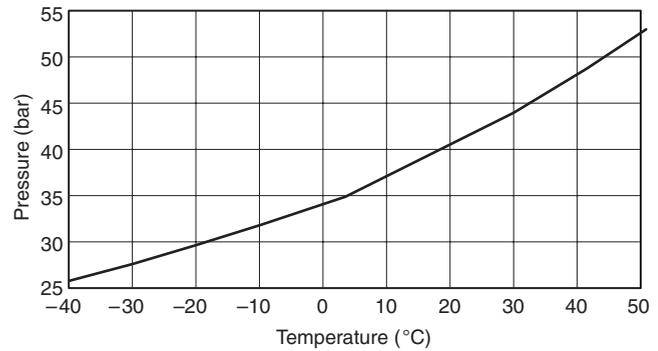


(4) Pressurized with nitrogen to 40 bar at 20°C for fill densities of 0.5 to 0.9 kg/m<sup>3</sup>

FIGURE A.4.1.4.1(c) Isometric Diagram of HCFC Blend A.

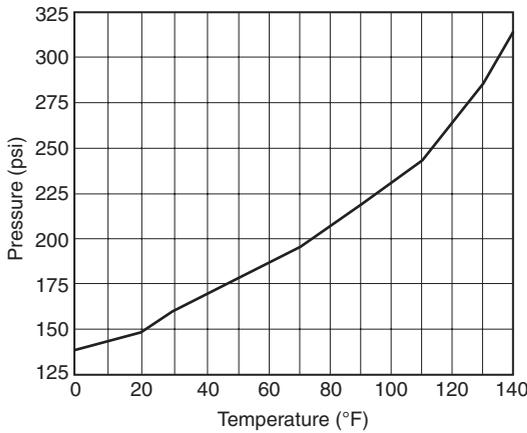


(1) Pressurized to 195 psi at 70°F and a loading density of 71.17 lb/ft<sup>3</sup>

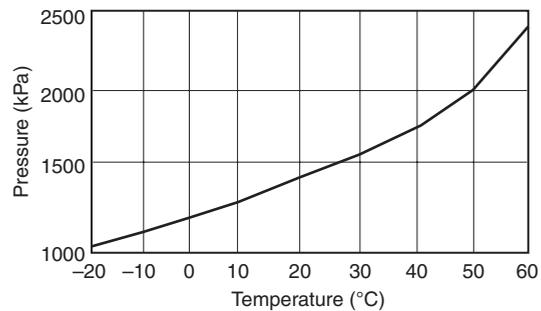


(2) Pressurized to 1340 kPa at 21°C and a loading density of 1140 kg/m<sup>3</sup>


FIGURE A.4.1.4.1(d) Isometric Diagram of HCFC-124 Pressurized with Nitrogen.

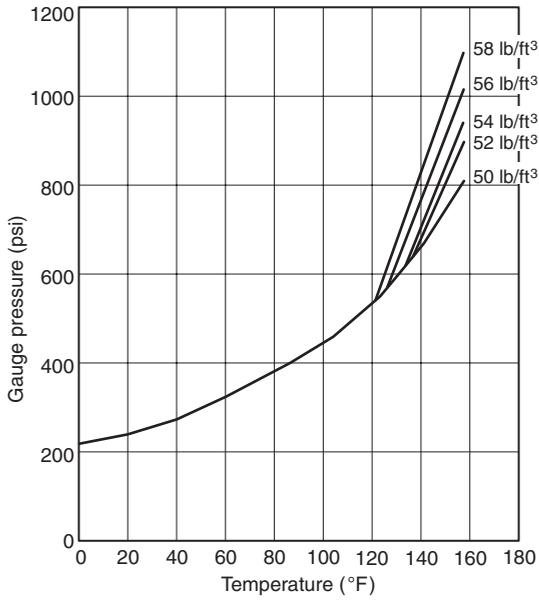


(1) Pressurized to 360 psi at 72°F

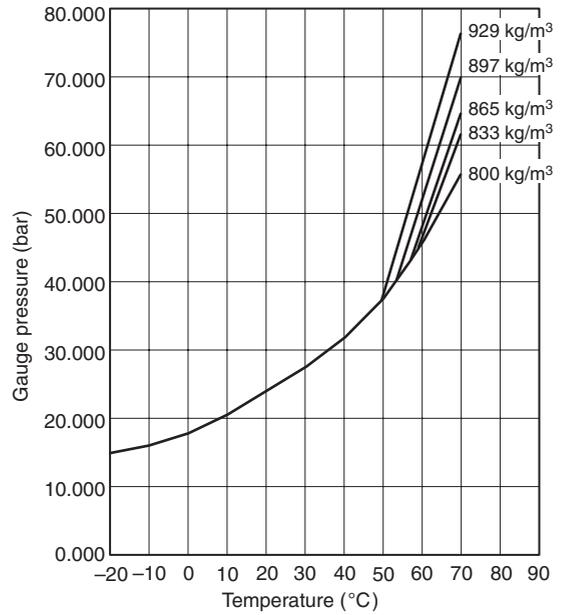

(2) Pressurized to 25 bar (gauge) at 22°C

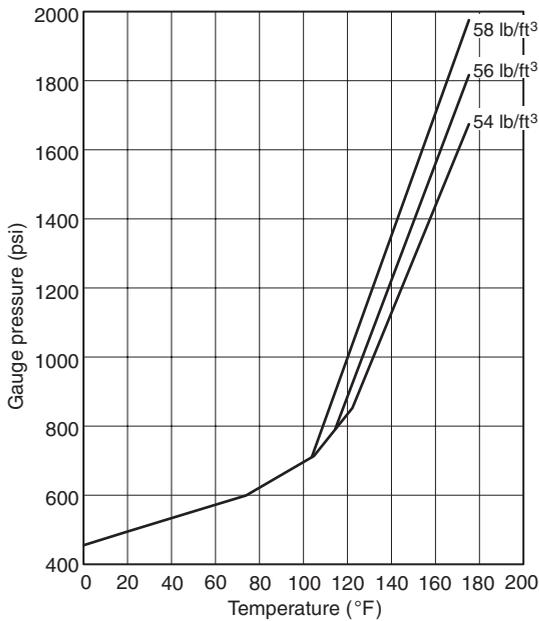


(3) Pressurized to 600 psi at 72°F

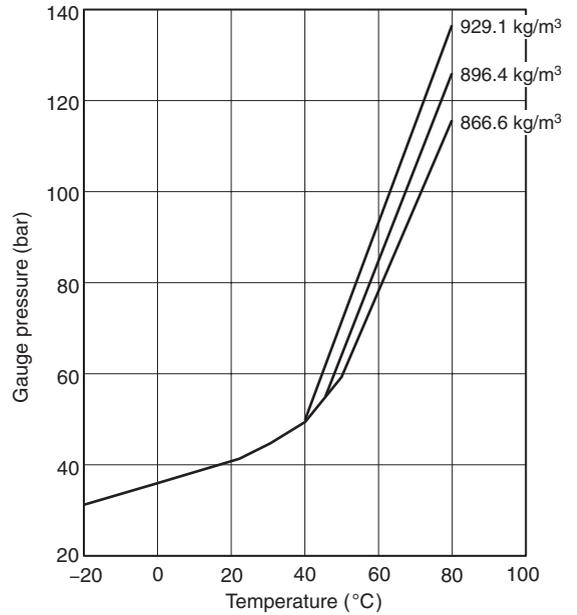


(4) Pressurized to 41 bar (gauge) at 22°C

FIGURE A.4.1.4.1(e) Isometric Diagram of HCFC-125 Pressurized with Nitrogen.

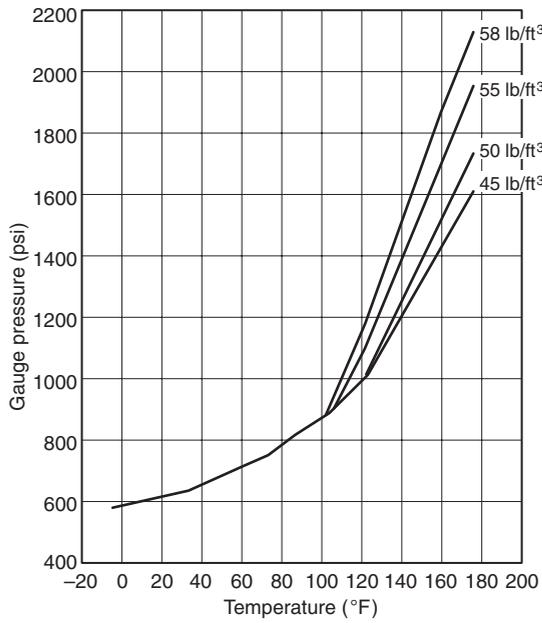


(5) Pressurized to 750 psi at 72°F

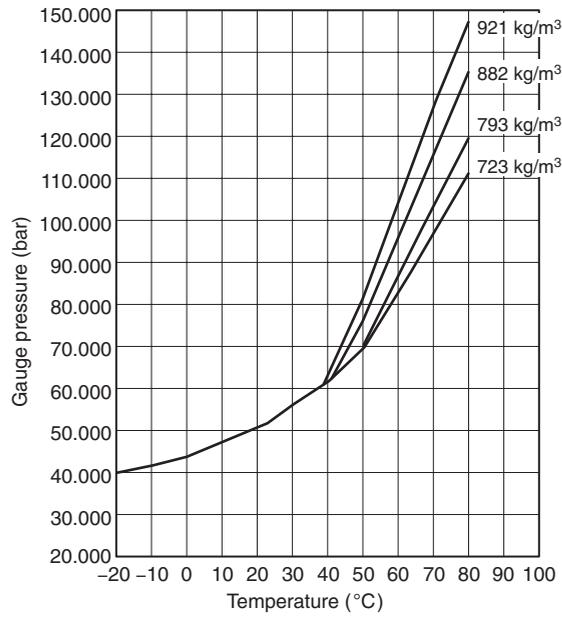


(6) Pressurized to 52 bar (gauge) at 22°C


FIGURE A.4.1.4.1(e) *Continued*

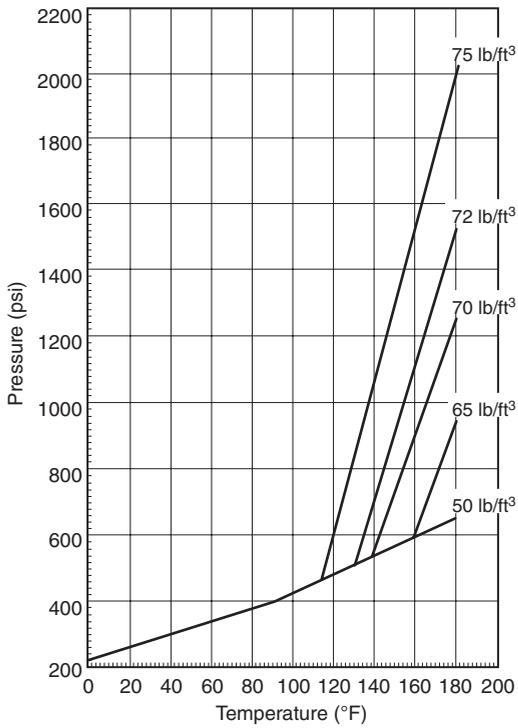


(1) Pressurized to 360 psi at 70°F

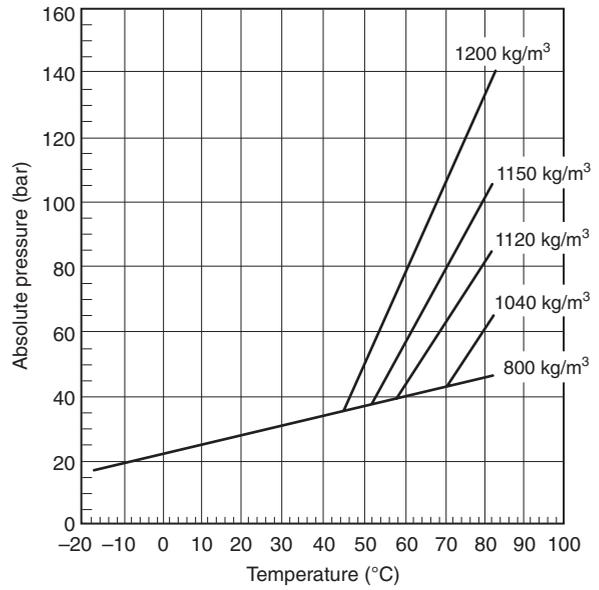

(2) Pressurized to 25 bar at 21°C

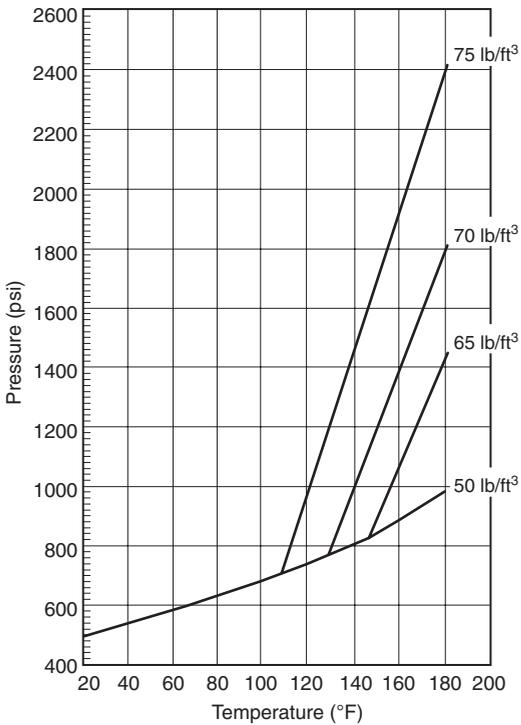


(3) Pressurized to 600 psi at 70°F

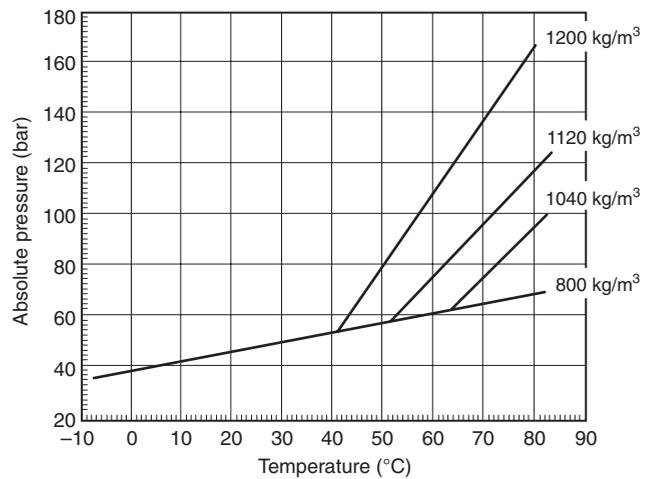


(4) Pressurized to 40 bar at 21°C

FIGURE A.4.1.4.1(f) Isometric Diagram of HCFC-227ea Pressurized with Nitrogen.

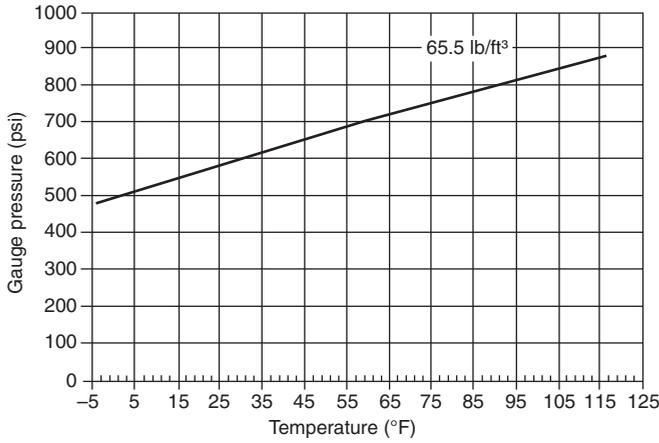


(5) HFC-227ea pressurized to 725 psi at 68°F

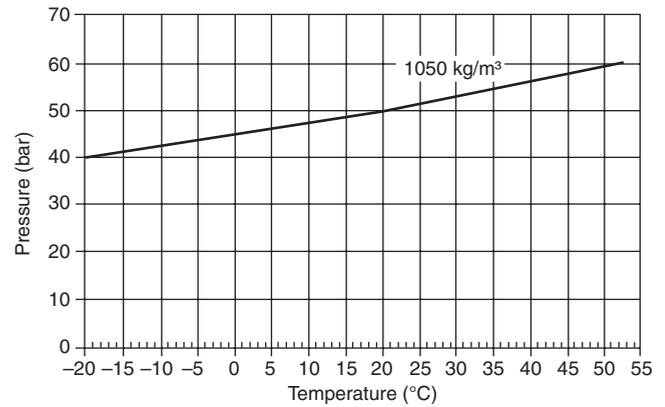


(6) HFC-227ea pressurized to 50 bar at 20°C

FIGURE A.4.1.4.1(f) Continued

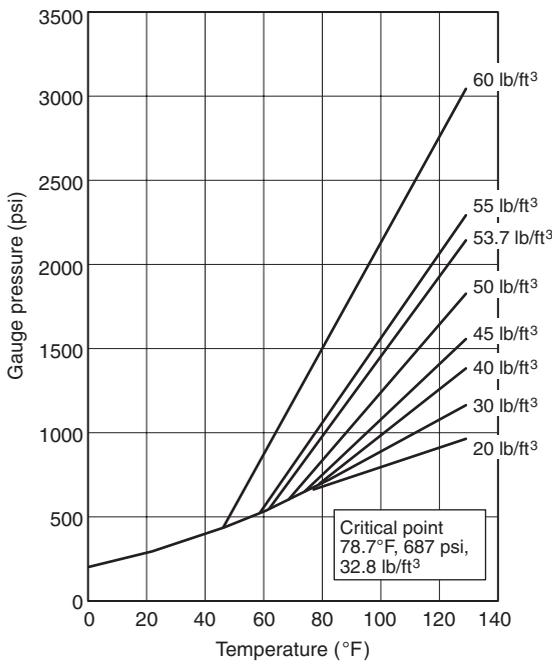


(1) Self-pressurized at 608.9 psi at 70°F

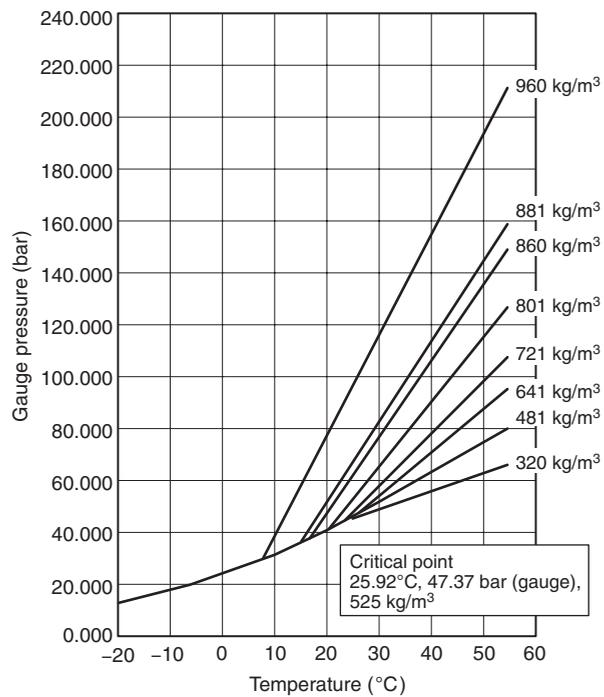


(2) Self-pressurized 42 bar at 21°C


FIGURE A.4.1.4.1(g) Isometric Design of HFC-23.

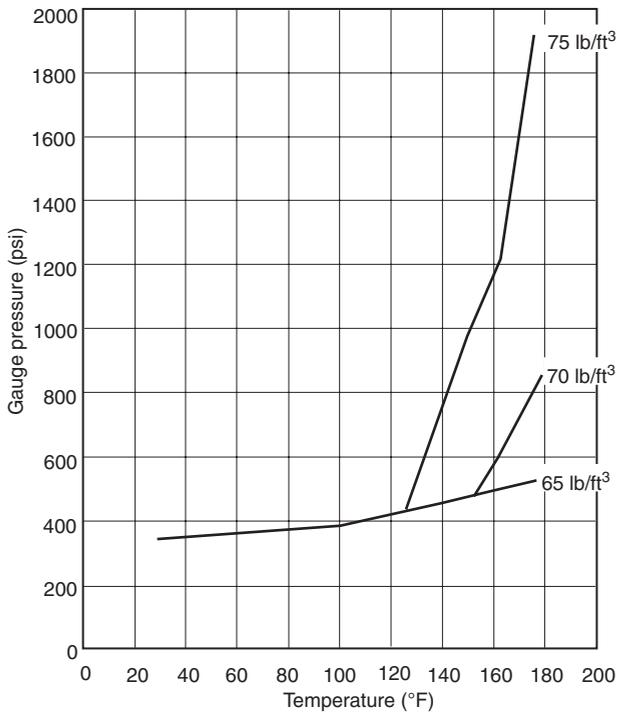


(1) Pressurized to 360 psi at 72°F

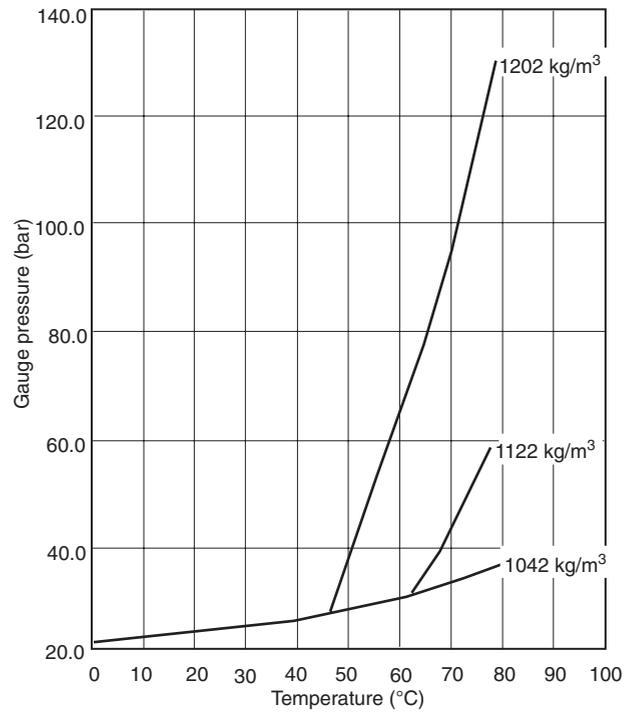

(2) Pressurized to 24.82 bar (gauge) at 22°C

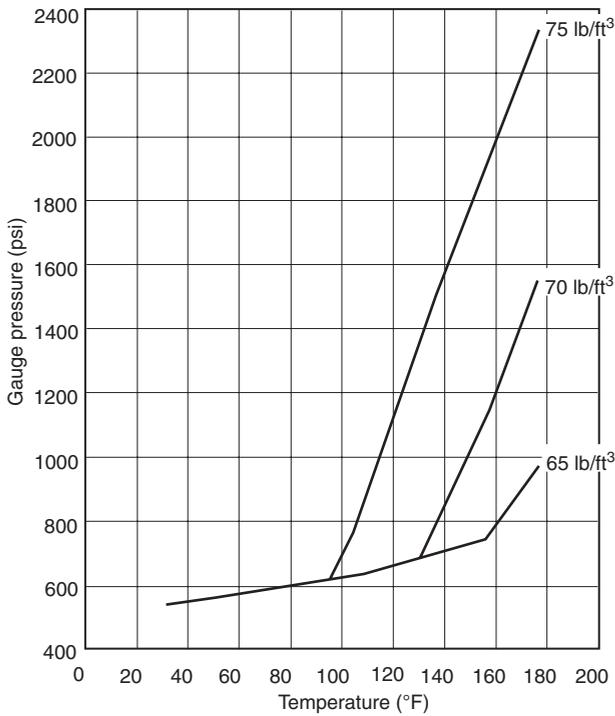


(3) Pressurized to 600 psi at 72°F

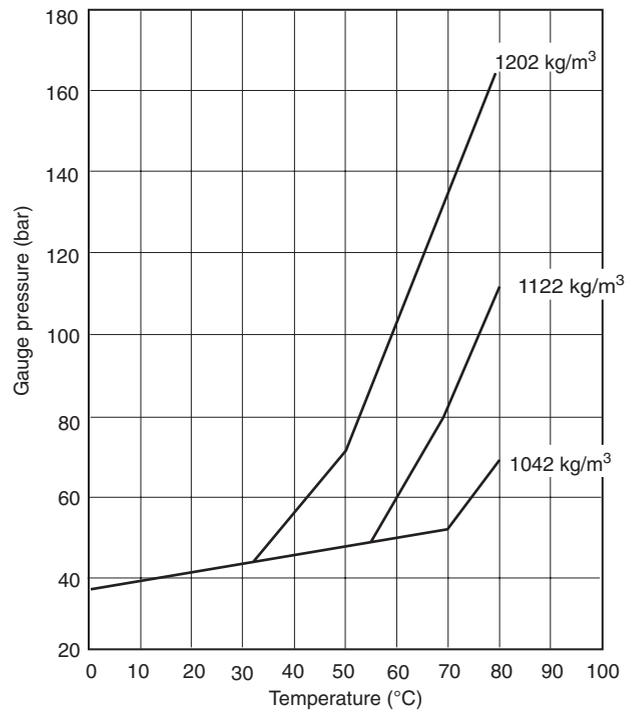


(4) Pressurized to 41.4 bar (gauge) at 22°C


FIGURE A.4.1.4.1(h) Isometric Diagram of HCFC-236fa Pressurized with Nitrogen.

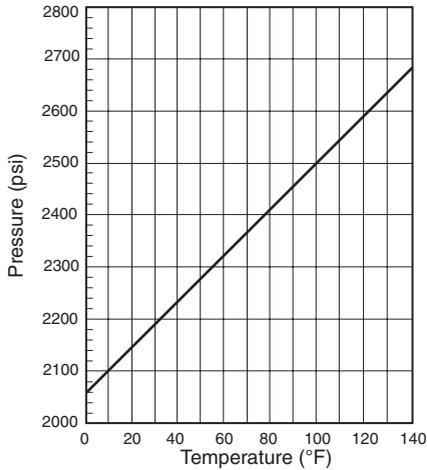


(1) Pressurized to 2370 psi at 70°F

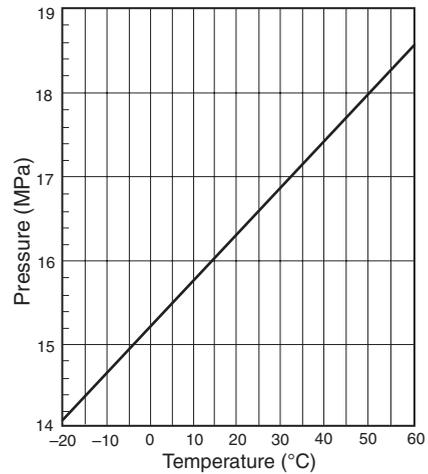


(2) Pressurized to 160 bar at 15°C

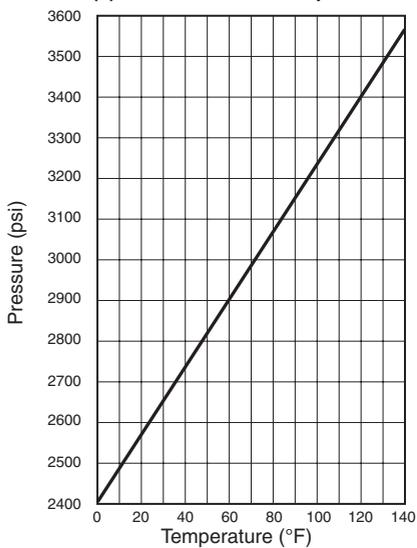


(3) Pressurized to 2894 psi at 70°F

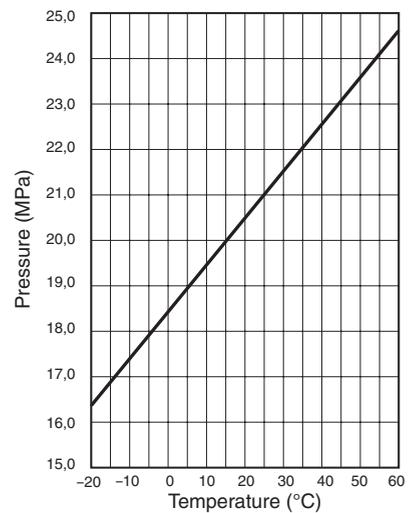

(4) Pressurized to 20.0 MPa at 15°C

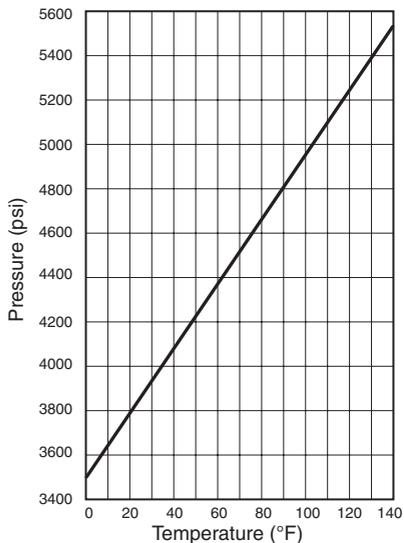


(5) Pressurized to 4510 psi at 70°F

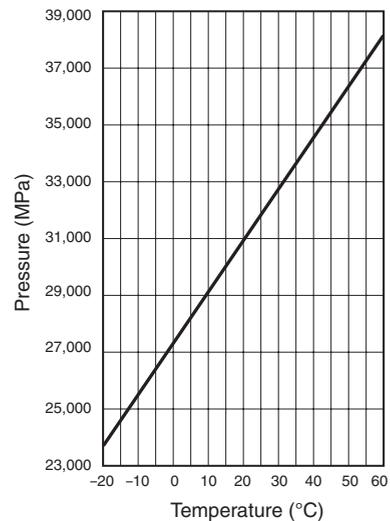


(6) Pressurized to 30.0 MPa at 15°C

FIGURE A.4.1.4.1(i) Isometric Diagram of IG-01.

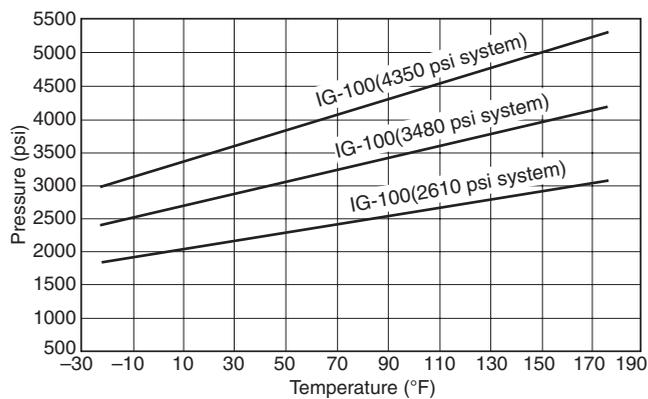

(1) 2610 psi, 3480 psi, and 4350 psi systems

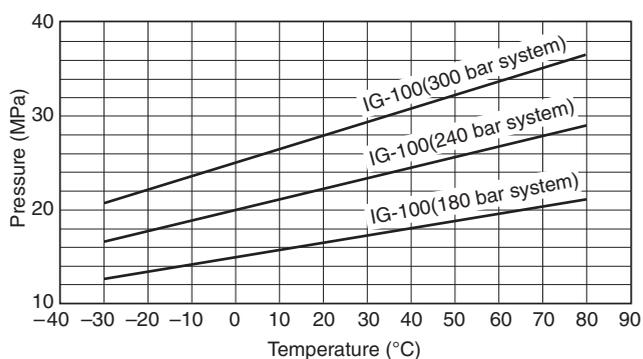

(2) 180 bar, 240 bar, and 300 bar systems

FIGURE A.4.1.4.1(j) Isometric Diagram of IG-100.

**A.4.1.4.2** Although it is not a requirement of 4.1.4.2, all new and existing halocarbon agent storage containers should be affixed with a label advising the user that the product in question can be returned for recovery and recycling to a qualified recycler when the halocarbon agent is no longer needed. The qualified recycler can be a halocarbon agent manufacturer, a fire equipment manufacturer, a fire equipment distributor or installer, or an independent commercial venture. It is not the intent to set down specific requirements but to indicate the factors that need to be taken into consideration with regard to recycling and reclamation of the halocarbon agent products, once facilities are available. As more information becomes available, more definitive requirements can be set forth in this section regarding quality, efficiency, recovery, and qualifications and certifications of facilities recycling halocarbon agents. Currently, no such facilities exist that would apply to the halocarbon agents covered by this document.

Inert gas agents need not be collected or recycled.

**A.4.1.4.5(2)** Inert gas agents are single-phase gases in storage and at all times during discharge.

**A.4.1.4.6** The use of environmental controls should be considered when the storage location for clean agent system containers is subject to conditions outside of the storage temperature limits stated in the listed manual for the clean agent system.

**A.4.2.1** Piping should be installed in accordance with good commercial practice. Care should be taken to avoid possible restrictions due to foreign matter, faulty fabrication, or improper installation.

The piping system should be securely supported with due allowance for agent thrust forces and thermal expansion and contraction and should not be subjected to mechanical, chemical, vibration, or other damage. ASME B31.1 should be consulted for guidance on this matter. Where explosions are likely, the piping should be attached to supports that are least likely to be displaced.

**A.4.2.1.1** Paragraph 4.2.1.1 requires that “the thickness of the piping shall be calculated in accordance with ASME B31.1.” To comply with this requirement, the guidelines found in the *FSSA Pipe Design Guide for Use with Special Hazard Fire Suppression Systems* should be followed. The *FSSA Pipe Design Guide for Use with Special Hazard Fire Suppression Systems* provides guidance on how to apply ASME B31.1 in a uniform and consistent manner in the selection of acceptable types of pipe and tubing used in special hazard fire suppression systems. ASME B31.1 allows the pressure to exceed the maximum design pressure, provided it is for short operating periods. Clean agent piping systems are not subjected to continuous pressurization. When discharge times are less than 60 minutes in duration, NFPA 2001 allows the yield stress factors (SE) published in ASME B31.1 to be increased by 20 percent when calculating the pipe thickness.


**A.4.2.1.6** Design of closed sections of pipe should follow the guidelines in Section 5 of the *FSSA Pipe Design Guide for Use with Special Hazard Fire Suppression Systems*.

**A.4.2.3.1** Fittings that are acceptable for use in clean agent systems can be found in Table A.4.2.3.1(a) and Table A.4.2.3.1(b). The fittings shown in these tables are based on use in open-ended piping systems. For fittings used in closed sections of pipe, Sections 4 and 7 of the *FSSA Pipe Design Guide for Use with Special Hazard Fire Suppression Systems* should be consulted.


Pressure-temperature ratings have been established for certain types of fittings. A list of ANSI standards covering the different types of fittings is given in Table 126.1 of ASME B31.1. Where fittings not covered by one of these standards are used, the design recommendations of the manufacturer of the fittings should not be exceeded.

**A.4.2.4.3** Some of the new clean agents might not be compatible with the elastomers used in Halon 1301 system valves. Before charging a system container with some of the clean agents, it could be necessary to disassemble the discharge valve and completely replace the O-rings and other sealing surfaces with components that will not react to that agent. It is important that this evaluation has been completed and that the change results in the valve, container, and system complying with the appropriate listings or approvals.


**A.4.2.5.5** The impingement of the extinguishing agent during a discharge can adversely affect the development of a homogenous concentration throughout the protected space. The manufacturer should be consulted for acceptable distances for the discharge nozzles from obstructions such as cable trays, hot aisle/cold aisle containment structures, duct work, and so forth. Where minimum distances cannot be achieved, the manufacturer should be consulted to obtain agent loss calculations for the specific nozzle locations, and the necessary compensating quantity of agent should be added.

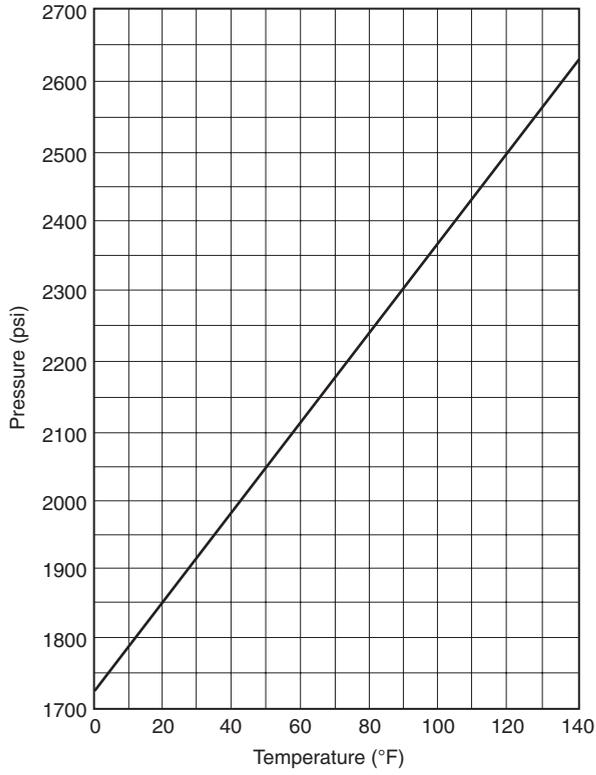


(1) Pressurized to 2175 psi at 70°F

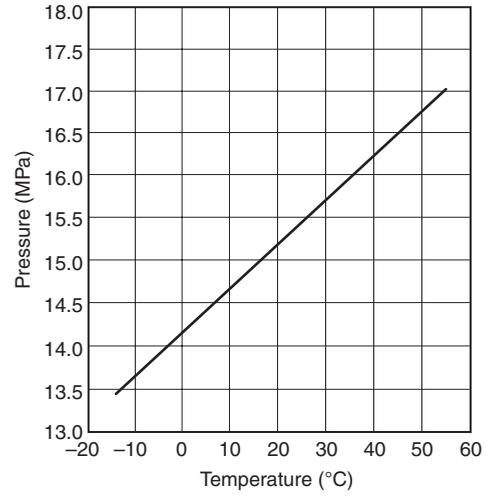

(2) Pressurized to 15 MPa at 21°C

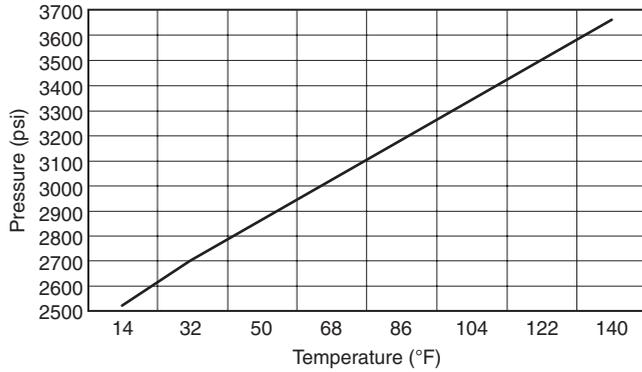

(3) Pressurized to 2900 psi at 59°F

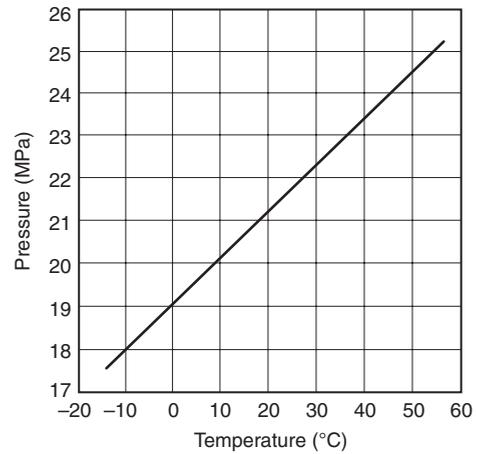

(4) Pressurized to 20 MPa at 15°C

FIGURE A.4.1.4.1(k) Isometric Diagram of IG-541.




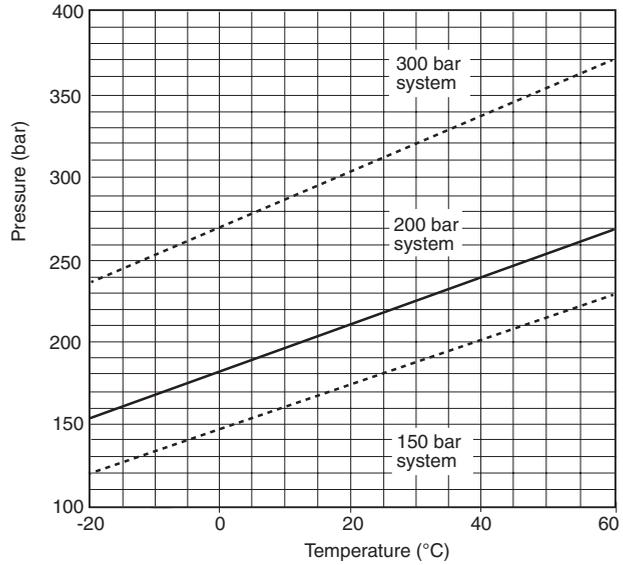



FIGURE A.4.1.4.1(l) Isometric Diagram of IG-55.

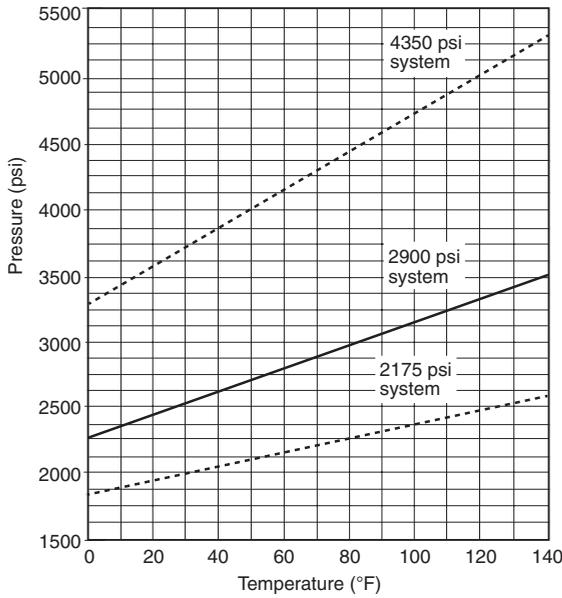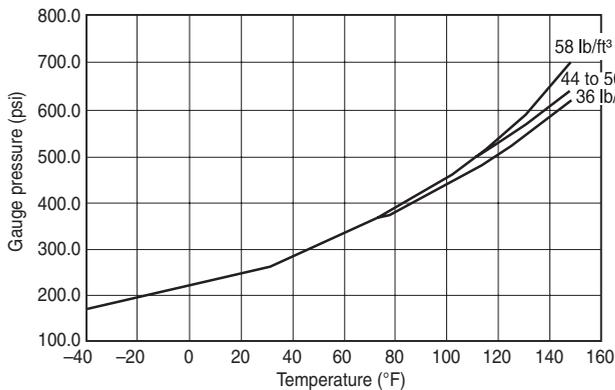


(1) Pressurized with nitrogen to 360 psi

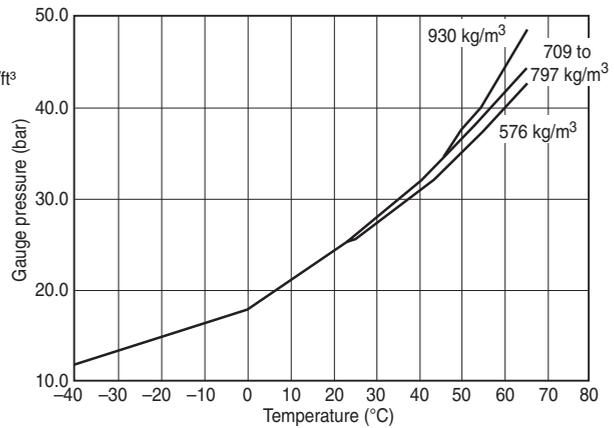

(2) Pressurized with nitrogen to 25 bar

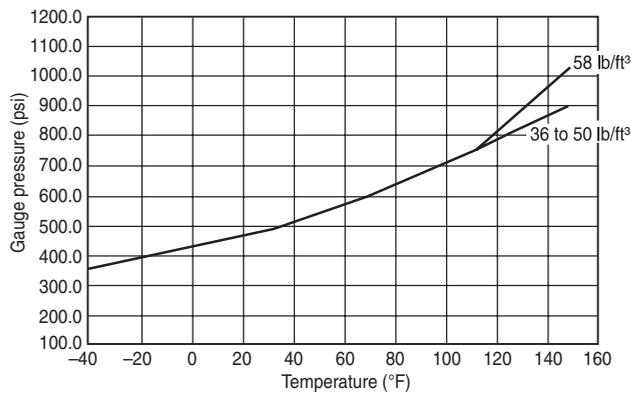

(3) Pressurized with nitrogen to 600 psi

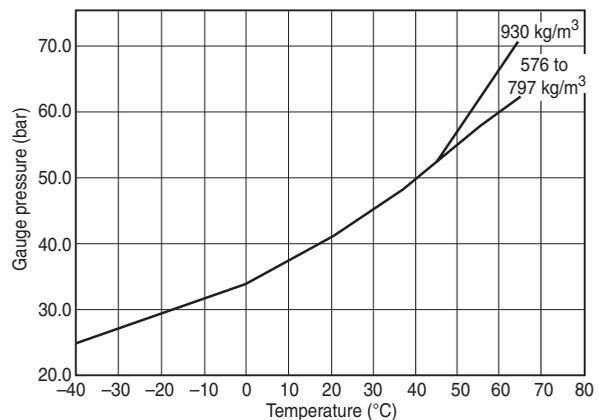

(4) Pressurized with nitrogen to 42 bar

FIGURE A.4.1.4.1(m) Isometric Diagram of HFC Blend B.

Table A.4.1.4.1 Storage Container Characteristics

Extinguishing Agent	Maximum Fill Density for Conditions Listed (lb/ft <sup>3</sup> )	Minimum Container Design Level Working Pressure (Gauge) (psi)		Total Gauge Pressure Level at 70°F (psi)
FK-5-1-12	90	500		360
HCFC Blend A	56.2	500		360
HCFC-124	71	240		195
HFC-125	58	320		166.4 <sup>a</sup>
HFC-227ea	72	500		360
HFC-23	54	1800		608.9 <sup>a</sup>
FIC-131I	104.7	500		360
IG-01	N/A	2120		2370
IG-100 (300)	N/A	3600		4061
IG-100 (240)	N/A	2879		3236
IG-100 (180)	N/A	2161		2404
IG-541	N/A	2015		2175
IG-541 (200)	N/A	2746		2900
IG-55 (2222)	N/A	2057		2222 <sup>b</sup>
IG-55 (2962)	N/A	2743		2962 <sup>c</sup>
IG-55 (4443)	N/A	4114		4443 <sup>d</sup>
HFC Blend B	58	400		195 <sup>e</sup>

For SI units, 1 lb/ft<sup>3</sup> = 16.018 kg/m<sup>3</sup>; 1 psi = 6895 Pa; °C = (°F - 32)/1.8.

Notes:

(1) The maximum fill density requirement is not applicable for IG-541. Cylinders for IG-541 are DOT 3A or 3AA and are stamped 2015 or greater.

(2) Total pressure level at 70°F (21°C) is calculated from the following filling conditions:

IG-100 (300): 4351 psi (30.0 MPa) and 95°F (35°C)

IG-100 (240): 3460 psi (23.9 MPa) and 95°F (35°C)

IG-100 (180): 2560 psi (17.7 MPa) and 95°F (35°C)

IG-55 (2222): 2175 psi (15 MPa) and 59°F (15°C)

IG-55 (2962): 2901 psi (20 MPa) and 59°F (15°C)

IG-55 (4443): 4352 psi (30 MPa) and 59°F (15°C)

<sup>a</sup> Vapor pressure for HFC-23 and HFC-125.

<sup>b</sup> Cylinders for IG-55 are stamped 2060.

<sup>c</sup> Cylinders for IG-55 are DOT 3A or 3AA stamped 2750 or greater.

<sup>d</sup> Cylinders for IG-55 are DOT 3A or 3AA stamped 4120 or greater.

<sup>e</sup> Vapor pressure of agent.

Table A.4.2.3.1(a) Piping Systems Fittings

Clean Agent	Pressure in Agent Container at 70°F (21°C) (up to and including)		Fitting Minimum Design Pressure <sup>a</sup>		Minimum Acceptable Fittings	Maximum Pipe Size (NPS)
	psi	kPa	psi	kPa		
All halocarbon agents (except HFC-23)	360	2,482	416	2,868	Class 300 threaded malleable iron Class 300 threaded ductile iron Groove type fittings <sup>b</sup>	3 in. All 6 in.
	600	4,137	820	5,654	Class 300 flanged joints Class 300 threaded malleable iron Class 2,000 threaded/welded forged steel Class 400 flanged joint	All 4 in. All All All
HFC-23	609	4,199	1,371	9,453 <sup>c</sup>	Class 300 threaded malleable iron Class 2,000 threaded/welded forged steel Class 600 flanged joint	2 in. All All All



Table A.4.2.3.1(a) *Continued*

Clean Agent	Pressure in Agent Container at 70°F (21°C) (up to and including)		Fitting Minimum Design Pressure <sup>a</sup>		Minimum Acceptable Fittings	Maximum Pipe Size (NPS)	
	psi	kPa	psi	kPa			
IG-541	2,175	14,997	2,175	14,997	Class 3,000 threaded/welded forged steel	All	
					Upstream of the pressure reducer	Class 1,500 flanged joint	All
					Downstream of the pressure reducer <sup>d</sup>	— <sup>d</sup>	— <sup>d</sup>
	2,900	19,996	2,900	19,996	Class 3,000 threaded/welded forged steel	All	
					Upstream of the pressure reducer	Class 1,500 flanged joint	All
					Downstream of the pressure reducer <sup>d</sup>	— <sup>d</sup>	— <sup>d</sup>
	4,508	31,050			Class 6,000 threaded/welded forged steel	All	
						Class 2,500 flanged joint	All
IG-01	2,370	16,341	2,370	16,341	Class 3,000 threaded/welded forged steel	All	
					Upstream of the pressure reducer	Class 1,500 flanged joint	All
					Downstream of the pressure reducer <sup>d</sup>	— <sup>d</sup>	— <sup>d</sup>
	2,964	20,346	2,964	20,346	Class 3,000 threaded/welded forged steel	All	
					Upstream of the pressure reducer	Class 1,500 flanged joint	All
					Downstream of the pressure reducer	— <sup>d</sup>	— <sup>d</sup>
	4,510	31,097	4,510	31,097	Class 6,000 threaded/welded forged steel	All	
					Upstream of the pressure reducer	Class 2,500 flanged joint	
					Downstream of the pressure reducer	<sup>d</sup>	<sup>d</sup>
IG-55	2,222	15,320	2,222	15,320	Class 3,000 threaded/welded forged steel	All	
					Upstream of the pressure reducer	Class 1,500 flanged joint	All
					Downstream of the pressure reducer <sup>d</sup>	— <sup>d</sup>	— <sup>d</sup>
	2,962	20,422	2,962	20,422	Class 3,000 threaded/welded forged steel	All	
					Upstream of the pressure reducer	Class 1,500 flanged joint	All
					Downstream of the pressure reducer <sup>d</sup>	— <sup>d</sup>	— <sup>d</sup>
	4,443	30,633	4,443	30,633	Class 6,000 threaded/welded forged steel	All	

Table A.4.2.3.1(a) *Continued*

Clean Agent	Pressure in Agent Container at 70°F (21°C) (up to and including)		Fitting Minimum Design Pressure <sup>a</sup>		Minimum Acceptable Fittings	Maximum Pipe Size (NPS)
	psi	kPa	psi	kPa		
			Upstream of the pressure reducer		Class 2,500 flanged joint	All
			Downstream of the pressure reducer <sup>d</sup>		— <sup>d</sup>	— <sup>d</sup>
IG-100	2,404	16,575	2,404	16,575	Class 3,000 threaded/welded forged steel	All
			Upstream of the pressure reducer		Class 1,500 flanged joint	All
			Downstream of the pressure reducer <sup>d</sup>		— <sup>d</sup>	— <sup>d</sup>
	3,236	22,312	3,236	22,312	Class 6,000 threaded/welded forged steel	All
			Upstream of the pressure reducer		Class 1,500 flanged joint	All
			Downstream of the pressure reducer <sup>d</sup>		— <sup>d</sup>	— <sup>d</sup>
	4,061	28,000	4,061	28,000	Class 6,000 threaded/welded forged steel	All
			Upstream of the pressure reducer		Class 2,500 flanged joint	All
			Downstream of the pressure reducer <sup>d</sup>		— <sup>d</sup>	— <sup>d</sup>

## Notes:

(1) All fitting ratings shown are based on open-ended piping systems.

(2) The materials in this table do not preclude the use of other materials and other types and styles of fittings that satisfy the requirements of 4.2.3.1.

<sup>a</sup> Minimum design pressures taken from Table 4.2.1.1(a) and Table 4.2.1.1(b).

<sup>b</sup> Check with grooved fitting manufacturers for pressure ratings.

<sup>c</sup> This value good for all fill densities up to 48 lb/ft<sup>3</sup>.

<sup>d</sup> The minimum design pressure for fittings downstream of the pressure reducer should be determined by system flow calculations. Acceptable pipe fittings for several values of pressures downstream of the pressure reducer can be found in Table A.4.2.3.1(b).

**Table A.4.2.3.1(b) Piping Systems Fittings for Use in Inert Gas Systems Downstream of the Pressure Reducer**

Maximum Pressure Downstream of the Pressure Reducer at 70°F (21°C) (up to and including)		Minimum Acceptable Fittings	Maximum Pipe Size (NPS)
psi	kPa		
1,000	6,895	Class 300 threaded malleable iron	4 in.
		Class 2,000 threaded/welded forged steel	All
		Class 600 flanged joint	All
1,350	9,308	Class 300 threaded malleable iron	2 in.
		Class 2,000 threaded/welded forged steel	All
		Class 600 flanged joint	All
1,500	10,343	Class 300 threaded malleable iron	2 in.
		Class 2,000 threaded/welded forged steel	All
		Class 900 flanged joint	All
2,000	13,790	Class 300 threaded malleable iron	1 in.
		Class 2,000 threaded/welded forged steel	All
		Class 900 flanged joint	All

**A.4.3.1.1** The FSSA *Application Guide Detection & Control for Fire Suppression Systems* offers the designer information of the various types of detection and control equipment.

**A.4.3.2.1** The detection system selection process should evaluate the ambient environmental condition in determining the appropriate device and sensitivity in order to prevent unwanted discharges while still providing the necessary earliest actuation. In high air flow environments, air-sampling detection devices should be considered.

Detectors installed at the maximum spacing as listed or approved for fire alarm use can result in excessive delay in agent release, especially where more than one detection device is required to be in alarm before automatic actuation results.

Where there is a risk of a flammable atmosphere being formed, the spacing and siting of flammable vapor detectors should be carefully considered to avoid excessive delay in agent release.

**A.4.3.3.5.1** A discharge pressure switch can serve to initiate electrical functions that normally occur upon system actuation, such as shutdown functions and control panel actuation.

**A.4.3.4.1** *NFPA 72*, 14.2.6.4, requires that “Suppression systems shall be secured from inadvertent actuation, including disconnection of releasing solenoids or electric actuators, closing of valves, other actions, or combinations thereof, for the specific system, for the duration of the fire alarm system testing.”

Clean agent systems generally have a device attached to one or more agent storage container discharge valves that, upon signal from the fire system releasing control unit, causes the discharge valve(s) to operate to release the agent. The device is referred to as an electric actuator. These actuators are typically either a solenoid operated device or a squib operated device.

During system maintenance, it is a common procedure to remove the solenoid operated actuators from the agent storage container discharge valve to prevent accidental discharge of the system and permit functional testing of the actuator. Some systems that incorporate selector valves also have electric actuators attached to the selector valves to control their operation by electrical signal from the control panel. These electric actuators might also need to be routinely removed from their selector valves during maintenance.

Since the electrical connection between the solenoid and the system control panel is not broken by this maintenance procedure, special provision is required to provide an indication of system impairment at the releasing control panel when the electric actuator is physically removed from the valve it controls. There have been numerous reports of systems inadvertently left disabled after maintenance because the technician failed to reinstall the actuator on its valve. Fortunately in all reported cases, the impairment was discovered before the system was required to operate, and only successful extinguishments have been reported — no failures to operate under fire conditions have come to the attention of the technical committee responsible for this standard.

Squib actuators are covered by this requirement only if the manufacturer’s maintenance instruction requires physical removal of the squib operated device from the valve it controls.

With the evolution of technology, cost effective means to monitor the placement of actuators can be developed. Because of the time required to develop hardware and to obtain listings and approvals for the hardware, the effective date for this provision of the standard is January 1, 2016.

**A.4.3.5.3** A telephone should be located near the abort switch.

**A.4.3.5.6.1** Hazards associated with fast growth fires would include, but not be limited to, flammable liquid storage or transfer areas and aerosol filling areas.

**A.4.3.6** Accidental discharge can be a significant factor in unwanted clean agent emissions. Equipment lockout or service disconnects can be instrumental in preventing false discharges when the clean agent system is being tested or serviced. In addition, servicing of air-conditioning systems with the release of refrigerant aerosols, soldering, or turning electric plenum heaters on for the first time after a long period of idleness could trip the clean agent system. Where used, an equipment disconnect switch should be of the keyed-access type if external to the control panel, or it can be of the toggle type if within the locked control panel. Either type should

annunciate at the panel when in the out-of-service mode. Written procedures should be established for taking the clean agent system out of service. Care should be taken to thoroughly evaluate and correct any factors that could result in unwanted discharges.

**A.5.1.2.2(28)** “Specified enclosure pressure limit” is a value determined or estimated with confidence to be less than the enclosure pressure strength. It is not intended to necessarily be the same as the “enclosure pressure strength” which would be determined by a structural engineering analysis.

Guidance to determine “pressure relief vent area” can be found in the FSSA *Application Guide to Estimating Enclosure Pressure & Pressure Relief Vent Area for Use with Clean Agent Fire Extinguishing Systems*. That guide can assist the designer in accurately determining the required information for inclusion on the working plans.

**A.5.2** The two types of system flow calculations are liquefied compressed gas flow calculations and inert gas flow calculations.

*Liquefied compressed gas flow calculations.* Analyzing the behavior of two-phase agents in pipelines is a complex process with numerous methods. Two calculation methods are commonly used by fire protection professionals. The first is based on modifications to the HFLOW Method (DiNunno et al., 1995), completed in 1994, and the other is based on enhancement to the work of Hesson (Hesson, 1953) in 1953. Only those calculation methods that have been listed or approved should be used for design purposes.

The modified HFLOW calculation method is based on major modifications by Elliot et al. (1984) of a calculation method called HFLOW, developed by the Jet Propulsion Laboratory. The revised method is capable of predicting the two-phase flow characteristics of clean agents based on their thermodynamic properties. This method can calculate the flow characteristics of fire suppression agents across the wide range of real engineering systems in reasonable time scales.

To simplify the methodology, the following basic assumptions are made:

- (1) The conditions in the cylinder (pressure, temperature, and composition) are solely functions of the initial conditions and the outage fraction (fraction of the initial charge mass having left the cylinder). This assumption effectively ignores the effect on the cylinder energy balance of the increased kinetic energy of the fluid leaving the cylinder.
- (2) Quasi-steady flow exists. The average flow rate over a small time interval step is equal to the flow rate that would exist if the cylinder conditions were held steady during that time step.
- (3) The heat transferred from the pipe walls to the flowing fluid is often insignificant.
- (4) The flow through the pipe network is homogeneous. Liquid flow and vapor flow through the piping are at the same velocity and evenly dispersed.

Calculation cannot be done without adequate manufacturer’s hardware data. This data includes dip tube and manifold equivalent lengths and nozzle discharge coefficients.

Required input data include cylinder volume, valve and dip tube equivalent lengths, agent mass and temperature, pipe length and diameter, elevation, fittings, nozzle area, and discharge coefficients. Output data for each node (pipe, cylinder, or nozzle) include pressure, temperature, component fraction, phase distribution, mass flow rate, and velocity.

Due to its complexity, the HFLOW method does not lend itself to hand calculation.

The modified Hesson calculation methodology is a two-phase flow method first developed by Hesson for calculating pressure drop along a pipeline flowing carbon dioxide. Hesson adapted Bernoulli’s equation for ease of use with compressible, two-phase flow. It was refined by H. V. Williamson and then Wysocki (1996) for use with Halon 1301 and other clean agents.

The two-phase flow method models the following three basic flow conditions for a liquefied compressed gas discharge from a storage container:

- (1) The initial transient discharge during which agent flows from the container and cools the pipe
- (2) A quasi-steady state flow during which the agent is assumed to maintain a constant enthalpy (adiabatic) condition with constant mass flow rate
- (3) The final transient discharge during which the two-phase flow is replaced by an essentially vapor discharge as the storage container empties

The pressure drop during the quasi-steady state flow is based on the work of Hesson (1953). The transient conditions are modeled using standard thermodynamics. During testing of the two-phase methodology with Halon 1301, mechanical separation of the liquid and vapor phases due to centripetal forces was observed. This effect has been noted for every liquefied compressed gas tested to date. The effect is not predicted by thermodynamics but was inferred from test data and confirmed using ultra-high speed photography (HT Research Institute, 1973). To accurately predict the quantity of agent discharge from each nozzle in a system, empirical corrections based on the degree of flow split, orientation of the tee junction, component fraction, and phase distribution are developed for the specific liquefied compressed gas.

The pressure drop calculation for the quasi-steady state flow using Hesson’s adaption of Bernoulli’s equation can be done by hand. The calculation of transient conditions and the calculation of mechanical separation effects at tees, and their effect on pressure drop and quantity of agent discharged from each nozzle in an unbalanced system, require many complex iterations. Manual calculation of these effects is not practical. Therefore, a listed and approved computer program must be used for a complete calculation.

Required input data include cylinder volume, agent mass and temperature, valve and dip tube equivalent lengths, pipe lengths, elevation changes, fittings, and pre-discharge pipe temperature. Most programs permit the user to specify either the required flow rate or the agent quantity for each nozzle or the “as-built” system condition. If flow rate or agent quantity is specified, the program will calculate the required pipe and nozzle diameters. If an “as-built” condition including pipe and nozzle diameters is specified, the program calculates system flow rates. In either case, pressure drop, discharge time, and quantity discharged from each nozzle are reported.

*Inert gas flow calculations.* Inert gases present a problem in single-phase compressible flow. Many fluid dynamics handbooks provide formulas for compressible gas flow that can be suitable for relatively simple pipe networks with short lengths of pipe. These formulas are inadequate to calculate systems using longer pipe lengths with complex configurations. Wysocki and Christensen (Wysocki et al., 1996) adapted the work of Hesson for use with single-phase compressible gases.



Inert gas discharge from a cylinder into a pipe and nozzle network involves the following three stages:

- (1) The initial transient phase as the gas flows into the pipe and fills the pipe up to the nozzles. There is a marked variation between the time at which various nozzles in an unbalanced pipe network begin discharging agent.
- (2) Full flow, during which all nozzles discharge agent. This is a dynamic condition during which the flow rates, agent temperatures, and pressure conditions constantly change.
- (3) Final transient condition, during which the storage container and pipeline empty. Complex changes in flow rates at the individual nozzles take place.

Flow in these systems is neither adiabatic nor isothermal (the two classical limits). The complexity of the calculation for large, unbalanced pipe networks necessitates use of a listed or approved computer program.

Regardless of the method used for flow calculations, certain limits are established during the listing and approval process for the flow calculation. Typical limits include the following:

- (1) Limit arc degree of split at tees
- (2) Limits on the orientation of tees
- (3) Limits on agent arrival time
- (4) Limits on agent “run out” or “end of liquid” time differences between nozzles
- (5) Minimum pressure limits
- (6) Minimum flow density limits
- (7) Maximum and minimum storage container fill density limits
- (8) Additional limits specific to the flow calculation program

The results of the calculation must be checked to verify that limits have not been exceeded. Computerized calculations generally report warning or error messages if the system falls outside program limits.

**A.5.2.1** A listed or approved calculation method should predict agent mass discharged per nozzle, average nozzle pressure, and system discharge time within the following limits of accuracy:

- (1) The mass of agent predicted to discharge from a nozzle by the flow calculation method should agree with mass of agent measured from the nozzle by  $\pm 10$  percent of the predicted value. A standard deviation of the percentage differences between measured and predicted nozzle agent quantities, relative to zero, should not be greater than 5 percent.
- (2) The system discharge time predicted by the flow calculation method should agree with the actual system discharge time value or by  $\pm 1$  second for halocarbon systems or  $\pm 10$  seconds for inert gas systems, whichever is greater.
- (3) The average nozzle pressures predicted by the flow calculation method should agree with the actual nozzle pressures by  $\pm 10$  percent of the predicted value.
- (4) The nozzle pressure should not fall below the minimum or above the maximum nozzle pressure required for the nozzle to uniformly distribute the agent throughout the volume that the nozzle’s discharge is to protect.

**A.5.3** NFPA 75, 5.1.3.3, offers clear guidance on the construction of an enclosure being protected by clean agent fire extinguishing systems, specifically that “the fire-resistant-rated enclosures shall extend from the structural floor to the structural floor above or to the roof.” Proper room construction will

ensure that the integrity of the room will be maintained and that the extinguishing agent concentration will be held for the required duration.

**A.5.3.5.1** NFPA 75, 8.1.1.2, requires the following: “An automatic sprinkler system, a carbon dioxide extinguishing system, or an inert agent fire extinguishing system for the protection of the area below the raised floor in an information technology equipment room or information technology equipment area shall be provided.” NFPA 75, A.8.1.1.2, notes that halocarbon agents should not be used to protect the space below a raised floor unless the space above the raised floor is likewise protected by the system and the system is designed to discharge simultaneously into both the space below the raised floor and the room above the raised floor.

During and after a discharge, some of the agent from the space under the raised floor will migrate into the room above the raised floor. If any fire exists in the equipment above the raised floor, the agent at a concentration below the extinguishing concentration may be exposed to the fire. If the agent is a halocarbon, considerable decomposition of the agent could occur. Note that NFPA 12A, in 5.3.1.2, also prohibits the use of Halon 1301 for flooding the space under a raised floor if the room above the raised floor is not simultaneously protected by the Halon 1301 total flooding system.

**A.5.3.6** Examples of ventilation systems necessary to ensure safety include cooling of vital equipment required for process safety and ventilation systems required for containment of hazardous materials. Where recirculating ventilation is not shut off, additional agent could be needed to compensate for room leakage during the hold time.

**A.5.3.7** Enclosure pressures developed during the discharge of a clean agent system are dependent on many variables, including factors unique to each agent, system, and enclosure. Over- or underpressurization of the enclosure can occur during the discharge.

**A.5.4.2** This standard requires that the flame extinguishing concentration of a gaseous agent for a Class B fuel be determined by the cup burner method. Cup burner testing in the past has involved a variety of techniques, apparatus, and investigators. It was reported by Senecal (2005) that significant inconsistencies are apparent in Class B flame extinguishing data for inert gases currently in use in national and international standards. In 2003, the Technical Committee for NFPA 2001 appointed a task group to develop an improved cup burner test method. Through this effort, the degree of standardization of the cup burner test method was significantly improved. A standard cup burner test procedure with defined apparatus has now been established and is outlined in Annex B. Values for minimum flame extinguishing concentration (MEC) for gaseous agents addressed in this standard, as determined by the revised test method, are given in Table A.5.4.2(a). Values for MEC that were determined by the 2004 test method are retained in this edition for the purpose of providing an MEC reference where data obtained by the revised test method were not available. It is intended that in subsequent editions the 2004 MEC data can be deleted.

Table A.5.4.2(b) lists cup burner flame extinguishing concentrations for n-heptane.

**Table A.5.4.2(a) Minimum Flame Extinguishing Concentration (Fuel: n-heptane)**

Agent	MEC (% vol.)	
	By 2004 Test Method	By Revised Test Method
FIC-1311	3.2*	TBD
FK-5-1-12	4.5	TBD
HCFC Blend A	9.9	TBD
HCFC-124	6.6	TBD
HFC-125	8.7	TBD
HFC-227ea	6.6 <sup>†</sup>	6.62
HFC-23	12.9	TBD
HFC-236fa	6.3	TBD
IG-01	42	TBD
IG-100	31*	32.2
IG-541	31	TBD
IG-55	35	TBD

\*Not derived from standardized cup burner method.

<sup>†</sup>A value of cup burner extinguishing concentration of 6.7 percent for HCF-227ea for commercial heptane fuel.

**Table A.5.4.2(b) n-Heptane Cup Burner Extinguishment Concentrations**

Agent	Cup Burner Value
FIC-1311*	3.2
FK-5-1-12	4.5
HCFC Blend A	9.9
HCFC-124	6.6
HFC-125	8.7
HFC-227ea	6.7
HFC-23	12.9
HFC-236fa	6.4
IG-01	42
IG-100*	31
IG-541	31
IG-55	35
HFC Blend B	11.3

Note: A value of cup burner extinguishing concentration of 6.7 percent for HCF-227ea for commercial heptane fuel.

\*Not derived from standardized cup burner method.

**A.5.4.2.2** The following steps detail the fire extinguishment/area coverage fire test procedure for engineered and pre-engineered clean agent extinguishing system units:

- (1) The general requirements are as follows:
  - (a) An engineered or pre-engineered extinguishing system should mix and distribute its extinguishing agent and should totally flood an enclosure when tested in accordance with the recommendations of A.5.4.2.2(c) through A.5.4.2.2(f) under the maximum design limitations and most severe installation instructions. See also A.5.4.2.2(1)(b).
  - (b) When tested as described in A.5.4.2.2(2)(a) through A.5.4.2.2(b), an extinguishing system unit should extinguish all fires within 30 seconds after the end of system discharge. When tested as described in A.5.4.2.2(2)(a)

through A.5.4.2.2(3)(c) and A.5.4.2.2(6)(a) through A.5.4.2.2(6)(f), an extinguishing system should prevent reignition of the wood crib after a 10 minute soak period.

- (c) The tests described in A.5.4.2.2(6)(f) should be carried out. Consider the intended use and limitations of the extinguishing system, with specific reference to the following:
  - i. The area coverage for each type of nozzle
  - ii. The operating temperature range of the system
  - iii. Location of the nozzles in the protected area
  - iv. Either maximum length and size of piping and number of fittings to each nozzle or minimum nozzle pressure
  - v. Maximum discharge time
  - vi. Maximum fill density
- (2) The test enclosure construction is as follows:
  - (a) The enclosure for the test should be constructed of either indoor or outdoor grade minimum  $\frac{3}{8}$  in. (9.5 mm) thick plywood or equivalent material.
  - (b) An enclosure(s) is to be constructed having the maximum area coverage for the extinguishing system unit or nozzle being tested and the minimum and maximum protected area height limitations. The test enclosure(s) for the maximum height, flammable liquid, and wood crib fire extinguishment tests need not have the maximum coverage area, but should be at least 13.1 ft (4.0 m) wide by 13.1 ft (4.0 m) long and 3351 ft<sup>3</sup> (100 m<sup>3</sup>) in volume.
- (3) The extinguishing system is as follows:
  - (a) A pre-engineered type of extinguishing system unit is to be assembled using its maximum piping limitations with respect to number of fittings and length of pipe to the discharge nozzles and nozzle configuration(s), as specified in the manufacturer's design and installation instructions.
  - (b) An engineered-type extinguishing system unit is to be assembled using a piping arrangement that results in the minimum nozzle design pressure at 70°F (21°C).
  - (c) Except for the flammable liquid fire test using the 2.5 ft<sup>2</sup> (0.23 m<sup>2</sup>) square pan and the wood crib extinguishment test, the cylinders are to be conditioned to the minimum operating temperature specified in the manufacturer's installation instructions.
- (4) The extinguishing concentration is as follows:
  - (a) The extinguishing agent concentration for each test is to be 83.34 percent of the intended end use design concentration specified in the manufacturer's design and installation instructions at the ambient temperature of approximately 70°F (21°C) within the enclosure.
  - (b) The concentration for inert gas clean agents can be adjusted to take into consideration actual leakage measured from the test enclosure.
  - (c) The concentration within the enclosure for halocarbon clean agents should be calculated using the following formula unless it is demonstrated that the test enclosure exhibits significant leakage. If significant test enclosure leakage does exist, the formula used to determine the test enclosure concentration of halocarbon clean agents can be modified to account for the leakage measured.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right) \quad [\text{A.5.4.2.2a}]$$

where:

$W$  = weight of clean agents [lb (kg)]

$V$  = volume of test enclosure [ $\text{ft}^3$  ( $\text{m}^3$ )]

$s$  = specific volume of clean agent at test temperature [ $\text{ft}^3/\text{lb}$  ( $\text{m}^3/\text{kg}$ )]

$C$  = concentration (vol%)

(5) The flammable liquid extinguishment tests are as follows:

- (a) Steel test cans having a nominal thickness of 0.216 in. (5.5 mm) (such as Schedule 40 pipe) and 3.0 in. to 3.5 in. (76.2 mm to 88.9 mm) in diameter and at least 4 in. (102 mm) high, containing either heptane or heptane and water, are to be placed within 2 in. (50.8 mm) of the corners of the test enclosure(s) and directly behind the baffle, and located vertically within 12 in. (305 mm) of the top or bottom of the enclosure or both the top and bottom if the enclosure permits such placement. If the cans contain heptane and water, the heptane is to be at least 2 in. (50.8 mm) deep. The level of heptane in the cans should be at least 2 in. (50.8 mm) below the top of the can. For the minimum room height area coverage test, closable openings are provided directly above the cans to allow for venting prior to system installation. In addition, for the minimum height limitation area coverage test, a baffle is to be installed between the floor and ceiling in the center of the enclosure. The baffle is to be perpendicular to the direction of nozzle discharge and to be 20 percent of the length or width of the enclosure, whichever is applicable with respect to nozzle location. For the maximum room height extinguishment test, an additional test is to be conducted using a 2.5  $\text{ft}^2$  (0.23  $\text{m}^2$ ) square pan located in the center of the room and the storage cylinder conditioned to 70°F (21°C). The test pan is to contain at least 2 in. (50.8 mm) of heptane, with the heptane level at least 2 in. (50.8 mm) below the top of the pan. For all tests, the heptane is to be ignited and allowed to burn for 30 seconds, at which time all openings are to be closed and the extinguishing system is to be manually actuated. At the time of actuation, the percent of oxygen within the enclosure should be at least 20 percent.

- (b) The heptane is to be commercial grade having the following characteristics:
- Initial boiling point: 194°F (90°C) minimum
  - Dry point: 212°F (100°C) maximum
  - Specific gravity: 0.69–0.73

(6) The wood crib extinguishment tests are as follows:

- (a) The storage cylinder is to be conditioned to 70°F (21°C). The test enclosure is to have the maximum ceiling height as specified in the manufacturer's installation instructions.
- (b) The wood crib is to consist of four layers of six, trade size 2 by 2 (1½ by 1½ in.) by 18 in. long, kiln spruce or fir lumber having a moisture content between 9 and 13 percent. The alternate layers of the wood members are to be placed at right angles to one another. The individual wood members in each layer are to be evenly spaced, forming a square determined by the specified length of the wood members. The

wood members forming the outside edges of the crib are to be stapled or nailed together.

- (c) Ignition of the crib is to be achieved by the burning of commercial grade heptane in a square steel pan 2.5  $\text{ft}^2$  (0.23  $\text{m}^2$ ) in area and not less than 4 in. (101.6 mm) in height. The crib is to be centered with the bottom of the crib 12 to 24 in. (304 to 609.6 mm) above the top of the pan, and the test stand constructed so as to allow for the bottom of the crib to be exposed to the atmosphere.
- (d) The heptane is to be ignited, and the crib is to be allowed to burn freely for approximately 6 minutes outside the test enclosure. The heptane fire is to burn for 3 to 3½ minutes. Approximately ¼ gal (0.95 L) of heptane will provide a 3 to 3½ minute burn time. Just prior to the end of the pre-burn period, the crib is to be moved into the test enclosure and placed on a stand such that the bottom of the crib is between 20 and 28 in. (508 and 711 mm) above the floor. The closure is then to be sealed.
- (e) After the crib is allowed to burn for a period of 6 minutes, the system is to be actuated. At the time of actuation, the percent of oxygen within the enclosure at the level of the crib should be at least 20 percent.
- (f) After the end of system discharge, the enclosure is to remain sealed for a total of 10 minutes. After the 10 minute soak period, the crib is to be removed from the enclosure and observed to determine whether sufficient fuel remains to sustain combustion and to detect signs of re-ignition.
- (7) The following is a schematic of the process to determine the design quantity:
- (a) Determine hazard features, as follows:
- Fuel type: Extinguishing concentration (EC) per 5.4.2 or inerting concentration (IC) per 5.4.3
  - Enclosure volume
  - Enclosure temperature
  - Enclosure barometric pressure
- (b) Determine the agent minimum design concentration (MDC) by multiplying EC or IC by the safety factor (SF):

$$\text{MDC} = (\text{EC or IC}) \text{ SF} \quad [\text{A.5.4.2.2b}]$$

- (c) Determine the agent minimum design quantity (MDQ) by referring to 5.5.1 for halocarbons or 5.5.2 for inert gases
- (d) Determine whether design factors (DF) apply. See 5.5.3 to determine individual DF [DF(i)] and then determine sum:

$$\text{DF} = \sum \text{DF}(i) \quad [\text{A.5.4.2.2c}]$$

- (e) Determine the agent adjusted minimum design quantity (AMDQ):

$$\text{AMDQ} = \text{MDQ} (1 + \text{DF}) \quad [\text{A.5.4.2.2d}]$$

- (f) Determine the pressure correction factor (PCF) per 5.5.3.3
- (g) Determine the final design quantity (FDQ) as follows:

$$\text{FDQ} = \text{AMDQ} \times \text{PCF} \quad [\text{A.5.4.2.2e}]$$

Where any of the following conditions exists, higher extinguishing concentrations might be required:

- (1) Cable bundles greater than 4 in. (100 mm) in diameter
- (2) Cable trays with a fill density greater than 20 percent of the tray cross section
- (3) Horizontal or vertical stacks of cable trays less than 10 in. (250 mm) apart
- (4) Equipment energized during the extinguishment period where the collective power consumption exceeds 5 kW

*Fire extinguishment tests for (noncellulosic) Class A Surface Fires.*

The purpose of the tests outlined in this procedure is to develop the minimum extinguishing concentration (MEC) for a gaseous fire suppression agent for a range of noncellulosic, solid polymeric combustibles. It is intended that the MEC will be increased by appropriate safety factors and flooding factors as provided for in the standard.

These Class A tests should be conducted in a draft-free room with a volume of at least 3530 ft<sup>3</sup> (100 m<sup>3</sup>) and a minimum height of 11.5 ft (3.5 m) and each wall at least 13.1 ft (4 m) long. Provisions should be made for relief venting if required.

The test objects are as follows:

- (1) The polymer fuel array consists of 4 sheets of polymer,  $\frac{3}{8}$  in. (9.53 mm) thick, 16 in. (406 mm) tall, and 8 in. (203 mm) wide. Sheets are spaced and located per Figure A.5.4.2.2(a). The bottom of the fuel array is located 8 in. (203 mm) from the floor. The fuel sheets should be mechanically fixed at the required spacing.
- (2) A fuel shield is provided around the fuel array as indicated in Figure A.5.4.2.2(a). The fuel shield is 15 in. (381 mm) wide, 33.5 in. (851 mm) high, and 24 in. (610 mm) deep. The 24 in. (610 mm) wide  $\times$  33.5 in. (851 mm) high sides and the 24 in. (610 mm)  $\times$  15 in. (381 mm) top are sheet metal. The remaining two sides and the bottom are open. The fuel array is oriented in the fuel shield such that the 8 in. (203 mm) dimension of the fuel array is parallel to the 24 in. (610 mm) side of the fuel shield.
- (3) Two external baffles measuring 40 in.  $\times$  40 in. (1 m  $\times$  1 m) and 12 in. (0.3 m) tall are located around the exterior of the fuel shield as shown in Figure A.5.4.2.2(a) and Figure A.5.4.2.2(b). The baffles are placed 3.5 in. (0.09 m) above the floor. The top baffle is rotated 45 degrees with respect to the bottom baffle.
- (4) Tests are conducted for three plastic fuels — polymethyl methacrylate (PMMA), polypropylene (PP), and acrylonitrile-butadiene-styrene (ABS) polymer. Plastic properties are given in Table A.5.4.2.2(a).
- (5) The ignition source is a heptane pan 2 in.  $\times$  2 in.  $\times$   $\frac{7}{8}$  in. deep (51 mm  $\times$  51 mm  $\times$  22 mm deep) centered  $\frac{1}{2}$  in. (12 mm) below the bottom of the plastic sheets. The pan is filled with 3.0 ml of heptane to provide 90 seconds of burning.
- (6) The agent delivery system should be distributed through an approved nozzle. The system should be operated at the minimum nozzle pressure ( $\pm 10$  percent) and the maximum discharge time ( $\pm 1$  second).

The test procedure is as follows:

- (1) The procedures for ignition are as follows:
  - (a) The heptane pan is ignited and allowed to burn for 90 seconds.
  - (b) The agent is discharged 210 seconds after ignition of heptane.

- (c) The compartment remains sealed for 600 seconds after the end of discharge. Extinguishment time is noted. If the fire is not extinguished within 600 seconds of the end of agent discharge, a higher minimum extinguishing concentration must be utilized.
  - (d) The test is repeated two times for each fuel for each concentration evaluated and the extinguishment time averaged for each fuel. Any one test with an extinguishment time above 600 seconds is considered a failure.
  - (e) If the fire is extinguished during the discharge period, the test is repeated at a lower concentration or additional baffling provided to ensure that local transient discharge effects are not impacting the extinguishment process.
  - (f) At the beginning of the tests, the oxygen concentration must be within 2 percent (approximately 0.5 percent by volume O<sub>2</sub>) of ambient value.
  - (g) During the post-discharge period, the oxygen concentration should not fall below 0.5 percent by volume of the oxygen level measured at the end of agent discharge.
- (2) The observation and recording procedures are as follows:
    - (a) The following data must be continuously recorded during the test:
      - i. Oxygen concentration ( $\pm 0.5$  percent)
      - ii. Fuel mass loss ( $\pm 5$  percent)
      - iii. Agent concentration ( $\pm 5$  percent) (Inert gas concentration can be calculated based on oxygen concentration.)
    - (b) The following events are timed and recorded:
      - i. Time at which heptane is ignited
      - ii. Time of heptane pan burnout
      - iii. Time of plastic sheet ignition
      - iv. Time of beginning of agent discharge
      - v. Time of end of agent discharge
      - vi. Time all visible flame is extinguished

The minimum extinguishing concentration is determined by all of the following conditions:

- (1) All visible flame is extinguished within 600 seconds of agent discharge.
- (2) The fuel weight loss between 10 seconds and 600 seconds after the end of discharge does not exceed 0.5 oz (15 g).
- (3) There is no ignition of the fuel at the end of the 600 second soak time and subsequent test compartment ventilation.

Deep-seated fires involving Class A fuels can require substantially higher design concentrations and extended holding times than the design concentrations and holding times required for surface-type fires involving Class A fuels. Wood crib and polymeric sheet Class A fire tests may not adequately indicate extinguishing concentrations suitable for the protection of certain plastic fuel hazards (e.g., electrical- and electronic-type hazards involving grouped power or data cables such as computer and control room underfloor voids and telecommunication facilities).

The values in Table A.5.4.2.2(b) are representative of the minimum extinguishing concentrations and design concentrations for various agents. The concentrations required can vary by equipment manufacturer. Equipment manufacturers should be contacted for the concentration required for their specific system.




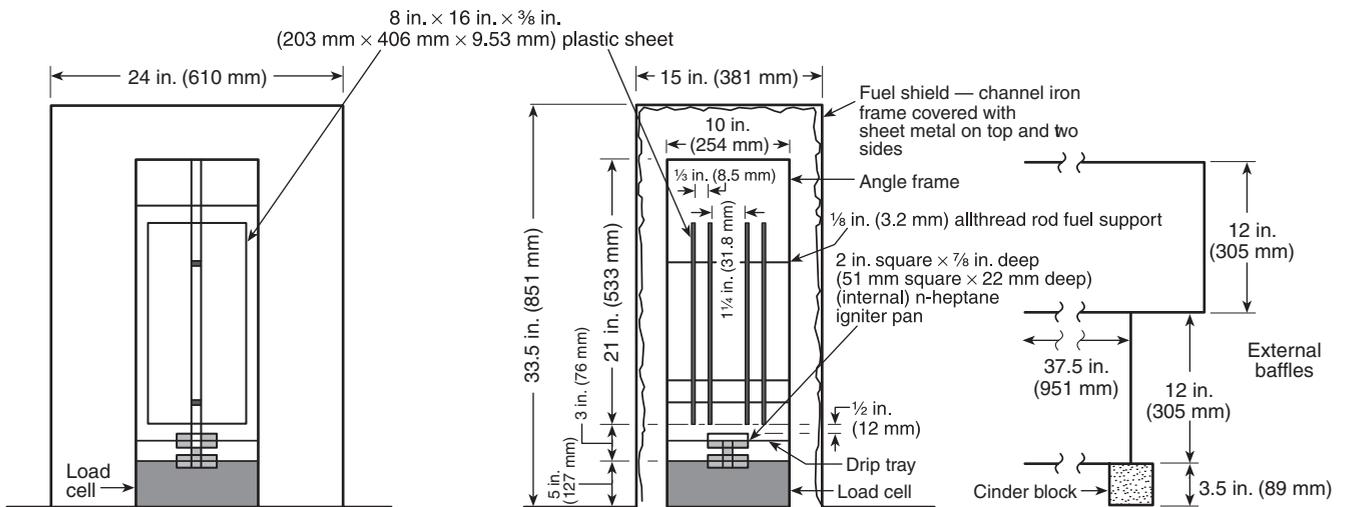


FIGURE A.5.4.2.2(a) Four Piece Modified Plastic Setup.

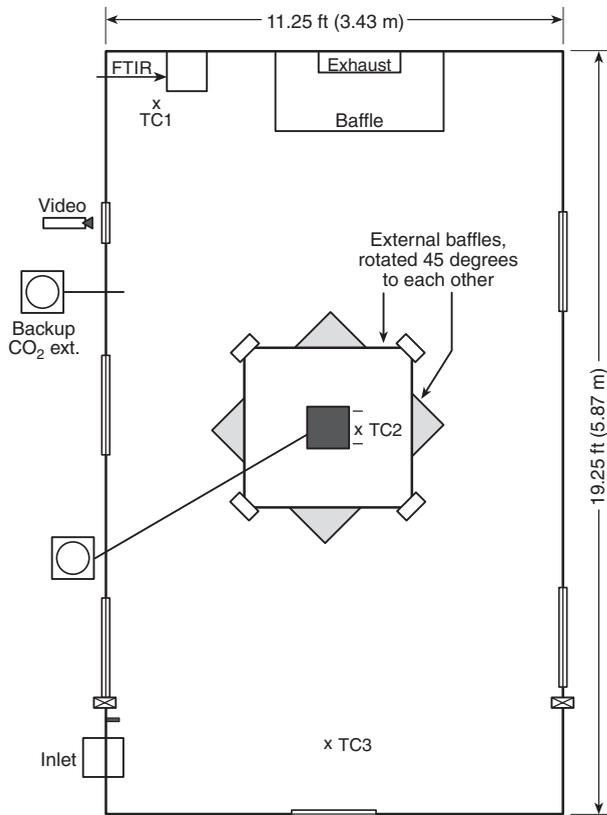

- x TC1— 0 in. (0 mm), 12 in. (305 mm), 24 in. (610 mm), 48 in. (915 mm), 72 in. (1.8 m), 96 in. (2.4 m), 120 in. (3 m) from ceiling
- x TC2— 0 in. (0 mm), 12 in. (305 mm), 24 in. (610 mm), 48 in. (915 mm), 72 in. (1.8 m), 96 in. (2.4 m), 120 in. (3 m) from ceiling
- x TC3— 0 in. (0 mm), 12 in. (305 mm), 24 in. (610 mm), 48 in. (915 mm), 72 in. (1.8 m), 96 in. (2.4 m), 120 in. (3 m) from ceiling
- ☒ ODM — 12 in. (305 mm) down from ceiling
- FTIR — 27 in. (686 mm) up from floor
- Noisemeter — 12 in. (305 mm) down from ceiling
- FTIR — Fourier transform infrared (spectrometer)
- ODM — Oxygen deficiency monitor
- TC — Thermocouple

FIGURE A.5.4.2.2(b) Chamber Plan View.

**A.5.4.2.4 Hazards** containing both Class A and Class B fuels should be evaluated on the basis of the fuel requiring the highest design concentration.

**A.5.4.2.6** Two types of fires can occur in solid fuels: (1) one in which volatile gases resulting from heating or decomposition of the fuel surface are the source of combustion and (2) one in which oxidation occurs at the surface of or in the mass of fuel. The first type of fire is commonly referred to as “flaming” combustion, while the second type is often called “smoldering” or “glowing” combustion. The two types of fires frequently occur concurrently, although one type of burning can precede the other. For example, a wood fire can start as flaming combustion and become smoldering as burning progresses. Conversely, spontaneous ignition in a pile of oily rags can begin as a smoldering fire and break into flames at some later point. Flaming combustion, because it occurs in the vapor phase, can be extinguished with relatively low levels of clean agents. In the absence of smoldering combustion, it will stay out.

Unlike flaming combustion, smoldering combustion is not subject to immediate extinguishment. Characteristic of this type of combustion is the slow rate of heat losses from the reaction zone. Thus, the fuel remains hot enough to react with oxygen, even though the rate of reaction, which is controlled by diffusion processes, is extremely slow. Smoldering fires can continue to burn for many weeks, for example, in bales of cotton and jute and heaps of sawdust. A smoldering fire ceases to burn only when either all the available oxygen or fuel has been consumed or the fuel surface is at too low a temperature to react. Smoldering fires usually are extinguished by reducing the fuel temperature, either directly by application of a heat-absorbing medium, such as water, or by blanketing with an inert gas. The inert gas slows the reaction rate to the point where heat generated by oxidation is less than heat losses to surroundings. This causes the temperature to fall below the level necessary for spontaneous ignition after removal of the inert atmosphere.

For the purposes of this standard, smoldering fires are divided into two classes: (1) where the smoldering is not “deep seated” and (2) deep-seated fires. Whether a fire will become deep seated depends, in part, on the length of time it has been burning before application of the extinguishing agent. This time is usually called the “preburn” time.

Table A.5.4.2.2(a) Plastic Fuel Properties

25 kW/m <sup>2</sup> Exposure in Cone Calorimeter — ASTM E1354								
Fuel	Color	Density (g/cm <sup>3</sup> )	Ignition Time		180-Second Average Heat Release Rate		Effective Heat of Combustion	
			sec	Tolerance	kW/m <sup>2</sup>	Tolerance	MJ/kg	Tolerance
PMMA	Black	1.19	77	±30%	286	25%	23.3	±15%
PP	Natural (white)	0.905	91	±30%	225	25%	39.8	±15%
ABS	Natural (cream)	1.04	115	±30%	484	25%	29.1	±15%

Another important variable is the fuel configuration. While wood cribs and pallets are easily extinguished with Class A design concentrations, vertical wood panels closely spaced and parallel can require higher concentrations and long hold times for extinguishment. Fires in boxes of excelsior and in piles of shredded paper also can require higher concentrations and long hold times for extinguishment. In these situations, heat tends to be retained in the fuel array rather than being dissipated to the surroundings. Radiation is an important mechanism for heat removal from smoldering fires.

**A.5.4.3** The following paragraphs summarize a method of evaluating inerting concentration of a fire extinguishing vapor.

One characteristic of halons and replacement agents is frequently referred to as the inerting, or inhibiting, concentration. Flammability diagram data (Dalzell, 1975, and Coll, 1976) on ternary systems can be found in NFPA 12A. The procedures used to generate those data have been used more recently to evaluate inerting concentrations of halons and replacement chemicals against various fuel-air systems. Differences between the earlier studies and the recent work are that the test vessel volume used in the more recent work was 2.1 gal (7.9 L) versus the 1.5 gal (5.6 L) used previously. The igniter type — carbon rod corona discharge spark — was the same,

but the capacitor-stored energy levels in the later studies were higher, approximately 68 J (16.2 cal) versus 6 or 11 J (1.4 or 2.6 cal) in the earlier work. The basic procedure, employing a gap spark, has been adopted to develop additional data.

Ternary fuel-air agent mixtures were prepared at a test pressure of 1 atm and at room temperature in a 2.1 gal (7.9 L) spherical test vessel (see Figure A.5.4.3) by the partial pressure method. The vessel was fitted with inlet and vent ports, a thermocouple, and a pressure transducer. First, the test vessel was evacuated, then agent was admitted; if the agent was a liquid, sufficient time was allowed for evaporation to occur. Fuel vapor and finally air were admitted, raising the vessel pressure to 1 atm. An internal flapper allowed the mixtures to be agitated by rocking the vessel back and forth. The pressure transducer was connected to a suitable recording device to measure any pressure rise that occurred on actuation of the igniter.

The igniter employed consisted of a bundle of four graphite rods (“H” pencil leads) held together by two wire or metal brand wraps on either end of the bundle, leaving a gap between the wraps of about 0.12 in. (3 mm). The igniter was wired in series with two 525 mF 450 V capacitors. The capacitors were charged to a potential of 720 to 730 V dc. The stored energy was, therefore, 68 to 70 J (16.2 to 16.7 cal). The nominal resistance of the rod assembly was about 1 ohm. On switch

Table A.5.4.2.2(b) Class A and Class B Flame Extinguishing and Minimum Design Concentrations Tested to UL 2166 and UL 2127

Agent	Class A MEC	Class A Minimum Design Concentration	Class C Minimum Design Concentration	Class B MEC	Class B Minimum Design Concentration
FK-5-1-12	3.5	4.5	4.7	4.5	5.9
HFC-125	6.7	8.7	9.0	8.7	11.3
HFC-227ea	5.2	6.7	7.0	6.7	8.7
HFC-23	15.0	18.0	20.3	15.0*	19.5
IG-541	28.5	34.2	38.5	31.25	40.6
IG-55	31.6	37.9	42.7	30.1	39.1
IG-100	31.0	37.2	41.9	33.6	43.7

Note: Concentrations reported are at 70°F (21°C). Class B values are for heptane. Class A design values are the greater of (1) the Class A extinguishing concentration, determined in accordance with 5.4.2.2, times a safety factor of 1.2; or (2) the minimum extinguishing concentration for heptane as determined from 5.4.2.1. Class B design values are at a safety factor of 1.3.

\*Listed and approved Class B extinguishing concentration determined in accordance with 5.4.2.2.

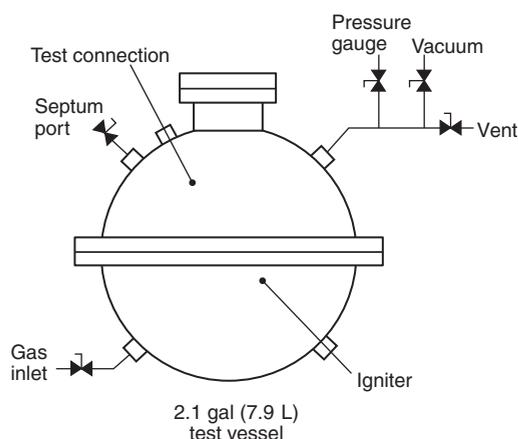


FIGURE A.5.4.3 Spherical Test Vessel.

Table A.5.4.3 Inerting Concentrations for Various Agents

Fuel	Agent	Inerting Concentration (vol. %)	Reference
i-butane	HFC-227ea	11.3	Robin
	HCFC Blend A	18.4	Moore
	IG-100	40	Zabetakis
1-chloro-1,1-difluoroethane (HCFC-142b)	HFC-227ea	2.6	Robin
	HFC-227ea	8.6	Robin
1,1-difluoroethane (HFC-152a)	HCFC Blend A	13.6	Moore
	HFC-227ea	3.5	Robin
Difluoromethane (HFC-32)	HCFC Blend A	8.6	Moore
	IF-100	44	Zabetakis
Ethane	HFC-227ea	13.6	Robin
Hexane	IF-100	42	Zabetakis
Methane	FK-5-1-12	8.8	Schmeer
	HFC-125	14.7	Senecal
	HFC-227ea	8	Robin
	HFC-23	20.2	Senecal
	HCFC Blend A	18.3	Moore
	IG-100	37	Zabetakis
Pentane	IG-541	43	Tamanini
	HFC-227ea	11.6	Robin
Propane	IG-100	42	Zabetakis
	FK-5-1-12	8.1	Schmeer
Propane	FC-5-1-14	7.3	Senecal
	FIC-13I1	6.5	Moore
	HFC-125	15.7	Senecal
	HFC-227ea	11.6	Robin
	HFC-23	20.2	Senecal
	HFC-23	20.4	Skaggs
	HCFC Blend A	18.6	Moore
	IG-541	49.0	Tamanini
	IG-100	42	Zabetakis

closure, the capacitor discharge current resulted in ionization at the graphite rod surface. A corona spark jumped across the connector gap. The spark energy content was taken as the stored capacitor energy; in principle, however, stored capacitor energy must be somewhat less than this amount due to line resistance losses.

The pressure rise, if any, resulting from ignition of the test mixture was recorded. The interior of the test vessel was wiped clean between tests with a cloth damp with either water or a solvent to avoid buildup of decomposition residues, which could influence the results.

The definition of the flammable boundary was taken as that composition that just produces a pressure rise of 0.07 times the initial pressure or 1 psi (6.9 kPa) when the initial pressure is 1 atm. Tests were conducted at fixed fuel-air ratios and varying amounts of agent vapor until conditions were found to give rise to pressure increases that bracket 0.07 times the initial pressure. Tests were conducted at several fuel-air ratios to establish that condition requiring the highest agent vapor concentration to inert.

Data obtained on several chemicals that can serve as fire protection agents are given in Table A.5.4.3.

**A.5.4.3.2** These conditions exist where both the following occur:

- (1) The types and quantity of fuel permitted in the enclosure have the potential to lead to development of a fuel vapor concentration equal to or greater than one-half of the lower flammable limit throughout the enclosure.
- (2) The system response is not rapid enough to detect and extinguish the fire before the volatility of the fuel is increased to a dangerous level as a result of the fire.

**A.5.5.1** The quantity of clean agent required to develop a given concentration will be greater than the final quantity of agent in the same enclosure. In most cases, the clean agent must be applied in a manner that promotes progressive mixing of the atmosphere. As the clean agent is injected, the displaced atmosphere is exhausted freely from the enclosure through small openings or through special vents. Some clean agent is therefore lost with the vented atmosphere, and the higher the concentration, the greater the loss of clean agent.

For the purposes of this standard, it is assumed that the clean agent-air mixture lost in this manner contains the final design concentration of the clean agent. This represents the worst case from a theoretical standpoint and provides a built-in safety factor to compensate for nonideal discharge arrangements.

Table A.5.5.1(a) through Table A.5.5.1(r) provide the quantity of clean agent needed to achieve design concentration.

Table A.5.5.1(a) FK-5-1-12 Total Flooding Quantity (U.S. Units)<sup>a</sup>

Temp ( <i>t</i> ) (°F) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (ft <sup>3</sup> /lb) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (lb/ft <sup>3</sup> ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		3	4	5	6	7	8	9	10
-20	0.93678	0.0330	0.0445	0.0562	0.0681	0.0803	0.0928	0.1056	0.1186
-10	0.96119	0.0322	0.0433	0.0548	0.0664	0.0783	0.0905	0.1029	0.1156
0	0.9856	0.0314	0.0423	0.0534	0.0648	0.0764	0.0882	0.1003	0.1127
10	1.01001	0.0306	0.0413	0.0521	0.0632	0.0745	0.0861	0.0979	0.1100
20	1.03442	0.0299	0.0403	0.0509	0.0617	0.0728	0.0841	0.0956	0.1074
30	1.05883	0.0292	0.0394	0.0497	0.0603	0.0711	0.0821	0.0934	0.1049
40	1.08324	0.0286	0.0385	0.0486	0.0589	0.0695	0.0803	0.0913	0.1026
50	1.10765	0.0279	0.0376	0.0475	0.0576	0.0680	0.0785	0.0893	0.1003
60	1.13206	0.0273	0.0368	0.0465	0.0564	0.0665	0.0768	0.0874	0.0981
70	1.15647	0.0267	0.0360	0.0455	0.0552	0.0651	0.0752	0.0855	0.0961
80	1.18088	0.0262	0.0353	0.0446	0.0541	0.0637	0.0736	0.0838	0.0941
90	1.20529	0.0257	0.0346	0.0437	0.0530	0.0624	0.0721	0.0821	0.0922
100	1.22970	0.0252	0.0339	0.0428	0.0519	0.0612	0.0707	0.0804	0.0904
110	1.25411	0.0247	0.0332	0.0420	0.0509	0.0600	0.0693	0.0789	0.0886
120	1.27852	0.0242	0.0326	0.0412	0.0499	0.0589	0.0680	0.0774	0.0869
130	1.30293	0.0237	0.0320	0.0404	0.0490	0.0578	0.0667	0.0759	0.0853
140	1.32734	0.0233	0.0314	0.0397	0.0481	0.0567	0.0655	0.0745	0.0837
150	1.35175	0.0229	0.0308	0.0389	0.0472	0.0557	0.0643	0.0732	0.0822
160	1.37616	0.0225	0.0303	0.0382	0.0464	0.0547	0.0632	0.0719	0.0807
170	1.40057	0.0221	0.0297	0.0376	0.0456	0.0537	0.0621	0.0706	0.0793
180	1.42498	0.0217	0.0292	0.0369	0.0448	0.0528	0.0610	0.0694	0.0780
190	1.44939	0.0213	0.0287	0.0363	0.0440	0.0519	0.0600	0.0682	0.0767
200	1.47380	0.0210	0.0283	0.0357	0.0433	0.0511	0.0590	0.0671	0.0754
210	1.49821	0.0206	0.0278	0.0351	0.0426	0.0502	0.0580	0.0660	0.0742
220	1.52262	0.0203	0.0274	0.0346	0.0419	0.0494	0.0571	0.0650	0.0730

<sup>a</sup>The manufacturer's listing specifies the temperature range for the operation.

<sup>b</sup>*W/V* [agent weight requirements (lb/ft<sup>3</sup>)] = pounds of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°F)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (ft<sup>3</sup>/lb)] = specific volume of FK-5-1-12 vapor can be approximated by  $s = 0.9856 + 0.002441t$ , where *t* is the temperature (°F).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of FK-5-1-12 in air at the temperature indicated.

Table A.5.5.1(b) FK-5-1-12 Total Flooding Quantity (SI Units)<sup>a</sup>

Temp ( <i>t</i> ) (°C) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (m <sup>3</sup> /kg) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (kg/m <sup>3</sup> ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		3	4	5	6	7	8	9	10
-20	0.0609140	0.5077	0.6840	0.8640	1.0479	1.2357	1.4275	1.6236	1.8241
-15	0.6022855	0.4965	0.6690	0.8450	1.0248	1.2084	1.3961	1.5879	1.7839
-10	0.0636570	0.4859	0.6545	0.8268	1.0027	1.1824	1.3660	1.5337	1.7455
-5	0.0650285	0.4756	0.6407	0.8094	0.9816	1.1575	1.3372	1.5209	1.7087
0	0.0664000	0.4658	0.6275	0.7926	0.9613	1.1336	1.3096	1.4895	1.6734
5	0.0677715	0.4564	0.6148	0.7766	0.9418	1.1106	1.2831	1.4593	1.6395
10	0.0691430	0.4473	0.6026	0.7612	0.9232	1.0886	1.2576	1.4304	1.6070
15	0.0705145	0.4386	0.5909	0.7464	0.9052	1.0674	1.2332	1.4026	1.5757
20	0.0718860	0.4302	0.5796	0.7322	0.8879	1.0471	1.2096	1.3758	1.5457
25	0.0732575	0.4222	0.5688	0.7184	0.8713	1.0275	1.1870	1.3500	1.5167
30	0.0746290	0.4144	0.5583	0.7052	0.8553	1.0086	1.1652	1.3252	1.4888
35	0.0760005	0.4069	0.5482	0.6925	0.8399	0.9904	1.1442	1.3013	1.4620
40	0.0773720	0.3997	0.5385	0.6802	0.8250	0.9728	1.1239	1.2783	1.4361
45	0.0787435	0.3928	0.5291	0.6684	0.8106	0.9559	1.1043	1.2560	1.4111
50	0.0801150	0.3860	0.5201	0.6570	0.7967	0.9395	1.0854	1.2345	1.3869
55	0.0814865	0.3795	0.5113	0.6459	0.7833	0.9237	1.0671	1.2137	1.3636
60	0.0828580	0.3733	0.5029	0.6352	0.7704	0.9084	1.0495	1.1936	1.3410
65	0.0842295	0.3672	0.4947	0.6249	0.7578	0.8936	1.0324	1.1742	1.3191
70	0.0856010	0.3613	0.4868	0.6148	0.7457	0.8793	1.0158	1.1554	1.2980
75	0.0869725	0.3556	0.4791	0.6052	0.7339	0.8654	0.9998	1.1372	1.2775
80	0.0883440	0.3501	0.4716	0.5958	0.7225	0.8520	0.9843	1.1195	1.2577
85	0.0897155	0.3447	0.4644	0.5866	0.7115	0.8390	0.9692	1.1024	1.2385
90	0.0910870	0.3395	0.4574	0.5778	0.7008	0.8263	0.9547	1.0858	1.2198
95	0.0924585	0.3345	0.4507	0.5692	0.6904	0.8141	0.9405	1.0697	1.2017
100	0.0938300	0.3296	0.4441	0.5609	0.6803	0.8022	0.9267	1.0540	1.1842

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>*W/V* [agent weight requirements (kg/m<sup>3</sup>)] = kilograms of agent required per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°C)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (m<sup>3</sup>/kg)] = specific volume of FK-5-1-12 vapor can be approximated by  $s = 0.0664 + 0.0002741t$ , where *t* is the temperature (°C).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of FK-5-1-12 in air at the temperature indicated.

Table A.5.5.1(c) HCFC Blend A Total Flooding Quantity (U.S. Units)<sup>a</sup>

Temp (t) (°F) <sup>c</sup>	Specific Vapor Volume (s) (ft <sup>3</sup> /lb) <sup>d</sup>	Weight Requirements of Hazard Volume, W/V (lb/ft <sup>3</sup> ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		8.6	9	10	11	12	13	14	15
-50	3.2192	0.0292	0.0307	0.0345	0.0384	0.0424	0.0464	0.0506	0.0548
-40	3.2978	0.0285	0.0300	0.0337	0.0375	0.0414	0.0453	0.0494	0.0535
-30	3.3763	0.0279	0.0293	0.0329	0.0366	0.0404	0.0443	0.0482	0.0523
-20	3.4549	0.0272	0.0286	0.0322	0.0358	0.0395	0.0433	0.0471	0.0511
-10	3.5335	0.0261	0.0280	0.0314	0.035	0.0386	0.0423	0.0461	0.0499
0	3.6121	0.0260	0.0274	0.0308	0.0342	0.0378	0.0414	0.0451	0.0489
10	3.6906	0.0255	0.0268	0.0301	0.0335	0.0369	0.0405	0.0441	0.0478
20	3.7692	0.0250	0.0262	0.0295	0.0328	0.0362	0.0396	0.0432	0.0468
30	3.8478	0.0245	0.0257	0.0289	0.0321	0.0354	0.0388	0.0423	0.0459
40	3.9264	0.0240	0.0252	0.0283	0.0315	0.0347	0.0381	0.0415	0.0449
50	4.0049	0.0235	0.0247	0.0277	0.0309	0.0340	0.0373	0.0406	0.0441
60	4.0835	0.0230	0.0242	0.0272	0.0303	0.0334	0.0366	0.0399	0.0432
70	4.1621	0.0226	0.0238	0.0267	0.0297	0.0328	0.0359	0.0391	0.0424
80	4.2407	0.0222	0.0233	0.0262	0.0291	0.0322	0.0352	0.0384	0.0416
90	4.3192	0.0218	0.0229	0.0257	0.0286	0.0316	0.0346	0.0377	0.0409
100	4.3978	0.0214	0.0225	0.0253	0.0281	0.0310	0.0340	0.0370	0.0401
110	4.4764	0.0210	0.0221	0.0248	0.0276	0.0305	0.0334	0.0364	0.0394
120	4.5550	0.0207	0.0217	0.0244	0.0271	0.0299	0.0328	0.0357	0.0387
130	4.6336	0.0203	0.0213	0.0240	0.0267	0.0294	0.0322	0.0351	0.0381
140	4.7121	0.0200	0.0210	0.0236	0.0262	0.0289	0.0317	0.0345	0.0375
150	4.7907	0.0196	0.0206	0.0232	0.0258	0.0285	0.0312	0.0340	0.0368
160	4.8693	0.0193	0.0203	0.0228	0.0254	0.0280	0.0307	0.0334	0.0362
170	4.9479	0.0190	0.0200	0.0225	0.0250	0.0276	0.0302	0.0329	0.0357
180	5.0264	0.0187	0.0197	0.0221	0.0246	0.0271	0.0297	0.0324	0.0351
190	5.1050	0.0184	0.0194	0.0218	0.0242	0.0267	0.0293	0.0319	0.0346
200	5.1836	0.0182	0.0191	0.0214	0.0238	0.0263	0.0288	0.0314	0.0340

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>W/V [agent weight requirements (lb/ft<sup>3</sup>)] = pounds of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>t [temperature (°F)] = design temperature in the hazard area.

<sup>d</sup>s [specific volume (ft<sup>3</sup>/lb)] = specific volume of HCFC Blend A vapor can be approximated by  $s = 3.612 + 0.0079t$ , where  $t$  = temperature (°F).

<sup>e</sup>C [concentration (%)] = volumetric concentration of HCFC Blend A in air at the temperature indicated.

Table A.5.5.1(d) HCFC Blend A Total Flooding Quantity (SI Units)<sup>a</sup>

Temp( <i>t</i> ) (°C) <sup>c</sup>	Specific Vapor Volume( <i>s</i> ) (m <sup>3</sup> /kg) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (kg/m <sup>3</sup> ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		8.6	9	10	11	12	13	14	15
-50	0.1971	0.4774	0.5018	0.5638	0.6271	0.6919	0.7582	0.8260	0.8954
-45	0.2015	0.4669	0.4908	0.5514	0.6134	0.6767	0.7415	0.8079	0.8758
-40	0.2059	0.4569	0.4803	0.5396	0.6002	0.6622	0.7256	0.7906	0.8570
-35	0.2103	0.4473	0.4702	0.5283	0.5876	0.6483	0.7104	0.7740	0.8390
-30	0.2148	0.4381	0.4605	0.5174	0.5755	0.6350	0.6958	0.7580	0.8217
-25	0.2192	0.4293	0.4513	0.507	0.5639	0.6222	0.6818	0.7428	0.8052
-20	0.2236	0.4208	0.4423	0.497	0.5528	0.6099	0.6683	0.7281	0.7893
-15	0.2280	0.4127	0.4338	0.4873	0.5421	0.5981	0.6554	0.7140	0.7740
-10	0.2324	0.4048	0.4255	0.4781	0.5318	0.5867	0.6429	0.7004	0.7593
-5	0.2368	0.3973	0.4176	0.4692	0.5219	0.5758	0.6309	0.6874	0.7451
0	0.2412	0.3900	0.4100	0.4606	0.5123	0.5652	0.6194	0.6748	0.7315
5	0.2457	0.3830	0.4026	0.4523	0.5031	0.5551	0.6083	0.6627	0.7183
10	0.2501	0.3762	0.3955	0.4443	0.4942	0.5453	0.5975	0.6510	0.7057
15	0.2545	0.3697	0.3886	0.4366	0.4856	0.5358	0.5871	0.6397	0.6934
20	0.2589	0.3634	0.3820	0.4291	0.4774	0.5267	0.5771	0.6288	0.6816
25	0.2633	0.3573	0.3756	0.422	0.4694	0.5178	0.5675	0.6182	0.6702
30	0.2677	0.3514	0.3694	0.415	0.4616	0.5093	0.5581	0.6080	0.6591
35	0.2722	0.3457	0.3634	0.4083	0.4541	0.5010	0.5490	0.5981	0.6484
40	0.2766	0.3402	0.3576	0.4017	0.4469	0.4930	0.5403	0.5886	0.6381
45	0.2810	0.3349	0.3520	0.3954	0.4399	0.4853	0.5318	0.5793	0.6280
50	0.2854	0.3297	0.3465	0.3893	0.4331	0.4778	0.5236	0.5704	0.6183
55	0.2898	0.3247	0.3412	0.3834	0.4265	0.4705	0.5156	0.5617	0.6089
60	0.2942	0.3198	0.3361	0.3776	0.4201	0.4634	0.5078	0.5533	0.5998
65	0.2987	0.3151	0.3312	0.372	0.4138	0.4566	0.5003	0.5451	0.5909
70	0.3031	0.3105	0.3263	0.3666	0.4078	0.4499	0.4930	0.5371	0.5823
75	0.3075	0.3060	0.3216	0.3614	0.4020	0.4435	0.4860	0.5294	0.5739
80	0.3119	0.3017	0.3171	0.3562	0.3963	0.4372	0.4791	0.5219	0.5658
85	0.3163	0.2975	0.3127	0.3513	0.3907	0.4311	0.4724	0.5146	0.5579
90	0.3207	0.2934	0.3084	0.3464	0.3854	0.4252	0.4659	0.5076	0.5502
95	0.3251	0.2894	0.3042	0.3417	0.3801	0.4194	0.4596	0.5007	0.5427

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>*W/V* [agent weight requirements (kg/m<sup>3</sup>)] = kilograms required per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°C)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (m<sup>3</sup>/kg)] = specific volume of HCFC Blend A vapor can be approximated by  $s = 0.2413 + 0.00088t$ , where *t* = temperature (°C).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of HCFC Blend A in air at the temperature indicated.

Table A.5.5.1(e) HCFC-124 Total Flooding Quantity (U.S. Units)<sup>a</sup>

Temp ( <i>t</i> ) (°F) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (ft <sup>3</sup> /lb) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (lb/ft <sup>3</sup> ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		5	6	7	8	9	10	11	12
20	2.4643	0.0214	0.0259	0.0305	0.0353	0.0401	0.0451	0.0502	0.0553
30	2.5238	0.0209	0.0253	0.0298	0.0345	0.0392	0.0440	0.0490	0.0540
40	2.5826	0.0204	0.0247	0.0291	0.0337	0.0383	0.0430	0.0479	0.0528
50	2.6409	0.0199	0.0242	0.0285	0.0329	0.0374	0.0421	0.0468	0.0516
60	2.6988	0.0195	0.0237	0.0279	0.0322	0.0366	0.0412	0.0458	0.0505
70	2.7563	0.0191	0.0232	0.0273	0.0315	0.0359	0.0403	0.0448	0.0495
80	2.8136	0.0187	0.0227	0.0268	0.0309	0.0352	0.0395	0.0439	0.0485
90	2.8705	0.0183	0.0222	0.0262	0.0303	0.0345	0.0387	0.0431	0.0475
100	2.9272	0.0180	0.0218	0.0257	0.0297	0.0338	0.0380	0.0422	0.0466
110	2.9837	0.0176	0.0214	0.0252	0.0291	0.0331	0.0372	0.0414	0.0457
120	3.0400	0.0173	0.0210	0.0248	0.0286	0.0325	0.0365	0.0407	0.0449
130	3.0961	0.0170	0.0206	0.0243	0.0281	0.0319	0.0359	0.0399	0.0440
140	3.1520	0.0167	0.0203	0.0239	0.0276	0.0314	0.0353	0.0392	0.0433
150	3.2078	0.0164	0.0199	0.0235	0.0271	0.0308	0.0346	0.0385	0.0425
160	3.2635	0.0161	0.0196	0.0231	0.0266	0.0303	0.0340	0.0379	0.0418
170	3.3191	0.0159	0.0192	0.0227	0.0262	0.0298	0.0335	0.0372	0.0411
180	3.3745	0.0156	0.0189	0.0223	0.0258	0.0293	0.0329	0.0366	0.0404
190	3.4298	0.0153	0.0186	0.0219	0.0254	0.0288	0.0324	0.0360	0.0398
200	3.4850	0.0151	0.0183	0.0216	0.0250	0.0284	0.0319	0.0355	0.0391

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>*W/V* [agent weight requirements (lb/ft<sup>3</sup>)] = pounds of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°F)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (ft<sup>3</sup>/lb)] = specific volume of HCFC-124 vapor can be approximated by  $s = 2.3580 + 0.0057t$  where *t* = temperature in (°F).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of HCFC-124 in air at the temperature indicated.

Table A.5.5.1(f) HCFC-124 Total Flooding Quantity (SI Units)<sup>a</sup>

Temp ( <i>t</i> ) (°C) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (m <sup>3</sup> /kg) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (kg/m <sup>3</sup> ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		5	6	7	8	9	10	11	12
-10	0.1516	0.3472	0.4210	0.6524	0.5736	0.6524	0.7329	0.8153	0.1346
-5	0.1550	0.3396	0.4119	0.6382	0.5612	0.6382	0.7170	0.7976	0.1317
0	0.1583	0.3325	0.4032	0.6248	0.5493	0.6248	0.7019	0.7808	0.1289
5	0.1616	0.3257	0.3950	0.6120	0.5381	0.6120	0.6876	0.7649	0.1263
10	0.1649	0.3192	0.3872	0.5999	0.5274	0.5999	0.6739	0.7497	0.1238
15	0.1681	0.3131	0.3797	0.5883	0.5172	0.5883	0.6609	0.7352	0.1214
20	0.1714	0.3071	0.3725	0.5772	0.5074	0.5772	0.6484	0.7213	0.1191
25	0.1746	0.3015	0.3656	0.5665	0.4981	0.5665	0.6364	0.7080	0.1169
30	0.1778	0.2960	0.3590	0.5563	0.4891	0.5563	0.6250	0.6952	0.1148
35	0.1810	0.2908	0.3527	0.5465	0.4805	0.5465	0.6140	0.6830	0.1128
40	0.1842	0.2858	0.3466	0.5371	0.4722	0.5371	0.6034	0.6712	0.1108
45	0.1873	0.2810	0.3408	0.5280	0.4642	0.5280	0.5932	0.6598	0.1089
50	0.1905	0.2763	0.3351	0.5192	0.4565	0.5192	0.5833	0.6489	0.1071
55	0.1936	0.2718	0.3296	0.5108	0.4491	0.5108	0.5738	0.6383	0.1054
60	0.1968	0.2675	0.3244	0.5026	0.4419	0.5026	0.5646	0.6281	0.1037
65	0.1999	0.2633	0.3193	0.4947	0.4350	0.4947	0.5558	0.6183	0.1021
70	0.2030	0.2592	0.3144	0.4871	0.4283	0.4871	0.5472	0.6087	0.1005
75	0.2062	0.2553	0.3096	0.4797	0.4218	0.4797	0.5390	0.5995	0.0990
80	0.2093	0.2515	0.3050	0.4726	0.4155	0.4726	0.5309	0.5906	0.0975
85	0.2124	0.2478	0.3005	0.4657	0.4094	0.4657	0.5231	0.5819	0.0961
90	0.2155	0.2442	0.2962	0.4589	0.4035	0.4589	0.5156	0.5735	0.0947
95	0.2186	0.2408	0.2920	0.4524	0.3978	0.4524	0.5083	0.5654	0.0934

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup> $W/V$  [agent weight requirements (kg/m<sup>3</sup>)] = kilograms of agent required per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup> $t$  [temperature (°C)] = design temperature in the hazard area.

<sup>d</sup> $s$  [specific volume (m<sup>3</sup>/kg)] = specific volume of HCFC-124 vapor can be approximated by  $s = 0.1585 + 0.0006t$ , where  $t$  is the temperature (°C).

<sup>e</sup> $C$  [concentration (%)] = volumetric concentration of HCFC-124 in air at the temperature indicated.

Table A.5.5.1(g) HFC-125 Total Flooding Quantity (U.S. Units)<sup>a</sup>

Temp ( <i>t</i> ) (°F) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (ft <sup>3</sup> /lb) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (lb/ft <sup>3</sup> ) <sup>b</sup>									
		Design Concentration (% by Volume) <sup>e</sup>									
		7	8	9	10	11	12	13	14	15	16
-50	2.3902	0.0315	0.0364	0.0414	0.0465	0.0517	0.0571	0.0625	0.0681	0.0738	0.0797
-40	2.4577	0.0306	0.0354	0.0402	0.0452	0.0503	0.0555	0.0608	0.0662	0.0718	0.0775
-30	2.5246	0.0298	0.0344	0.0392	0.0440	0.0490	0.0540	0.0592	0.0645	0.0699	0.0754
-20	2.5909	0.0291	0.0336	0.0382	0.0429	0.0477	0.0526	0.0577	0.0628	0.0681	0.0735
-10	2.6568	0.0283	0.0327	0.0372	0.0418	0.0465	0.0513	0.0562	0.0613	0.0664	0.0717
0	2.7222	0.0276	0.0319	0.0363	0.0408	0.0454	0.0501	0.0549	0.0598	0.0648	0.0700
10	2.7872	0.0270	0.0312	0.0355	0.0399	0.0443	0.0489	0.0536	0.0584	0.0633	0.0683
20	2.8518	0.0264	0.0305	0.0347	0.0390	0.0433	0.0478	0.0524	0.0571	0.0619	0.0668
30	2.9162	0.0258	0.0298	0.0339	0.0381	0.0424	0.0468	0.0512	0.0558	0.0605	0.0653
40	2.9803	0.0253	0.0292	0.0332	0.0373	0.0415	0.0458	0.0501	0.0546	0.0592	0.0639
50	3.0441	0.0247	0.0286	0.0325	0.0365	0.0406	0.0448	0.0491	0.0535	0.0580	0.0626
60	3.1077	0.0242	0.0280	0.0318	0.0358	0.0398	0.0439	0.0481	0.0524	0.0568	0.0613
70	3.1712	0.0237	0.0274	0.0312	0.0350	0.0390	0.0430	0.0471	0.0513	0.0556	0.0601
80	3.2344	0.0233	0.0269	0.0306	0.0344	0.0382	0.0422	0.0462	0.0503	0.0546	0.0589
90	3.2975	0.0228	0.0264	0.0300	0.0337	0.0375	0.0414	0.0453	0.0494	0.0535	0.0578
100	3.3605	0.0224	0.0259	0.0294	0.0331	0.0368	0.0406	0.0445	0.0484	0.0525	0.0567
110	3.4233	0.0220	0.0254	0.0289	0.0325	0.0361	0.0398	0.0436	0.0476	0.0515	0.0556
120	3.4859	0.0216	0.0249	0.0284	0.0319	0.0355	0.0391	0.0429	0.0467	0.0506	0.0546
130	3.5485	0.0212	0.0245	0.0279	0.0313	0.0348	0.0384	0.0421	0.0459	0.0497	0.0537
140	3.6110	0.0208	0.0241	0.0274	0.0308	0.0342	0.0378	0.0414	0.0451	0.0489	0.0527
150	3.6734	0.0205	0.0237	0.0269	0.0302	0.0336	0.0371	0.0407	0.0443	0.0480	0.0519
160	3.7357	0.0201	0.0233	0.0265	0.0297	0.0331	0.0365	0.0400	0.0436	0.0472	0.0510
170	3.7979	0.0198	0.0229	0.0260	0.0293	0.0325	0.0359	0.0393	0.0429	0.0465	0.0502
180	3.8600	0.0195	0.0225	0.0256	0.0288	0.0320	0.0353	0.0387	0.0422	0.0457	0.0493
190	3.9221	0.0192	0.0222	0.0252	0.0283	0.0315	0.0348	0.0381	0.0415	0.0450	0.0486
200	3.9841	0.0189	0.0218	0.0248	0.0279	0.0310	0.0342	0.0375	0.0409	0.0443	0.0478

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>*W/V* [agent weight requirements (lb/ft<sup>3</sup>)] = pounds of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°F)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (ft<sup>3</sup>/lb)] = specific volume of HFC-125 vapor can be approximated  $s = 2.7208 + 0.0064t$ , where *t* = temperature (°F).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of HFC-125 in air at the temperature indicated.

Table A.5.5.1(h) HFC-125 Total Flooding Quantity (SI Units)<sup>a</sup>

Temp ( <i>t</i> ) (°C) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (m <sup>3</sup> /kg) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (kg/m <sup>3</sup> ) <sup>b</sup>									
		Design Concentration (% by Volume) <sup>e</sup>									
		7	8	9	10	11	12	13	14	15	16
-45	0.1496	0.5030	0.5811	0.6609	0.7425	0.8260	0.9113	0.9986	1.0879	1.1793	1.2729
-40	0.1534	0.4906	0.5668	0.6446	0.7242	0.8055	0.8888	0.9739	1.0610	1.1502	1.2415
-35	0.1572	0.4788	0.5532	0.6292	0.7069	0.7863	0.8675	0.9506	1.0356	1.1227	1.2118
-30	0.1609	0.4677	0.5404	0.6146	0.6905	0.7681	0.8474	0.9286	1.0116	1.0966	1.1837
-25	0.1646	0.4572	0.5282	0.6007	0.6749	0.7507	0.8283	0.9076	0.9888	1.0719	1.1570
-20	0.1683	0.4472	0.5166	0.5876	0.6602	0.7343	0.8102	0.8878	0.9672	1.0485	1.1317
-15	0.1720	0.4377	0.5056	0.5751	0.6461	0.7187	0.7930	0.8689	0.9466	1.0262	1.1076
-10	0.1756	0.4286	0.4952	0.5632	0.6327	0.7038	0.7765	0.8509	0.9270	1.0049	1.0847
-5	0.1792	0.4199	0.4851	0.5518	0.6199	0.6896	0.7608	0.8337	0.9082	0.9845	1.0627
0	0.1829	0.4116	0.4756	0.5409	0.6077	0.6759	0.7458	0.8172	0.8903	0.9651	1.0417
5	0.1865	0.4037	0.4664	0.5304	0.5959	0.6629	0.7314	0.8014	0.8731	0.9465	1.0216
10	0.1900	0.3961	0.4576	0.5204	0.5847	0.6504	0.7176	0.7863	0.8566	0.9286	1.0023
15	0.1936	0.3888	0.4491	0.5108	0.5739	0.6384	0.7043	0.7718	0.8408	0.9115	0.9838
20	0.1972	0.3817	0.4410	0.5016	0.5635	0.6268	0.6916	0.7578	0.8256	0.8950	0.9660
25	0.2007	0.3750	0.4332	0.4927	0.5535	0.6157	0.6793	0.7444	0.8110	0.8791	0.9489
30	0.2043	0.3685	0.4257	0.4841	0.5439	0.6050	0.6675	0.7315	0.7969	0.8639	0.9324
35	0.2078	0.3622	0.4184	0.4759	0.5347	0.5947	0.6562	0.7190	0.7833	0.8492	0.9165
40	0.2114	0.3561	0.4114	0.4679	0.5257	0.5848	0.6452	0.7070	0.7702	0.8349	0.9012
45	0.2149	0.3503	0.4047	0.4603	0.5171	0.5752	0.6346	0.6954	0.7576	0.8213	0.8864
50	0.2184	0.3446	0.3982	0.4528	0.5088	0.5659	0.6244	0.6842	0.7454	0.8080	0.8721
55	0.2219	0.3392	0.3918	0.4457	0.5007	0.5569	0.6145	0.6733	0.7336	0.7952	0.8583
60	0.2254	0.3339	0.3857	0.4387	0.4929	0.5483	0.6049	0.6628	0.7221	0.7828	0.8449
65	0.2289	0.3288	0.3798	0.4320	0.4853	0.5399	0.5957	0.6527	0.7111	0.7708	0.8320
70	0.2324	0.3238	0.3741	0.4255	0.4780	0.5318	0.5867	0.6429	0.7004	0.7592	0.8195
75	0.2359	0.3190	0.3686	0.4192	0.4709	0.5239	0.5780	0.6333	0.6900	0.7480	0.8073
80	0.2394	0.3144	0.3632	0.4131	0.4641	0.5162	0.5696	0.6241	0.6799	0.7371	0.7956
85	0.2429	0.3099	0.3580	0.4072	0.4574	0.5088	0.5614	0.6151	0.6702	0.7265	0.7841
90	0.2464	0.3055	0.3529	0.4014	0.4509	0.5016	0.5534	0.6064	0.6607	0.7162	0.7730
95	0.2499	0.3012	0.3480	0.3958	0.4447	0.4946	0.5457	0.5980	0.6515	0.7062	0.7623

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup> $W/V$  [agent weight requirements (kg/m<sup>3</sup>)] = kilograms required per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°C)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (m<sup>3</sup>/kg)] = specific volume of HFC-125 vapor can be approximated  $s = 0.1826 + 0.0007t$ , where *t* = temperature (°C).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of HFC-125 in air at the temperature indicated.

Table A.5.5.1(i) HFC-227ea Total Flooding Quantity (U.S. Units)<sup>a</sup>

Temp ( <i>t</i> ) (°F) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (ft <sup>3</sup> /lb) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (lb/ft <sup>3</sup> ) <sup>b</sup>									
		Design Concentration (% by Volume) <sup>e</sup>									
		6	7	8	9	10	11	12	13	14	15
10	1.9264	0.0331	0.0391	0.0451	0.0513	0.0570	0.0642	0.0708	0.0776	0.0845	0.0916
20	1.9736	0.0323	0.0381	0.0441	0.0501	0.0563	0.0626	0.0691	0.0757	0.0825	0.0894
30	2.0210	0.0316	0.0372	0.0430	0.0489	0.0550	0.0612	0.0675	0.0739	0.0805	0.0873
40	2.0678	0.0309	0.0364	0.0421	0.0478	0.0537	0.0598	0.0659	0.0723	0.0787	0.0853
50	2.1146	0.0302	0.0356	0.0411	0.0468	0.0525	0.0584	0.0645	0.0707	0.0770	0.0835
60	2.1612	0.0295	0.0348	0.0402	0.0458	0.0514	0.0572	0.0631	0.0691	0.0753	0.0817
70	2.2075	0.0289	0.0341	0.0394	0.0448	0.0503	0.0560	0.0618	0.0677	0.0737	0.0799
80	2.2538	0.0283	0.0334	0.0386	0.0439	0.0493	0.0548	0.0605	0.0663	0.0722	0.0783
90	2.2994	0.0278	0.0327	0.0378	0.0430	0.0483	0.0538	0.0593	0.0650	0.0708	0.0767
100	2.3452	0.0272	0.0321	0.0371	0.0422	0.0474	0.0527	0.0581	0.0637	0.0694	0.0752
110	2.3912	0.0267	0.0315	0.0364	0.0414	0.0465	0.0517	0.0570	0.0625	0.0681	0.0738
120	2.4366	0.0262	0.0309	0.0357	0.0406	0.0456	0.0507	0.0560	0.0613	0.0668	0.0724
130	2.4820	0.0257	0.0303	0.0350	0.0398	0.0448	0.0498	0.0549	0.0602	0.0656	0.0711
140	2.5272	0.0253	0.0298	0.0344	0.0391	0.0440	0.0489	0.0540	0.0591	0.0644	0.0698
150	2.5727	0.0248	0.0293	0.0338	0.0384	0.0432	0.0480	0.0530	0.0581	0.0633	0.0686
160	2.6171	0.0244	0.0288	0.0332	0.0378	0.0425	0.0472	0.0521	0.0571	0.0622	0.0674
170	2.6624	0.0240	0.0283	0.0327	0.0371	0.0417	0.0464	0.0512	0.0561	0.0611	0.0663
180	2.7071	0.0236	0.0278	0.0321	0.0365	0.0410	0.0457	0.0504	0.0552	0.0601	0.0652
190	2.7518	0.0232	0.0274	0.0316	0.0359	0.0404	0.0449	0.0496	0.0543	0.0592	0.0641
200	2.7954	0.0228	0.0269	0.0311	0.0354	0.0397	0.0442	0.0488	0.0535	0.0582	0.0631

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup> *W/V* [agent weight requirements (lb/ft<sup>3</sup>)] = pounds of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup> *t* [temperature (°F)] = design temperature in the hazard area.

<sup>d</sup> *s* [specific volume (ft<sup>3</sup>/lb)] = specific volume of HFC-227ea vapor can be approximated by  $s = 1.885 + 0.0046t$ , where *t* = temperature (°F).

<sup>e</sup> *C* [concentration (%)] = volumetric concentration of HFC-227ea in air at the temperature indicated.

Table A.5.5.1(j) HFC-227ea Total Flooding Quantity (SI Units)<sup>a</sup>

Temp ( <i>t</i> ) (°C) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (m <sup>3</sup> /kg) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (kg/m <sup>3</sup> ) <sup>b</sup>									
		Design Concentration (% per Volume) <sup>e</sup>									
		6	7	8	9	10	11	12	13	14	15
-10	0.1215	0.5254	0.6196	0.7158	0.8142	0.9147	1.0174	1.1225	1.2301	1.3401	1.4527
-5	0.1241	0.5142	0.6064	0.7005	0.7987	0.8951	0.9957	1.0985	1.2038	1.3114	1.4216
0	0.1268	0.5034	0.5936	0.6858	0.7800	0.8763	0.9748	1.0755	1.1785	1.2839	1.3918
5	0.1294	0.4932	0.5816	0.6719	0.7642	0.8586	0.9550	1.0537	1.1546	1.2579	1.3636
10	0.1320	0.4834	0.5700	0.6585	0.7490	0.8414	0.9360	1.0327	1.1316	1.2328	1.3264
15	0.1347	0.4740	0.5589	0.6457	0.7344	0.8251	0.9178	1.0126	1.1096	1.2089	1.3105
20	0.1373	0.4650	0.5483	0.6335	0.7205	0.8094	0.9004	0.9934	1.0886	1.1859	1.2856
25	0.1399	0.4564	0.5382	0.6217	0.7071	0.7944	0.8837	0.9750	1.0684	1.1640	1.2618
30	0.1425	0.4481	0.5284	0.6104	0.6943	0.7800	0.8676	0.9573	1.0490	1.1428	1.2388
35	0.1450	0.4401	0.5190	0.5996	0.6819	0.7661	0.8522	0.9402	1.0303	1.1224	1.2168
40	0.1476	0.4324	0.5099	0.5891	0.6701	0.7528	0.8374	0.9230	1.0124	1.1029	1.1956
45	0.1502	0.4250	0.5012	0.5790	0.6586	0.7399	0.8230	0.9080	0.9950	1.0840	1.1751
50	0.1527	0.4180	0.4929	0.5694	0.6476	0.7276	0.8093	0.8929	0.9784	1.0660	1.1555
55	0.1553	0.4111	0.4847	0.5600	0.6369	0.7156	0.7960	0.8782	0.9623	1.0484	1.1365
60	0.1578	0.4045	0.4770	0.5510	0.6267	0.7041	0.7832	0.8641	0.9469	1.0316	1.1183
65	0.1604	0.3980	0.4694	0.5423	0.6167	0.6929	0.7707	0.8504	0.9318	1.0152	1.1005
70	0.1629	0.3919	0.4621	0.5338	0.6072	0.6821	0.7588	0.8371	0.9173	0.9994	1.0834
75	0.1654	0.3859	0.4550	0.5257	0.5979	0.6717	0.7471	0.8243	0.9033	0.9841	1.0668
80	0.1679	0.3801	0.4482	0.5178	0.5890	0.6617	0.7360	0.8120	0.8898	0.9694	1.0509
85	0.1704	0.3745	0.4416	0.5102	0.5803	0.6519	0.7251	0.8000	0.8767	0.9551	1.0354
90	0.1730	0.3690	0.4351	0.5027	0.5717	0.6423	0.7145	0.7883	0.8638	0.9411	1.0202

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup> $W/V$  [agent weight requirements (kg/m<sup>3</sup>)] = kilograms of agent per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°C)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (m<sup>3</sup>/kg)] = specific volume of HFC-227ea vapor can be approximated by  $s = 0.1269 + 0.0005t$ , where *t* = temperature (°C).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of HFC-227ea in air at the temperature indicated.

Table A.5.5.1(k) HFC-23 Total Flooding Quantity (U.S. Units)<sup>a</sup>

Temp ( <i>t</i> ) (°F) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (ft <sup>3</sup> /lb) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (lb/ft <sup>3</sup> ) <sup>b</sup>									
		Design Concentration (% by Volume) <sup>e</sup>									
		10	12	14	15	16	17	18	19	20	22
-70	3.9636	0.0280	0.0344	0.0411	0.0445	0.0481	0.0517	0.0554	0.0592	0.0631	0.0712
-60	4.0752	0.0273	0.0335	0.0399	0.0433	0.0467	0.0503	0.0539	0.0576	0.0613	0.0692
-50	4.1859	0.0265	0.0326	0.0389	0.0422	0.0455	0.0489	0.0524	0.0560	0.0597	0.0674
-40	4.2959	0.0259	0.0317	0.0379	0.0411	0.0443	0.0477	0.0511	0.0546	0.0582	0.0657
-30	4.4053	0.0252	0.0310	0.0370	0.0401	0.0432	0.0465	0.0498	0.0532	0.0567	0.0640
-20	4.5151	0.0246	0.0302	0.0361	0.0391	0.0422	0.0454	0.0486	0.0520	0.0554	0.0625
-10	4.6225	0.0240	0.0295	0.0352	0.0382	0.0412	0.0443	0.0475	0.0507	0.0541	0.0610
0	4.7305	0.0235	0.0288	0.0344	0.0373	0.0403	0.0433	0.0464	0.0496	0.0528	0.0596
10	4.8383	0.0230	0.0282	0.0336	0.0365	0.0394	0.0423	0.0454	0.0485	0.0517	0.0583
20	4.9457	0.0225	0.0276	0.0329	0.0357	0.0385	0.0414	0.0444	0.0474	0.0505	0.0570
30	5.0529	0.0220	0.0270	0.0322	0.0349	0.0377	0.0405	0.0434	0.0464	0.0495	0.0558
40	5.1599	0.0215	0.0264	0.0315	0.0342	0.0369	0.0397	0.0425	0.0455	0.0485	0.0547
50	5.2666	0.0211	0.0259	0.0309	0.0335	0.0362	0.0389	0.0417	0.0445	0.0475	0.0536
60	5.3733	0.0207	0.0254	0.0303	0.0328	0.0354	0.0381	0.0409	0.0437	0.0465	0.0525
70	5.4797	0.0203	0.0249	0.0297	0.0322	0.0348	0.0374	0.0401	0.0428	0.0456	0.0515
80	5.5860	0.0199	0.0244	0.0291	0.0316	0.0341	0.0367	0.0393	0.0420	0.0448	0.0505
90	5.6922	0.0195	0.0240	0.0286	0.0310	0.0335	0.0360	0.0386	0.0412	0.0439	0.0496
100	5.7983	0.0192	0.0235	0.0281	0.0304	0.0329	0.0353	0.0379	0.0405	0.0431	0.0486
110	5.9043	0.0188	0.0231	0.0276	0.0299	0.0323	0.0347	0.0372	0.0397	0.0423	0.0478
120	6.0102	0.0185	0.0227	0.0271	0.0294	0.0317	0.0341	0.0365	0.0390	0.0416	0.0469
130	6.1160	0.0182	0.0223	0.0266	0.0289	0.0311	0.0335	0.0359	0.0384	0.0409	0.0461
140	6.2217	0.0179	0.0219	0.0262	0.0284	0.0306	0.0329	0.0353	0.0377	0.0402	0.0453
150	6.3274	0.0176	0.0216	0.0257	0.0279	0.0301	0.0324	0.0347	0.0371	0.0395	0.0446
160	6.4330	0.0173	0.0212	0.0253	0.0274	0.0296	0.0318	0.0341	0.0365	0.0389	0.0438
170	6.5385	0.0170	0.0209	0.0249	0.0270	0.0291	0.0313	0.0336	0.0359	0.0382	0.0431
180	6.6440	0.0167	0.0205	0.0245	0.0266	0.0287	0.0308	0.0330	0.0353	0.0376	0.0424
190	6.7494	0.0165	0.0202	0.0241	0.0261	0.0282	0.0303	0.0325	0.0348	0.0370	0.0418

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup> $W/V$  [agent weight requirements (lb/ft<sup>3</sup>)] = pounds of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°F)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (ft<sup>3</sup>/lb)] = specific volume of HFC-23 vapor can be approximated by  $s = 4.7264 + 0.0107t$ , where *t* = temperature (°F).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of HFC-23 in air at the temperature indicated.

Table A.5.5.1(l) HFC-23 Total Flooding Quantity (SI Units)<sup>a</sup>

Temp ( <i>t</i> ) (°C) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (m <sup>3</sup> /kg) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (kg/m <sup>3</sup> ) <sup>b</sup>										
		Design Concentration (% by Volume) <sup>e</sup>										
		10	12	14	15	16	17	18	19	20	22	24
-60	0.2432	0.4568	0.5606	0.6693	0.7255	0.7831	0.8421	0.9025	0.9644	1.0278	1.1596	1.2983
-55	0.2495	0.4453	0.5465	0.6524	0.7072	0.7633	0.8208	0.8797	0.9400	1.0018	1.1303	1.2655
-50	0.2558	0.4344	0.5331	0.6364	0.6899	0.7446	0.8007	0.8581	0.9170	0.9773	1.1026	1.2345
-45	0.2620	0.4241	0.5205	0.6213	0.6735	0.7270	0.7817	0.8378	0.8953	0.9542	1.0765	1.2053
-40	0.2682	0.4143	0.5085	0.6070	0.6580	0.7102	0.7637	0.8185	0.8746	0.9322	1.0517	1.1775
-35	0.2743	0.4050	0.4971	0.5934	0.6433	0.6943	0.7466	0.8002	0.8551	0.9113	1.0281	1.1511
-30	0.2805	0.3962	0.4862	0.5805	0.6292	0.6792	0.7303	0.7827	0.8364	0.8914	1.0057	1.1260
-25	0.2866	0.3878	0.4759	0.5681	0.6158	0.6647	0.7148	0.7661	0.8186	0.8724	0.9843	1.1020
-20	0.2926	0.3797	0.4660	0.5563	0.6031	0.6509	0.6999	0.7502	0.8016	0.8544	0.9639	1.0792
-15	0.2987	0.3720	0.4566	0.5450	0.5908	0.6377	0.6857	0.7349	0.7853	0.8370	0.9443	1.0573
-10	0.3047	0.3646	0.4475	0.5342	0.5791	0.6251	0.6721	0.7203	0.7698	0.8204	0.9256	1.0363
-5	0.3108	0.3575	0.4388	0.5238	0.5679	0.6129	0.6591	0.7064	0.7548	0.8045	0.9076	1.0162
0	0.3168	0.3508	0.4305	0.5139	0.5571	0.6013	0.6466	0.6929	0.7405	0.7892	0.8904	0.9969
5	0.3228	0.3442	0.4225	0.5043	0.5467	0.5901	0.6345	0.6800	0.7267	0.7745	0.8738	0.9783
10	0.3288	0.3379	0.4147	0.4951	0.5367	0.5793	0.6229	0.6676	0.7134	0.7604	0.8578	0.9605
15	0.3348	0.3319	0.4073	0.4863	0.5271	0.5690	0.6118	0.6557	0.7007	0.7468	0.8425	0.9433
20	0.3408	0.3261	0.4002	0.4777	0.5179	0.5590	0.6011	0.6442	0.6884	0.7337	0.8277	0.9267
25	0.3467	0.3204	0.3933	0.4695	0.5089	0.5493	0.5907	0.6331	0.6765	0.7210	0.8134	0.9107
30	0.3527	0.3150	0.3866	0.4616	0.5003	0.5401	0.5807	0.6224	0.6651	0.7088	0.7997	0.8953
35	0.3587	0.3098	0.3802	0.4539	0.4920	0.5311	0.5711	0.6120	0.6540	0.6970	0.7864	0.8804
40	0.3646	0.3047	0.3740	0.4465	0.4840	0.5224	0.5617	0.6020	0.6433	0.6856	0.7735	0.8661
45	0.3706	0.2998	0.3680	0.4393	0.4762	0.5140	0.5527	0.5923	0.6330	0.6746	0.7611	0.8521
50	0.3765	0.2951	0.3622	0.4323	0.4687	0.5059	0.5440	0.5830	0.6230	0.6640	0.7491	0.8387
55	0.3825	0.2905	0.3565	0.4256	0.4614	0.4980	0.5355	0.5739	0.6133	0.6536	0.7374	0.8257
60	0.3884	0.2861	0.3511	0.4191	0.4543	0.4904	0.5273	0.5652	0.6039	0.6436	0.7262	0.8130
65	0.3944	0.2818	0.3458	0.4128	0.4475	0.4830	0.5194	0.5566	0.5948	0.6340	0.7152	0.8008
70	0.4003	0.2776	0.3407	0.4067	0.4409	0.4759	0.5117	0.5484	0.5860	0.6246	0.7046	0.7889

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup> $W/V$  [agent weight requirements (kg/m<sup>3</sup>)] = kilograms required per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°C)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (m<sup>3</sup>/kg)] = specific volume of HFC-23 vapor can be approximated by  $s = 0.3164 + 0.0012t$ , where *t* = temperature (°C).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of HFC-23 in air at the temperature indicated.

Table A.5.5.1(m) HFC-236fa Total Flooding Quantity (U.S. Units)<sup>a</sup>

Temp (t) (°F) <sup>c</sup>	Specific Vapor Volume (s) (ft <sup>3</sup> /lb) <sup>d</sup>	Weight Requirements of Hazard Volume, W/V (lb/ft <sup>3</sup> ) <sup>b</sup>									
		Design Concentration (% by Volume) <sup>e</sup>									
		5	6	7	8	9	10	11	12	13	14
30	2.2454	0.0234	0.0284	0.0335	0.0387	0.0440	0.0495	0.0550	0.0607	0.0665	0.0725
40	2.2997	0.0229	0.0278	0.0327	0.0378	0.0430	0.0483	0.0537	0.0593	0.0650	0.0708
50	2.3533	0.0224	0.0271	0.0320	0.0370	0.0420	0.0472	0.0525	0.0579	0.0635	0.0692
60	2.4064	0.0219	0.0265	0.0313	0.0361	0.0411	0.0462	0.0514	0.0567	0.0621	0.0676
70	2.4591	0.0214	0.0260	0.0306	0.0354	0.0402	0.0452	0.0503	0.0555	0.0608	0.0662
80	2.5114	0.0210	0.0254	0.0300	0.0346	0.0394	0.0442	0.0492	0.0543	0.0595	0.0648
90	2.5633	0.0205	0.0249	0.0294	0.0339	0.0386	0.0433	0.0482	0.0532	0.0583	0.0635
100	2.6150	0.0201	0.0244	0.0288	0.0333	0.0378	0.0425	0.0473	0.0521	0.0571	0.0623
110	2.6663	0.0197	0.0239	0.0282	0.0326	0.0371	0.0417	0.0464	0.0511	0.0560	0.0611
120	2.7174	0.0194	0.0235	0.0277	0.0320	0.0364	0.0409	0.0455	0.0502	0.0550	0.0599
130	2.7683	0.0190	0.0231	0.0272	0.0314	0.0357	0.0401	0.0446	0.0493	0.0540	0.0588
140	2.8190	0.0187	0.0226	0.0267	0.0308	0.0351	0.0394	0.0438	0.0484	0.0530	0.0577
150	2.8695	0.0183	0.0222	0.0262	0.0303	0.0345	0.0387	0.0431	0.0475	0.0521	0.0567
160	2.9199	0.0180	0.0219	0.0258	0.0298	0.0339	0.0381	0.0423	0.0467	0.0512	0.0558
170	2.9701	0.0177	0.0215	0.0253	0.0293	0.0333	0.0374	0.0416	0.0459	0.0503	0.0548
180	3.0202	0.0174	0.0211	0.0249	0.0288	0.0327	0.0368	0.0409	0.0452	0.0495	0.0539
190	3.0702	0.0171	0.0208	0.0245	0.0283	0.0322	0.0362	0.0403	0.0444	0.0487	0.0530
200	3.1201	0.0169	0.0205	0.0241	0.0279	0.0317	0.0356	0.0396	0.0437	0.0479	0.0522

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>W/V [agent weight requirements (lb/ft<sup>3</sup>)] = pounds of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>t [temperature (°F)] = design temperature in the hazard area.

<sup>d</sup>s [specific volume (ft<sup>3</sup>/lb)] = specific volume of HFC-236fa vapor can be approximated by  $s = 2.0983 + 0.0051t$ , where  $t$  = temperature (°F).

<sup>e</sup>C [concentration (%)] = volumetric concentration of HFC-236fa in air at the temperature indicated.

Table A.5.5.1(n) HFC-236fa Total Flooding Quantity (SI Units)<sup>a</sup>

Temp ( <i>t</i> ) (°C)	Specific Vapor Volume ( <i>s</i> ) (m <sup>3</sup> /kg) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (kg/m <sup>3</sup> ) <sup>b</sup>									
		Design Concentration (% by volume) <sup>c</sup>									
		5	6	7	8	9	10	11	12	13	14
0	0.1409	0.3736	0.4531	0.5344	0.6173	0.7021	0.7888	0.8774	0.9681	1.0608	1.1557
5	0.1439	0.3658	0.4436	0.5231	0.6043	0.6873	0.7721	0.8589	0.9476	1.0384	1.1313
10	0.1469	0.3583	0.4345	0.5123	0.5919	0.6732	0.7563	0.8413	0.9282	1.0171	1.1081
15	0.1499	0.3511	0.4258	0.5021	0.5801	0.6598	0.7412	0.8245	0.9097	0.9968	1.0860
20	0.1529	0.3443	0.4176	0.4924	0.5689	0.6470	0.7269	0.8086	0.8921	0.9775	1.0650
25	0.1558	0.3378	0.4097	0.4831	0.5581	0.6348	0.7131	0.7932	0.8752	0.9590	1.0448
30	0.1587	0.3316	0.4021	0.4742	0.5478	0.6231	0.7000	0.7787	0.8591	0.9414	1.0256
35	0.1616	0.3256	0.3949	0.4657	0.5380	0.6119	0.6874	0.7646	0.8436	0.9244	1.0071
40	0.1645	0.3199	0.3880	0.4575	0.5285	0.6011	0.6753	0.7512	0.8288	0.9082	0.9894
45	0.1674	0.3144	0.3813	0.4496	0.5194	0.5908	0.6637	0.7383	0.8145	0.8926	0.9724
50	0.1703	0.3091	0.3749	0.4420	0.5107	0.5808	0.6525	0.7258	0.8008	0.8775	0.9560
55	0.1731	0.3040	0.3687	0.4347	0.5022	0.5712	0.6417	0.7138	0.7876	0.8630	0.9402
60	0.1760	0.2991	0.3627	0.4277	0.4941	0.5620	0.6313	0.7023	0.7748	0.8491	0.9250
65	0.1788	0.2943	0.3569	0.4209	0.4863	0.5531	0.6214	0.6912	0.7626	0.8356	0.9104
70	0.1817	0.2897	0.3514	0.4143	0.4787	0.5444	0.6116	0.6804	0.7507	0.8226	0.8961
75	0.1845	0.2853	0.3460	0.4080	0.4714	0.5361	0.6023	0.6700	0.7392	0.8100	0.8824
80	0.1873	0.2810	0.3408	0.4019	0.4643	0.5280	0.5932	0.6599	0.7280	0.7978	0.8691
85	0.1901	0.2768	0.3358	0.3959	0.4574	0.5202	0.5845	0.6501	0.7173	0.7860	0.8563
90	0.1929	0.2728	0.3309	0.3902	0.4508	0.5127	0.5760	0.6407	0.7069	0.7746	0.8439
95	0.1957	0.2689	0.3261	0.3846	0.4443	0.5053	0.5677	0.6315	0.6968	0.7635	0.8318

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>*W/V* [agent weight requirements (kg/m<sup>3</sup>)] = kilograms of agent required per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°C)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (m<sup>3</sup>/kg)] = specific volume of HFC-236fa vapor can be approximated by  $s = 0.1413 + 0.0006t$ , where *t* = temperature (°C).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of HFC-236fa in air at the temperature indicated.

Table A.5.5.1(o) FIC-13II Total Flooding Quantity (U.S. Units)<sup>a</sup>

Temp ( <i>t</i> ) (°F) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (ft <sup>3</sup> /lb) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (lb/ft <sup>3</sup> ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		3	4	5	6	7	8	9	10
0	1.6826	0.0184	0.0248	0.0313	0.0379	0.0447	0.0517	0.0588	0.0660
10	1.7264	0.0179	0.0241	0.0305	0.0370	0.0436	0.0504	0.0573	0.0644
20	1.7703	0.0175	0.0235	0.0297	0.0361	0.0425	0.0491	0.0559	0.0628
30	1.8141	0.0170	0.0230	0.0290	0.0352	0.0415	0.0479	0.0545	0.0612
40	1.8580	0.0166	0.0224	0.0283	0.0344	0.0405	0.0468	0.0532	0.0598
50	1.9019	0.0163	0.0219	0.0277	0.0336	0.0396	0.0457	0.0520	0.0584
60	1.9457	0.0159	0.0214	0.0270	0.0328	0.0387	0.0447	0.0508	0.0571
70	1.9896	0.0155	0.0209	0.0265	0.0321	0.0378	0.0437	0.0497	0.0558
80	2.0335	0.0152	0.0205	0.0259	0.0314	0.0370	0.0428	0.0486	0.0546
90	2.0773	0.0149	0.0201	0.0253	0.0307	0.0362	0.0419	0.0476	0.0535
100	2.1212	0.0146	0.0196	0.0248	0.0301	0.0355	0.0410	0.0466	0.0524
110	2.1650	0.0143	0.0192	0.0243	0.0295	0.0348	0.0402	0.0457	0.0513
120	2.2089	0.0140	0.0189	0.0238	0.0289	0.0341	0.0394	0.0448	0.0503
130	2.2528	0.0137	0.0185	0.0234	0.0283	0.0334	0.0386	0.0439	0.0493
140	2.2966	0.0135	0.0181	0.0229	0.0278	0.0328	0.0379	0.0431	0.0484
150	2.3405	0.0132	0.0178	0.0225	0.0273	0.0322	0.0372	0.0423	0.0475
160	2.3843	0.0130	0.0175	0.0221	0.0268	0.0316	0.0365	0.0415	0.0466
170	2.4282	0.0127	0.0172	0.0217	0.0263	0.0310	0.0358	0.0407	0.0458
180	2.4721	0.0125	0.0169	0.0213	0.0258	0.0304	0.0352	0.0400	0.0449
190	2.5159	0.0123	0.0166	0.0209	0.0254	0.0299	0.0346	0.0393	0.0442
200	2.5598	0.0121	0.0163	0.0206	0.0249	0.0294	0.0340	0.0386	0.0434

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>*W/V* [agent weight requirements (lb/ft<sup>3</sup>)] = pounds of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°F)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (ft<sup>3</sup>/lb)] = specific volume of FIC-13II vapor can be approximated by  $s = 1.683 + 0.0044t$ , where  $t$  = temperature (°F).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of FIC-13II in air at the temperature indicated.

Table A.5.5.1(p) FIC-131I Total Flooding Quantity (SI Units)<sup>a</sup>

Temp ( <i>t</i> ) (°C) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (m <sup>3</sup> /kg) <sup>d</sup>	Weight Requirements of Hazard Volume, <i>W/V</i> (kg/m <sup>3</sup> ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		3	4	5	6	7	8	9	10
-40	0.0938	0.3297	0.4442	0.5611	0.6805	0.8024	0.9270	1.0544	1.1846
-30	0.0988	0.3130	0.4217	0.5327	0.6461	0.7618	0.8801	1.0010	1.1246
-20	0.1038	0.2980	0.4014	0.5070	0.6149	0.7251	0.8377	0.9528	1.0704
-10	0.1088	0.2843	0.3830	0.4837	0.5867	0.6918	0.7992	0.9090	1.0212
0	0.1138	0.2718	0.3661	0.4625	0.5609	0.6614	0.7641	0.8691	0.9764
10	0.1188	0.2603	0.3507	0.4430	0.5373	0.6336	0.7320	0.8325	0.9353
20	0.1238	0.2498	0.3366	0.4251	0.5156	0.6080	0.7024	0.7989	0.8975
30	0.1288	0.2401	0.3235	0.4086	0.4956	0.5844	0.6751	0.7679	0.8627
40	0.1338	0.2311	0.3114	0.3934	0.4771	0.5625	0.6499	0.7392	0.8304
50	0.1388	0.2228	0.3002	0.3792	0.4599	0.5423	0.6265	0.7125	0.8005
60	0.1438	0.2151	0.2898	0.3660	0.4439	0.5234	0.6047	0.6878	0.7727
70	0.1488	0.2078	0.2800	0.3537	0.4290	0.5058	0.5844	0.6647	0.7467
80	0.1538	0.2011	0.2709	0.3422	0.4150	0.4894	0.5654	0.6431	0.7224
90	0.1588	0.1948	0.2624	0.3314	0.4020	0.4740	0.5476	0.6228	0.6997
100	0.1638	0.1888	0.2544	0.3213	0.3897	0.4595	0.5309	0.6038	0.6783

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>*W/V* [agent weight requirements (kg/m<sup>3</sup>)] = kilograms required per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°C)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (m<sup>3</sup>/kg)] = specific volume of FIC-131I vapor can be approximated by  $s = 0.1138 + 0.0005t$ , where *t* = temperature (°C).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of FIC-131I in air at the temperature indicated.

Table A.5.5.1(q) HFC Blend B Total Flooding Quantity Table (U.S. Units)<sup>a</sup>

Temp (t) (°F) <sup>c</sup>	Specific Vapor Volume (s) (ft <sup>3</sup> /lb) <sup>d</sup>	Weight Requirement of Hazard Volume W/V (lb/ft <sup>3</sup> ) <sup>b</sup>								
		Concentration (% by volume) <sup>e</sup>								
		8	9	10	11	12	13	14	15	16
-40	2.9642	0.0293	0.0334	0.0375	0.0417	0.0460	0.0504	0.0549	0.0595	0.0643
-30	3.0332	0.0287	0.0326	0.0366	0.0407	0.0450	0.0493	0.0537	0.0582	0.0628
-20	3.1022	0.0280	0.0319	0.0358	0.0398	0.0440	0.0482	0.0525	0.0569	0.0614
-10	3.1712	0.0274	0.0312	0.0350	0.0390	0.0430	0.0471	0.0513	0.0556	0.0601
0	3.2402	0.0268	0.0305	0.0343	0.0381	0.0421	0.0461	0.0502	0.0545	0.0588
10	3.3092	0.0263	0.0299	0.0336	0.0373	0.0412	0.0452	0.0492	0.0533	0.0576
20	3.3782	0.0257	0.0293	0.0329	0.0366	0.0404	0.0442	0.0482	0.0522	0.0564
30	3.4472	0.0252	0.0287	0.0322	0.0359	0.0396	0.0433	0.0472	0.0512	0.0553
40	3.5162	0.0247	0.0281	0.0316	0.0352	0.0388	0.0425	0.0463	0.0502	0.0542
50	3.5852	0.0243	0.0276	0.0310	0.0345	0.0380	0.0417	0.0454	0.0492	0.0531
60	3.6542	0.0238	0.0271	0.0304	0.0338	0.0373	0.0409	0.0445	0.0483	0.0521
70	3.7232	0.0234	0.0266	0.0298	0.0332	0.0366	0.0401	0.0437	0.0474	0.0512
80	3.7922	0.0229	0.0261	0.0293	0.0326	0.0360	0.0394	0.0429	0.0465	0.0502
90	3.8612	0.0225	0.0256	0.0288	0.0320	0.0353	0.0387	0.0422	0.0457	0.0493
100	3.9302	0.0221	0.0252	0.0283	0.0314	0.0347	0.0380	0.0414	0.0449	0.0485
110	3.9992	0.0217	0.0247	0.0278	0.0309	0.0341	0.0374	0.0407	0.0441	0.0476
120	4.0682	0.0214	0.0243	0.0273	0.0304	0.0335	0.0367	0.0400	0.0434	0.0468
130	4.1372	0.0210	0.0239	0.0269	0.0299	0.0330	0.0361	0.0393	0.0427	0.0460
140	4.2062	0.0207	0.0235	0.0264	0.0294	0.0324	0.0355	0.0387	0.0420	0.0453
150	4.2752	0.0203	0.0231	0.0260	0.0289	0.0319	0.0350	0.0381	0.0413	0.0446
160	4.3442	0.0200	0.0228	0.0256	0.0285	0.0314	0.0344	0.0375	0.0406	0.0438
170	4.4132	0.0197	0.0224	0.0252	0.0280	0.0309	0.0339	0.0369	0.0400	0.0432
180	4.4822	0.0194	0.0221	0.0248	0.0276	0.0304	0.0333	0.0363	0.0394	0.0425
190	4.5512	0.0191	0.0217	0.0244	0.0272	0.0300	0.0328	0.0358	0.0388	0.0419
200	4.6202	0.0188	0.0214	0.0240	0.0268	0.0295	0.0323	0.0352	0.0382	0.0412

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>W/V [agent weight requirement (lb/ft<sup>3</sup>)] = pounds of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>t [temperature (°F)] = the design temperature in the hazard area.

<sup>d</sup>s [specific volume (ft<sup>3</sup>/lb)] = specific volume of HFC Blend B vapor can be approximated by  $s = 3.2402 + 0.0069t$ , where  $t$  = temperature (°F).

<sup>e</sup>C [concentration (%)] = volumetric concentration of HFC Blend B in air at the temperature indicated.

Table A.5.5.1(r) HFC Blend B Total Flooding Quantity Table (SI Units)<sup>a</sup>

Temp ( <i>t</i> ) (°C) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (m <sup>3</sup> /kg) <sup>d</sup>	Weight Requirement of Hazard Volume <i>W/V</i> (kg/m <sup>3</sup> ) <sup>b</sup>								
		Concentration (% by volume) <sup>e</sup>								
		8	9	10	11	12	13	14	15	16
-40	0.1812	0.4799	0.5458	0.6132	0.6821	0.7526	0.8246	0.8984	0.9739	1.0512
-30	0.1902	0.4572	0.5200	0.5842	0.6498	0.7169	0.7856	0.8559	0.9278	1.0015
-20	0.1992	0.4365	0.4965	0.5578	0.6205	0.6846	0.7501	0.8172	0.8859	0.9562
-10	0.2082	0.4177	0.4750	0.5337	0.5936	0.6550	0.7177	0.7819	0.8476	0.9149
0	0.2172	0.4004	0.4553	0.5116	0.5690	0.6278	0.6880	0.7495	0.8125	0.8770
10	0.2262	0.3844	0.4372	0.4912	0.5464	0.6028	0.6606	0.7197	0.7802	0.8421
20	0.2352	0.3697	0.4205	0.4724	0.5255	0.5798	0.6353	0.6921	0.7503	0.8098
30	0.2442	0.3561	0.4050	0.4550	0.5061	0.5584	0.6119	0.6666	0.7226	0.7800
40	0.2532	0.3434	0.3906	0.4388	0.4881	0.5386	0.5901	0.6429	0.6970	0.7523
50	0.2622	0.3316	0.3772	0.4238	0.4714	0.5201	0.5699	0.6209	0.6730	0.7265
60	0.2712	0.3206	0.3647	0.4097	0.4557	0.5028	0.5510	0.6003	0.6507	0.7023
70	0.2802	0.3103	0.3530	0.3965	0.4411	0.4867	0.5333	0.5810	0.6298	0.6798
80	0.2892	0.3007	0.3420	0.3842	0.4274	0.4715	0.5167	0.5629	0.6102	0.6586
90	0.2982	0.2916	0.3317	0.3726	0.4145	0.4573	0.5011	0.5459	0.5918	0.6388
100	0.3072	0.2831	0.3219	0.3617	0.4023	0.4439	0.4864	0.5299	0.5744	0.6200
110	0.3162	0.2750	0.3128	0.3514	0.3909	0.4313	0.4726	0.5148	0.5581	0.6024
120	0.3252	0.2674	0.3041	0.3417	0.3801	0.4193	0.4595	0.5006	0.5427	0.5857
130	0.3342	0.2602	0.2959	0.3325	0.3698	0.4080	0.4471	0.4871	0.5280	0.5699
140	0.3432	0.2534	0.2882	0.3238	0.3601	0.3973	0.4354	0.4743	0.5142	0.5550
150	0.3522	0.2469	0.2808	0.3155	0.3509	0.3872	0.4243	0.4622	0.5011	0.5408
160	0.3612	0.2407	0.2738	0.3076	0.3422	0.3775	0.4137	0.4507	0.4886	0.5273
170	0.3702	0.2349	0.2672	0.3001	0.3339	0.3684	0.4036	0.4397	0.4767	0.5145
180	0.3792	0.2293	0.2608	0.2930	0.3259	0.3596	0.3941	0.4293	0.4654	0.5023
190	0.3882	0.2240	0.2548	0.2862	0.3184	0.3513	0.3849	0.4193	0.4546	0.4907
200	0.3972	0.2189	0.2490	0.2797	0.3112	0.3433	0.3762	0.4098	0.4443	0.4795

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>*W/V* [agent weight requirement (kg/m<sup>3</sup>)] = kilograms of agent required per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$W = \frac{V}{s} \left( \frac{C}{100 - C} \right)$$

<sup>c</sup>*t* [temperature (°C)] = design temperature in the hazard area.

<sup>d</sup>*s* [specific volume (m<sup>3</sup>/kg)] = specific volume of HFC Blend B vapor can be approximated by  $s = 0.2172 + 0.0009t$ , where  $t$  = temperature (°C).

<sup>e</sup>*C* [concentration (%)] = volumetric concentration of HFC Blend B in air at the temperature indicated.

**A.5.5.2** The volume of inert gas clean agent required to develop a given concentration will be greater than the final volume remaining in the same enclosure. In most cases, the inert gas clean agent must be applied in a manner that promotes progressive mixing of the atmosphere. As the clean agent is injected, the displaced atmosphere is exhausted freely from the enclosure through small openings or through special vents. Some inert gas clean agent is therefore lost with the vented atmosphere. This loss becomes greater at high concentrations. This method of application is called “free efflux” flooding.

Under these conditions, the volume of inert gas clean agent required to develop a given concentration in the atmosphere is expressed by one of the following equations:

$$e^x = \frac{100}{100 - \% \text{ IG}} \quad [\text{A.5.5.2a}]$$

or

$$X = 2.303 \log_{10} \frac{100}{100 - \% \text{ IG}} \quad [\text{A.5.5.2b}]$$

where:

% IG = volume percent of inert gas

X = volume of inert gas added per volume of space

Table A.5.5.2(a) through Table A.5.5.2(h) provide the quantity of clean agent needed to achieve design concentration.

**Table A.5.5.2(a) IG-01 Total Flooding Quantity (U.S. Units)<sup>a</sup>**

Temp (t) (°F) <sup>c</sup>	Specific Vapor Volume (s) (ft <sup>3</sup> /lb) <sup>d</sup>	Volume Requirements of Agent per Unit Volume of Hazard ( $V_{\text{agent}}/V_{\text{enclosure}}$ ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		34	37	40	42	47	49	58	62
-40	7.67176	0.524	0.583	0.645	0.688	0.801	0.850	1.095	1.221
-30	7.85457	0.512	0.570	0.630	0.672	0.783	0.830	1.069	1.193
-20	8.03738	0.501	0.557	0.615	0.656	0.765	0.811	1.045	1.166
-10	8.22019	0.489	0.544	0.602	0.642	0.748	0.793	1.022	1.140
0	8.40299	0.479	0.532	0.589	0.628	0.732	0.776	1.000	1.115
10	8.58580	0.469	0.521	0.576	0.614	0.716	0.759	0.978	1.091
20	8.76861	0.459	0.510	0.564	0.602	0.701	0.744	0.958	1.088
30	8.95142	0.449	0.500	0.553	0.589	0.687	0.728	0.938	1.047
40	9.13422	0.440	0.490	0.541	0.577	0.673	0.714	0.920	1.026
50	9.31703	0.432	0.480	0.531	0.566	0.660	0.700	0.902	1.006
60	9.49984	0.424	0.471	0.521	0.555	0.647	0.686	0.884	0.986
70	9.68265	0.416	0.462	0.511	0.545	0.635	0.673	0.868	0.958
80	9.86545	0.408	0.453	0.501	0.535	0.623	0.661	0.851	0.950
90	10.04826	0.400	0.445	0.492	0.525	0.612	0.649	0.836	0.932
100	10.23107	0.393	0.437	0.483	0.516	0.601	0.637	0.821	0.916
110	10.41988	0.386	0.430	0.475	0.506	0.590	0.626	0.807	0.900
120	10.59668	0.380	0.422	0.467	0.498	0.580	0.615	0.793	0.884
130	10.77949	0.373	0.415	0.459	0.489	0.570	0.605	0.779	0.869
140	10.96230	0.367	0.408	0.451	0.481	0.561	0.595	0.766	0.855
150	11.14511	0.361	0.401	0.444	0.473	0.552	0.585	0.754	0.841
160	11.32791	0.355	0.395	0.437	0.466	0.543	0.576	0.742	0.827
170	11.51072	0.350	0.389	0.430	0.458	0.534	0.566	0.730	0.814
180	11.69353	0.344	0.383	0.423	0.451	0.526	0.558	0.718	0.801
190	11.87634	0.339	0.377	0.416	0.444	0.518	0.549	0.707	0.789
200	12.05914	0.334	0.371	0.410	0.437	0.510	0.541	0.697	0.777

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>X [agent volume requirements (ft<sup>3</sup>/ft<sup>3</sup>)] = volume of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$X = 2.303 \times \left( \frac{s_0}{s} \right) \times \log_{10} \left( \frac{100}{100 - C} \right) = \left( \frac{s_0}{s} \right) \times \ln \left( \frac{100}{100 - C} \right)$$

where:

$s_0$  [specific volume (ft<sup>3</sup>/lb)] = specific volume of inert gas agent at 70°F and 14.7 psi absolute

$t$  [temperature (°F)] = design temperature in the hazard area.

$s$  [specific volume (ft<sup>3</sup>/lb)] = specific volume of IG-01 vapor can be approximated by  $s = 8.514 + 0.0185t$ , where  $t$  = temperature (°F).

$C$  [concentration (%)] = volumetric concentration of IG-01 in air at the temperature indicated.

Table A.5.5.2(b) IG-01 Total Flooding Quantity (SI Units)<sup>a</sup>

Temp (t) (°C) <sup>c</sup>	Specific Vapor Volume (s) (m <sup>3</sup> /kg) <sup>d</sup>	Volume Requirements of Agent per Unit Volume of Hazard ( $V_{\text{agent}}/V_{\text{enclosure}}$ ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		34	37	40	42	47	49	58	62
-20	0.5201	0.4812	0.5350	0.5915	0.6308	0.7352	0.7797	1.0046	1.1205
-10	0.5406	0.4629	0.5147	0.5691	0.6068	0.7073	0.7501	0.9664	1.0779
0	0.5612	0.4459	0.4950	0.5482	0.5846	0.6814	0.7226	0.9310	1.0384
10	0.5817	0.4302	0.4784	0.5289	0.5640	0.6573	0.6971	0.8981	1.0018
15	0.5920	0.4227	0.4701	0.5197	0.5542	0.6459	0.6850	0.8828	0.9844
20	0.6023	0.4155	0.4620	0.5108	0.5447	0.6349	0.6733	0.8675	0.9676
30	0.6228	0.4018	0.4468	0.4940	0.5268	0.6139	0.6511	0.8389	0.9357
35	0.6331	0.3953	0.4395	0.4860	0.5182	0.6040	0.6406	0.8253	0.9205
40	0.6434	0.3890	0.4325	0.4762	0.5099	0.5943	0.6303	0.8121	0.9058
50	0.6639	0.3769	0.4191	0.4634	0.4942	0.5759	0.6108	0.7870	0.8778
60	0.6845	0.3656	0.4066	0.4495	0.4793	0.5587	0.5925	0.7633	0.8514
70	0.7050	0.3550	0.3947	0.4304	0.4654	0.5424	0.5752	0.7411	0.8200
80	0.7256	0.3449	0.3835	0.4240	0.4522	0.5270	0.5589	0.7201	0.8032
90	0.7461	0.3354	0.3730	0.4124	0.4397	0.5125	0.5436	0.7003	0.7811
100	0.7666	0.3264	0.3630	0.4013	0.4270	0.4988	0.5290	0.6815	0.7601
110	0.7872	0.3179	0.3535	0.3908	0.4168	0.4857	0.5152	0.6637	0.7403
120	0.8077	0.3098	0.3445	0.3809	0.4062	0.4734	0.5021	0.6468	0.7215

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup> $X$  [agent volume requirements (m<sup>3</sup>/m<sup>3</sup>)] = volume of agent required per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$X = 2.303 \times \left( \frac{s_0}{s} \right) \times \log_{10} \left( \frac{100}{100 - C} \right) = \left( \frac{s_0}{s} \right) \times \ln \left( \frac{100}{100 - C} \right)$$

where:

$s_0$  [specific volume (m<sup>3</sup>/kg)] = specific volume of inert gas agent at 21°C and 1.013 bar absolute

<sup>c</sup> $t$  [temperature (°C)] = design temperature in the hazard area.

<sup>d</sup> $s$  [specific volume (m<sup>3</sup>/kg)] = specific volume of IG-01 vapor can be approximated by  $s = 0.5685 + 0.00208t$ , where  $t$  = temperature (°C).

<sup>e</sup> $C$  [concentration (%)] = volumetric concentration of IG-01 in air at the temperature indicated.

Table A.5.5.2(c) IG-100 Total Flooding Quantity (U.S. Units)<sup>a</sup>

Temp ( <i>t</i> ) (°F) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (ft <sup>3</sup> /lb) <sup>d</sup>	Volume Requirements of Agent per Unit Volume of Hazard ( $V_{\text{agent}}/V_{\text{enclosure}}$ ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		34	37	40	42	47	49	58	62
-40	10.934	0.522	0.581	0.642	0.685	0.798	0.847	1.091	1.216
-30	11.195	0.510	0.567	0.627	0.669	0.780	0.827	1.065	1.188
-20	11.455	0.499	0.554	0.613	0.654	0.762	0.808	1.041	1.161
-10	11.716	0.488	0.542	0.599	0.639	0.745	0.790	1.018	1.135
0	11.976	0.477	0.530	0.586	0.625	0.729	0.773	0.996	1.111
10	12.237	0.467	0.519	0.574	0.612	0.713	0.756	0.975	1.087
20	12.497	0.457	0.508	0.562	0.599	0.698	0.741	0.954	1.064
30	12.758	0.448	0.498	0.550	0.587	0.684	0.726	0.935	1.043
40	13.018	0.439	0.488	0.539	0.575	0.670	0.711	0.916	1.022
50	13.279	0.430	0.478	0.529	0.564	0.657	0.697	0.898	1.002
60	13.540	0.422	0.469	0.519	0.553	0.645	0.684	0.881	0.982
70	13.800	0.414	0.460	0.509	0.543	0.632	0.671	0.864	0.964
80	14.061	0.406	0.452	0.499	0.533	0.621	0.658	0.848	0.946
90	14.321	0.399	0.444	0.490	0.523	0.609	0.646	0.833	0.929
100	14.582	0.392	0.436	0.482	0.514	0.599	0.635	0.818	0.912
110	14.842	0.385	0.428	0.473	0.505	0.588	0.624	0.803	0.896
120	15.103	0.378	0.421	0.465	0.496	0.578	0.613	0.790	0.881
130	15.363	0.372	0.413	0.457	0.487	0.568	0.602	0.776	0.866
140	15.624	0.366	0.407	0.449	0.479	0.559	0.592	0.763	0.851
150	15.885	0.360	0.400	0.442	0.471	0.549	0.583	0.751	0.837
160	16.145	0.354	0.393	0.435	0.464	0.541	0.573	0.739	0.824
170	16.406	0.348	0.387	0.428	0.456	0.532	0.564	0.727	0.811
180	16.666	0.343	0.381	0.421	0.449	0.524	0.555	0.716	0.798
190	16.927	0.337	0.375	0.415	0.442	0.516	0.547	0.705	0.786
200	17.187	0.332	0.370	0.409	0.436	0.508	0.539	0.694	0.774

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup> $X$  [agent volume requirements (ft<sup>3</sup>/ft<sup>3</sup>)] = volume of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$X = 2.303 \times \left( \frac{s_0}{s} \right) \times \log_{10} \left( \frac{100}{100 - C} \right) = \left( \frac{s_0}{s} \right) \times \ln \left( \frac{100}{100 - C} \right)$$

where:

$s_0$  [specific volume (ft<sup>3</sup>/lb)] = specific volume of inert gas agent at 70°F and 14.7 psi absolute

<sup>c</sup> $t$  [temperature (°F)] = design temperature in the hazard area.

<sup>d</sup> $s$  [specific volume (ft<sup>3</sup>/lb)] = specific volume of IG-100 vapor can be approximated by  $s = 11.976 + 0.02606t$ , where  $t$  = temperature (°F).

<sup>e</sup> $C$  [concentration (%)] = volumetric concentration of IG-100 in air at the temperature indicated.

Table A.5.5.2(d) IG-100 Total Flooding Quantity (SI Units)<sup>a</sup>

Temp ( <i>t</i> ) (°C) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (m <sup>3</sup> /kg) <sup>d</sup>	Volume Requirements of Agent per Unit Volume of Hazard ( $V_{\text{agent}}/V_{\text{enclosure}}$ ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		34	37	40	42	47	49	58	62
-40	0.6826	0.5225	0.5809	0.6423	0.6849	0.7983	0.8466	1.0908	1.2166
-30	0.7119	0.5009	0.5570	0.6159	0.6567	0.7654	0.8118	1.0459	1.1665
-20	0.7412	0.4811	0.5350	0.5915	0.6308	0.7352	0.7797	1.0045	1.1204
-10	0.7704	0.4629	0.5147	0.5691	0.6069	0.7073	0.7501	0.9664	1.0779
0	0.7997	0.4459	0.4959	0.5482	0.5846	0.6814	0.7227	0.9310	1.0384
10	0.8290	0.4302	0.4783	0.5289	0.5640	0.6573	0.6971	0.8981	1.0017
20	0.8582	0.4155	0.4621	0.5109	0.5448	0.6349	0.6734	0.8676	0.9677
30	0.8875	0.4018	0.4468	0.4940	0.5268	0.6140	0.6512	0.8389	0.9357
40	0.9168	0.3890	0.4325	0.4782	0.5100	0.5943	0.6304	0.8121	0.9058
50	0.9461	0.3769	0.4191	0.4634	0.4942	0.5759	0.6108	0.7870	0.8778
60	0.9753	0.3657	0.4066	0.4495	0.4794	0.5587	0.5925	0.7634	0.8515
70	1.0046	0.3550	0.3947	0.4364	0.4654	0.5424	0.5753	0.7411	0.8266
80	1.0339	0.3449	0.3835	0.4241	0.4522	0.5270	0.5590	0.7201	0.8032
90	1.0631	0.3355	0.3730	0.4124	0.4398	0.5126	0.5436	0.7004	0.7812
100	1.0924	0.3265	0.3630	0.4013	0.4280	0.4988	0.5290	0.6816	0.7602

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup> $X$  [agent volume requirements (m<sup>3</sup>/m<sup>3</sup>)] = volume of agent required per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$X = 2.303 \times \left( \frac{s_0}{s} \right) \times \log_{10} \left( \frac{100}{100 - C} \right) = \left( \frac{s_0}{s} \right) \times \ln \left( \frac{100}{100 - C} \right)$$

where:

$s_0$  [specific volume (m<sup>3</sup>/kg)] = specific volume of inert gas agent at 21°C and 1.013 bar absolute

<sup>c</sup> $t$  [temperature (°C)] = design temperature in the hazard area.

<sup>d</sup> $s$  [specific volume (m<sup>3</sup>/kg)] = specific volume of IG-100 vapor can be approximated by  $s = 0.7997 + 0.00293t$ , where  $t$  = temperature (°C).

<sup>e</sup> $C$  [concentration (%)] = volumetric concentration of IG-100 in air at the temperature indicated.

Table A.5.5.2(e) IG-541 Total Flooding Quantity (U.S. Units)<sup>a</sup>

Temp (t) (°F) <sup>c</sup>	Specific Vapor Volume (s) (ft <sup>3</sup> /lb) <sup>d</sup>	Volume Requirements of Agent per Unit Volume of Hazard ( $V_{\text{agent}}/V_{\text{enclosure}}$ ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		34	38	42	46	50	54	58	62
-40	9.001	0.524	0.603	0.686	0.802	0.873	0.977	1.096	1.218
-30	9.215	0.513	0.590	0.672	0.760	0.855	0.958	1.070	1.194
-20	9.429	0.501	0.576	0.657	0.743	0.836	0.936	1.046	1.166
-10	9.644	0.490	0.563	0.642	0.726	0.817	0.915	1.022	1.140
0	9.858	0.479	0.551	0.628	0.710	0.799	0.895	1.000	1.116
10	10.072	0.469	0.539	0.615	0.695	0.782	0.876	0.979	1.092
20	10.286	0.459	0.528	0.602	0.681	0.766	0.858	0.958	1.069
30	10.501	0.450	0.517	0.590	0.667	0.750	0.840	0.939	1.047
40	10.715	0.441	0.507	0.578	0.653	0.735	0.824	0.920	1.026
50	10.929	0.432	0.497	0.566	0.641	0.721	0.807	0.902	1.006
60	11.144	0.424	0.487	0.555	0.628	0.707	0.792	0.885	0.987
70	11.358	0.416	0.478	0.545	0.616	0.693	0.777	0.868	0.968
80	11.572	0.408	0.469	0.535	0.605	0.681	0.762	0.852	0.950
90	11.787	0.401	0.461	0.525	0.594	0.668	0.749	0.836	0.933
100	12.001	0.393	0.453	0.516	0.583	0.656	0.735	0.821	0.916
110	12.215	0.386	0.445	0.507	0.573	0.645	0.722	0.807	0.900
120	12.429	0.380	0.437	0.498	0.563	0.634	0.710	0.793	0.884
130	12.644	0.373	0.430	0.489	0.554	0.623	0.698	0.779	0.869
140	12.858	0.367	0.422	0.481	0.544	0.612	0.686	0.766	0.855
150	13.072	0.361	0.415	0.473	0.535	0.602	0.675	0.754	0.841
160	13.287	0.355	0.409	0.466	0.527	0.593	0.664	0.742	0.827
170	13.501	0.350	0.402	0.458	0.518	0.583	0.653	0.730	0.814
180	13.715	0.344	0.396	0.451	0.510	0.574	0.643	0.718	0.801
190	13.930	0.339	0.390	0.444	0.502	0.565	0.633	0.707	0.789
200	14.144	0.334	0.384	0.437	0.495	0.557	0.624	0.697	0.777

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>X [agent volume requirements (ft<sup>3</sup>/ft<sup>3</sup>) = volume of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$X = 2.303 \times \left( \frac{s_0}{s} \right) \times \log_{10} \left( \frac{100}{100 - C} \right) = \left( \frac{s_0}{s} \right) \times \ln \left( \frac{100}{100 - C} \right)$$

where:

$s_0$  [specific volume (ft<sup>3</sup>/lb)] = specific volume of inert gas agent at 70°F and 14.7 psi absolute

$t$  [temperature (°F)] = design temperature in the hazard area.

$s$  [specific volume (ft<sup>3</sup>/lb)] = specific volume of IG-541 vapor can be approximated by  $s = 9.8579 + 0.02143t$ , where  $t$  = temperature (°F).

$C$  [concentration (%)] = volumetric concentration of IG-541 in air at the temperature indicated.

Table A.5.5.2(f) IG-541 Total Flooding Quantity (SI Units)<sup>a</sup>

Temp ( <i>t</i> ) (°C) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (m <sup>3</sup> /kg) <sup>d</sup>	Volume Requirements of Agent per Unit Volume of Hazard ( $V_{\text{agent}}/V_{\text{enclosure}}$ ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		34	38	42	46	50	54	58	62
-40	0.562	0.524	0.602	0.686	0.776	0.873	0.978	1.093	1.219
-30	0.586	0.502	0.578	0.658	0.745	0.838	0.938	1.048	1.169
-20	0.610	0.482	0.555	0.633	0.716	0.805	0.902	1.007	1.124
-10	0.634	0.464	0.534	0.609	0.689	0.775	0.868	0.969	1.081
0	0.659	0.447	0.515	0.587	0.664	0.746	0.836	0.934	1.042
10	0.683	0.432	0.497	0.566	0.640	0.720	0.807	0.901	1.005
20	0.707	0.417	0.480	0.547	0.619	0.696	0.780	0.871	0.971
30	0.731	0.403	0.464	0.529	0.598	0.673	0.754	0.842	0.940
40	0.755	0.391	0.449	0.512	0.579	0.652	0.730	0.816	0.910
50	0.779	0.379	0.436	0.496	0.562	0.632	0.708	0.791	0.882
60	0.803	0.367	0.423	0.482	0.545	0.613	0.687	0.767	0.855
70	0.827	0.357	0.410	0.468	0.529	0.595	0.667	0.745	0.831
80	0.851	0.347	0.399	0.455	0.514	0.578	0.648	0.724	0.807
90	0.875	0.337	0.388	0.442	0.500	0.563	0.630	0.704	0.785
100	0.900	0.328	0.378	0.430	0.487	0.548	0.613	0.685	0.764

<sup>a</sup> The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup>  $X$  [agent volume requirements (m<sup>3</sup>/m<sup>3</sup>) = volume of agent required per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$X = 2.303 \times \left( \frac{s_0}{s} \right) \times \log_{10} \left( \frac{100}{100 - C} \right) = \left( \frac{s_0}{s} \right) \times \ln \left( \frac{100}{100 - C} \right)$$

where:

$s_0$  [specific volume (m<sup>3</sup>/kg)] = specific volume of inert gas agent at 21°C and 1.013 bar absolute

$t$  [temperature (°C)] = design temperature in the hazard area.

$s$  [specific volume (m<sup>3</sup>/kg)] = specific volume of IG-541 vapor can be approximated by  $s = 0.65799 + 0.00239t$ , where  $t$  = temperature (°C).

$C$  [concentration (%)] = volumetric concentration of IG-541 in air at the temperature indicated.

Table A.5.5.2(g) IG-55 Total Flooding Quantity (U.S. Units)<sup>a</sup>

Temp ( <i>t</i> ) (°F) <sup>c</sup>	Specific Vapor Volume ( <i>s</i> ) (ft <sup>3</sup> /lb) <sup>d</sup>	Volume Requirements of Agent per Unit Volume of Hazard ( $V_{\text{agent}}/V_{\text{enclosure}}$ ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		34	38	42	46	50	54	58	62
-40	9.02108	0.524	0.603	0.688	0.778	0.875	0.980	1.095	1.221
-30	9.23603	0.512	0.589	0.672	0.760	0.854	0.957	1.069	1.193
-20	9.45099	0.501	0.576	0.656	0.742	0.835	0.935	1.045	1.166
-10	9.66594	0.489	0.563	0.642	0.726	0.816	0.915	1.022	1.140
0	9.88090	0.479	0.551	0.628	0.710	0.799	0.895	1.000	1.115
10	10.09586	0.469	0.539	0.614	0.695	0.782	0.876	0.978	1.091
20	10.31081	0.459	0.528	0.602	0.680	0.765	0.857	0.958	1.068
30	10.52577	0.449	0.517	0.589	0.667	0.750	0.840	0.938	1.047
40	10.74073	0.440	0.507	0.577	0.653	0.735	0.823	0.920	1.026
50	10.95568	0.432	0.497	0.566	0.640	0.720	0.807	0.902	1.006
60	11.17064	0.424	0.487	0.555	0.628	0.706	0.791	0.884	0.986
70	11.38560	0.416	0.478	0.545	0.616	0.693	0.777	0.868	0.968
80	11.60055	0.408	0.469	0.535	0.605	0.680	0.762	0.851	0.950
90	11.81551	0.400	0.461	0.525	0.594	0.668	0.748	0.836	0.932
100	12.03046	0.393	0.452	0.516	0.583	0.656	0.735	0.821	0.916
110	12.24542	0.386	0.444	0.506	0.573	0.644	0.722	0.807	0.900
120	12.46038	0.380	0.437	0.498	0.563	0.633	0.710	0.793	0.884
130	12.67533	0.373	0.429	0.489	0.553	0.623	0.698	0.779	0.869
140	12.89029	0.367	0.422	0.481	0.544	0.612	0.686	0.766	0.855
150	13.10525	0.361	0.415	0.473	0.535	0.602	0.675	0.754	0.841
160	13.32020	0.355	0.409	0.466	0.527	0.592	0.664	0.742	0.827
170	13.53516	0.350	0.402	0.458	0.518	0.583	0.653	0.730	0.814
180	13.75012	0.344	0.396	0.451	0.510	0.574	0.643	0.718	0.801
190	13.96507	0.339	0.390	0.444	0.502	0.565	0.633	0.707	0.789
200	14.18003	0.334	0.384	0.437	0.495	0.557	0.623	0.697	0.777

Note:  $V_s$  = the term  $X = \ln [100/(100 - C)]$  gives the volume at a rated concentration (%) and temperature to reach an air-agent mixture at the end of flooding time in a volume of 1 ft<sup>3</sup>.

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup> $X$  [agent volume requirements (lb/ft<sup>3</sup>)] = volume of agent required per cubic foot of protected volume to produce indicated concentration at temperature specified.

$$X = 2.303 \times \left( \frac{s_0}{s} \right) \times \log_{10} \left( \frac{100}{100 - C} \right) = \left( \frac{s_0}{s} \right) \times \ln \left( \frac{100}{100 - C} \right)$$

where:

$s_0$  [specific volume (ft<sup>3</sup>/lb)] = specific volume of inert gas agent at 70°F and 14.7 psi absolute

<sup>c</sup> $t$  [temperature (°F)] = design temperature in the hazard area.

<sup>d</sup> $s$  [specific volume (ft<sup>3</sup>/lb)] = specific volume of IG-55 vapor can be approximated by  $s = 9.8809 + 0.0215t$ , where  $t$  = temperature (°F).

<sup>e</sup> $C$  [concentration (%)] = volumetric concentration of IG-55 in air at the temperature indicated.



Table A.5.5.2(h) IG-55 Total Flooding Quantity (SI Units)<sup>a</sup>

Temp (t) (°C) <sup>c</sup>	Specific Vapor Volume (s) (m <sup>3</sup> /kg) <sup>d</sup>	Volume Requirements of Agent per Unit Volume of Hazard ( $V_{\text{agent}}/V_{\text{enclosure}}$ ) <sup>b</sup>							
		Design Concentration (% by Volume) <sup>e</sup>							
		34	38	42	46	50	54	58	62
-40	0.56317	0.524	0.603	0.688	0.778	0.875	0.980	1.095	1.221
-35	0.56324	0.513	0.591	0.673	0.761	0.856	0.959	1.072	1.196
-30	0.58732	0.503	0.579	0.659	0.746	0.839	0.940	1.050	1.171
-25	0.59940	0.493	0.567	0.646	0.731	0.822	0.921	1.029	1.147
-20	0.61148	0.483	0.556	0.633	0.716	0.806	0.903	1.008	1.125
-15	0.62355	0.474	0.545	0.621	0.702	0.790	0.885	0.989	1.103
-10	0.63563	0.465	0.535	0.609	0.689	0.775	0.868	0.970	1.082
-5	0.64771	0.456	0.525	0.598	0.676	0.761	0.852	0.952	1.062
0	0.65979	0.448	0.515	0.587	0.664	0.747	0.837	0.935	1.042
5	0.67186	0.440	0.506	0.576	0.652	0.733	0.822	0.918	1.024
10	0.68394	0.432	0.497	0.566	0.640	0.720	0.807	0.902	1.006
15	0.69602	0.424	0.488	0.556	0.629	0.708	0.793	0.886	0.988
20	0.70810	0.417	0.480	0.547	0.619	0.696	0.779	0.871	0.971
25	0.72017	0.410	0.472	0.538	0.608	0.684	0.766	0.856	0.955
30	0.73225	0.403	0.464	0.529	0.598	0.673	0.754	0.842	0.939
35	0.74433	0.397	0.456	0.520	0.588	0.662	0.742	0.828	0.924
40	0.75641	0.390	0.449	0.512	0.579	0.651	0.730	0.815	0.909
45	0.76848	0.384	0.442	0.504	0.570	0.641	0.718	0.802	0.895
50	0.78056	0.378	0.435	0.496	0.561	0.631	0.707	0.790	0.881
55	0.79264	0.373	0.429	0.488	0.553	0.622	0.696	0.778	0.868
60	0.80471	0.367	0.422	0.481	0.544	0.612	0.686	0.766	0.855
65	0.81679	0.362	0.416	0.474	0.536	0.603	0.676	0.755	0.842
70	0.82887	0.356	0.410	0.467	0.528	0.594	0.666	0.744	0.830
75	0.84095	0.351	0.404	0.460	0.521	0.586	0.656	0.733	0.818
80	0.85302	0.346	0.398	0.454	0.513	0.578	0.647	0.723	0.806
85	0.86510	0.341	0.393	0.448	0.506	0.569	0.638	0.713	0.795
90	0.87718	0.337	0.387	0.441	0.499	0.562	0.629	0.703	0.784
95	0.88926	0.332	0.382	0.435	0.493	0.554	0.621	0.693	0.773
100	0.90133	0.328	0.377	0.430	0.486	0.547	0.612	0.684	0.763

<sup>a</sup>The manufacturer's listing specifies the temperature range for operation.

<sup>b</sup> $X$  [agent volume requirements (m<sup>3</sup>/m<sup>3</sup>) = volume of agent required per cubic meter of protected volume to produce indicated concentration at temperature specified.

$$X = 2.303 \times \left( \frac{s_0}{s} \right) \times \log_{10} \left( \frac{100}{100 - C} \right) = \left( \frac{s_0}{s} \right) \times \ln \left( \frac{100}{100 - C} \right)$$

where:

$s_0$  [specific volume (m<sup>3</sup>/kg)] = specific volume of inert gas agent at 21°C and 1.013 bar absolute

$t$  [temperature (°C)] = design temperature in the hazard area.

$s$  [specific volume (m<sup>3</sup>/kg)] = specific volume of IG-55 vapor can be approximated by  $s = 0.6598 + 0.00242t$ , where  $t$  = temperature (°C).

$C$  [concentration (%)] = volumetric concentration of IG-55 in air at the temperature indicated.

**A.5.5.3** The minimum design concentration based either on the cup burner extinguishing concentration plus 30 percent or on Class A fire test extinguishing concentration plus 20 percent should encompass design tolerances for most applications. However, these safety factors do not account for specific conditions or requirements for some particular applications that can require additional agent to ensure complete fire extinguishment. The following list gives certain conditions or considerations that can require the use of design factors that would increase the quantity of agent used:

- (1) *Unclosable openings* (see also 5.7.2). Special considerations should be taken into account in the design of a fire suppression system for an enclosure that cannot or will not be sealed or closed before the fire suppression system is discharged. The loss of agent through the openings needs to be compensated for by some method. Compensation for unclosable openings can be handled through extending the discharge time, which in turn extends the period of agent application. A method of determining the additional agent required/rate of application can be accomplished by conducting an enclosure integrity test per Annex C. When agent is applied to compensate for the loss through an unclosable opening, consideration needs to be taken to extend the discharge of agent to enable the concentration within the enclosure to be held for a longer period of time. The discharge time defined in 5.7.1.1.1 is for the time required for the initial agent required to protect the enclosure without leakage through the unclosable openings. Without extending the discharge time for the additional agent being applied, leak rates through the unclosable openings will increase.
- (2) *Acid gas formation considerations*. High concentrations of hydrogen fluoride (HF) can be expected at cup burner design concentrations. HF can be reduced by increasing the design concentration. Dramatic reduction can be achieved by increasing design concentration up to cup burner plus 30 percent. Above cup burner plus 30 percent, reduction in HF is not as dramatic. (For further information see Sheinson et al., 1994, and Sheinson et al., 1995.)
- (3) *Fuel geometry considerations*. For Class A and B fires, fuel geometry and compartment obstructions can affect agent concentration at the fire. Full-scale machinery space tests conducted by the Naval Research Laboratory (NRL) have shown that for a large [850 m<sup>3</sup> (30,000 ft<sup>3</sup>)] enclosure with a complex obstructed fuel geometry, agent concentration can vary  $\pm 20$  percent. Increasing the design concentration or adding or relocating discharge nozzles can compensate for concentrations below the design concentration. For further information, see Naval Research Laboratory Report Ser 6180/0049.2.
- (4) *Enclosure geometry*. Typically in applications involving unusual enclosure geometries, agent distribution is addressed through nozzle placement. If the geometry of the enclosure (or system design) is such that the agent distribution cannot be adequately addressed through nozzle placement, additional concentration should be considered. An example of such applications could be enclosures having very high or very low aspect ratios (length/width).

- (5) *Obstructions within the enclosure*. The following three considerations should be given to enclosure obstructions:
  - (a) Room volume should be calculated considering the room empty. Exceptions can be made only for structural components or shafts that pass through the room.
  - (b) For small room volumes, consideration should be given to equipment/storage that take up a considerable percentage of the room volume, specifically, whether the reduced volume will raise the effective concentration of the agent from the NOAEL to the LOAEL in normally occupied spaces. However, this consideration must be closely balanced against the need to maintain an adequate concentration even when the room is empty.
  - (c) Obstructions located near the nozzle could block or impede agent discharge from the nozzle and could affect the distribution of the agent within the enclosure. Obstructions such as ducts, cable trays, large conduits, and light fixtures have the potential to disrupt the flow pattern of the agent from the nozzle. If the flow of the agent is forced down to the floor, for example, it is unlikely that concentration will be achieved at the middle or upper elevations. Certainly, uniform dispersion and concentration will not be achieved.

**A.5.5.3.1** The tee design factor is meant to compensate for the uncertainty in the quantity of agent flowing through a pipe as the agent passes through an increasing number of tees. The listing tests generally incorporate systems with a very limited number of tees (2 to 4). If the number of tees in a system is greater, additional agent is required to compensate for the uncertainty at the tee splits and ensure that a sufficient quantity of agent is delivered to each hazard. Tees that deliver agent only to nozzles within a hazard are not counted for this design factor because it is believed mixing within the hazard will compensate for any discrepancy.

The design factor for the inert gases is less than for the halocarbons because it is believed that the flow of inert gases can be more accurately predicted and that inert gases are less sensitive to pipe variability.

The following two examples illustrate the method for determining the design factor tee count (note that these examples might not represent good design practice):

- (1) **Example 1** [see Figure A.5.5.3.1(a)]

Hazard	Design Factor Tee Count
1	9 (tees A, B, C, D, E, F, G, H, I)
2	8 (tees C, D, E, F, G, H, I, A)
3	1 (tee C)

Therefore, if the system uses a halocarbon agent, the design factor is 0.05, and if the system uses an inert gas agent, the design factor is 0.01.



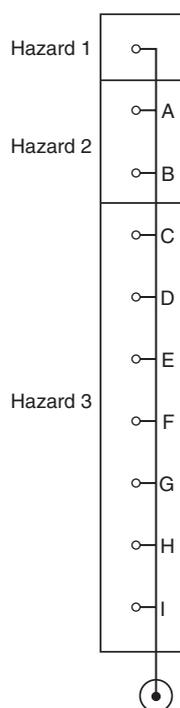


FIGURE A.5.5.3.1(a) Piping for Design Factor Tee Count for Example 1.

(2) Example 2 [see Figure A.5.5.3.1(b)]

Hazard	Design Factor Tee Count
1	5 (tees B, C, D, E, F)
2	3 (tees B, E, H)
3	2 (tees E, F)

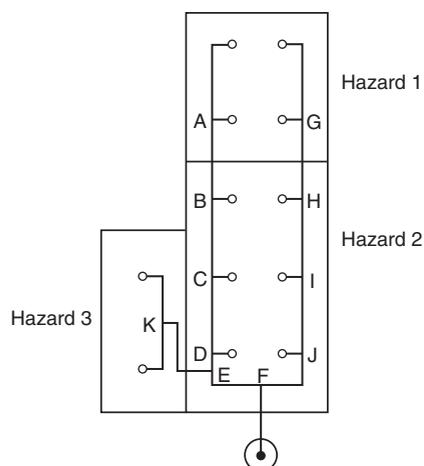


FIGURE A.5.5.3.1(b) Piping for Design Factor Tee Count for Example 2.

For Hazard 1, the branch consisting of tees H, I, and J, F is not used because the other branch has a greater tee count.

Therefore, if the system uses a halocarbon agent, the design factor is 0.01, and if the system uses an inert gas agent, the design factor would be 0.00.

**A.5.5.3.2** The listing of engineered halon alternative systems requires running a number of tests that include measuring the agent quantity from each nozzle. To successfully pass these tests, the flow calculation software cannot overpredict the measured mass by more than 5 percent nor underpredict the measured mass by more than 10 percent. Experience performing these tests indicates the maximum laboratory accuracy for the calculations is  $\pm 5$  percent of the measured value with a 90 percent certainty. This means that 90 percent of the measured agent quantities will be within  $\pm 5$  percent of the predicted value. If the error is due to random factors, then that can be represented statistically by a normal (Gaussian) distribution. A normal distribution curve is shown in Figure A.5.5.3.2(a), with the measured mass normalized by the predicted value. The resulting standard deviation is 0.0304 from standard tables. These systems generally have two tees and three nozzles.

For a system that utilizes more than two tees, the error will propagate and the certainty for the prediction of the agent quantity will be less. The more tees between a nozzle and the cylinder, the lower the certainty. This propagation of error can be calculated and results in a new normal distribution with a greater standard deviation. This can be calculated for any number of tees. For example, the standard deviation for a system with eight tees would be 0.0608.

For the purpose of this standard, the uncertainty for the prediction for an installed system is limited to having at least 99 percent of the nozzles deliver at least 90 percent of the predicted agent quantity. This implies not “using up” more than one-half of the 20 percent safety factor for 99 percent of the nozzles. For a normal distribution with a standard deviation of 0.0608, the tail area representing 1 percent of the systems occurs at a normalized mass value of 0.859.

It is apparent that significantly more than 1 percent of the systems will have less than 90 percent of the predicted mass delivered. To rectify this situation, more agent should be used in the system, which would move the entire probability curve up. The quantity of agent that would need to be added is as follows:

$$0.90 - 0.859 = 0.041, \text{ or } 4.1 \text{ percent}$$

The addition of 4.1 percent more agent would ensure that 99 percent of the nozzles deliver at least 90 percent of the required mass of agent.

The analysis for Table 5.5.3.1 was performed for up to 19 tees, 20 nozzles, in a system. [See Figure A.5.5.3.2(b) through Figure A.5.5.3.2(g).]

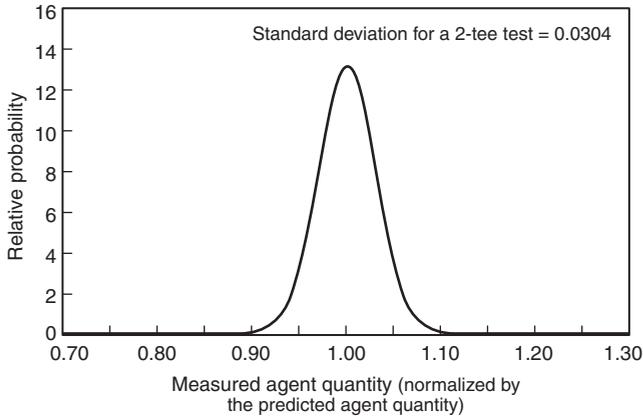


FIGURE A.5.5.3.2(a) Normal Distribution Curve.

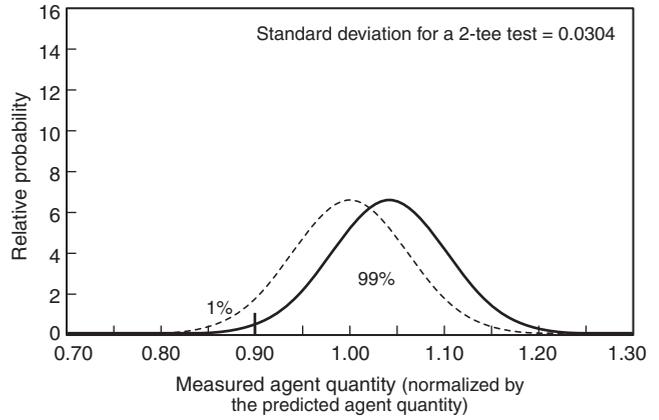


FIGURE A.5.5.3.2(d) Distribution Curve No. 3.

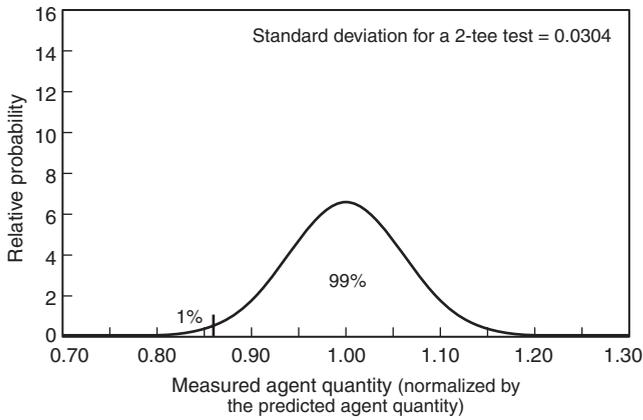


FIGURE A.5.5.3.2(b) Distribution Curve No. 1.

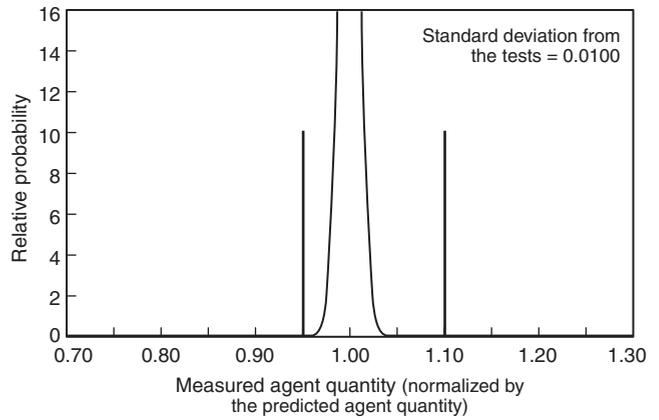


FIGURE A.5.5.3.2(e) Distribution Curve No. 4.

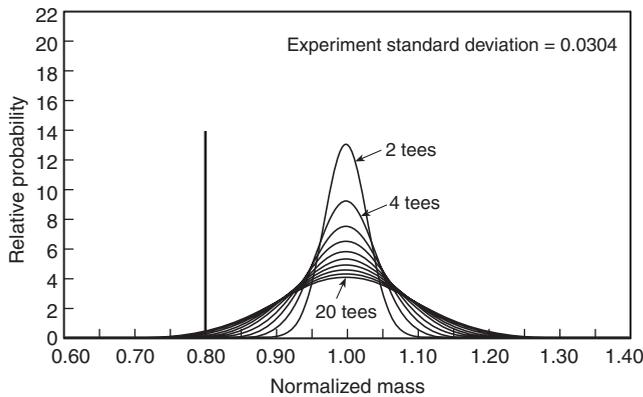


FIGURE A.5.5.3.2(c) Distribution Curve No. 2.

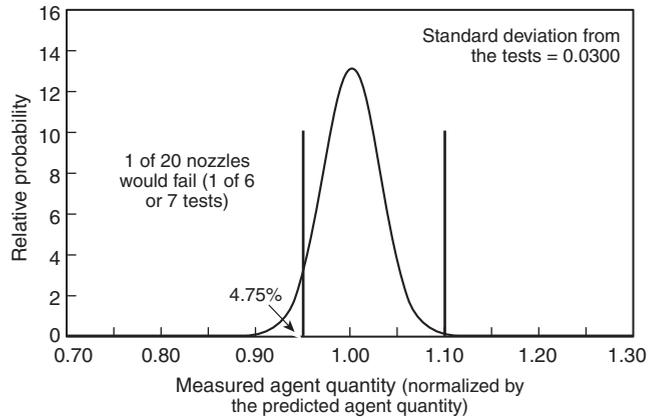


FIGURE A.5.5.3.2(f) Distribution Curve No. 5.

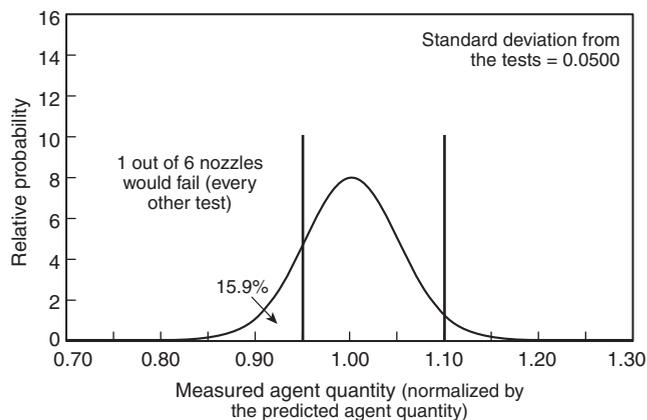


FIGURE A.5.5.3.2(g) Distribution Curve No. 6.

**A.5.5.3.3** Some areas affected by pressures other than sea level include hyperbaric enclosures; facilities where ventilation fans are used to create artificially higher or lower pressures, such as test chambers; and facilities at altitudes above or below sea level. Although mines are usually below normal ground levels, they occasionally have to be ventilated so that personnel can work in that environment. Ambient pressures in that situation can be considerably different from those expected by a pure altitude correction.

Although adjustments are required for barometric pressures equivalent to 3000 ft (915 m) or more above or below sea level, adjustments can be made for any ambient pressure condition.

The atmospheric correction factor is not linear. However, in the moderate range discussed, it can be closely approximated with two lines:

For -3000 ft to 5500 ft of equivalent altitude:

$$Y = (-0.000036 \times X) + 1 \quad [\text{A.5.5.3.3a}]$$

For 5501 ft to 10,000 ft of equivalent altitude:

$$Y = (-0.00003 \times X) + 0.96 \quad [\text{A.5.5.3.3b}]$$

where:

Y = correction factor

X = altitude (ft)

For SI units, 1 ft = 0.305 m.

The increase, from the 1996 edition to this edition, in safety factor for manually actuated systems and systems protecting Class B hazards, is intended to account for the uncertainty in minimum design concentration associated with these types of systems and hazards.

The presence of hot metal surfaces, large fire sizes, increased fuel temperatures, and other variables associated with longer pre-burn times can increase the minimum extinguishing concentration needed for these types of fires. In addition, the increased safety factor will serve to reduce decomposition product formation for halocarbon agents in the presence of larger fires expected in manually operated systems and Class B hazards.

There have been no reported system failures associated with these types of fires in fueled installations, and successful extinguishment events have been reported for systems designed and installed in accordance with previous editions of this standard.

This change is intended to enhance the overall effectiveness of new clean agent systems and is based on theoretical and laboratory experience. This change in safety factor does not apply to existing systems. Field experience indicates that any existing system designed with a 20 percent safety factor will perform as intended.

The ambient pressure is affected by changes in altitude, pressurization or depressurization of the protected enclosure, and weather-related barometric pressure changes. The design factor to account for cases where the pressure of the protected hazard is different from atmospheric pressure is computed as the ratio of the nominal absolute pressure within the hazard divided by the average atmospheric pressure at sea level [14.7 psia/(1 bar)].

**A.5.6** In establishing the hold time, designers and authorities having jurisdiction should consider the following or other unique factors that can influence the performance of the suppression system:

- (1) Response time of trained personnel
- (2) Sources of persistent ignition
- (3) Excessive enclosure leakage
- (4) System enclosure venting requirements
- (5) Inertion and reflash hazards
- (6) Winddown of rotating equipment

The hold time for the duration of protection should be sufficient to control the initial event and allow for support should resurgence occur once the agent has dissipated.

Energized electrical equipment that could provide a prolonged ignition source should be de-energized prior to or during agent discharge.

If electrical equipment cannot be de-energized, consideration should be given to the use of extended agent discharge, higher initial concentration, and the possibility of the formation of combustion and decomposition products. Additional testing can be needed on suppression of energized electrical equipment fires to determine these quantities.

**A.5.6.1** This is equally important in all classes of fires, since a persistent ignition source (e.g., an arc, heat source, oxyacetylene torch, or "deep-seated" fire) can lead to resurgence of the initial event once the clean agent has dissipated.

**A.5.7.1.1** The optimum discharge time is a function of many variables, five of which are very important:

- (1) Limitation of decomposition products
- (2) Limitation of fire damage and its effects
- (3) Enhanced agent mixing
- (4) Limitation of compartment overpressure
- (5) Secondary nozzle effects

It is essential for the end user to understand that both the products of combustion and the decomposition products formed from the suppression agent contribute to the total threat to life or assets associated with a fire.

Essentially all fires will produce carbon monoxide and carbon dioxide, and the contribution of these products to the toxic threat posed by the fire event is well known. In the case of large fires, the high temperatures can by themselves lead to life- and asset-threatening conditions. In addition, most fires produce smoke, and it is well documented that damage to sensitive assets can occur at very low levels of smoke. Depending upon the particular fuel involved, numerous toxic products of combustion can be produced in a fire (e.g., HCl, HBr, HF, HCN, CO).

The halogenated hydrocarbon fire extinguishing agents described in this standard will break down into their decomposition products when they are exposed to a fire. It is essential that the end user understand this process, since the selection of the discharge time and other design factors will be affected by the amount of decomposition products the protected hazard can tolerate.

The concentration of thermal decomposition products from a halogenated fire suppression agent is dependent upon several factors. The size of the fire at the time of system activation and the discharge time of the suppression agent play major roles in determining the amount of decomposition products formed. The smaller the fire, the less energy (heat) is available to cause thermal decomposition of the suppression agent, and hence the lower the concentration of thermal decomposition products. The size of the fire at the time of system activation is dependent upon the fire growth rate, the detector sensitivity, and the system discharge delay time. The first factor is primarily a function of the fuel type and geometry, whereas the latter two are adjustable characteristics of the fire protection system. The discharge time affects the production of thermal decomposition products, because it determines the exposure time to the fire of sub-extinguishing concentrations of the fire suppression agent. Suppression systems have traditionally employed a combination of rapid detection and rapid discharge to limit both the production of thermal decomposition products and damage to assets by providing rapid flame extinguishment.

The enclosure volume also affects the concentration of thermal decomposition products, since larger volumes, that is, smaller fire-size-to-room-volume ratios, will lead to dilution of decomposition products. Additional factors affecting the concentration of thermal decomposition products include vaporization and mixing of the agent, the pre-burn time, the presence of hot surfaces or deep-seated fires, and the suppression agent concentration.

This decomposition issue is not unique to the new clean halogenated agents. The thermal decomposition products resulting from the extinguishment of fires with Halon 1301 have been investigated by numerous authors (e.g., Ford, 1972, and Cholin, 1972), and it is well established that the most important Halon 1301 thermal decomposition products from the standpoint of potential toxicity to humans or potential corrosion of electronic equipment are the halogen acids HF and HBr. Concentrations of acid halides produced from Halon 1301 ranging from a few parts per million to over 7000 ppm HF and HBr have been reported, depending upon the exact nature of the fire scenario (Sheinson et al., 1981). Smaller amounts of additional decomposition products can be produced, depending upon the particular conditions of the fire. Under certain conditions, thermal decomposition of Halon 1301 in a fire has been reported to produce small amounts of carbonyl fluoride ( $\text{COF}_2$ ), carbonyl bromide ( $\text{COBr}_2$ ), and bromine ( $\text{Br}_2$ ), in addition to relatively large amounts of HF and HBr. Note that all of these products are subject to relatively rapid hydrolysis to form the acid halides HF and HBr (Cotton and Wilkinson, 1980), and hence these acids constitute the product of primary concern from the standpoint of potential toxicity or corrosion.

As was the case for Halon 1301, the thermal decomposition products of primary concern for the halogenated agents described in this standard are the associated halogen acids, HF in the case of HFCs and PFCs, HF and HCl in the case of HCFC agents, and HF and HI in the case of I-containing


agents. As was the case for Halon 1301, smaller amounts of other decomposition products can be produced, depending upon the particular conditions of the fire. In a fire, HFC or PFC agents can potentially produce small amounts of carbonyl fluoride ( $\text{COF}_2$ ). HCFC agents can potentially produce carbonyl fluoride ( $\text{COF}_2$ ), carbonyl chloride ( $\text{COCl}_2$ ), and elemental chlorine ( $\text{Cl}_2$ ), and I-containing compounds can potentially produce carbonyl fluoride ( $\text{COF}_2$ ) and elemental iodine ( $\text{I}_2$ ). All of these products are subject to relatively rapid hydrolysis (Cotton and Wilkinson, 1980) to produce the associated halogen acid (HF, HCl, or HI); hence, from the standpoint of potential toxicity to humans or potential corrosion of electronic equipment, the halogen acids are the decomposition products of concern.

The dependence of decomposition product formation on the discharge time and fire size has been extensively evaluated (Sheinson et al., 1994; Brockway, 1994; Moore et al., 1993; Back et al., 1994; Forssell and DiNenno, 1995; DiNenno, 1993; Purser, 1998; and Dierdorf et al., 1993). Figure A.5.7.1.1(a) is a plot of peak HF concentration as a function of the fire-size-to-room-volume ratio. The data encompass room scales of  $1.2 \text{ m}^3$  ( $42 \text{ ft}^3$ ) to  $972 \text{ m}^3$  ( $34,326 \text{ ft}^3$ ). The  $526 \text{ m}^3$  results are from U.S. Coast Guard (USCG) testing; the  $972 \text{ m}^3$  results are based on NRL testing. These fires include diesel and heptane pool and spray fires. The design concentration in all cases except HCFC Blend A (at 8.6 percent) are at least 20 percent above the cup burner value. For fires where the extinguishment times were greater than 17 seconds, the extinguishment time is noted in brackets. Note that excessively high extinguishment times (>60 seconds), which is generally an indication of inadequate agent concentrations, yield qualitatively high HF concentrations; Halon 1301 will yield bromine and hydrogen bromide in addition to HF.

The quantity of HF formed in the tests for all the halocarbon agents tested is approximately three to eight times higher than that formed for Halon 1301 (which also forms bromine and hydrogen bromide). It is important to note that as pointed out by Peatross and Forssell (1996), in many of these large fire scenarios the levels of combustion products (e.g., CO) and the high temperatures involved make it unlikely that a person could survive large fires such as these, irrespective of the HF exposure. The iodine-containing agent  $\text{CF}_3\text{I}$  was not tested in the USCG or NRL studies, but other data available on  $\text{CF}_3\text{I}$  indicate that its production of HF is comparable to that of Halon 1301. In addition, elemental iodine ( $\text{I}_2$ ) is formed from  $\text{CF}_3\text{I}$ .

There might be differences between the various HFC/HCFC compounds tested, but it is not clear from these data whether such differences exist. In all the data reported, the fire sources — heptane or diesel pans of varying sizes — were baffled to prevent direct interaction with the agent.

While the above results are based on Class B fuels, fires involving some Class A combustibles produce lower HF concentrations. For example, hazards such as those in electronic data processing and telecommunication facilities often result in fire sizes of less than 10 kW at detection (Meacham, 1993). In many cases in the telecommunication industry, detection at fire sizes of 1 kW is desired (Grosshandler, 1998). Skaggs and Moore (1994) have pointed out that for typical computer rooms and office spaces, the analysis of DiNenno et al. (DiNenno, 1993) employing fire growth models and test data indicates that thermal decomposition product concentrations from the halogenated agents would be comparable to that from Halon 1301.

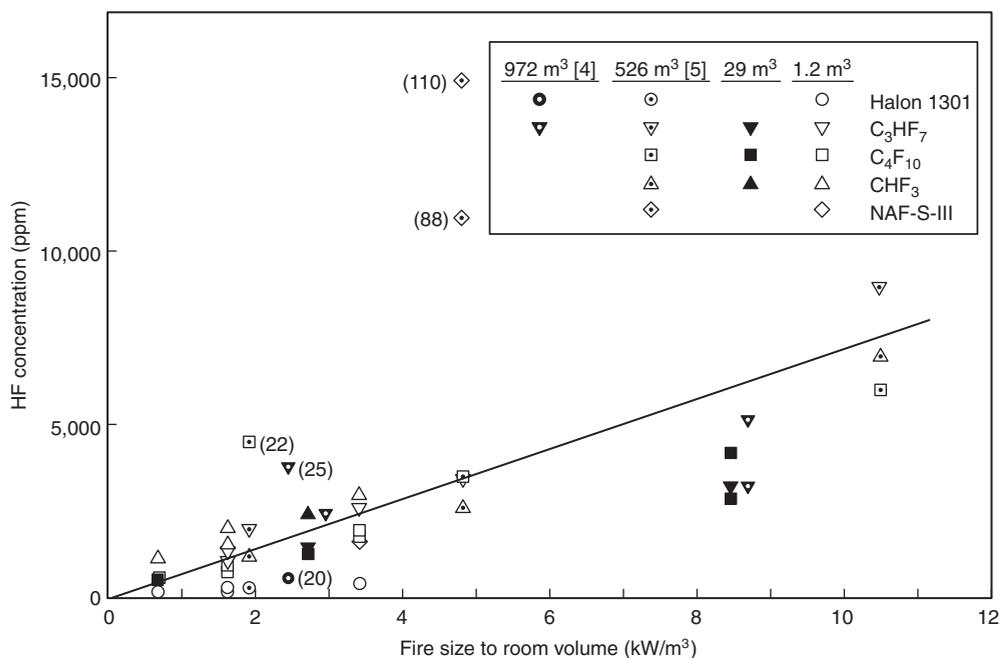


Extinguishment times (seconds) are given in brackets for fires that took longer than 17 seconds to extinguish. If more than one fire was utilized, the longer extinguishment time is given.

**FIGURE A.5.7.1.1(a) Peak HF Concentrations.**

Tests by Hughes Associates, Inc. (1995) evaluated the thermal decomposition products resulting from the extinguishment of Class A fires typical of those encountered in telecommunication and electronic data processing (EDP) facilities by HFC-227ea. The test fuels included shredded paper, PC boards, PVC-coated wire cables, and magnetic tape, representing the most common fuel sources expected to burn in a computer room environment. All fires were extinguished with the minimum design concentration of 7 percent HFC-227ea. Figure A.5.7.1.1(b) (Peatross and Forssell, 1996) shows the HF concentration resulting from these tests. Also shown in Figure A.5.7.1.1(b) is the approximate mammalian median lethal concentration (LC<sub>50</sub>) (Sax, 1984) and the dangerous toxic load (DTL) for humans based upon the analysis of Meldrum (1993). As seen in Figure A.5.7.1.1(b), the HF levels produced in the computer room were below both the estimated mammalian LC<sub>50</sub> and DTL curves. Peatross and Forssell (1996), in their analysis of the test results, concluded that "from an examination of the HF exposures, it is evident that this type of fire does not pose a toxic threat." Also shown in Figure A.5.7.1.1(b) are HF levels produced upon extinguishment of Class B fires of various sizes. In the case of these large Class B fires, HF levels in some cases can be seen to exceed the human DTL. It is important to note that, as pointed out by Peatross and Forssell (1996), in many of these large fire scenarios the levels of combustion products (e.g., CO) and the high temperatures involved make it unlikely that a person could survive large fires such as these, irrespective of the HF exposure.

Some agents, such as inert gases, will not form decomposition products and hence do not require discharge time limitations on that basis. However, the increased combustion products and oxygen level reduction associated with longer discharge times should be considered.

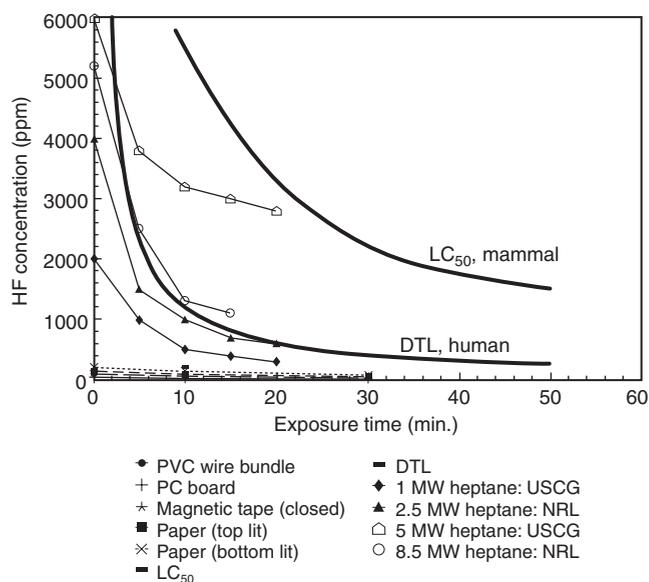

**FIGURE A.5.7.1.1(b) Hazard Assessment of HF Concentrations. Extinguishment of Typical EDP and Class B Hazards with 7 Percent HFC-227ea.**

Agent mass flow rates should be sufficiently high to cause adequate agent mixing and distribution in the compartment. In general, this parameter is determined by the listing of system hardware.

Overpressurization of the protected compartment also should be considered in determining minimum discharge time.

Other secondary flow effects on personnel and equipment include formation of missiles caused by very high discharge velocities, higher noise levels, lifting ceiling panels, among others. The likelihood of these effects increases if the maximum discharge time is set too low.

The maximum 10-second discharge time given in this standard reflects a reasonable value based on experience with Halon 1301 systems. The maximum and minimum discharge times should reflect consideration of the factors previously described.

For inert gases, the measured discharge time is considered to be the time when the measuring device starts to record reduction of oxygen until the design oxygen reduction level is achieved.

Systems designed for explosion prevention present particular design challenges. These systems typically discharge the agent, before ignition occurs, upon detection of some specified fraction of the lower flammable limit of the flammable vapors present.

**A.5.7.1.1.1** The minimum design concentration for flame extinguishment is defined in 5.4.2.2 and includes safety factors for both Class A (surface fires) and Class B hazards. However, many applications involve the use of higher than normal design concentrations for flame extinguishment in order to accomplish the following:

- (1) Provide an initial concentration that will pass minimum holding time requirements
- (2) Allow hot surfaces to cool and thus prevent re-ignition
- (3) Provide protection for electrical equipment that remains energized
- (4) Provide inerting concentrations to protect against the worst-case possibility of explosion of gas vapors, without a fire developing

In the examples cited in A.5.7.1.1.1 through A.5.7.1.1.1(4), it is the intent of 5.7.1.1 to allow discharge times greater than 10 seconds for halocarbon agents and greater than 60 seconds for inert gas agents (for that portion of the agent mass that exceeds the quantity required to achieve the minimum design concentration for flame extinguishment). The additional quantity of clean agent is to be introduced into the hazard at the same nominal flow rate required to achieve the flame extinguishing design concentration, using the same piping and nozzle(s) distribution system; as an alternative, separate piping networks with different flow rates can be used.

**A.5.7.1.1.2** See A.5.7.1.1.1.

**A.5.7.1.1.3** For third-party listing or approval of pre-engineered systems or flow calculation software for engineered systems (see 5.2.1), direct measurement of the point in time at which 95 percent of the agent mass is discharged from the nozzle is not necessary to satisfy compliance with the intent of 5.7.1.1.3. For some agents, the point in time at which 95 percent of the total agent mass coming from a given nozzle is extremely difficult to measure. Rather, for a given agent, a surrogate measurement based on engineering principles can be used. For instance, for some halocarbon agents, the point in which the agent discharge changes from predominately liquid to gas represents approximately 95 percent of the agent mass out of the nozzle and has been previously used in the listing/approval testing for discharge time. For low boiling point agents, the point at which the agent discharge changes from predominately liquid to gas may not be appropriate because this can occur before the point of 95 percent mass dis-

charged. For such agents, a method has been developed that utilizes an equation of state and measured cylinder conditions from the point at which the agent discharge changes from predominately liquid to gas to calculate an agent mass balance in the network of cylinders and pipes. The experimental discharge time is taken as the point at which the summed calculated mass discharged from all nozzles equals 95 percent of the agent required to achieve minimum design concentration.

**A.5.7.2** Special attention should be paid to safety and health issues when extended discharge systems are being considered.

The effect of decomposition products on electronic equipment is a potential area of concern. Sufficient data at present are not available to predict the effects of a given HF exposure scenario on all electronic equipment. Several evaluations of the effect of HF on electronics equipment have been performed relative to the decomposition of Halon 1301, where decomposition products include HF and HBr. One of the more notable was a National Aeronautics and Space Administration (NASA) study in which the space shuttle *Orbiter* electronics were exposed to 700, 7000, and 70,000 ppm HF and HBr (Pedley, 1995). In those tests, exposures up to 700 ppm HF and HBr caused no failures. At 7000 ppm, severe corrosion was noted, and there were some operating failures.

Dumayas (1992) exposed IBM-PC compatible multifunction cards to environments produced by a range of fire sizes as part of an evaluation program on halon alternatives. He found no loss of function of the boards following a 15 minute exposure to post-fire extinguishment atmosphere up to 5000 ppm HF, with unconditioned samples stored at ambient humidity and temperature conditions for up to 30 days. Forssell et al. (1994) exposed multifunction boards for 30 minutes in the post-fire extinguishment environment; no failures were reported up to 90 days post-test. HF concentrations up to 550 ppm were evaluated.

While no generic rule or statement can be made at this time, it appears that short-term damage (<90 days) resulting in electronic equipment malfunction is not likely for exposures up to 500 ppm HF for up to 30 minutes. This damage, however, is dependent on the characteristics of the equipment exposed, post-exposure treatment, exposure to other combustion products, and relative humidity. Important equipment characteristics include its location in the space, existence of equipment enclosures, and the sensitivity of the equipment to damage.

Extended discharge applications inherently have a performance objective of maintaining the agent concentration at or above the design concentration within the enclosure. This objective is valid if there is mixing of agent continually in the enclosure during the hold period, and the enclosure thereby experiences a decaying concentration over time as opposed to a descending interface. The application of agent should be done with sufficient turbulence to accomplish mixing of the additional agent throughout the enclosure. To accomplish this, the extended discharge probably will need to be performed through a separate network of piping and nozzles. These systems are outside the scope of current design requirements and testing procedures for total flooding systems. Systems should be designed and fully discharge tested on a case-by-case basis until the body of knowledge is sufficient enough to be addressed specifically in this standard.

**A.6.1.3** Local concentrations of agent in the vicinity of the discharge often will exceed the maximum permitted exposure limits described in Section 1.5.



Consideration for exposure to agent discharge from local application systems varies greatly and may be more complicated than that for total flooding systems, depending on the following:

- (1) Quantity of agent released
- (2) Time needed to extinguish the fire
- (3) Size of the room or enclosure in which the fire occurs
- (4) Size of the fire
- (5) Proximity of the person to the point of discharge of the agent
- (6) Rate at which fresh air infiltrates the space
- (7) Air exchange rate near the fire

One approach to assess consumer exposure is to employ a “box model,” which has been widely used for many years to estimate probable exposures of workers to hazardous airborne materials, and has been described in detail by the National Institute for Occupational Safety and Health (NIOSH). The box model takes into consideration assumptions on the volume of the space in which the extinguishant is used, the rate at which fresh air infiltrates the space, the quantity and rate of agent release, the area of the fire, the location of the worker, and the air exchange rate in the vicinity of the fire. Values obtained through the box model, compared to cardiotoxic NOAEL/LOAEL values, provide a screen for assessing risk.

It should be noted that because the model can overstate the actual exposure to an agent, it might be necessary to conduct personal monitoring tests in actual-use scenarios in order to complete the assessment.

**A.6.4.1.1** The maximum permitted time for fire extinguishment is based upon extinguishing agent being present at the discharge nozzle. For halocarbon agents, this typically is identified with either a pressure at the nozzle of 25 psi (1.7 bar) or rate of pressure increase of 11 psi/sec (0.8 bar/sec). The times for test fires to be extinguished are from this reference point.

**A.6.4.1.2** The maximum permitted time for fire extinguishment is based upon extinguishing agent being present at the discharge nozzle. Typically for inert gas agents, this is identified with either a pressure at the nozzle of 200 psi (13.8 bar) or rate of pressure increase of 600 psi/sec (41.4 bar/sec). The times for test fires to be extinguished are from this reference point.

**A.6.4.1.3** The nozzle listing evaluation should consider application on fuels, including solids and flammable liquids; orientation and angle of discharge; intended area of coverage and the related distance from fire; and extinguishment time and the related discharge rate. Testing of flammable liquids of appreciable depth (over ¼ in.) will consider evaluation of splash and extinguishment. The evaluation for splash will be at maximum rates of flow from minimum pressure loss in the piping limitations and maximum operating temperature of the system. The evaluation for extinguishment will be at minimum rates of flow from maximum pressure loss in the piping limitations and minimum operating temperature of the system.

**A.6.4.3.3** The maximum temperature of a burning liquid fuel is limited by its boiling point where evaporative cooling matches the heat input. In most liquids, the auto-ignition temperature is far above the boiling temperature, so that re-ignition after extinguishment can be caused only by an external ignition source. However, a few liquids have auto-ignition temperatures that are much lower than their boiling temperatures. Common cooking oils and melted paraffin wax have this property. To prevent re-ignition in these

materials, it is necessary to maintain an extinguishing atmosphere until the fuel has cooled below its auto-ignition temperature.

**A.6.5.1** Areas that require multiple nozzles should be considered as part of the listing.

**A.6.5.2** Nozzles should be located so that they do not interfere with normal operations and maintenance in the hazard area.

**A.6.6** The system should be designed to provide an effective discharge of clean agent promptly before excessive amounts of heat can be absorbed by materials within the hazard. Rapid detection should be considered. The clean agent supply should be located as near to the hazard as practicable and yet not exposed to the fire, and the pipeline should be as direct as practicable with a minimum number of turns in order to get clean agent to the fire promptly.

**A.7.1.2** The inspection report provides the owner with information pertaining to the fire system, its condition, and any necessary repairs or modifications. The servicing company should review the inspection report to ensure that the necessary data are captured and a safe and thorough inspection is performed. The *FSSA Design Guide for Use with Fire Protection Systems Inspection Forms* can assist in this review and assist a new servicing company in the development of a complete inspection report form.

**A.7.1.4** Inert gas clean agents based on those gases normally found in the earth’s atmosphere need not be recycled.

It is preferable to recycle recovered halogenated clean agents rather than to destroy them. If recovered halogenated agent is found by test to contain contaminants that make it either technically or economically unfeasible to process the recovered agent to bring it into compliance with 4.1.2, the agent should be destroyed in an environmentally acceptable manner.

**A.7.2** The Fire Suppression Systems Association has prepared a guide that provides essential information on the regulatory requirements for transportation and requalification of cylinders used in clean agent fire extinguishing systems. FSSA’s *Test Guide for Use with Special Hazard Fire Suppression Systems Containers* lists manufacturer-specific cylinder data. The quick reference guide will assist service personnel to determine the required test and requalification of the system container.

**A.7.2.1** Transporting charged containers that have not been tested within 5 years could be illegal. Federal and local regulations should be consulted.

**A.7.2.2** These guidelines apply only to the external inspection of containers continuously in service in the fire extinguishing system and should not be confused with the DOT retest requirements for visual inspection described in 49 CFR.

Proper recordkeeping is an important part of every inspection. The inspector should be guided by the following outline to ensure that the minimum information is recorded:

- (1) *Record tag.* A record tag should be attached to every container being inspected for future reference. The record tag should be marked with date of inspection (month/year), name of individual(s) and company performing the inspection, container serial number, condition of the container (paint, corrosion, dents, gouges, etc.), and disposition.
- (2) *Inspection report.* The following information should be recorded on an inspection report: date of inspection

(month/year), name of individual(s) and company performing the inspection, DOT specification number, container serial number, date of manufacture, date of previous inspection and/or test, type of protective coating, surface condition (corrosion, dents, gouges, fire damage, etc.), and disposition (satisfactory, repaint, repair, scrap, etc.). A sample of a suitable inspection report form can be found in Appendix A of CGA C-6.

**A.7.5** The manufacturer's maintenance procedure should be guided by the following outline:

- (1) System
  - (a) Check overall physical appearance.
  - (b) Disarm system prior to test.
- (2) Hazard
  - (a) Determine size.
  - (b) Determine configuration.
  - (c) Check for unclosable openings.
  - (d) Determine fuels.
  - (e) Determine other aspects of the hazard that could impair effectiveness of the extinguishing systems.
- (3) Supervised circuits
  - (a) Exercise all functions.
  - (b) Check all electrical or pneumatic supervisory circuits for proper operation.
- (4) Control panel
  - (a) Exercise all functions.
  - (b) Check supervision if applicable, of each circuit (including releasing devices) as recommended by the manufacturer.
- (5) Power supply
  - (a) Check routing, circuit breakers, fuses, disconnects.
- (6) Emergency power
  - (a) Check battery condition.
  - (b) Check charger operation; check fuse.
  - (c) Check automatic changeover.
  - (d) Check maintenance of generator (if one exists).
- (7) Detectors
  - (a) Test each detector using heat, smoke, or manufacturer's approved test device. (*See NFPA 72.*)
  - (b) Electric type.
    - i. Clean and adjust smoke detector and check sensitivity.
    - ii. Check wiring condition.
  - (c) Pneumatic type: Check tightness of tubing and operation of mercury checks, using manometer.
- (8) Time delay
  - (a) Exercise functions.
  - (b) Check time limit.
  - (c) Check that timer will complete its cycle even though wiring between it and the detector circuit is interrupted.
- (9) Alarms
  - (a) Test for operation (audible and visual).
  - (b) Check to see that warning signs are properly displayed.
- (10) Selector (directional) valves
  - (a) Exercise functions.
  - (b) Reset properly.
- (11) Release devices
  - (a) Check for complete closure of dampers.
  - (b) Check doors; check for any doors blocked open.
- (12) Equipment shutdown
  - (a) Test shutdown function.
  - (b) Check adequacy (all necessary equipment included).
- (13) Manual releases
  - (a) Mechanical type.
    - i. Check pull, force, and length of pull required.
    - ii. Operate and adjust all devices.
    - iii. Check tightness of connectors.
    - iv. Check condition of conduit.
    - v. Check condition and operation of corner pulleys.
  - (b) Electric type.
    - i. Test manual release.
    - ii. Check that covers are in place.
  - (c) Check pneumatic releases.
  - (d) Check accessibility during fire.
  - (e) Separate main and reserve manual pulls that require only one operation, to obtain discharge of either main or reserve supply of gas.
  - (f) Clearly mark and identify all manual releases.
- (14) Piping
  - (a) Check security; check that piping is adequately supported.
  - (b) Check condition; check for any corrosion.
- (15) Nozzles
  - (a) Check orientation and orifice size; make sure they are unchanged from original design.
  - (b) Check cleanliness.
  - (c) Check security.
  - (d) Check seals where needed.
- (16) Containers
  - (a) Check physical condition; check for any sign of corrosion.
  - (b) Check the contents for weight by acceptable methods for each cylinder. If the contents are below the required quantity specified in 7.1.3.1 and 7.1.3.2, then the containers must be refilled or replaced. (Proper operation of the liquid level gauge should be verified.)
  - (c) Check that cylinders are securely held in position.
  - (d) Check hydrostatic test date.
  - (e) Check cylinder connectors for integrity and condition.
  - (f) Check weights and cables of mechanical release system.
  - (g) Check release devices; check for proper arrangement and security.
  - (h) Check explosive release devices; check replacement date; check condition.
- (17) Test
  - (a) Perform recommended discharge tests when there is any question about the adequacy of the system.
  - (b) Perform recommended full discharge test when cylinder hydrostatic test is required.
- (18) Return all parts of system to full service.
- (19) Give certificate of inspection to owner.
  - (a) Regular service contracts with the manufacturer or installing company are recommended. Work should be performed by personnel thoroughly trained and regularly engaged in providing such service.



**A.7.5.3** The method of sealing should not introduce any new hazards.

**A.7.6.2** Training should cover the following:

- (1) Health and safety hazards associated with exposure to extinguishing agent caused by inadvertent system discharge
- (2) Difficulty in escaping spaces with inward swinging doors that are overpressurized due to an inadvertent system discharge
- (3) Possible obscuration of vision during system discharge
- (4) Need to block open doors at all times during maintenance activities
- (5) Need to verify that a clear escape path exists to compartment access
- (6) A review of how the system could be accidentally discharged during maintenance, including actions required by rescue personnel should accidental discharge occur

**A.7.7** Manufacturers of fire suppression system equipment should make available the manufacturer's design, installation, and maintenance manual and product safety bulletins to the authority having jurisdiction upon request.

**A.7.7.2.1** A sample test report is provided in Figure A.7.7.2.1. An alternative form that assures that all the applicable design, operational, and safety requirements of this standard are documented to the satisfaction of the authority having jurisdiction can be used.

**A.7.7.2.4.10** A discharge test is generally not required.

**A.7.7.2.4.13** The purpose is to conduct a flow test of short duration (also known as a "puff test") through the piping network to determine that the flow is continuous and to check that valves are properly oriented and the piping and nozzles are unobstructed.

The flow test should be performed using gaseous nitrogen or an inert gas at a pressure not to exceed the normal operating pressure of the clean agent system.

The nitrogen or an inert gas pressure should be introduced into the piping network at the clean agent cylinder connection. The quantity of nitrogen or inert gas used for this test should be sufficient to verify that each and every nozzle is unobstructed.

Visual indicators should be used to verify that nitrogen or an inert gas has discharged out of each and every nozzle in the system.

**A.7.7.2.5** The leakage and predicted retention time of an enclosure can be determined using the procedure in Annex C, Enclosure Integrity Procedure, or by an alternative method that can be used to obtain an equivalent quantitative result. The currently preferred method is using a blower door fan unit and smoke pencil.

**A.7.7.2.7.1(2)** For electrically actuated release mechanisms, these devices can include 24-V lamps, flashbulbs, or circuit breakers. Pneumatically actuated release mechanisms can include pressure gauges. Refer to the manufacturer's recommendations in all cases.

**A.7.8** Safety should be a prime concern during installation, service, maintenance, testing, handling, and recharging of clean agent systems and agent containers.

One of the major causes of personnel injury and property damage is attributed to the improper handling of agent containers by untrained and unqualified personnel. In the interest of safety and in order to minimize the potential for personnel injury and property damage, the following guidelines should be adhered to:

- (1) If any work is to be performed on the fire suppression system, qualified fire service personnel, trained and experienced in the type of equipment installed, should be engaged to do the work.
- (2) Personnel involved with fire suppression system cylinders must be thoroughly trained in the safe handling of the containers as well as in the proper procedures for installation, removal, handling, shipping, and filling; and connection and removal of other critical devices, such as discharge hoses, control heads, discharge heads, initiators, and anti-recoil devices.
- (3) The procedures and cautions outlined on the cylinder nameplates and in the operation and maintenance manuals, owner's manuals, service manuals, and service bulletins that are provided by the equipment manufacturer for the specified equipment installed should be followed.
- (4) Most fire suppression system cylinders are furnished with valve outlet anti-recoil devices and in some cases cylinder valve protection caps. Do not disconnect cylinders from the system piping or move or ship the cylinders if the anti-recoil devices or protection caps are missing. Obtain these parts from the distributor of the manufacturer's equipment or the equipment manufacturer. These devices are provided for safety reasons and should be installed at all times, except when the cylinders are connected into the system piping or being filled.
- (5) All control heads, pressure-operated heads, initiators, discharge heads, or other type of actuation devices should be removed before disconnecting the cylinders from the system piping, and anti-recoil devices and/or protection caps should be immediately installed before the cylinders are moved or shipped. Most fire suppression system equipment varies from manufacturer to manufacturer; therefore, it is important to follow the instructions and procedures provided in the equipment manufacturer's manuals. These actions should be undertaken only by qualified fire suppression system service personnel.
- (6) Safety is of prime concern. Never assume that a cylinder is empty. Treat all cylinders as if they are fully charged. Most fire suppression system cylinders are equipped with high flow rate valves that are capable of producing high discharge thrusts out of the valve outlet if not handled properly. Remember, pressurized cylinders are extremely hazardous. Failure to follow the equipment manufacturer's instructions and the guidelines contained herein can result in serious bodily injury, death, or property damage.

**A.8.2.1** Some typical hazards that could be suitable include, but are not limited to, the following:

- (1) Machinery spaces such as main machinery spaces
- (2) Emergency generator rooms
- (3) Pump rooms
- (4) Flammable liquid storage and handling areas and paint lockers
- (5) Control rooms and electronic equipment spaces