

NFPA 253
Standard Method of
Test for Critical
Radiant Flux of
Floor Covering Systems
Using a Radiant Heat
Energy Source

2000 Edition



National Fire Protection Association, 1 Batterymarch Park, PO Box 9101, Quincy, MA 02269-9101
An International Codes and Standards Organization

Copyright ©
National Fire Protection Association, Inc.
One Batterymarch Park
Quincy, Massachusetts 02269

IMPORTANT NOTICE ABOUT THIS DOCUMENT

NFPA codes, standards, recommended practices, and guides, of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in its codes and standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on this document. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making this document available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of this document. Nor does the NFPA list, certify, test or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

NOTICES

All questions or other communications relating to this document and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA documents during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

Users of this document should be aware that this document may be amended from time to time through the issuance of Tentative Interim Amendments, and that an official NFPA document at any point in time consists of the current edition of the document together with any Tentative Interim Amendments then in effect. In order to determine whether this document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments, consult appropriate NFPA publications such as the *National Fire Codes*[®] Subscription Service, visit the NFPA website at www.nfpa.org, or contact the NFPA at the address listed above.

A statement, written or oral, that is not processed in accordance with Section 5 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

The NFPA does not take any position with respect to the validity of any patent rights asserted in connection with any items which are mentioned in or are the subject of this document, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on this document. Users of this document are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Users of this document should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

Licensing Policy

This document is copyrighted by the National Fire Protection Association (NFPA). By making this document available for use and adoption by public authorities and others, the NFPA does not waive any rights in copyright to this document.

1. Adoption by Reference—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription—**A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

3. Scope of License Grant—The terms and conditions set forth above do not extend to the index of this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Copyright © 2000 NFPA, All Rights Reserved

NFPA 253

Standard Method of Test for

Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source

2000 Edition

This edition of NFPA 253, *Standard Method of Test for Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source*, was prepared by the Technical Committee on Fire Tests and acted on by the National Fire Protection Association, Inc., at its November Meeting held November 14–17, 1999, in New Orleans, LA. It was issued by the Standards Council on January 14, 2000, with an effective date of February 11, 2000, and supersedes all previous editions.

This edition of NFPA 253 was approved as an American National Standard on February 11, 2000.

Origin and Development of NFPA 253

Experience suggests that during the early stages of a fire, floor covering systems seldom have acted as a fire spread medium. However, in a few fires involving multiple occupancy buildings, the floor covering materials in corridors were primarily responsible for fire spread over a considerable distance. These situations caused grave concern and pointed to the need for a realistic test to evaluate the flame spread of floor covering systems.

The flooring radiant panel test had its inception with the Armstrong Cork Company in 1966. In 1972, conceptualization of critical radiant flux (W/cm^2 at extinguishment) as a measure of flame spread hazard was underway at the National Bureau of Standards (NBS). It was determined in the course of NBS work on model corridor fire tests that the radiant energy levels incident on the floor covering had a considerable influence on whether or not flaming combustion would propagate. Accordingly, it was natural to apply the critical radiant flux concept, and, in 1973, the NBS prepared a draft of the flooring radiant panel test.

In 1975, the Technical Committee on Fire Tests began its evaluation of the proposed test methods, which culminated in the adoption of this test as an official NFPA standard in May 1978. The standard was revised in 1984 and 1990.

The 1995 edition included significant improvements based on work conducted by the National Institute of Standards and Technology (NIST) and the carpet industry. These findings improved the overall application of the standard and provided measured improvement in test precision. Other changes included a new pilot burner and reduction of the variation in the airflow through the chamber, which reduced the variability of data. Revisions also were made to eliminate “permissive” language. These revisions created closer harmony with ASTM E 648, *Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source*.

The 2000 edition is a reconfirmation of the 1995 edition.

Technical Committee on Fire Tests

Jesse J. Beitel, *Chair*
Hughes Assoc. Inc., MD [SE]

Patty K. Adair, American Textile Mfrs., Inst., DC [M]
April L. Berkol, Starwood Hotels and Resorts, Inc., NY [U]
Rep. American Hotel & Motel Assn.
John A. Blair, The DuPont Co., DE [M]
Rep. The Society of the Plastics Industry Inc.
William E. Fitch, Omega Point Laboratories Inc., TX [RT]
Thomas W. Fritz, Armstrong World Industries Inc., PA [M]
James R. Griffith, Southwest Research Inst., TX [RT]
Gordon E. Hartzell, Hartzell Consulting, Inc., TX [SE]
Marcelo M. Hirschler, GBH Int'l, CA [SE]
Alfred J. Hogan, Reedy Creek Improvement District, FL [E]
Rep. Int'l Fire Marshals Assn.
William E. Koffel, Jr., Koffel Assoc. Inc., MD [SE]
James R. Lawson, U.S. Nat'l Inst. of Standards & Technology, MD [RT]
Gerald E. Lingenfelter, American Insurance Services Group Inc., NY [I]
Rodney A. McPhee, Canadian Wood Council, ON, Canada [M]

William S. Metes, Underwriters Laboratories Inc., IL [RT]
James A. Milke, University of Maryland, MD [SE]
John Roberts, Underwriters Laboratories of Canada, ON, Canada [RT]
Nigel R. Stamp, Intertek Testing Services NA Inc., WI [RT]
Phil M. Stricklen, Amoco Fabrics and Fibers, GA [M]
Kuma Sumathipala, American Forest & Paper Assn., DC [M]
T. Hugh Talley, Hugh Talley Co., TN [M]
Rep. Upholstered Furniture Action Council
David K. Tanaka, Factory Mutual Research Corp., MA [I]
Richard P. Thornberry, The Code Consortium, Inc., CA [SE]
William A. Webb, Performance Technology Consulting, Ltd, IL [SE]
Robert A. Wessel, Gypsum Assn., DC [M]
Robert J. Wills, American Iron & Steel Inst., AL [M]
Peter J. Gore Willse, HSB Industrial Risk Insurers, CT [I]

Alternates

Kenneth G. Adams, The Society of the Plastics Industry Inc., DC [M]
(Alt. to J. A. Blair)
Robert G. Bill, Jr., Factory Mutual Research Corp., MA [I]
(Alt. to D. K. Tanaka)
Delbert F. Boring, Jr., American Iron & Steel Inst., OH [M]
(Alt. to R. J. Wills)
Tony Crimi, Underwriters Laboratories of Canada, ON, Canada [RT]
(Alt. to J. Roberts)
Philip J. DiNunno, Hughes Assoc., Inc., MD [SE]
(Alt. to J. J. Beitel)
Sam W. Francis, American Forest & Paper Assn., PA [M]
(Alt. to K. Sumathipala)
Richard G. Gann, U.S. Nat'l Inst. of Standards & Technology, MD [RT]
(Alt. to J. R. Lawson)

Marc L. Janssens, Southwest Research Inst., TX [RT]
(Alt. to J. R. Griffith)
John W. Michener, Milliken Research Corp., SC [M]
(Alt. to P. K. Adair)
Frederick W. Mowrer, University of Maryland, MD [SE]
(Alt. to J. A. Milke)
Gene V. Paolucci, Yasuda Fire & Marine Insurance Co. of America, NY [I]
(Alt. to G. E. Lingenfelter)
William A. Thornberg, HSB Industrial Risk Insurers, CT [I]
(Alt. to P. J. G. Willse)
James J. Urban, Underwriters Laboratories Inc., IL [RT]
(Alt. to W. S. Metes)
Joe Ziolkowski, American Furniture Mfrs. Assn., NC [M]
(Alt. to T. H. Talley)

Nonvoting

Robert H. Barker, American Fiber Mfrs. Assn., DC [M]
(Alt. to T. L. Jilg)
James F. Hoebel, U.S. Consumer Product Safety Commission, MD [C]
Tod L. Jilg, Hoechst Celanese Corp., NC [M]
Rep. American Fiber Mfrs. Assn.

Rohit Khanna, U.S. Consumer Product Safety Commission, MD [C]
(Alt. to J. F. Hoebel)
James C. Norris, Couance Laboratories Ltd, [SE]
Herman H. Spaeth, Novato, CA
(Member Emeritus)

Walter P. Sterling, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of this document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on fire testing procedures, for reviewing existing fire test standards and recommending appropriate action to NFPA, for recommending the application of and advising on the interpretation of acceptable test standards for fire problems of concern to NFPA technical committees and members, and for acting in a liaison capacity between NFPA and the committees of other organizations writing fire test standards. This Committee does not cover fire tests that are used to evaluate extinguishing agents, devices, or systems.

Contents

Chapter 1 General	253- 4	6-2 Sample Mounting	253- 9
1-1 Scope	253- 4	6-3 Ignition of Pilot Burner	253- 9
1-2 Significance and Use	253- 4	6-4 Flame Propagation of Specimen	253- 9
1-3 Summary of Test Method	253- 4	6-5 Completion of Test	253- 9
1-4 Definitions	253- 4	6-6 Data Collection and Recording	253- 9
		6-7 Removal of Specimen	253- 9
		6-8 Subsequent Testing	253- 9
Chapter 2 Test Apparatus	253- 5	Chapter 7 Calculations	253-10
2-1 Radiant Panel Test Apparatus	253- 5	7-1 General.....	253-10
2-2 Test Chamber	253- 5	Chapter 8 Report	253-10
2-3 Radiant Heat Energy Source	253- 6	8-1 Required Information.....	253-10
2-4 Specimen Holder	253- 6	Chapter 9 Referenced Publications	253-10
2-5 Pilot Burner	253- 7	Appendix A Explanatory Material	253-10
2-6 Thermocouples.....	253- 7	Appendix B Procedure for Calibration of Apparatus	253-10
2-7 Exhaust Hood.....	253- 8	Appendix C Mounting Methods	253-11
2-8 Dummy Specimen	253- 8	Appendix D Sample Data Log	253-11
2-9 Timer.....	253- 8	Appendix E Commentary on Critical Radiant Flux Test	253-12
Chapter 3 Test Specimens	253- 8	Appendix F Precision and Bias	253-14
3-1 Sampling Procedure.....	253- 8	Appendix G Referenced Publications	253-14
3-2 Specimen Size and Mounting	253- 8	Index	253-15
3-3 Specimen Conditioning.....	253- 8		
Chapter 4 Safety Precautions	253- 8		
4-1 Gas-Air Fuel Explosions	253- 8		
4-2 Exhaust System.....	253- 8		
Chapter 5 Radiant Heat Energy Flux Profile Standardization	253- 8		
5-1 Procedure.....	253- 8		
Chapter 6 Test Procedure	253- 9		
6-1 Pretest Heating.....	253- 9		

NFPA 253

Standard Method of Test for
**Critical Radiant Flux of Floor Covering
 Systems Using a Radiant Heat
 Energy Source**

2000 Edition

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Appendix A.

Information on referenced publications can be found in Chapter 9 and Appendix G.

Chapter 1 General

1-1 Scope.

1-1.1 This fire test response standard describes a procedure for measuring critical radiant flux behavior of horizontally mounted floor covering systems exposed to a flaming ignition source in a graded, radiant heat energy environment within a test chamber. The specimen can be mounted over underlayment or over a simulated concrete structural floor, bonded to a simulated structural floor, or otherwise mounted in a typical and representative way.

1-1.2 This fire test response standard measures the critical radiant flux at flameout. It provides a basis for estimating one aspect of fire exposure behavior for floor covering systems.

The imposed radiant flux simulates the thermal radiation levels likely to impinge on the floors of a building whose upper surfaces are heated by flames or hot gases, or both, from a fully developed fire in an adjacent room or compartment. The standard was developed to simulate an important fire exposure component in fires that develop in corridors or exitways of buildings and is not intended for routine use in estimating flame spread behavior of floor covering in building areas other than corridors or exitways. Appendix F provides information on the proper application and interpretation of the results of this test.

1-1.3 This standard shall be used to measure and describe the response of materials, products, or assemblies to heat and flame under controlled conditions and shall not be used to describe or appraise the fire hazard or fire risk of materials, products, or assemblies under actual fire conditions. However, the results of the test shall be permitted to be used as elements of a fire hazard assessment or a fire risk assessment that takes into account all factors that are pertinent to an assessment of the fire hazard or fire risk of a particular end use.

1-1.4 This standard does not purport to address all safety problems associated with its use. The user of this standard is responsible to establish appropriate safety and health practices and to determine the applicability of regulatory limitations prior to use. Specific safety precautions are provided in Chapter 4.

1-2 Significance and Use.

1-2.1 This fire test response standard is designed to provide a basis for estimating one aspect of the fire exposure behavior

of a floor covering system installed in a building corridor. The test environment simulates conditions that have been observed and defined in full-scale corridor experiments.

1-2.2 The test is suitable for regulatory statutes, specification acceptance, design purposes, or development and research.

1-2.3 The fundamental assumption inherent in the test is that "critical radiant flux" is one measure of the sensitivity to flame spread of floor covering systems located in a building corridor.

1-2.4 The test is applicable to floor covering system specimens that follow or simulate accepted installation practice. Tests on the individual elements of a floor system are not valid for evaluation of the flooring system.

1-3 Summary of Test Method. The basic elements of the test chamber include an air-gas-fueled radiant heat energy panel inclined at 30 degrees to and directed at a horizontally mounted floor covering system specimen. The radiant panel generates a radiant energy flux distribution along the 100-cm length of the test specimen from a nominal maximum of 1.0 W/cm² to a minimum of 0.1 W/cm². The test is initiated by open-flame ignition from a pilot burner. The distance burned to flameout is converted to W/cm² from the flux profile graph shown in Figure 1-3 and is reported as critical radiant flux W/cm².

1-4 Definitions.

1-4.1 Blackbody Temperature. The temperature of a perfect radiator; a surface with an emissivity of unity and, therefore, a reflectivity of zero (0).

1-4.2 Corridor. An enclosed space connecting a room or compartment with an exit. The corridor includes normal extensions, such as lobbies and other enlarged spaces.

1-4.3 Critical Radiant Flux. The level of incident radiant heat energy on the floor covering system at the most distant flameout point. It is reported as W/cm².

1-4.4 Flameout. The time at which the last vestige of flame or glow disappears from the surface of the test specimen, frequently accompanied by a final puff of smoke; time zero (0) is the time at which the specimen is moved into the chamber and the door is closed. (See Section 6-3.)

1-4.5 Floor Covering. A separate or secondary surface applied over a flooring and including underlayment materials, carpeting, resilients, and coating systems.

1-4.6 Floor Covering System. A flooring or a combination of flooring and floor covering.

1-4.7 Flooring. A primary floor surface or a final floor surface.


1-4.8 Flux Profile. The curve of incident radiant heat energy on the specimen plane relative to the distance from the point of initiation of flaming ignition (i.e., 0 cm).

1-4.9 Shall. Indicates a mandatory requirement.

1-4.10 Should. Indicates a recommendation or that which is advised but not required.

1-4.11 Standard Cushion. *Type II — Rubber Coated Jute and Animal Hair or Fiber*, Federal Specification DDD-C-001023 (GSA-FSS), Amendment 1, March 10, 1972 (minimum 9.53 mm thick, 1.47 kg/0.836 m²).

FIGURE 1-3 Standard radiant heat energy flux profile.

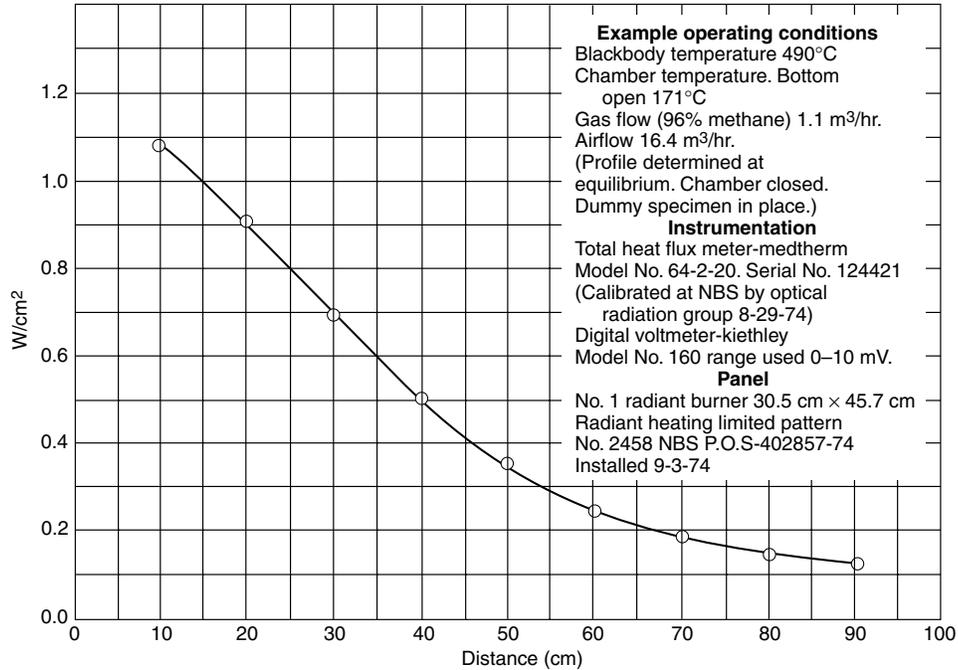

1-4.12 Standard Simulated Concrete Subfloor. Uncoated fiber-reinforced cement board with a nominal thickness of 6.3 mm and a density of 1762 kg/m³ ± 80 kg/m³.

1-4.13 Total Flux Meter. The instrument used to measure the level of radiant heat energy incident on the specimen plane at any point.

Chapter 2 Test Apparatus


2-1 Radiant Panel Test Apparatus. The apparatus shall be essentially as shown in Figures 2-1(a) and 2-1(b).

FIGURE 2-1(a) Flooring radiant panel test apparatus.




2-2 Test Chamber. The flooring radiant panel test chamber employed for this test shall be located in a draft-protected laboratory.

FIGURE 2-1(b) Flooring radiant panel test apparatus showing carpet specimen and gas-fueled panel.

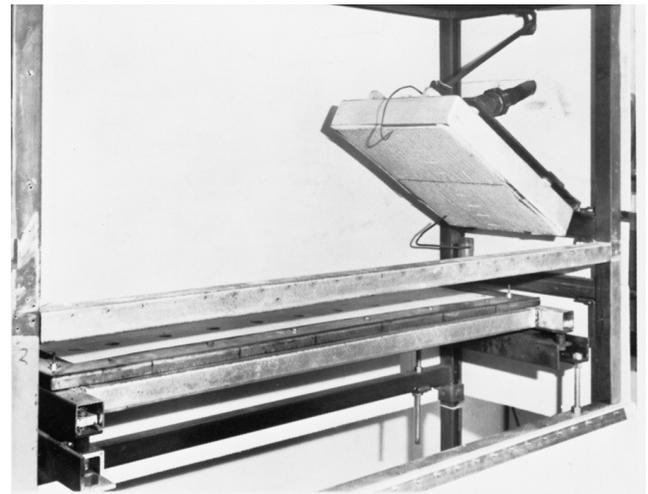

2-2.1 The flooring radiant panel test chamber [see Figures 2-2.1(a) and 2-2.1(b)] shall consist of an enclosure 1400 mm long × 500 mm wide × 710 mm high above the test specimen. The sides, ends, and top shall be of 13-mm calcium silicate board, with a nominal density insulating material of 0.74 g/cm³ and shall have a thermal conductivity at 177°C of 0.128 W/(m·k). One side shall be provided with an approximately 100-mm × 1100-mm, draft-tight, fire-resistant glass window so that the entire length of the test specimen can be observed from outside the fire test chamber. On the same side and below the observation window, there shall be a door that, when open, allows the specimen platform to be moved out for mounting or removal of test specimens. Where necessary for observation, a draft-tight, fire-resistant observation window shall be installed at the low flux end of the chamber.

FIGURE 2-2.1(a) Side elevation of flooring radiant panel tester schematic.

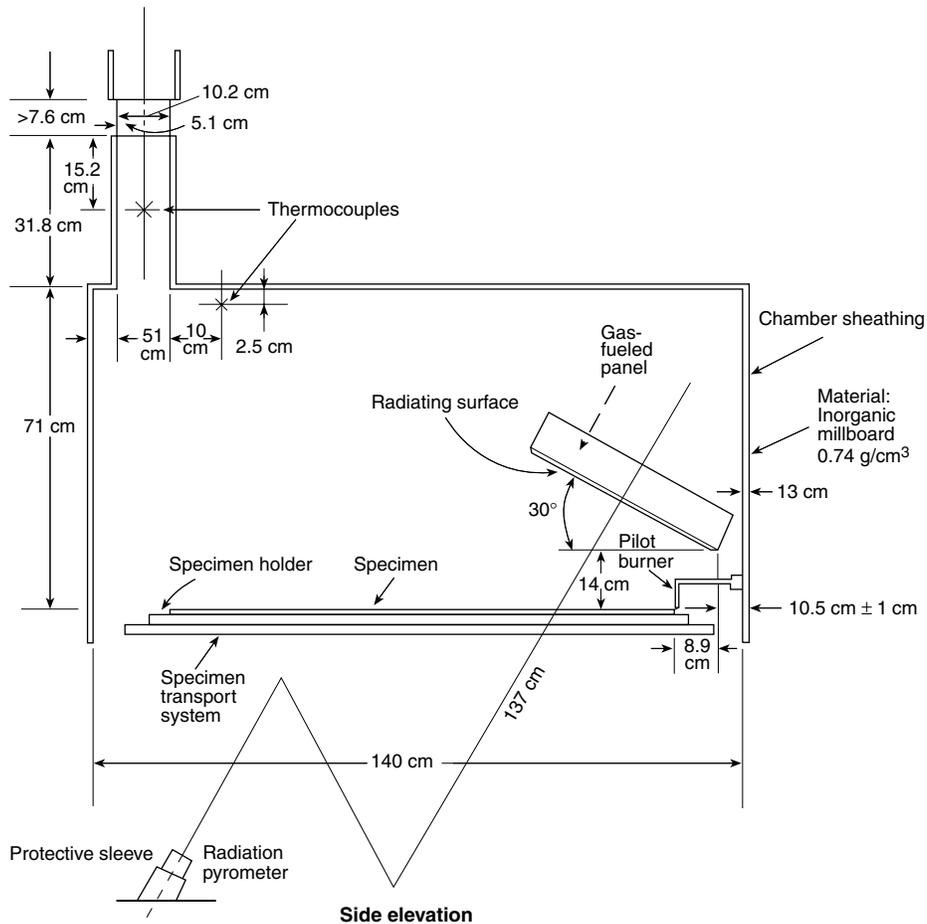

2-2.2 The bottom of the test chamber shall consist of a sliding steel platform that has provisions for rigidly securing the test specimen holder in a fixed and level position.

2-2.2.1 The test specimen holder shall be level when in place and shall be secured to the specimen mounting platform.

2-2.2.2 The free, or air access, area around the platform shall be 2580 cm² to 3225 cm².

2-2.3 The top of the chamber shall have an exhaust stack with interior dimensions of 102 mm ± 3 mm wide × 380 mm ± 3 mm deep × 318 mm ± 3 mm high at the opposite end of the chamber from the radiant panel.

2-3 Radiant Heat Energy Source.

2-3.1 The radiant heat energy source shall be a panel consisting of a porous refractory material mounted in a cast-iron frame or steel frame and having a radiation surface of 305 mm × 457 mm. It shall be capable of operating at temperatures up to 816°C.

2-3.2 The panel fuel system shall consist of a venturi-type aspirator for mixing gas and air at approximately atmospheric pressure, a clean, dry air supply capable of providing 28.3 NTP m³/hr at 76 mm of water column, and suitable instrumentation for monitoring and controlling the flow of fuel to the panel. The radiant heat energy panel shall be fired by propane, methane, or natural gas.

2-3.3 The radiant heat energy panel shall be mounted at 30 degrees to the horizontal specimen plane. The horizontal distance from the zero (0) mark on the specimen fixture to the bottom edge (projected) of the radiating surface of the panel shall be 89 mm.

The panel-to-specimen vertical distance shall be 140 mm [see Figures 2-2.1(a) and 2-2.1(b)]. The preceding angle and dimension shall be followed to obtain the required radiant flux profile.

2-3.4 The radiation pyrometer for standardizing the thermal output of the panel shall be suitable for viewing a circular area 254 mm in diameter at a distance of about 1.37 m. The radiation pyrometer shall be calibrated over an operating black-body temperature range of 490°C to 510°C in accordance with the procedure described in Appendix B.

2-3.5 A high impedance voltmeter or potentiometric voltmeter with a suitable millivolt range shall be used to monitor the output of the radiation pyrometer described in 2-3.4.

2-4* Specimen Holder. The specimen holder (see Figure 2-4) shall be constructed from heat-resistant stainless steel having a thickness of 1.98 mm, and an overall dimension of 1140 mm × 320 mm, with a specimen opening of 200 mm × 1000 mm. Six slots shall be cut in the flange on either side of the holder to reduce warping. The holder shall be fastened to the platform with two stud bolts at each end.

FIGURE 2-2.1(b) Low flux elevation of flooring radiant panel tester schematic.

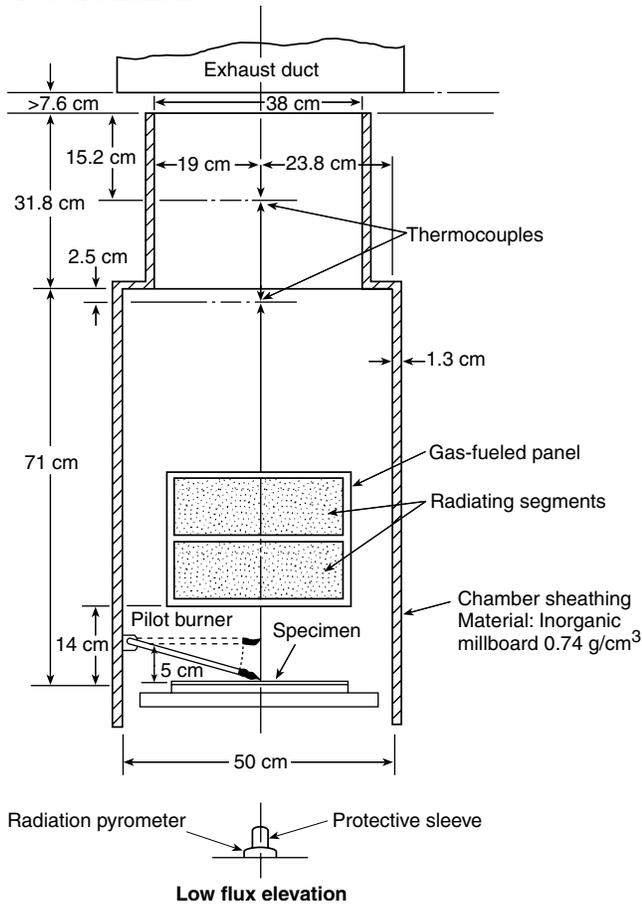


FIGURE 2-4 Dummy specimen in specimen holder.


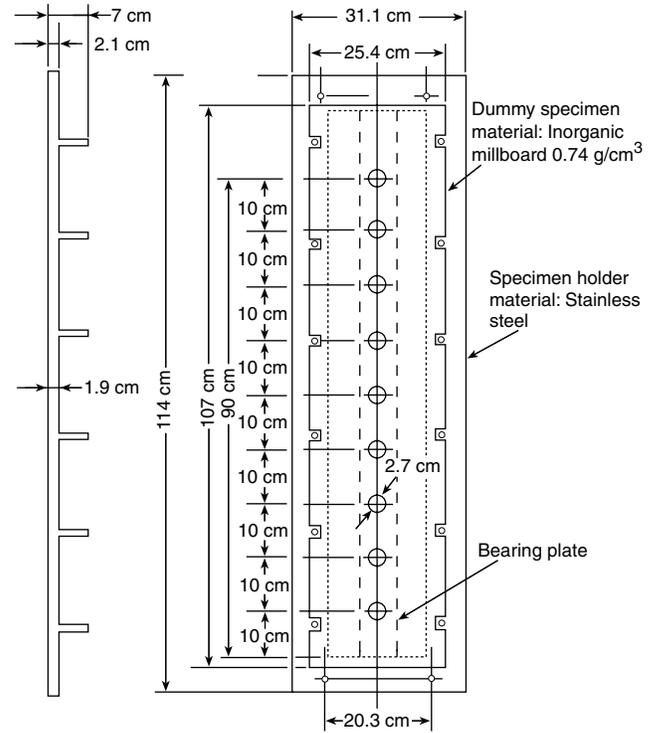


FIGURE 2-5.1 Pilot burner.

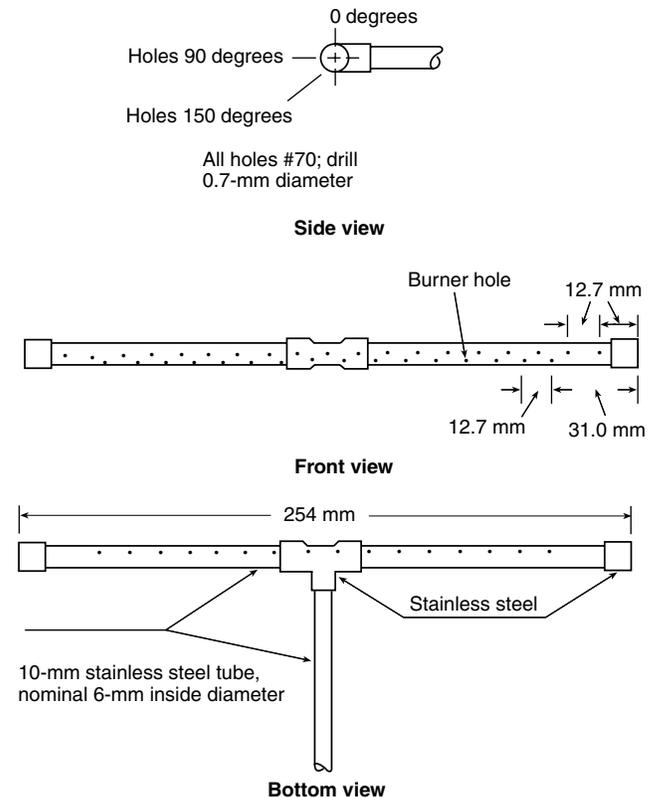

Note: All joints silver soldered, heliarced, or other appropriate seal.

2-5 Pilot Burner.

2-5.1 The pilot burner used to ignite the specimen shall be a nominal 6-mm inside diameter, 10-mm outside diameter stainless steel tube line burner having 19 evenly spaced 0.7-mm diameter (no. 70 drill) holes drilled radially along the centerline and 16 evenly spaced 0.7-mm diameter (no. 70 drill) holes drilled radially 60 degrees below the centerline (see Figure 2-5.1). In operation, the gas flow shall be adjusted to a flow rate of 0.085 m³/hr to 0.100 m³/hr (air scale). With the gas flow properly adjusted and the pilot burner in the test position, the pilot flame shall extend from approximately 63.5 mm at either end to approximately 127 mm at the center.

2-5.1.1 The pilot burner shall be positioned no more than 5 degrees from the horizontal, so that the flame generated impinges on the specimen at the zero (0) distance burned point [see Figures 2-2.1(a) and 2-2.1(b)]. When not being applied to the specimen, the burner shall be capable of being moved at least 50 mm away from the specimen.

2-5.1.2 The holes in the pilot burner shall be kept clean. A soft wire brush shall be used to remove surface contaminants. Nickel-chromium or stainless steel wire or its equivalent with an outside diameter of 0.5 mm shall be used for opening the holes.

2-6 Thermocouples.

2-6.1 A 3.2-mm stainless steel-sheathed, grounded junction, Chromel-Alumel thermocouple shall be located in the flooring radiant panel test chamber. [See Figures 2-2.1(a) and 2-2.1(b).]

2-6.1.1 The thermocouple shall be kept clean to ensure the accuracy of the readout.

2-6.1.2 The chamber thermocouple shall be located in the longitudinal central vertical plane of the chamber, 25 mm down from the top and 102 mm back from the inside of the exhaust stack.

2-6.2 An indicating potentiometer with a range of 100°C to 500°C shall be used to determine the chamber temperature prior to the test.

2-7* Exhaust Hood. An exhaust duct with a capacity of 28.3 NTP m³/min to 85 NTP m³/min, decoupled from the chamber stack by at least 76 mm on all sides, and with an effective canopy area larger than the plane area of the chamber with the specimen platform in the out position, shall be used to remove combustion products from the chamber. With the panel turned on and the dummy specimen in place, the airflow rate through the stack shall be 76.2 m³/min ± 15.2 m³/min when measured with a hot wire anemometer 30 seconds after insertion of the probe into the center of the stack opening at a distance of 152 mm down from the top of the stack opening.

2-8 Dummy Specimen.

2-8.1 The dummy specimen, which is used in the flux profile determination, shall be made of 19-mm inorganic calcium silicate board, with a nominal density of 0.74 g/cm³ (see Figure 2-4). The specimen shall measure 250 mm × 1070 mm with 27-mm diameter holes located on the centerline at points ranging from 100 mm to 900 mm, spaced in 100-mm increments, starting at the maximum flux end of the specimen.

2-8.2 To provide proper and consistent seating of the flux meter in the hole openings, a stainless steel or galvanized steel bearing plate shall be mounted and secured firmly to the underside of the calcium silicate board with holes corresponding to those specified in 2-8.1. The bearing plate shall run the length of the dummy specimen and shall have a minimum width of 76 mm. The thickness of the bearing plate shall vary to maintain the flux meter height specified in 5-1.6 up to the maximum of 3.2 mm.

2-8.2.1* The total heat flux transducer used to determine the flux profile of the chamber in conjunction with the dummy specimen (see 2-3.5) shall have a range of 0 W/cm² to 1.5 W/cm² and shall be calibrated over the operating flux level range of 0.10 W/cm² to 1.5 W/cm² in accordance with the procedure outlined in Appendix B. A source of cooling water at 15°C to 25°C shall be provided for this instrument.

2-8.2.2 A high impedance voltmeter or potentiometric voltmeter with a range of 0 mV to 10 mV and reading to 0.01 mV shall be used to measure the output of the total heat flux transducer during the flux profile determination.

2-9 Timer. A timer reading to the nearest 0.1 minute shall be used to measure preheating, pilot contact, and flameout times.

Chapter 3 Test Specimens

3-1 Sampling Procedure.

3-1.1 The sample selected for testing shall be representative of the product.

3-1.2 American Society for Testing and Materials (ASTM) sampling practice shall be followed.

3-2 Specimen Size and Mounting.

3-2.1 The test specimen shall be a floor covering system sized to provide for adequate clamping in the mounting frame. The specimen's minimum dimensions shall exceed the frame width (200 mm nominal) and length (1000 mm nominal) by about 50 mm. Holes shall be made in the specimen to accommodate the mounting frame bolts. (See Figure 2-4.)

3-2.2* The floor covering system specimen shall simulate actual installation practice insofar as possible.

3-2.3 A minimum of three specimens per sample shall be tested.

3-3 Specimen Conditioning. Test specimens shall be conditioned at 21°C ± 3°C and a relative humidity of 50 percent ± 5 percent horizontally or vertically in open racks for optimum air circulation for a minimum of 48 hours. Carpet specimens that have been glued down shall be conditioned for a minimum of 96 hours. Conditioning shall be conducted in accordance with ASTM E 171, *Standard Specification for Standard Atmospheres for Conditioning and Testing Flexible Barrier Materials*.

Chapter 4 Safety Precautions

4-1 Gas-Air Fuel Explosions. The possibility of a gas-air fuel explosion in the test chamber shall be recognized. Suitable safeguards consistent with sound engineering practice shall be installed in the panel fuel supply system. Safeguards shall include one or more of the following:

- (1) A gas feed cutoff activated when the air supply fails
- (2) A fire sensor directed at the panel surface that stops fuel flow when the panel flame goes out
- (3) A commercial gas water heater or gas-fired furnace pilot burner control thermostatic shutoff that is activated when the gas supply fails, or other suitable approved device

Safeguards shall be arranged for a manual reset.

4-2 Exhaust System. The exhaust system shall be designed and operated so that the laboratory environment is protected from smoke and gas. Operator exposure to combustion products shall be minimized by following sound safety practice. The operator shall ensure that the exhaust system is working properly and shall wear appropriate clothing, including gloves.

Chapter 5 Radiant Heat Energy Flux Profile Standardization

5-1 Procedure.

5-1.1 In a continuing program of tests, the flux profile shall be determined at least weekly. Where the time interval between tests is greater than 1 week, the flux profile shall be determined at the start of the test series.

5-1.2 The dummy specimen shall be mounted in the mounting frame, and the assembly shall be attached to the sliding platform.

5-1.3 With the sliding platform outside the chamber, the radiant panel shall be ignited. The unit shall heat for $1\frac{1}{2}$ hours. The pilot burner shall be off during this determination. The fuel mixture shall be adjusted to provide an air-rich flame. Fuel flow shall be set to bring the panel blackbody temperature to about 500°C , and the chamber temperature shall be recorded.

5-1.4 When equilibrium has been established, the specimen platform shall be moved into the chamber and the door shall be closed.

5-1.5 The closed chamber shall be allowed to equilibrate for 30 minutes.

5-1.6 The radiant heat energy flux level shall be measured at the 400-mm point with the total flux meter instrumentation. This measurement shall be accomplished by inserting the flux meter into the opening so that its detecting plane is 1.6 mm to 3.2 mm above and parallel to the plane of the dummy specimen and then reading its output after 30 seconds \pm 10 seconds. If the level is within the limits specified in 5-1.7, the flux profile determination shall be started. Otherwise, the necessary adjustments in panel fuel flow shall be made. Data shall be recorded using the flux profile data log format shown in Appendix D or equivalent.

5-1.7 The test shall be run under chamber operating conditions that provide a flux profile as shown in Figure 1-3. The radiant heat energy incident on the dummy specimen shall be as follows:

- (1) Between 0.87 W/cm^2 and 0.95 W/cm^2 at the 200-mm point
- (2) Between 0.48 W/cm^2 and 0.52 W/cm^2 at the 400-mm point
- (3) Between 0.22 W/cm^2 and 0.26 W/cm^2 at the 600-mm point

5-1.8 The flux meter shall be inserted into the 100-mm opening following the procedure outlined in 5-1.6. The mV output shall be read at 30 seconds \pm 10 seconds. The same procedure shall be repeated at the 200-mm point. The 300-mm to 900-mm flux levels shall be determined in the same manner. Following the 900-mm measurement, a reading check shall be made at 400 mm. The test chamber shall be in calibration when it is within the limits set forth in 5-1.7 and the profile determination is completed. Otherwise, the fuel flow shall be adjusted carefully, allowing 30 minutes for equilibrium, and the procedure shall be repeated.

5-1.9 The radiant heat energy flux data shall be plotted as a function of distance along the specimen plane on rectangular coordinate graph paper. The best smooth curve shall be drawn carefully through the data points. This curve shall be hereafter referred to as the flux profile curve.

5-1.10 The open chamber temperature and radiant panel blackbody temperature identified with the standard flux profile shall be determined by opening the door and moving the specimen platform outside the chamber. The chamber shall be allowed to equilibrate for 30 minutes. The chamber temperature and optical pyrometer output that indicate the panel blackbody temperature shall be read and recorded in degrees Celsius. These temperature settings shall be used in subsequent test work instead of measuring the dummy specimen radiant flux at 200 mm, 400 mm, and 600 mm.

Chapter 6 Test Procedure

6-1 Pretest Heating. With the sliding platform outside the chamber, the radiant panel shall be ignited. The unit shall be allowed to heat for $1\frac{1}{2}$ hours. A sheet of inorganic millboard, such as calcium silicate, or equivalent, shall be used to cover the opening when the hinged portion of the front panel is open and the specimen platform is moved out of the chamber. The millboard shall be used to prevent heating of the specimen and to protect the operator. The panel blackbody temperature and the chamber temperature shall be read. If these temperatures are in agreement to within $\pm 5^{\circ}\text{C}$ of those determined in accordance with 5-1.10, the chamber shall be ready for use.

6-2 Sample Mounting. The sample holder shall be inverted on a workbench, and the flooring system shall be inserted. The steel bar clamps shall be placed across the back of the assembly, and the nuts shall be tightened firmly. The sample holder shall be returned to its upright position, the test surface shall be cleaned with a vacuum, and the sample holder shall be mounted on the specimen platform. Carpet specimens shall be brushed to raise the pile to its normal position.

6-3 Ignition of Pilot Burner. The pilot burner shall be ignited, keeping it at least 50 mm away from the specimen, the specimen shall be moved into the chamber, and the door shall be closed. The timer shall be started. After 5 minutes, the chamber shall be preheated. With the pilot burner on and at least 50 mm away from the specimen, the pilot burner flame shall be brought into contact with the specimen at the zero (0) mm mark. The pilot burner flame shall remain in contact with the specimen for 5 minutes. It then shall be removed to a position at least 50 mm away from the specimen and the pilot burner flame shall be extinguished.

6-4 Flame Propagation of Specimen. If the specimen does not propagate flame within 5 minutes following pilot burner flame application, the test shall be terminated. For specimens that do propagate flame, the test shall be continued until the flame goes out. Significant phenomena such as melting, blistering, and penetration of flame to the substrate shall be observed and recorded.

6-5 Completion of Test. When the test is completed, the door shall be opened and the specimen platform shall be pulled out. The protective inorganic millboard sheet shall be put in place.

6-6 Data Collection and Recording. The distance burned shall be measured (i.e., the point of farthest advance of the flame front to the nearest 1 mm). The distance to W/cm^2 critical radiant heat flux at flameout shall be converted from the flux profile curve. Data shall be recorded using the data log format shown in Appendix D or equivalent.

6-7 Removal of Specimen. The specimen and its mounting frame shall be removed from the movable platform.

6-8 Subsequent Testing. The succeeding test shall be started as soon as the panel blackbody and chamber temperatures are verified (*see 5-1.10*). The test assembly shall be at room temperature prior to startup.

Chapter 7 Calculations

7-1 General. The mean, standard deviation, and coefficient of variation of the critical radiant flux test data on the three specimens shall be calculated in accordance with ASTM Manual 7, *Manual on Quality Control of Materials*. The following formulas shall be used:

$$S = \sqrt{\frac{(\sum X^2 - n\bar{X}^2)}{n-1}} \quad \text{and} \quad V = \frac{S}{\bar{X}} \times 100$$

where:

- S = estimated standard deviation
- X = value of single observation
- n = number of observations
- \bar{X} = arithmetic mean of the set of observations
- V = coefficient of variation

Chapter 8 Report

8-1 Required Information. The report shall include the following:

- (1) Description of the floor covering system tested, including its elements
- (2) Description of the procedure used to assemble the floor covering system specimen
- (3) Number of specimens tested
- (4) Individual values of critical radiant flux
- (5) Average critical radiant flux, standard deviation, and coefficient of variation
- (6) Observations of the burning characteristics of the specimen during the testing exposure, such as delamination, melting, sagging, and shrinking

Chapter 9 Referenced Publications

9-1 The following documents or portions thereof are referenced within this standard as mandatory requirements and shall be considered part of the requirements of this standard. The edition indicated for each referenced mandatory document is the current edition as of the date of the NFPA issuance of this standard. Some of these mandatory documents might also be referenced in this standard for specific informational purposes and, therefore, are also listed in Appendix G.

9-1.1 ASTM Publications. American Society for Testing and Materials, 100 Barr Harbor Drive, West Conshohocken, PA 19428-2959.

ASTM Manual 7, *Manual on Quality Control of Materials*.

ASTM E 171, *Standard Specification for Standard Atmospheres for Conditioning and Testing Flexible Barrier Materials*, 1998.

9-1.2 U.S. Government Publication. U.S. Government Printing Office, Washington, DC 20402.

Type II — Rubber Coated Jute and Animal Hair or Fiber, Federal Specification DDD-C-001023 (GSA-FSS), Amendment 1, March 10, 1972.

Appendix A Explanatory Material

Appendix A is not a part of the requirements of this NFPA document but is included for informational purposes only. This appendix contains explanatory material, numbered to correspond with the applicable text paragraphs.

A-2-4 The following is being provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees. An acceptable heat-resistant stainless steel is AISI Type 300 (UNAN08 330) or equivalent.

A-2-7 The following is being provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees. An acceptable anemometer is an Omega HH-615 HT hot-wired anemometer manufactured by Omega Engineering Inc., Stamford, CT.

A-2-8.2.1 The following is being provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees. An acceptable heat flux transducer is a Schmidt-Boelter-type Medtherm 64-2-20 manufactured by Medtherm Corporation, Huntsville, AL.

A-3-2.2 Typical examples of floor covering systems are as follows:

- (1) A hardwood floor nailed to a plywood subfloor, and sanded and finished according to standard practice
- (2) A carpet with or without integral cushion pad bonded to a high-density inorganic sheet simulating a concrete subfloor
- (3) A carpet mounted over the standard cushion or the standard simulated concrete subfloor
- (4) A carpet mounted over the actual cushion pad or a carpet mounted over the actual subfloor to be used in the installation
- (5) A resilient floor bonded to a high-density inorganic sheet simulating a concrete subfloor

Appendix B Procedure for Calibration of Apparatus

This appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

B-1 Radiation Pyrometer.

B-1.1 The radiation pyrometer should be calibrated by means of a conventional blackbody enclosure placed within a furnace and maintained at uniform temperatures of 490°C, 500°C, and 510°C. The blackbody enclosure can consist of a closed Chromel metal cylinder with a small sight hole in one end. The radiation pyrometer is sighted on the opposite end of the cylinder where a thermocouple indicates the blackbody temperature. The thermocouple is placed within a drilled hole and in good thermal contact with the blackbody. When the blackbody enclosure has reached the appropriate temperature equilibrium, the output of the radiation pyrometer should be read. This procedure is repeated for each temperature.

B-1.2 As an alternative to the procedure described in B-1.1, a laboratory can be permitted to utilize the services of an outside agency to provide calibration traceable to the National Institute of Standards and Technology (NIST).

B-2 Total Heat Flux Meter.

B-2.1 The total flux meter should be developed by transfer calibration methods with a NIST-calibrated flux meter. This calibration should make use of the flooring radiant panel tester as the heat source. Measurements should be made at each of the nine dummy specimen positions, and the mean value of these results should be used to constitute the final calibration.

B-2.2 Each laboratory should maintain a dedicated, calibrated reference flux meter against which one or more working flux meters can be compared as needed. The working flux meters should be calibrated at least annually.

Appendix C Mounting Methods

This appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

C-1 Introduction. This appendix has been compiled as an aid in selecting a method for mounting various flooring materials in the fire test chamber. These mountings are recommended for test method uniformity and convenience.

C-2 Mounting Procedures.

C-2.1 Carpet and Cushion Pad over Concrete, Simulated. Carpet specimens should be cut in the machine direction. To mount a specimen, the holder should be inverted on a clean, flat surface. The test specimen should be inserted into the holder. The cushion pad then is inserted with the pattern side facing the carpet, followed by nominal 6.3-mm thick, fiber-reinforced, high density ($762 \text{ kg/m}^3 \pm 80 \text{ kg/m}^3$) cement board and a 13-mm inorganic millboard with a density of 0.74 g/cm^3 . It should be noted that fiber-reinforced cement board could spall during a test and this can be avoided by heating the board for 12 hours at 163°C . Finally, the steel bar clamps should be placed across the assembly and tightened firmly. The test assembly should be mounted on the specimen transport frame so that the pile lay faces the panel.

C-2.2 Carpet with or without Integral Cushion Pad Bonded to Concrete, Simulated. Carpet specimens should be cut in the machine direction. The adhesive used should be that which is recommended by the carpet manufacturer. In the absence of a manufacturer's recommendation, a multipurpose adhesive typical of commercial installation should be selected by the laboratory. The adhesive needs to be applied to the smooth side of the fiber-reinforced cement board in accordance with the directions provided by the adhesive manufacturer. In the absence of a manufacturer's recommendation, the adhesive should be applied with a 3.2-mm V-notched trowel. A nominal 9.1-kg roller with a diameter of 76 mm and a width approximately that of the specimen should be used to apply the adhesive across the top of the specimen to ensure good contact with the substrate. Specimens can be permitted to be stacked under a dead load after bonding specimens to the fiber-reinforced cement board for no more than 24 hours prior to conditioning (*see Section 3-3 for conditioning requirements*). The specimen should be mounted in the testing frame as described in C-2.1 and should be tested in accordance with standard procedure.

C-2.3 Carpet, Other. The actual subfloor can be permitted to be substituted for the standard fiber-reinforced cement board substrate.

C-3 Resilient Flooring. Commercial installation practice should be followed or simulated, or both. In most instances, this type of installation practice necessitates bonding to the standard fiber-reinforced cement substrate.

C-4 Hardwood Flooring. Commercial installation practice should be followed or simulated, or both. In a typical system, the substrate is a 16-mm plywood sheet covered with building paper. The oak flooring strips are nailed to the plywood and then sanded, sealed, and waxed. The assembly should be tested with the moisture content of the oak at 7 percent to 8 percent.

Appendix D Sample Data Log

This appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

D-1 Data Logs. Sample Data Logs for Flooring Radiant Panel and Radiant Flux Profile are provided in Figures D-1(a) and D-1(b).

FIGURE D-1(a) Radiant flux profile data log.

Date _____		
Blackbody temperature _____ mV _____ °C		
Gas flow _____ NTP m ³ /hr		
Airflow _____ NTP m ³ /hr		
Room temperature _____ °C		
Pressure: Air _____ cm of H ₂ O; Gas _____ cm of H ₂ O		
Flux meter no. _____	Conversion factor from calibration on _____	
Distance (cm)	mV	W/cm²
10	_____	_____
20	_____	_____
30	_____	_____
40	_____	_____
60	_____	_____
70	_____	_____
80	_____	_____
90	_____	_____
Signed _____		

