

NFPA® 720

Standard for the Installation of Carbon Monoxide (CO) Detection and Warning Equipment

2012 Edition



NFPA, 1 Batterymarch Park, Quincy, MA 02169-7471
An International Codes and Standards Organization



IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® DOCUMENTS
NOTICE AND DISCLAIMER OF LIABILITY CONCERNING THE USE OF NFPA DOCUMENTS

NFPA® codes, standards, recommended practices, and guides (“NFPA Documents”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Documents.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Documents. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Documents available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Documents. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA DOCUMENTS

ADDITIONAL NOTICES AND DISCLAIMERS

Updating of NFPA Documents

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Documents”) should be aware that these documents may be superseded at any time by the issuance of new editions or may be amended from time to time through the issuance of Tentative Interim Amendments. An official NFPA Document at any point in time consists of the current edition of the document together with any Tentative Interim Amendments and any Errata then in effect. In order to determine whether a given document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments or corrected through the issuance of Errata, consult appropriate NFPA publications such as the National Fire Codes® Subscription Service, visit the NFPA website at www.nfpa.org, or contact the NFPA at the address listed below.

Interpretations of NFPA Documents

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Document. The users of NFPA Documents bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Documents.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Document may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Documents should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Documents are copyrighted by the NFPA. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Documents for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Documents, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Documents and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA documents during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02169-7471; email: stds_admin@nfpa.org

For more information about NFPA, visit the NFPA website at www.nfpa.org.

Copyright © 2011 National Fire Protection Association®. All Rights Reserved.

NFPA® 720

Standard for the

Installation of Carbon Monoxide (CO) Detection and Warning Equipment

2012 Edition

This edition of NFPA 720, *Standard for the Installation of Carbon Monoxide (CO) Detection and Warning Equipment*, was prepared by the Technical Committee on Carbon Monoxide Detection, released by the Technical Correlating Committee on Signaling Systems for the Protection of Life and Property, and acted on by NFPA at its June Association Technical Meeting held June 12–15, 2011, in Boston, MA. It was issued by the Standards Council on August 11, 2011, with an effective date of August 31, 2011, and supersedes all previous editions.

This edition of NFPA 720 was approved as an American National Standard on August 31, 2011.

Origin and Development of NFPA 720

With the increased concern over carbon monoxide (CO) hazards in residential applications, the National Fire Protection Association was petitioned to develop a document covering the installation of CO detectors and related equipment. In late 1993, the Technical Committee on Household Fire Warning Equipment was tasked to develop a document covering the installation and use of CO detectors. This document was originally prepared by the Technical Committee on Household Fire Warning Equipment but was returned to committee at the 1995 Annual Meeting. The NFPA Standards Council later approved the formation of the Technical Committee on Carbon Monoxide and Fuel Gas Detectors to further develop this document.

The 2003 edition reflected editorial revisions to comply with the *Manual of Style for NFPA Technical Committee Documents*. Those revisions included the addition of three administrative chapters at the beginning of the document: “Administration,” “Referenced Publications,” and “Definitions.” Two technical chapters followed the administrative chapters: “General Provisions” from Chapter 1 (in part) of the 1998 edition and “Household Carbon Monoxide Warning Equipment” from Chapter 2 of the 1998 edition. Editorial revisions also included breaking out paragraphs with multiple requirements into individually numbered paragraphs, minimizing the use of exceptions, and using consistent headings for sections and subsections. Changes also were made in some sections to provide language and terminology that was more consistent and user friendly. The 2003 edition also contained technical revisions, including the recommendation that printed instructions for carbon monoxide alarms and detectors include minimum and recommended distances from fuel-burning appliances.

As communities began to recognize the life safety benefit of carbon monoxide warning equipment, requirements by local jurisdictions for the installation of this equipment became more common, and the need for an installation standard written in enforceable language became evident. The 2005 edition of NFPA 720 reflected that need — it was changed from a recommended practice to a standard. In addition, terms such as *family living unit* and *household* were replaced, where appropriate, with the term *dwelling unit*, to provide language consistent with standard terminology used in NFPA codes and standards.

The 2009 edition was a complete rewrite of the standard and addressed installations of carbon monoxide detection systems in commercial types of applications as well as the installation of carbon monoxide warning equipment in household applications. The 2009 edition was largely extracted from the 2007 edition of *NFPA 72, National Fire Alarm Code*, and was organized in a fashion similar to that of *NFPA 72*. Paragraphs that were extracted from *NFPA 72* were shown with the extract reference in brackets [] at the end of the paragraph. In some cases, modifications were made to the extracted text to use terminology appropriate for this standard, such as the term *carbon monoxide* instead of *fire*. In those instances, brackets encased the modified words. In a similar manner, where terms were deleted, empty brackets were shown, such as where the word *smoke* was removed from the term *smoke alarm*.

Some of the technical changes in the 2009 edition included the introduction of requirements for the placement of carbon monoxide detectors in commercial applications. Those requirements were based on the Fire Protection Research Foundation report *Development of a Technical Basis for Carbon Monoxide Detector Siting Research Project*. In addition, requirements for the siting, power supply, and interconnection of carbon monoxide alarms were updated.

The previous edition of NFPA 720 was largely extracted from the 2007 edition of *NFPA 72*. Extensive changes were made in the organization and content of the 2010 edition of *NFPA 72*. As a result, the extract material from *NFPA 72* has been updated in the 2012 edition of NFPA 720 to provide consistency. As in the 2009 edition, paragraphs that have been extracted from *NFPA 72* are shown with the extract reference in brackets [] at the end of the paragraph. In some cases, modifications have been made to the extracted text to use terminology appropriate for this standard, such as the term *carbon monoxide* instead of *fire*. In those instances, brackets encase the modifying words. In similar manner, where terms have been deleted, empty brackets are shown, such as where the word *smoke* is removed from the term *smoke alarm*.

Several noteworthy technical changes have also been included in this edition of NFPA 720. These include an expanded definition of the term “carbon monoxide alarm”; a revision of the secondary power requirement for systems monitored by a supervising station; a revision of the record of completion form and the inspection, testing, and maintenance form; an addition of a provision to permit performance-based designs for the location of system CO detectors; new provisions for low-frequency audible signaling for sleeping areas; removal of requirements for sensitivity testing of system CO detectors; revisions to address the replacement of combination smoke/CO alarms; new provisions to address signaling to the deaf and hard of hearing in applications of CO alarms and household CO detection systems; new provisions for CO alarms that use wireless signals to interconnect alarms within a household; and updated provisions for the transmission of signals from a household CO detection system to a supervising station.

Technical Correlating Committee on Signaling Systems for the Protection of Life and Property (SIG-AAC)

Robert P. Schifiliti, *Chair*
R. P. Schifiliti Associates, Inc., MA [SE]

Lee F. Richardson, *Nonvoting Secretary*
National Fire Protection Association, MA

Douglas M. Aiken, Lakes Region Mutual Fire Aid,
NH [U]

Rep. International Municipal Signal Association

Andrew G. Berezowski, Honeywell Inc., CT [M]

Rep. National Electrical Manufacturers Association

Art Black, Carmel Fire Protection Associates, CA [E]

J. Robert Boyer, UTC/Edwards Company, NJ [M]

John C. Fannin III, SafePlace Corporation, DE [U]

Louis T. Fiore, L. T. Fiore, Inc., NJ [IM]

Rep. Central Station Alarm Association

Bruce Fraser, Fraser Fire Protection Services, MA [SE]

Vic Humm, Vic Humm & Associates, TN [SE]

David F. Klein, Las Vegas Fire & Rescue, NV [E]

Rep. International Association of Fire Chiefs

Peter A. Larrimer, U.S. Department of Veterans Affairs,
PA [U]

Fred M. Leber, Leber/Rubes Incorporated, Canada [SE]

James M. Mundy, Jr., Asset Protection Associates, Ltd.,
NY [M]

Rep. Automatic Fire Alarm Association, Inc.

Lynn Nielson, City of Henderson, NV [E]

Thomas F. Norton, Norel Service Company, Inc.,

MA [IM]

Rep. U.S. Naval Historical Center VL to Document: 72

Rodger Reiswig, Tyco/SimplexGrinnell, FL [M]

Lawrence J. Shudak, Underwriters Laboratories Inc.,

IL [RT]

Tom G. Smith, Cox Systems Technology, OK [IM]

Rep. National Electrical Contractors Association

Lawrence J. Wenzel, Hughes Associates, Inc.,

CT [SE]

Alternates

Jeffrey R. Brooks, SimplexGrinnell, MA [M]

(Alt. to R. Reiswig)

Richard W. Bukowski, The RJA Group, Inc., MD [SE]

(Alt. to B. Fraser)

Louis Chavez, Underwriters Laboratories Inc., IL [RT]

(Alt. to L. J. Shudak)

Thomas P. Hammerberg, Automatic Fire Alarm
Association, Inc., GA [M]

(Alt. to J. M. Mundy, Jr.)

Jack McNamara, Bosch Security Systems, NY [M]

(Alt. to A. G. Berezowski)

Earl P. Valois, City of New Orleans Fire Department,

LA [E]

(Alt. to D. F. Klein)

Frank L. Van Overmeiren, FP&C Consultants, Inc.,

IN [SE]

(Alt. to V. Humm)

Nonvoting

Benjamin B. Aycock, Charlotte-Mecklenburg, NC
(Member Emeritus)

Merton W. Bunker, Jr., U.S. Department of State, VA [U]

Rep. TC on Protected Premises Fire Alarm Systems

Shane M. Clary, Bay Alarm Company, CA [IM]

Rep. TC on Fundamentals of Fire Alarm Systems

Laurence J. Dallaire, U.S. Architect of the Capitol,
DC [E]

Rep. TC on Household Fire Alarm Systems

Raymond A. Grill, Arup Fire, DC [SE]

Rep. TC on Notification Appliances for Fire Alarm
Systems

Jeffrey G. Knight, City of Newton Fire Department,
MA [U]

Rep. TC on Public Fire Reporting Systems

J. Jeffrey Moore, Hughes Associates, Inc., OH [SE]

Rep. TC on Testing & Maintenance of Fire Alarm
Systems

Wayne D. Moore, Hughes Associates, Inc.,
RI [SE]

Rep. TC on Emergency Communication Systems

Daniel J. O'Connor, Aon Fire Protection Engineering
Corporation, IL [I]

Rep. TC on Initiating Devices for Fire Alarm Systems

Warren E. Olsen, Fire Safety Consultants, Inc.,
IL [E]

Rep. TC on Supervising Station Fire Alarm Systems

Martin H. Reiss, The RJA Group, Inc., MA [SE]

Rep. Safety to Life Correlating Committee

Evan E. Stauffer, Jr., U.S. Department of the
Navy, PA

Rep. TC Public Emergency Service Communications

Dean K. Wilson, Hughes Associates, Inc.,
PA [SE]

(Member Emeritus)

Lee F. Richardson, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on the installation, performance, maintenance, testing, and use of signaling components and signaling systems for the protection of life, property and mission continuity.

Technical Committee on Carbon Monoxide Detection (SIG-CAR)

Thomas F. Norton, *Chair*

Norel Service Company, Inc., MA [IM]

William J. Aaron, Jr., Code Consultants, Inc., MO [SE]

Blair T. Ames, Montgomery Ames Associates, MA [M]

Art Black, Carmel Fire Protection Associates, CA [E]

H. Wayne Boyd, U.S. Safety & Engineering Corporation, CA [M]

Jeffrey R. Brooks, SimplexGrinnell, MA [M]

Shane M. Clary, Bay Alarm Company, CA [M]

Rep. Automatic Fire Alarm Association, Inc.

Bradford T. Cronin, Newport Fire Department, RI [E]

Scott G. Davis, GexCon U.S., MD [SE]

Lee C. DeVito, FIREPRO Incorporated, MA [SE]

Louis T. Fiore, L. T. Fiore, Inc., NJ [IM]

Rep. Central Station Alarm Association

Philip L. Gauthier, Gas Appliance Manufacturers Association, VA [M]

Rep. Air-Conditioning, Heating, & Refrigeration Institute

Wendy B. Gifford, Consultant, IL [SE]

Daniel T. Gottuk, Hughes Associates, Inc., MD [SE]

Deborah Hanson, First Alert BRK Brands Inc., IL [M]

Rick Heffernan, SDI, NJ [M]

Rep. National Electrical Manufacturers Association

Rick Kabele, Clark County Development Services, NV [E]

Rep. NFPA Lodging Industry Section

John Knecht, Intertek Testing Services, IL [RT]

Jeffrey G. Knight, City of Newton Fire Department, MA [U]

Rep. International Municipal Signal Association

David E. Mills, Underwriters Laboratories Inc., IL [RT]

James A. Petersen, Petersen Engineering, TX [SE]

Anthony V. Pierce, Forsyth County Planning & Development, GA [E]

Michael J. Pokorny, Montgomery County, MD [E]

Larry Ratzlaff, UTC/Kidde Safety, IL [M]

Richard Jay Roberts, Honeywell Life Safety, IL [M]

James M. Rowland, Quality Electric Service, LLC, NJ [IM]

Jason A. Sutula, Combustion Science & Engineering, Inc., MD [SE]

Ed Van Walraven, Aspen Fire Protection District, CO [E]

Alternates

David A. Bush, UTC/Kidde Safety, CO [M]

(Alt. to L. Ratzlaff)

Shane Courbier, Gentex Corporation, MI [M]

(Alt. to R. Heffernan)

Richard B. Cullwell, Jr., 3M Company, CO [M]

(Alt. to B. T. Ames)

Adam H. Hilton, Code Consultants, Inc., MO [SE]

(Alt. to W. J. Aaron, Jr.)

James M. Mundy, Jr., Asset Protection Associates, Ltd., NY [M]

(Alt. to S. M. Clary)

John Parsinen, UL, Inc. IL [RT]

(Alt. to D. Mills)

(Supplemental ballot only)

Rodger Reiswig, Tyco/SimplexGrinnell, FL [M]

(Alt. to J. R. Brooks)

Kurt A. Ruchala, FIREPRO Incorporated, MA [SE]

(Alt. to L. C. DeVito)

Nonvoting

Donald W. Switzer, U.S. Consumer Product Safety Commission, MD [C]

Lee F. Richardson, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents addressing the selection, installation, operation, and maintenance of carbon monoxide warning equipment.

Contents

Chapter 1 Administration	720- 7	5.11 Protected Premises Carbon Monoxide Safety Functions	720-30
1.1 Scope	720- 7	5.12 Special Requirements for Low-Power Radio (Wireless) Systems	720-30
1.2 Purpose	720- 7		
1.3 Application	720- 7		
1.4 Equivalency	720- 7		
1.5 Units of Measure	720- 7		
Chapter 2 Referenced Publications	720- 8	Chapter 6 Notification Appliances for Carbon Monoxide Detection Systems	720-31
2.1 General	720- 8	6.1 Application	720-31
2.2 NFPA Publications	720- 8	6.2 Purpose	720-32
2.3 Other Publications	720- 8	6.3 General	720-32
2.4 References for Extracts in Mandatory Sections	720- 8	6.4 Audible Characteristics	720-32
		6.5 Visible Characteristics — Public Mode	720-34
		6.6 Visible Characteristics — Private Mode	720-37
		6.7 Supplementary Visible and Audible Signaling Methods	720-37
Chapter 3 Definitions	720- 8	6.8 Textual Audible Appliances	720-37
3.1 General	720- 8	6.9 Textual Visible Appliances	720-37
3.2 NFPA Official Definitions	720- 8	6.10 Tactile Appliances	720-37
3.3 General Definitions	720- 8	6.11 Standard Emergency Service Interface	720-37
Chapter 4 Fundamentals of Carbon Monoxide Detection Systems	720-10	Chapter 7 Off-Premises Signal Transmission	720-37
4.1 Application	720-10	7.1 Application	720-37
4.2 Purpose	720-10	7.2 General	720-37
4.3 Equipment	720-10	7.3 Prearranged Testing	720-37
4.4 Personnel Qualifications	720-10	7.4 Operation and Record Keeping	720-37
4.5 Power Supplies	720-11		
4.6 Distinctive Signals	720-13	Chapter 8 Inspection, Testing, and Maintenance	720-38
4.7 Alarm Signals	720-13	8.1 Application	720-38
4.8 Supervisory Signals	720-13	8.2 General	720-38
4.9 Trouble Signals	720-14	8.3 Inspection	720-38
4.10 [Carbon Monoxide Safety] Function Status Indicators	720-14	8.4 Testing	720-38
4.11 Performance and Limitations	720-14	8.5 Maintenance	720-44
4.12 Annunciation and Annunciation Zoning	720-14	8.6 Records	720-44
4.13 Monitoring Integrity	720-15	8.7 Single- and Multiple-Station Carbon Monoxide Alarms	720-44
4.14 Documentation	720-16	8.8 Household Carbon Monoxide Detection Systems	720-44
Chapter 5 Protected Premises Carbon Monoxide Detection Systems	720-25	Chapter 9 Single- and Multiple-Station Alarms and Household Carbon Monoxide Detection Systems	720-53
5.1 Application	720-25	9.1 Application	720-53
5.2 General	720-25	9.2 Purpose	720-53
5.3 System Features	720-25	9.3 Basic Requirements	720-53
5.4 System Performance and Integrity	720-25	9.4 Required Protection	720-53
5.5 Performance of Initiating Device Circuits (IDCs)	720-26	9.5 Power Supplies	720-54
5.6 Performance of Signaling Line Circuits (SLCs)	720-26	9.6 Equipment Performance	720-54
5.7 Performance of Notification Appliance Circuits (NACs)	720-27	9.7 Installation	720-56
5.8 System Requirements	720-27	9.8 Maintenance and Testing	720-57
5.9 Signal Annunciation	720-30	9.9 Markings and Instructions	720-57
5.10 Off-Premises Signals	720-30		

Annex A Explanatory Material	720-57	Annex C Informational References	720-75
Annex B Dangers of Carbon Monoxide	720-74	Index	720-76



NFPA 720
Standard for the
Installation of Carbon Monoxide (CO)
Detection and Warning Equipment

2012 Edition

IMPORTANT NOTE: *This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading “Important Notices and Disclaimers Concerning NFPA Documents.” They can also be obtained on request from NFPA or viewed at www.nfpa.org/disclaimers.*

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

Changes other than editorial are indicated by a vertical rule beside the paragraph, table, or figure in which the change occurred. These rules are included as an aid to the user in identifying changes from the previous edition. Where one or more complete paragraphs have been deleted, the deletion is indicated by a bullet (•) between the paragraphs that remain.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. As an aid to the user, the complete title and edition of the source documents for extracts in mandatory sections of the document are given in Chapter 2 and those for extracts in informational sections are given in Annex C. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced publications can be found in Chapter 2 and Annex C.

Chapter 1 Administration

1.1* Scope.

1.1.1 This standard is primarily concerned with life safety, not with protection of property.

1.1.2* This standard covers the selection, design, application, installation, location, performance, inspection, testing, and maintenance of carbon monoxide detection and warning equipment in buildings and structures.

1.1.3 This standard contains requirements for the selection, installation, operation, and maintenance of equipment that detects concentrations of carbon monoxide that could pose a life safety risk to most occupants in buildings and structures.

1.2* Purpose.

1.2.1 The purpose of this standard is to provide requirements for carbon monoxide detection and warning equipment intended to warn occupants of the presence of carbon monoxide in sufficient time to allow occupants to either

escape or take other appropriate action and where required to summon aid.

1.2.2 The requirements provided by this standard address the means of signal initiation, transmission, notification, and annunciation; the levels of performance; and the reliability of carbon monoxide detection and warning equipment.

1.3 Application.

1.3.1 The requirements of this standard apply to the installation of carbon monoxide detection and warning equipment, including the following:

- (1) Single- and multiple-station carbon monoxide alarms
- (2) Carbon monoxide detectors and their related systems and components

1.3.2* Carbon monoxide detection and warning equipment shall not be used in lieu of fire detection or warning equipment required by NFPA 72, *National Fire Alarm and Signaling Code*; NFPA 101, *Life Safety Code*; or NFPA 5000, *Building Construction and Safety Code*.

1.4 Equivalency. Nothing in this standard is intended to prevent the use of systems, methods, devices, or appliances of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety over those prescribed by this standard.

1.4.1 Technical documentation shall be submitted to the authority having jurisdiction to demonstrate equivalency.

1.4.2 The system, method, device, or appliance shall be approved for the intended purpose by the authority having jurisdiction.

1.4.3 All alarms or detectors and related equipment having materials or forms different from those detailed in this standard shall be examined and tested in accordance with applicable standards and, if found equivalent, shall be permitted to be approved.

1.5 Units of Measure.

1.5.1 The units of measure in this standard are presented in U.S. customary units (inch/pound units).

1.5.2 Where presented, International System (SI) units follow the inch/pound units in parentheses.

1.5.3 Where both systems of units are presented, either system shall be acceptable for satisfying the requirements in this standard.

1.5.4 Where both systems of units are presented, users of this standard shall apply one set of units consistently and shall not alternate between units.

1.5.5 The values presented for measurements in this standard are expressed with a degree of precision appropriate for practical application and enforcement. It is not intended that the application or enforcement of these values be more precise than the precision expressed.

1.5.6* Where extracted text contains values expressed in only one system of units, the values in the extracted text have been retained without conversion to preserve the values established by the responsible technical committee in the source document.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 70[®], *National Electrical Code*[®], 2011 edition.

NFPA 72[®], *National Fire Alarm and Signaling Code*, 2010 edition.

NFPA 101[®], *Life Safety Code*[®], 2012 edition.

NFPA 110, *Standard for Emergency and Standby Power Systems*, 2010 edition.

NFPA 111, *Standard on Stored Electrical Energy Emergency and Standby Power Systems*, 2010 edition.

NFPA 780, *Standard for the Installation of Lightning Protection Systems*, 2011 edition.

NFPA 1221, *Standard for the Installation, Maintenance, and Use of Emergency Services Communications Systems*, 2010 edition.

NFPA 5000[®], *Building Construction and Safety Code*[®], 2012 edition.

2.3 Other Publications.

2.3.1 ANSI Publications. American National Standards Institute, Inc., 25 West 43rd Street, 4th Floor, New York, NY 10036.

ANSI A-58.1, *Building Code Requirements for Minimum Design Loads in Buildings and Other Structures*, 1982.

ANSI S1.4A, *Specification for Sound Level Meters*, 1985 (R2006).

ANSI S3.2, *Method for Measuring the Intelligibility of Speech over Communication Systems*, 1989 (R1999).

ANSI S3.41, *Audible Emergency Evacuation Signal*, 1990 (R2001).

2.3.2 IEC Publications. International Electrotechnical Commission, 3, rue de Varembe, P.O. Box 131, CH-1211 Geneva 20, Switzerland.

IEC 60849, *Sound Systems for Emergency Purposes*, 1998.

2.3.3 ISO Publications. International Organization for Standardization, 1, rue de Varembe, case postale 56, CH-1211 Geneva 20, Switzerland.

ISO 7731, *Danger signals for work places — Auditory danger signals*, 2003.

2.3.4 UL Publications. Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062-2096.

ANSI/UL 1971, *Standard for Safety Signaling Devices for Hearing Impaired*, 2002, revised 2008.

ANSI/UL 2034, *Standard for Single and Multiple Station Carbon Monoxide Alarms*, 2008, Revised 2009.

ANSI/UL 2075, *Gas and Vapor Detectors and Sensors*, November 2004, Revised 2007.

2.3.5 Other Publications. *Merriam-Webster's Collegiate Dictionary*, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections.

NFPA 72[®], *National Fire Alarm and Signaling Code*, 2010 edition.

NFPA 211, *Standard for Chimneys, Fireplaces, Vents, and Solid Fuel-Burning Appliances*, 2010 edition.

NFPA 1221, *Standard for the Installation, Maintenance, and Use of Emergency Services Communications Systems*, 2010 edition.

NFPA 5000[®], *Building Construction and Safety Code*[®], 2012 edition.

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3 Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3.2.4* Listed. Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

3.2.5 Shall. Indicates a mandatory requirement.

3.2.6 Should. Indicates a recommendation or that which is advised but not required.

3.2.7 Standard. A document, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and which is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions shall be located in an appendix or annex, footnote, or fine-print note and are not to be considered a part of the requirements of a standard.

3.3 General Definitions.

3.3.1* Acoustically Distinguishable Space (ADS). An emergency communications system notification zone, or subdivision thereof, that might be an enclosed or otherwise physically defined space, or that might be distinguished from other spaces because of different acoustical, environmental, or use characteristics, such as reverberation time and ambient sound pressure level. [72, 2010]

3.3.2 Alarm.

3.3.2.1 Carbon Monoxide Alarm. A single- or multiple-station carbon monoxide alarm intended for the purpose of detecting carbon monoxide gas and alerting occupants by a distinct audible signal comprising an assembly that incorporates a sensor, control components, and an alarm notification appliance in a single unit operated from a power source either located in the unit or obtained at the point of installation.



3.3.2.2 Multiple-Station [Carbon Monoxide] Alarm. A single-station [carbon monoxide] alarm capable of being interconnected to one or more additional alarms so that the actuation of one causes the appropriate alarm signal to operate in all interconnected alarms. [72, 2010]

3.3.2.3 Single-Station [Carbon Monoxide] Alarm. A detector comprising an assembly that incorporates a sensor, control components, and an alarm notification appliance in one unit operated from a power source either located in the unit or obtained at the point of installation. [72, 2010]

3.3.3 [Carbon Monoxide Detection] Control Unit. A component of the [carbon monoxide detection] system, provided with primary and secondary power sources, which receives signals from initiating devices or other [carbon monoxide detection] control units, and processes these signals to determine part or all of the required [carbon monoxide detection] system output function(s). [72, 2010]

3.3.4 Carbon Monoxide Detector. A device having a sensor that responds to carbon monoxide gas that is connected to an alarm control unit.

3.3.5 [Carbon Monoxide] Safety Functions. Building and [carbon monoxide] control functions that are intended to increase the level of life safety for occupants or to control the spread of the harmful effects of [carbon monoxide]. [72, 2010]

3.3.6 [Carbon Monoxide] Warning Equipment. Any detector, alarm, device, or material related to single- and multiple-station alarms or household [carbon monoxide detection] systems. [72, 2010]

3.3.7 Control Unit. A system component that monitors inputs and controls outputs through various types of circuits. [72, 2010]

3.3.8* Communications Center. A building or portion of a building that is specifically configured for the primary purpose of providing emergency communications services or public safety answering point (PSAP) services to one or more public safety agencies under the authority or authorities having jurisdiction. [1221, 2010]

3.3.9 Dwelling Unit. One or more rooms arranged for complete, independent housekeeping purposes, with space for eating, living, and sleeping; facilities for cooking; and provisions for sanitation. [5000, 2012]

3.3.10* Emergency Response Agency (ERA). Organizations providing law enforcement, emergency medical, fire, rescue, communications, and related support services. [1221, 2010]

3.3.11 Fireplace. A hearth, fire chamber, or similarly prepared area and a chimney. [211, 2010]

3.3.12 Frequency. Minimum and maximum time between events. [72, 2010]

3.3.12.1 Weekly Frequency. Fifty-two times per year, once per calendar week. [72, 2010]

3.3.12.2 Monthly Frequency. Twelve times per year, once per calendar month. [72, 2010]

3.3.12.3 Quarterly Frequency. Four times per year with a minimum of 2 months, maximum of 4 months. [72, 2010]

3.3.12.4 Semiannual Frequency. Twice per year with a minimum of 4 months, maximum of 8 months. [72, 2010]

3.3.12.5 Annual Frequency. Once per year with a minimum of 9 months, maximum 15 of months. [72, 2010]

3.3.13* Fuel-Burning Appliance. A device that burns solid, liquid, or gaseous fuel or a combination thereof.

3.3.14 Gateway. A device that is used in the transmission of serial data (digital or analog) from the [carbon monoxide detection] control unit to other building system control units, equipment, or networks and/or from other building system control units to the [carbon monoxide detection] control unit. [72, 2010]

3.3.15 Multiple-Purpose Alarm. An alarm that incorporates detection capabilities for more than one hazardous condition, such as fire, fuel gas, or carbon monoxide.

3.3.16 Notification Appliance. A [] system component such as a bell, horn, speaker, light, or text display that provides audible, tactile, or visible outputs, or any combination thereof. [72, 2010]

3.3.17 Protected Premises. The physical location protected by a [] system. [72, 2010]

3.3.18 Response Plan. The action to be taken in response to a carbon monoxide alarm signal.

3.3.19* Separate Sleeping Area. The area of a dwelling unit where the bedrooms or sleeping rooms are located.

3.3.20 Signal.

3.3.20.1 Carbon Monoxide Alarm Signal. A signal indicating a concentration of carbon monoxide at or above the alarm threshold that could pose a risk to the life safety of the occupants and that requires immediate action.

3.3.20.2 Supervisory Signal. A signal indicating the need for action in connection with a pre-alarm condition, or in connection with the supervision of protected premises carbon monoxide safety functions or equipment, or the maintenance features of related systems.

3.3.20.3 Trouble Signal. A signal initiated by a system or device indicative of a fault in a monitored circuit, system, or component. [72, 2010]

3.3.21 Supplementary. As used in this Code, *supplementary* refers to equipment or operations not required by this Code and designated as such by the authority having jurisdiction. [72, 2010]

3.3.22 System.

3.3.22.1 Carbon Monoxide Detection System. A system or portion of a combination system that consists of a control unit, components, and circuits arranged to monitor and annunciate the status of carbon monoxide alarm initiating devices and to initiate the appropriate response to those signals.

3.3.22.2 Combination Carbon Monoxide Detection System. A carbon monoxide detection system in which components are used, in whole or in part, in common with a non-carbon monoxide signaling system, and in which components are not used as part of a fire alarm system.

3.3.22.3* *Combination System.* A fire alarm system in which components are used, in whole or in part, in common with a non-fire signaling system. [72, 2010]

3.3.22.4 *Fire Alarm System.* A system or portion of a combination system that consists of components and circuits arranged to monitor and annunciate the status of fire alarm or supervisory signal-initiating devices and to initiate the appropriate response to those signals. [72, 2010]

3.3.22.5 *Household Carbon Monoxide Detection System.* A system of devices that uses a control unit to produce an alarm signal in the household for the purpose of notifying the occupants of the presence of concentrations of carbon monoxide that could pose a life safety risk.

Chapter 4 Fundamentals of Carbon Monoxide Detection Systems

4.1 Application.

4.1.1 The basic functions of a complete carbon monoxide detection system shall comply with the requirements of this chapter.

4.1.2 The requirements of this chapter shall apply to carbon monoxide detection systems, equipment, and components addressed in Chapter 5 through Chapter 8 of this document.

4.2 Purpose. The purpose of carbon monoxide detection systems shall be primarily to provide notification of predetermined exposure levels of carbon monoxide.

4.3 Equipment.

4.3.1 Equipment constructed and installed in conformity with this standard shall be listed for the purpose for which it is used. [72:10.3.1]

4.3.2 [Carbon monoxide detection] system components shall be installed, tested, and maintained in accordance with the manufacturer's published instructions and this standard. [72:10.3.2]

4.3.3* All devices and appliances that receive their power from the initiating device circuit or signaling line circuit of a control unit shall be listed for use with the control unit. [72:10.3.3]

4.3.4* Where no carbon monoxide product listing standard exists, products listed for fire alarm service shall be permitted provided all the requirements of this standard are met.

4.4 Personnel Qualifications.

4.4.1 System Designer.

4.4.1.1 [Carbon monoxide detection] system plans and specifications shall be developed in accordance with this standard by persons who are experienced in the proper design, application, installation, and testing of [carbon monoxide detection] systems. [72:10.4.1.1]

4.4.1.2 State or local licensure regulations shall be followed to determine qualified personnel. Depending on state or local licensure regulations, qualified personnel shall include, but not be limited to, one or more of the following:

- (1) Personnel who are registered, licensed, or certified by a state or local authority
- (2) Personnel who are certified by a nationally recognized [carbon monoxide] certification organization acceptable to the authority having jurisdiction

- (3) Personnel who are factory trained and certified for [carbon monoxide detection] system design of the specific type and brand of system and who are acceptable to the authority having jurisdiction

[72:10.4.1.2]

4.4.1.3 The system designer shall provide evidence of their qualifications and/or certifications when requested by the authority having jurisdiction. [72:10.4.1.3]

4.4.1.4 The system designer shall be identified on the system design documents. [72:10.4.1.4]

4.4.2 System Installer.

4.4.2.1 [Carbon monoxide detection] system installation personnel shall be qualified or shall be supervised by persons who are qualified in the installation, inspection, and testing of [carbon monoxide detection] systems. [72:10.4.2.1]

4.4.2.2 State or local licensure regulations shall be followed to determine qualified personnel. Depending on state or local licensure regulations, qualified personnel shall include, but not be limited to, one or more of the following:

- (1) Personnel who are registered, licensed, or certified by a state or local authority
- (2) Personnel who are certified by a nationally recognized [carbon monoxide] certification organization acceptable to the authority having jurisdiction
- (3) Personnel who are factory trained and certified for [carbon monoxide detection] system installation of the specific type and brand of system and who are acceptable to the authority having jurisdiction

[72:10.4.2.2]

4.4.2.3 The system installer shall provide evidence of their qualifications and/or certifications when requested by the authority having jurisdiction. [72:10.4.2.3]

4.4.3 Inspection, Testing, and Maintenance Personnel.

4.4.3.1* Service personnel shall be qualified and experienced in the inspection, testing, and maintenance of systems addressed within the scope of this standard. Qualified personnel shall include, but not be limited to, one or more of the following:

- (1)*Personnel who are factory trained and certified for the specific type and brand of system being serviced
- (2)*Personnel who are certified by a nationally recognized certification organization acceptable to the authority having jurisdiction
- (3)*Personnel who are registered, licensed, or certified by a state or local authority to perform service on systems addressed within the scope of this standard
- (4) Personnel who are employed and qualified by an organization listed by a nationally recognized testing laboratory for the servicing of systems within the scope of this standard

[72:10.4.3.1]

4.4.3.2 Evidence of qualifications shall be provided to the authority having jurisdiction upon request. [72:10.4.3.2]

4.4.4 Supervising Station Operators.

4.4.4.1 All operators in the supervising station shall demonstrate competence in all tasks required of them in Chapter 26 of *NFPA 72* by one or more of the following:

- (1) Certified by the manufacturer of the receiving system or equipment or the alarm-monitoring automation system



- (2)*Certified by an organization acceptable to the authority having jurisdiction
- (3) Licensed or certified by a state or local authority
- (4) Other training or certification approved by the authority having jurisdiction

[72:10.4.4.1]

4.4.4.2 Evidence of qualifications and/or certification shall be provided when requested by the authority having jurisdiction. A license or qualification listing shall be current in accordance with the requirements of the issuing authority or organization. [72:10.4.4.2]

4.4.4.3 Operator trainees shall be under the direct supervision of a qualified operator until qualified as required by 4.4.4.1. [72:10.4.4.3]

4.5 Power Supplies.

4.5.1 Scope. The provisions of this section shall apply to power supplies used for carbon monoxide detection systems.

4.5.2 Code Conformance. All power supplies shall be installed in conformity with the requirements of *NFPA 70, National Electrical Code*, for such equipment and with the requirements indicated in this subsection. [72:10.5.2]

4.5.3 Power Supply Sources.

4.5.3.1 Power shall be supplied in compliance with either 4.5.3.2 or 4.5.4. [72:10.5.3.1]

4.5.3.2 Unless configured in compliance with 4.5.4, at least two independent and reliable power supplies shall be provided, one primary and one secondary. [72:10.5.3.2]

4.5.3.3 Each power supply shall be of adequate capacity for the application. [72:10.5.3.3]

4.5.3.4 Monitoring the integrity of power supplies shall be in accordance with 4.5.9.6. [72:10.5.3.4]

4.5.4 Uninterruptible Power Supplies (UPS).

4.5.4.1 The UPS device shall be configured in compliance with NFPA 111, *Standard on Stored Electrical Energy Emergency and Standby Power Systems*, for a Type 0, Class 24, Level 1 system. [72:10.5.4.1]

4.5.4.2 The UPS device shall be supplied by a dedicated branch circuit as described in 4.5.5.1. [72:10.5.4.2]

4.5.4.3 Failure of the UPS shall result in the initiation of a trouble signal in accordance with Section 4.9. [72:10.5.4.3]

4.5.5 Primary Power Supply.

4.5.5.1 Dedicated Branch Circuit. A dedicated branch circuit of one of the following shall supply primary power:

- (1) Commercial light and power
- (2) An engine-driven generator or equivalent in accordance with 4.5.10.2, where a person specifically trained in its operation is on duty at all times
- (3) An engine-driven generator or equivalent arranged for cogeneration with commercial light and power in accordance with 4.5.10.2, where a person specifically trained in its operation is on duty at all times

[72:10.5.5.1]

4.5.5.2 Circuit Identification and Accessibility.

4.5.5.2.1 The location of the dedicated branch circuit disconnecting means shall be permanently identified at the control unit. [72:10.5.5.2.1]

4.5.5.2.2 The circuit disconnecting means shall be clearly marked and shall be accessible only to authorized personnel.

4.5.5.3 Mechanical Protection. The dedicated branch circuit(s) and connections shall be protected against physical damage. [72:10.5.5.3]

4.5.5.4 Overcurrent Protection. An overcurrent protective device of suitable current-carrying capacity that is capable of interrupting the maximum short-circuit current to which it can be subject shall be provided in each ungrounded conductor. [72:10.5.5.4]

4.5.6 Secondary Power Supply.

4.5.6.1* Secondary Power Supply for Protected Premises [Carbon Monoxide Detection] Systems.

4.5.6.1.1 The secondary power supply shall consist of one of the following:

- (1) A storage battery dedicated to the [carbon monoxide detection] system arranged in accordance with 4.5.9
- (2) An automatic-starting, engine-driven generator serving the dedicated branch circuit specified in 4.5.5.1 and arranged in accordance with 4.5.10.3.1, and storage batteries dedicated to the [carbon monoxide detection] system with 4 hours of capacity arranged in accordance with 4.5.9

[72:10.5.6.1.1]

4.5.6.1.2 Secondary circuits that provide power to the control unit and are not integral to the unit shall be protected against physical damage. [72:10.5.6.1.2]

4.5.6.2 Capacity.

4.5.6.2.1* Where a combination (fire) system is used, the secondary power supply capacity requirements shall comply with 4.5.6.2.3 and with those of *NFPA 72, National Fire Alarm and Signaling Code*.

4.5.6.2.2* Where a combination carbon monoxide detection system is used, the secondary power supply capacity requirements shall comply with 4.5.6.2.3 and with the provisions of the applicable NFPA code or standard.

4.5.6.2.3 The secondary power supply shall have sufficient capacity to operate the carbon monoxide detection system under quiescent load (system operating in a nonalarm condition) for a minimum of 24 hours and, at the end of that period, shall be capable of operating the carbon monoxide detection system and all notification appliances for 12 hours. Notification appliances shall perform in accordance with 5.8.6.5.

Exception: The 12-hour requirement shall be permitted to be reduced to 5 minutes where the system is monitored by a supervising station and emergency response in accordance with 7.2.2 is provided.

4.5.6.2.4 For systems not addressed by 4.5.6.2.1 through 4.5.6.2.3, the secondary power supply capacity required shall include all power supply loads that are not automatically disconnected upon the transfer to the secondary power supply.

4.5.6.3 Secondary Power Operation.

4.5.6.3.1 Operation on secondary power shall not affect the required performance of a [carbon monoxide detection] system. [72:10.5.6.4.1]

4.5.6.3.2 Systems operating on secondary power shall comply with 4.13.1. [72:10.5.6.4.2]

4.5.7* Continuity of Power Supplies.

4.5.7.1 The secondary power supply shall automatically provide power to the protected premises [carbon monoxide detection] system within 10 seconds whenever the primary power supply fails to provide the minimum voltage required for proper operation. [72:10.5.7.1]

4.5.7.2 Required signals shall not be lost, interrupted, or delayed by more than 10 seconds as a result of the primary power failure. [72:10.5.7.3]

4.5.7.2.1 Storage batteries dedicated to the [carbon monoxide detection] system or an uninterruptible power supply (UPS) arranged in accordance with the provisions of NFPA 111, *Standard on Stored Electrical Energy Emergency and Standby Power Systems*, shall be permitted to supplement the secondary power supply to ensure required operation during the transfer period. [72:10.5.7.3.1]

4.5.7.2.2 Where a UPS is employed in 4.5.7.2.1, a positive means for disconnecting the input and output of the UPS system while maintaining continuity of power supply to the load shall be provided. [72:10.5.7.3.2]

4.5.8 Power Supply for Remotely Located Control Equipment.

4.5.8.1 Additional power supplies, where provided for control units, circuit interfaces, or other equipment essential to system operation, and located remotely from the main control unit, shall be comprised of a primary and secondary power supply that shall meet the same requirements as those of 4.5.1 through 4.5.7 and 4.13.2. [72:10.5.8.1]

4.5.8.2 The location of any remotely located power supply shall be identified at the master control unit. [72:10.5.8.2]

4.5.8.3 The master control unit display shall be permitted to satisfy the requirement of 4.5.8.2. [72:10.5.8.3]

4.5.8.4 The location of any remotely located power supply shall be identified on the record drawings. [72:10.5.8.4]

4.5.9 Storage Batteries.

4.5.9.1 Marking.

4.5.9.1.1 Batteries shall be marked with the month and year of manufacture using the month/year format. [72:10.5.9.1.1]

4.5.9.1.2 Where the battery is not marked with the month/year by the manufacturer, the installer shall obtain the date-code and mark the battery with the month/year of battery manufacture. [72:10.5.9.1.2]

4.5.9.2 Location. Storage batteries shall be located so that the [carbon monoxide detection] equipment, including overcurrent devices, are not adversely affected by battery gases and shall conform to the requirements of *NFPA 70, National Electrical Code*, Article 480. [72:10.5.9.2]

4.5.9.2.1 Cells shall be suitably insulated against grounds. [72:10.5.9.2.1]

4.5.9.2.2 Cells shall be suitably insulated against crosses. [72:10.5.9.2.2]

4.5.9.2.3 Cells shall be mounted in such a manner so as to be protected from physical damage. [72:10.5.9.2.3]

4.5.9.2.4 Racks shall be suitably protected against deterioration. [72:10.5.9.2.4]

4.5.9.2.5 If not located in or adjacent to the [carbon monoxide detection] control unit, the batteries and their charger location shall be permanently identified at the [carbon monoxide detection] control unit. [72:10.5.9.2.5]

4.5.9.3 Battery Charging.

4.5.9.3.1 Adequate facilities shall be provided to automatically maintain the battery fully charged under all conditions of normal operation. [72:10.5.9.3.1]

4.5.9.3.2 Adequate facilities shall be provided to recharge batteries within 48 hours after fully charged batteries have been subject to a single discharge cycle as specified in 4.5.6.2. [72:10.5.9.3.2]

4.5.9.3.3 Upon attaining a fully charged condition, the charge rate shall not be so excessive as to result in battery damage. [72:10.5.9.3.3]

4.5.9.3.4 Supervising stations shall maintain spare parts or units available, which shall be used to restore failed charging capacity prior to the consumption of one-half of the capacity of the batteries for the supervising station equipment. [72:10.5.9.3.5]

4.5.9.4 Overcurrent Protection.

4.5.9.4.1 The batteries shall be protected against excessive load current by overcurrent devices. [72:10.5.9.4.1]

4.5.9.4.2 The batteries shall be protected from excessive charging current by overcurrent devices or by automatic current-limiting design of the charging source. [72:10.5.9.4.2]

4.5.9.5 Metering. The charging equipment shall provide either integral meters or readily accessible terminal facilities for the connection of portable meters by which the battery voltage and charging current can be determined. [72:10.5.9.5]

4.5.9.6 Monitoring Integrity of Battery Charger.

4.5.9.6.1 Means for monitoring integrity appropriate for the batteries and charger employed shall be provided to detect a battery charger failure. [72:10.5.9.6.1]

4.5.9.6.2 Failure of the battery charger shall result in the initiation of a trouble signal in accordance with Section 4.9. [72:10.5.9.6.2]

4.5.10 Engine-Driven Generators.

4.5.10.1 Application and Installation. The application and installation of engine-driven generators shall be as specified in 4.5.10.2 through 4.5.10.7. [72:10.5.10.1]

4.5.10.2 Primary Power Supply.

4.5.10.2.1 Engine-driven generators arranged as the primary supply shall be designed in an approved manner. [72:10.5.10.2.1]

4.5.10.2.2 Engine-driven generators arranged as the primary supply shall be installed in an approved manner. [72:10.5.10.2.2]

4.5.10.3 Secondary Power Supplies.

4.5.10.3.1 Engine-driven generators used to provide secondary power for a [carbon monoxide detection] system shall comply with NFPA 110, *Standard for Emergency and Standby Power Systems*, Chapter 4, requirements for a Type 10, Class 24, Level 1 System. [72:10.5.10.3.1.1]

4.5.10.3.2 Installation of engine-driven generators used to provide secondary power for a [carbon monoxide detection]

system shall be in accordance with *NFPA 70, National Electrical Code*, Article 700. [72:10.5.10.3.1.2]

4.5.10.4 Performance, Operation, Testing, and Maintenance.

The requirements for performance, operation, testing, and maintenance of engine-driven generators shall conform to the applicable provisions of NFPA 110, *Standard for Emergency and Standby Power Systems*. [72:10.5.10.4]

4.5.10.5 Capacity. The unit shall be of a capacity that is sufficient to operate the system under the maximum normal load conditions in addition to all other demands placed upon the unit. [72:10.5.10.5]

4.5.10.6 Fuel. Unless otherwise required or permitted in 4.5.10.6.1 through 4.5.10.6.2, fuel shall be available in storage sufficient for 6 months of testing plus the capacity specified in 4.5.6. [72:10.5.10.6]

4.5.10.6.1 If a reliable source of supply is available at any time on a 2-hour notice, it shall be permitted to have fuel in storage sufficient for 12 hours of operation at full load. [72:10.5.10.6.2]

4.5.10.6.2 Fuel systems using natural or manufactured gas supplied through reliable utility mains shall not be required to have fuel storage tanks unless located in seismic risk zone 3 or greater as defined in ANSI A-58.1, *Building Code Requirements for Minimum Design Loads in Buildings and Other Structures*. [72:10.5.10.6.3]

4.5.10.7 Battery and Charger. A separate storage battery and separate automatic charger shall be provided for starting the engine-driven generator and shall not be used for any other purpose. [72:10.5.10.7]

• 4.6 Distinctive Signals.

4.6.1 Carbon monoxide alarm signals and carbon monoxide detection system supervisory and trouble signals shall be distinctively and descriptively annunciated.

4.6.2 Audible alarm notification appliances for a [carbon monoxide detection] system shall produce signals that are distinctive from other similar appliances used for other purposes in the same area that are not part of the [carbon monoxide detection] system. [72:10.7.2]

4.6.3* Audible signals on a control unit, or on multiple control units that are interconnected to form a system, or at a remote location, shall be permitted to have the same audible characteristics for all alerting functions including, but not limited to, alarm, trouble, and supervisory, provided that the distinction between signals shall be by other appropriate means, such as visible annunciation. [72:10.7.3]

4.6.4* Supervisory signals shall be distinctive in sound from other signals, and their sound shall not be used for any other purpose except as permitted in 4.6.3. [72:10.7.4]

4.6.5 Trouble signals required to indicate at the protected premises shall be indicated by distinctive audible signals, which shall be distinctive from alarm signals except as permitted in 4.6.3. [72:10.7.5]

4.6.6 When a carbon monoxide detection system is combined with either a fire alarm system and or an intrusion detection system, trouble signals from each system shall be permitted to use a common audible signal.

4.7 Alarm Signals.

4.7.1 Carbon monoxide alarm signals shall comply with 5.8.6.5.

4.7.2 Alarm Signal Deactivation.

4.7.2.1 A means for turning off activated alarm notification appliance(s) shall be permitted only if it complies with 4.7.2.3 through 4.7.2.6. [72:10.10.1]

Exception: An initiating device with integral sounder shall be permitted to comply with 5.8.2.9.

4.7.2.2 When an alarm signal deactivation means is actuated, both audible and visible notification appliances shall be simultaneously deactivated. [72:10.10.2]

4.7.2.3 The [alarm signal deactivation] means shall be key-operated or located within a locked cabinet, or arranged to provide equivalent protection against unauthorized use. [72:10.10.3]

4.7.2.4 The [alarm signal deactivation] means shall provide a visible zone alarm indication or the equivalent as specified in 4.12.1. [72:10.10.4]

4.7.2.5 Subsequent actuation of initiating devices on other initiating device circuits or subsequent actuation of addressable initiating devices on signaling line circuits shall cause the notification appliances to reactivate.

Exception: Subsequent actuation of another addressable initiating device of the same type in the same room or space shall not be required to cause the notification appliance(s) to reactivate. [72:10.10.5]

4.7.2.6 A means that is left in the “off” position when there is no alarm shall operate an audible trouble signal until the means is restored to normal. [72:10.10.6]

4.7.2.7* Resetting of alarm signals shall comply with the requirements of 5.8.2.1. [72:10.10.7]

4.8 Supervisory Signals.

4.8.1 Supervisory Signal Indication. Visible and audible indication of supervisory signals and visible indication of their restoration to normal shall be indicated within 90 seconds at the following locations:

- (1) Control unit for local carbon monoxide detection systems
- (2) Building command center for emergency voice/alarm communications systems
- (3) Supervising station location for systems installed in compliance with Chapter 7

4.8.2 Self-Restoring Signal. A supervisory signal initiating device shall be permitted to be self-restoring provided the control panel continues to indicate the supervisory condition.

4.8.3 Supervisory Signal Silencing.

4.8.3.1 A means for silencing a supervisory signal notification appliance(s) shall be permitted only if it complies with 4.8.3.2 through 4.8.3.4. [72:10.11.5.1]

4.8.3.2 The means shall be key-operated or located within a locked cabinet, or arranged to provide equivalent protection against unauthorized use. [72:10.11.5.2]

4.8.3.3 The means shall transfer the supervisory indication to a lamp or other visible indicator, and subsequent supervisory signals in other zones shall cause the supervisory notification appliance(s) to re-sound. [72:10.11.5.3]

4.8.3.4 A means that is left in the “silence” position where there is no supervisory off-normal signal shall operate a visible signal silence indicator. [72:10.11.5.4]

4.8.3.5 A means that is left in the “silence” position shall cause the trouble signal to sound until the silencing means is restored to normal position. [72:10.11.5.5]

4.9 Trouble Signals.

4.9.1 Trouble signals and their restoration to normal shall be indicated within 200 seconds at the locations identified in 4.9.6. [72:10.12.1]

4.9.2 Indication of primary power failure trouble signals transmitted to a supervising station shall be delayed in accordance with 4.13.2.3. [72:10.12.2]

4.9.3 If an intermittent signal is used, it shall sound at least once every 10 seconds, with a minimum duration of ½ second. [72:10.12.3]

4.9.4 A single audible trouble signal shall be permitted to annunciate multiple fault conditions. [72:10.12.4]

4.9.5 The trouble signal(s) shall be located in an area where it is likely to be heard. [72:10.12.5]

4.9.6 Visible and audible trouble signals and visible indication of their restoration to normal shall be indicated at the following locations:

- (1) Control unit for carbon monoxide detection systems
- (2) Building command center for emergency voice/alarm communications systems
- (3) Supervising stations for systems installed in compliance with Chapter 7

4.9.7 Audible Trouble Signal Silencing Means.

4.9.7.1 A means for silencing the trouble notification appliance(s) shall be permitted only if it complies with the following:

- (1) The means shall be key-operated or located within a locked cabinet, or arranged to provide equivalent protection against unauthorized use.
- (2) The means shall transfer the trouble indication to a suitably identified lamp or other acceptable visible indicator.
- (3) The visible indication in 4.9.7.1(2) shall persist until the trouble condition has been corrected.
- (4) The audible trouble signal shall sound when the silencing means is in its silence position and no trouble exists.

[72:10.12.8.1]

4.9.7.2* An audible trouble signal that has been silenced at the protected premises shall comply with the following:

- (1) The audible trouble signal shall automatically re-sound every 24 hours or less until fault conditions are restored to normal.
- (2) The audible trouble signal shall sound until it is manually silenced or acknowledged.
- (3) The re-sounded trouble signal shall also be automatically retransmitted to any supervising station to which the original trouble signal was transmitted.

[72:10.12.8.3]

4.9.7.3 If permitted by the authority having jurisdiction, the requirement for a 24-hour re-sound of an audible trouble signal shall be permitted to occur only at a supervising station

that meets the requirements of Chapter 7 and not at the protected premises. [72:10.12.8.4]

4.10 [Carbon Monoxide Safety] Function Status Indicators.

4.10.1 All controls provided specifically for the purpose of manually overriding any automatic [carbon monoxide safety] function shall provide visible indication of the status of the associated control circuits. [72:10.13.1]

4.10.2* Where status indicators are provided for emergency equipment or [carbon monoxide safety] functions, they shall be arranged to reflect the actual status of the associated equipment or function. [72:10.13.2]

4.11 Performance and Limitations.

4.11.1 Voltage, Temperature, and Humidity Variation. Equipment other than that addressed by 4.11.2.4 and 5.8.5.3.6 shall be designed so that it is capable of performing its intended functions under the following conditions:

- (1)*At 85 percent and at 110 percent of the nameplate primary (main) and secondary (standby) input voltage(s)
- (2) At ambient temperatures of 32°F (0°C) and 120°F (49°C)
- (3) At a relative humidity of 85 percent and an ambient temperature of 86°F (30°C)

4.11.2 Installation and Design.

4.11.2.1* All systems shall be installed in accordance with the manufacturer’s published installation instructions and applicable codes and standards.

4.11.2.2 Devices and appliances shall be located and mounted so that accidental operation or failure is not caused by vibration or jarring. [72:10.14.2.2]

4.11.2.3 All apparatus requiring [] resetting to maintain normal operation shall be restored to normal as promptly as possible after each alarm and kept in normal condition for operation. [72:10.14.2.3]

4.11.2.4 Equipment shall be installed in locations where conditions do not exceed the voltage, temperature, and humidity limits specified in the manufacturer’s published instructions. [72:10.14.2.4]

4.12 Annunciation and Annunciation Zoning.

4.12.1 Alarm Annunciation.

4.12.1.1 The location of an actuated initiating device shall be annunciated by visible means.

4.12.1.2 Visible annunciation of the location of an operated initiation device shall be by an indicator lamp, alphanumeric display, printout, or other approved means. [72:10.16.1.1.1]

4.12.1.3 The visible annunciation of the location of operated initiating devices shall not be canceled by the means used to deactivate alarm notification appliances. [72:10.16.1.1.2]

4.12.2 Trouble Annunciation.

4.12.2.1 Trouble annunciation shall be annunciated by visible means.

4.12.2.2 Visible annunciation shall be by an indicator lamp, an alphanumeric display, a printout, or other means. [72:10.16.2.1.1]

4.12.2.3 The visible annunciation of trouble conditions shall not be canceled by the means used to deactivate trouble notification appliances.

4.12.3* **Annunciator Access and Location.**

4.12.3.1 All required annunciation means shall be readily accessible to responding personnel. [72:10.16.3.1]

4.12.3.2 All required annunciation means shall be located as required by the authority having jurisdiction to facilitate an efficient response to the [] situation. [72:10.16.3.2]

4.12.4 Alarm Annunciation Display. Visible annunciators shall be capable of displaying all zones in alarm. [72:10.16.4]

4.12.4.1 If all zones in alarm are not displayed simultaneously, the zone of origin shall be displayed. [72:10.16.4.1]

4.12.4.2 If all zones in alarm are not displayed simultaneously, there shall be an indication that other zones are in alarm. [72:10.16.4.2]

4.12.5 [] Command Center. Annunciation at the [] command center shall be by means of audible and visible indicators. [72:10.16.5]

4.12.6 **Annunciation Zoning.**

4.12.6.1 For the purpose of alarm annunciation, each floor of the building shall be considered as a separate zone. [72:10.16.6.1]

4.12.6.2 Where the system serves more than one building, each building shall be annunciated separately. [72:10.16.6.3]

4.13 **Monitoring Integrity.**

4.13.1* **Monitoring Integrity of Installation Conductors and Other Signaling Channels.**

4.13.1.1 Unless otherwise permitted or required by 4.13.1.3 through 4.13.1.10, all means of interconnecting equipment, devices, and appliances and wiring connections shall be monitored for the integrity of the interconnecting conductors or equivalent path so that the occurrence of a single open or a single ground-fault condition in the installation conductors or other signaling channels is automatically indicated within 200 seconds. [72:10.17.1.1]

4.13.1.2 Unless otherwise permitted or required by 4.13.1.3 through 4.13.1.10, all means of interconnecting equipment, devices, and appliances and wiring connections shall be monitored for the integrity of the interconnecting conductors or equivalent path so that the restoration to normal of a single open or a single ground-fault condition in the installation conductors or other signaling channels is automatically indicated within 200 seconds. [72:10.17.1.2]

4.13.1.3 Shorts between conductors shall not be required to be monitored for integrity, unless required by 4.13.1.14. [72:10.17.1.3]

4.13.1.4 Monitoring for integrity shall not be required for connections to and between supplementary system components, provided that single open, ground, or short-circuit conditions of the supplementary equipment or interconnecting means, or both, do not affect the required operation of the [carbon monoxide detection] system. [72:10.17.1.5]

4.13.1.5 Monitoring for integrity shall not be required for the circuit of an alarm notification appliance installed in the same room with the central control equipment, provided that the notification appliance circuit conductors are installed in conduit or are equivalently protected against mechanical injury. [72:10.17.1.6]

4.13.1.6 Monitoring for integrity shall not be required for a trouble signal circuit. [72:10.17.1.7]

4.13.1.7* Monitoring for integrity shall not be required for the interconnection between listed equipment within a common enclosure. [72:10.17.1.8]

4.13.1.8 Monitoring for integrity shall not be required for the interconnection between enclosures containing control equipment located within 20 ft (6 m) of each other where the conductors are installed in conduit or equivalently protected against mechanical injury. [72:10.17.1.9]

4.13.1.9 Monitoring for integrity shall not be required for the conductors for ground detection where a single ground does not prevent the required normal operation of the system. [72:10.17.1.10]

4.13.1.10 Monitoring for integrity shall not be required for the interconnecting wiring of a stationary computer and the computer's keyboard, video monitor, mouse-type device, or touch screen, as long as the interconnecting wiring does not exceed 8 ft (2.4 m) in length; is a listed computer/data processing cable as permitted by *NFPA 70, National Electrical Code*; and failure of cable does not cause the failure of the required system functions not initiated from the keyboard, mouse, or touch screen. [72:10.17.1.13]

4.13.1.11 Interconnection means shall be arranged so that a single break or single ground fault does not cause a [carbon monoxide] alarm signal. [72:10.17.1.15]

4.13.1.12 Unacknowledged [carbon monoxide] alarm signals shall not be interrupted if a fault on an initiating device circuit or a signaling line circuit occurs while there is an alarm condition on that circuit.

Exception: Circuits used to interconnect [carbon monoxide detection] control units. [72:10.17.1.16]

4.13.1.13 An open, ground, or short-circuit fault on the installation conductors of one alarm notification appliance circuit shall not affect the operation of any other alarm notification circuit. [72:10.17.1.17]

4.13.1.13.1 Notification alarm circuits that do not have notification appliances tied directly to the circuit shall be considered control circuits. [72:10.17.1.17.1]

4.13.1.13.2 Control circuits shall not be required to comply with 4.13.1.13, provided that the circuit is monitored for integrity in accordance with 4.13.1 and a fault in the installation conductors shall result in a trouble signal in accordance with Section 4.9. [72:10.17.1.17.2]

4.13.1.14 A wire-to-wire short-circuit fault on any alarm notification appliance circuit shall result in a trouble signal in accordance with Section 4.9 and 4.9.7, except as permitted by 4.13.1.4 or 4.13.1.5. [72:10.17.1.18]

4.13.1.15 Where two or more systems are interconnected, the interconnecting circuit conductors shall be monitored for integrity so that open, short, or ground-fault conditions that affect the required normal operation of either system are indicated as a trouble condition. [72:10.17.1.19]

4.13.2 **Monitoring Integrity of Power Supplies.**

4.13.2.1 Unless otherwise permitted or required by 4.13.2.1.3 through 4.13.2.1.6, all primary and secondary power supplies shall be monitored for the presence of voltage at the point of connection to the system. [72:10.17.3.1]

4.13.2.1.1 Failure of either supply shall result in a trouble signal in accordance with Section 4.9. [72:10.17.3.1.1]

4.13.2.1.2 Where the digital alarm communicator transmitter (DACT) is powered from a protected premises [carbon monoxide detection] control unit, power failure indication shall be in accordance with 4.13.2.1. [72:10.17.3.1.2]

4.13.2.1.3 Monitoring shall not be required for a power supply for supplementary equipment. [72:10.17.3.1.3]

4.13.2.1.4 Monitoring shall not be required for the neutral of a three-, four-, or five-wire alternating current (ac) or direct current (dc) supply source. [72:10.17.3.1.4]

4.13.2.1.5 Monitoring shall not be required for the main power supply in a central station, provided the fault condition is otherwise indicated so as to be obvious to the operator on duty. [72:10.17.3.1.5]

4.13.2.1.6 Monitoring shall not be required for the output of an engine-driven generator that is part of the secondary power supply, provided that the generator is tested weekly in accordance with Chapter 8. [72:10.17.3.1.6]

4.13.2.2* Power supply sources and electrical supervision for digital alarm communications systems shall be in accordance with Sections 4.5 and 4.13. [72:10.7.3.2]

4.13.2.3* Unless prohibited by the authority having jurisdiction, where carbon monoxide detection systems are connected to a supervising station, the system shall be arranged to delay transmission of primary power failure signals for a period ranging from 60 to 180 minutes.

4.13.2.4 Power supervisory devices shall be arranged so as not to impair the receipt of [carbon monoxide] alarm or supervisory signals. [72:10.17.3.4]

4.14 Documentation.

4.14.1 Approval and Acceptance.

4.14.1.1 The authority having jurisdiction shall be notified prior to installation or alteration of equipment or wiring. [72:10.18.1.1]

4.14.1.2* At the authority having jurisdiction's request, complete information regarding the system or system alterations, including specifications, type of system or service, shop drawings, input/output matrix, battery calculations, and notification appliance circuit voltage drop calculations, shall be submitted for approval. [72:10.18.1.2]

4.14.1.3 Before requesting final approval of the installation, if required by the authority having jurisdiction, the installing contractor shall furnish a written statement stating that the system has been installed in accordance with approved plans and tested in accordance with the manufacturer's published instructions and the appropriate NFPA requirements. [72:10.18.1.3]

4.14.1.4* The [carbon monoxide detection system] record of completion form, Figure 4.14.2.1.1, shall be permitted to be a part of the written statement required in 4.14.1.3. When more than one contractor has been responsible for the installation, each contractor shall complete the portions of the form for which that contractor had responsibility. [72:10.18.1.4]

4.14.2 Completion Documents.

4.14.2.1 Preparation.

4.14.2.1.1* The preparation of a [carbon monoxide detection system] record of completion, Figure 4.14.2.1.1, shall be the responsibility of the qualified and experienced person described in 4.4.2. [72:10.18.2.1.1]

4.14.2.1.2 The preparation of a [carbon monoxide detection system] record of completion, Figure 4.14.2.1.1, shall be in accordance with 4.14.2.1.2.1 through 4.14.2.1.2.5. [72:10.18.2.1.2]

4.14.2.1.2.1 Parts 1 through 14 of the record of completion shall be completed after the system is installed and the installation wiring has been checked. [72:10.18.2.1.2.1]

4.14.2.1.2.2 Parts 15 and 16 of the record of completion shall be completed after the operational acceptance tests have been completed. [72:10.18.2.1.2.2]

4.14.2.1.2.3 A preliminary copy of the record of completion shall be given to the system owner and, if requested, to other authorities having jurisdiction after completion of the installation wiring tests. [72:10.18.2.1.2.3]

4.14.2.1.2.4 A final copy of the record of completion shall be provided after completion of the operational acceptance tests. [72:10.18.2.1.2.4]

4.14.2.1.2.5 One copy of the record of completion shall be stored at the [carbon monoxide detection] control unit or other approved location. [72:10.18.2.1.2.5]

4.14.2.1.2.6 This copy shall be updated to reflect all system additions or modifications and maintained in a current condition at all times. [72:10.18.2.1.2.6]

4.14.2.1.2.7 Where not stored at the main [carbon monoxide detection] control unit, the location of these documents shall be identified at the main fire alarm control unit. [72:10.18.2.1.2.7]

4.14.2.1.2.8 If the documents are located in a separate enclosure or cabinet, the separate enclosure or cabinet shall be prominently labeled [CARBON MONOXIDE DETECTION] DOCUMENTS. [72:10.18.2.1.2.8]

4.14.2.2 Revision. All [carbon monoxide detection] system modifications made after the initial installation shall be recorded on a revised version of the original record of completion. [72:10.18.2.2]

4.14.2.2.1 All changes from the original information shall be shown. [72:10.18.2.2.1]

4.14.2.2.2 The revised record of completion shall include a revision date. [72:10.18.2.2.2]

4.14.2.3 Documentation Required. Every system shall include the following documentation, which shall be delivered to the owner or the owner's representative upon final acceptance of the system:

- (1) *An owner's manual and manufacturer's published instructions covering all system equipment
- (2) Record drawings
- (3) For software-based systems, record copy of the site-specific software
- (4) A written sequence of operation

[72:10.18.2.3]



CARBON MONOXIDE SYSTEM RECORD OF COMPLETION

*To be completed by the system installation contractor at the time of system acceptance and approval.
It shall be permitted to modify this form as needed to provide a more complete and/or clear record.*

Insert N/A in all unused lines.

Attach additional sheets, data, or calculations as necessary to provide a complete record.

1. PROPERTY INFORMATION

Name of property: _____

Address: _____

Description of property: _____

Occupancy type: _____

Name of property representative: _____

Address: _____

Phone: _____ Fax: _____ E-mail: _____

Authority having jurisdiction over this property: _____

Phone: _____ Fax: _____ E-mail: _____

2. INSTALLATION, SERVICE, AND TESTING CONTRACTOR INFORMATION

Installation contractor for this equipment: _____

Address: _____

License or certification number: _____

Phone: _____ Fax: _____ E-mail: _____

Service organization for this equipment: _____

Address: _____

License or certification number: _____

Phone: _____ Fax: _____ E-mail: _____

A contract for test and inspection in accordance with NFPA standards is in effect as of: _____

Contracted testing company: _____

Address: _____

Phone: _____ Fax: _____ E-mail: _____

Contract expires: _____ Contract number: _____ Frequency of routine inspections: _____

3. DESCRIPTION OF SYSTEM OR SERVICE

Carbon monoxide system (nonvoice)

Carbon monoxide emergency voice alarm communication system (EVACS)

Combination carbon monoxide detection system, with the following components, describe: _____

NFPA 720 edition: _____ Additional description of system(s): _____

FIGURE 4.14.2.1.1 Carbon Monoxide Detection System Record of Completion.

3. DESCRIPTION OF SYSTEM OR SERVICE *(continued)*

3.1 Control Unit

Manufacturer: _____ Model number: _____

3.2 System Documentation

An owner's manual, a copy of the manufacturer's instructions, a written sequence of operation, and a copy of the numbered record drawings are stored on site. Location: _____

3.3 System Software

This system does not have alterable site-specific software.

Operating system (executive) software revision level: _____

Site-specific software revision date: _____ Revision completed by: _____

A copy of the site-specific software is stored on site. Location: _____

3.4 Off-Premises Signal Transmission

This system does not have off-premises transmission.

Name of organization receiving alarm signals with phone numbers:

Alarm: _____ Phone: _____

Supervisory: _____ Phone: _____

Trouble: _____ Phone: _____

Entity to which alarms are retransmitted: _____ Phone: _____

Method of retransmission: _____

Specify the means of transmission from the protected premises to the supervising station or receiving station:

4. CIRCUITS AND PATHWAYS

4.1 Signaling Line Pathways

4.1.1 Pathways Class Designations

Pathways class: _____ Quantity: _____

(See NFPA 720, 5.4.3.)

4.1.2 Pathways Utilizing Two or More Media

Quantity: _____ Description: _____

4.1.3 Device Power Pathways

No separate power pathways from the signaling line pathway

Power pathways are separate but of the same pathway classification as the signaling line pathway

Power pathways are separate and different classification from the signaling line pathway

4.1.4 Isolation Modules

Quantity: _____

FIGURE 4.14.2.1.1 *Continued*



4. CIRCUITS AND PATHWAYS (continued)

4.2 Alarm Initiating Device Pathways

4.2.1 Pathways Class Designations

Pathways class: _____ Quantity: _____

(See NFPA 720, 5.4.3.)

4.2.2 Pathways Utilizing Two or More Media

Quantity: _____ Description: _____

4.2.3 Device Power Pathways

- No separate power pathways from the initiating device pathway
- Power pathways are separate but of the same pathway classification as the initiating device pathway
- Power pathways are separate and different classification from the initiating device pathway

4.3 Non-Voice Audible System Pathways

4.3.1 Pathways Class Designations

Pathways class: _____ Quantity: _____

(See NFPA 720, 5.4.3.)

4.3.2 Pathways Utilizing Two or More Media

Quantity: _____ Description: _____

4.3.3 Device Power Pathways

- No separate power pathways from the notification appliance pathway
- Power pathways are separate but of the same pathway classification as the notification appliance pathway
- Power pathways are separate and different classification from the notification appliance pathway

5. ALARM INITIATING DEVICES

5.1 Automatic Initiating Devices

5.1.1 Carbon Monoxide Detectors

Type and number of devices: Addressable: _____ Conventional: _____

Other (specify): _____

Type of detector sensing technology: Electrochemical Biomimetic Metal oxide semiconductor (MOS)

Other (specify): _____

5.1.2 Addressable Monitoring Modules

This system does not have monitoring modules.

Number of devices: _____

5.1.3 Other Initiating Devices

This system does have other initiating devices.

Describe: _____

6. SUPERVISORY SIGNAL-INITIATING DEVICES

6.1 Supervisory Devices

This system does not have supervisory devices.

Type and number of devices: Addressable: _____ Conventional: _____ Coded: _____ Transmitter: _____

Describe: _____

FIGURE 4.14.2.1.1 Continued

7. ANNUNCIATORS This system does not have annunciators.**7.1 Location and Description of Annunciators**

Location 1: _____

Location 2: _____

Location 3: _____

8. ALARM NOTIFICATION APPLIANCES**8.1 Emergency Voice Alarm Communication System** This system does not have an EVACS.

Number of single voice alarm channels: _____ Number of multiple voice alarm channels: _____

Number of speakers: _____ Number of speaker circuits: _____

Location of amplification and sound-processing equipment: _____

Location of paging microphone stations:

Location 1: _____

Location 2: _____

Location 3: _____

8.2 Nonvoice Notification Appliances This system does not have nonvoice notification appliances.

Horns: _____ With visible: _____ Bells: _____ With visible: _____

Chimes: _____ With visible: _____

Visible only: _____ Other (describe): _____

8.3 Notification Appliance Power Extender Panels This system does not have power extender panels.

Quantity: _____

Locations: _____

9. CARBON MONOXIDE SAFETY FUNCTIONS

This system activates the following control functions: _____

Describe: _____

9.1 Addressable Control Modules This system does not have control modules.

Number of devices: _____

Other (specify): _____

10. SYSTEM POWER**10.1 Control Unit****10.1.1 Primary Power**

Input voltage of control panel: _____ Control panel amps: _____

Overcurrent protection: Type: _____ Amps: _____

Location (of primary supply panel board): _____

Disconnecting means location: _____

FIGURE 4.14.2.1.1 *Continued*

10. SYSTEM POWER (continued)

10.1.2 Engine-Driven Generator

This system does not have a generator.

Location of generator: _____

Location of fuel storage: _____ Type of fuel: _____

10.1.3 Uninterruptible Power System

This system does not have a UPS.

Equipment powered by a UPS system: _____

Location of UPS system: _____

Calculated capacity of UPS batteries to drive the system components connected to it:

In standby mode (hours): _____ In alarm mode (minutes): _____

10.1.4 Batteries

Location: _____ Type: _____ Nominal voltage: _____ Amp/hour rating: _____

Calculated capacity of batteries to drive the system:

In standby mode (hours): _____ In alarm mode (minutes): _____

Batteries are marked with date of manufacture Battery calculations are attached

10.2 Emergency Voice Alarm Communication System

This system does not have an EVACS.

10.2.1 Primary Power

Input voltage of EVACS panel: _____ EVACS panel amps: _____

Overcurrent protection: Type: _____ Amps: _____

Location (of primary supply panel board): _____

Disconnecting means location: _____

10.2.2 Engine-Driven Generator

This system does not have a generator.

Location of generator: _____

Location of fuel storage: _____ Type of fuel: _____

10.2.3 Uninterruptible Power System

This system does not have a UPS.

Equipment powered by a UPS system: _____

Location of UPS system: _____

Calculated capacity of UPS batteries to drive the system components connected to it:

In standby mode (hours): _____ In alarm mode (minutes): _____

10.2.4 Batteries

Location: _____ Type: _____ Nominal voltage: _____ Amp/hour rating: _____

Calculated capacity of batteries to drive the system:

In standby mode (hours): _____ In alarm mode (minutes): _____

Batteries are marked with date of manufacture Battery calculations are attached

10.3 Notification Appliance Power Extender Panels

This system does not have power extender panels

FIGURE 4.14.2.1.1 Continued

10. SYSTEM POWER (continued)**10.3.1 Primary Power**

Input voltage of power extender panel(s): _____ Power extender panel amps: _____

Overcurrent protection: Type: _____ Amps: _____

Location (of primary supply panel board): _____

Disconnecting means location: _____

10.3.2 Engine-Driven Generator This system does not have a generator.

Location of generator: _____

Location of fuel storage: _____ Type of fuel: _____

10.3.3 Uninterruptible Power System This system does not have a UPS.

Equipment powered by a UPS system: _____

Location of UPS system: _____

Calculated capacity of UPS batteries to drive the system components connected to it:

In standby mode (hours): _____ In alarm mode (minutes): _____

10.3.4 Batteries

Location: _____ Type: _____ Nominal voltage: _____ Amp/hour rating: _____

Calculated capacity of batteries to drive the system:

In standby mode (hours): _____ In alarm mode (minutes): _____

 Batteries are marked with date of manufacture Battery calculations are attached**11. RECORD OF SYSTEM INSTALLATION***Fill out after all installation is complete and wiring has been checked for opens, shorts, ground faults, and improper branching, but before conducting operational acceptance tests.*This is a: New system Modification to an existing system Permit number: _____

The system has been installed in accordance with the following requirements: (Note any or all that apply.)

 NFPA 720, Edition: _____ NFPA 72, Edition: _____ NFPA 70, National Electrical Code, Article 760, Edition: _____ Manufacturer's published instructions

Other (specify): _____

System deviations from referenced NFPA standards: _____

Signed: _____ Printed name: _____ Date: _____

Organization: _____ Title: _____ Phone: _____

FIGURE 4.14.2.1.1 *Continued*

12. RECORD OF SYSTEM OPERATIONAL ACCEPTANCE TEST

- New system

All operational features and functions of this system were tested by, or in the presence of, the signer shown below, on the date shown below, and were found to be operating properly in accordance with the requirements for the following:

- Modifications to an existing system

All newly modified operational features and functions of the system were tested by, or in the presence of, the signer shown below, on the date shown below, and were found to be operating properly in accordance with the requirements of the following:

- NFPA 720, Edition: _____
- NFPA 72, Edition: _____
- NFPA 70, National Electrical Code, Article 760, Edition: _____
- Manufacturer's published instructions

Other (specify): _____

- Individual device testing documentation [Inspection and Testing Form (Figure 8.6.2.2) is attached]

Signed: _____ Printed name: _____ Date: _____
 Organization: _____ Title: _____ Phone: _____

13. CERTIFICATIONS AND APPROVALS

13.1 System Installation Contractor:

This system, as specified herein, has been installed and tested according to all NFPA standards cited herein.

Signed: _____ Printed name: _____ Date: _____
 Organization: _____ Title: _____ Phone: _____

13.2 System Service Contractor:

The undersigned has a service contract for this system in effect as of the date shown below.

Signed: _____ Printed name: _____ Date: _____
 Organization: _____ Title: _____ Phone: _____

13.3 Supervising Station:

This system, as specified herein, will be monitored according to all NFPA standards cited herein.

Signed: _____ Printed name: _____ Date: _____
 Organization: _____ Title: _____ Phone: _____

FIGURE 4.14.2.1.1 Continued

13. CERTIFICATIONS AND APPROVALS (continued)**13.4 Property or Owner Representative:**

I accept this system as having been installed and tested to its specifications and all NFPA standards cited herein.

Signed: _____ Printed name: _____ Date: _____

Organization: _____ Title: _____ Phone: _____

13.5 Authority Having Jurisdiction:

I have witnessed a satisfactory acceptance test of this system and find it to be installed and operating properly in accordance with its approved plans and specifications, with its approved sequence of operations, and with all NFPA standards cited herein.

Signed: _____ Printed name: _____ Date: _____

Organization: _____ Title: _____ Phone: _____

FIGURE 4.14.2.1.1 *Continued*

Chapter 5 Protected Premises Carbon Monoxide Detection Systems

5.1 Application.

5.1.1 The application, installation, and performance of carbon monoxide detection systems within protected premises, including carbon monoxide alarm, supervisory, and trouble signals, shall comply with the requirements of this chapter.

5.1.2 The requirements of Chapters 4, 6, and 7 shall also apply, unless they are in conflict with this chapter.

5.1.3 The requirements of Chapter 8 shall apply.

5.1.4 The requirements of this chapter shall not apply to carbon monoxide alarms and household carbon monoxide detection systems addressed in Chapter 9 unless otherwise noted.

5.2 General.

5.2.1* Purpose. The systems covered in Chapter 5 shall be for the protection of life by indicating the existence of carbon monoxide impacting the protected premises.

5.2.2 Software and Firmware Control.

5.2.2.1 A record of installed software and firmware version numbers shall be maintained at the location of the [carbon monoxide detection] control unit. [72:23.2.2.1]

5.2.2.1.1* Software and firmware within the [carbon monoxide detection] system that interfaces to other required software or firmware shall be functionally compatible. [72:23.2.2.1.1]

5.2.2.1.2* The compatible software or firmware versions shall be documented at the initial acceptance test and at any reacceptance tests. [72:23.2.2.1.2]

5.2.2.2* All software and firmware shall be protected from unauthorized changes. [72:23.2.2.2]

5.2.2.3 All changes shall be tested in accordance with 8.4.1.2. [72:23.2.2.3]

5.2.3 Separate Systems. The requirements of this chapter shall not preclude the use of separate fire, life safety, and carbon monoxide detection systems, provided that the systems do not generate simultaneous conflicting notification to building occupants or conflicting activation of safety functions.

5.2.4* Nonrequired (Voluntary) Systems and Components.

5.2.4.1 Nonrequired [carbon monoxide detection] systems and components shall meet the requirements of this standard. [72:23.2.3.1]

5.2.4.2 Nonrequired [carbon monoxide detection] systems and components shall be identified on the record drawings required in 4.14.2.3(2). [72:23.2.3.2]

5.3 System Features. The features required for a protected premises [carbon monoxide detection] system shall be documented as a part of the system design and shall be determined in accordance with 5.3.1 through 5.3.3. [72:23.3]

5.3.1 Required Systems. Features for required systems shall be based on the requirements of other applicable codes or statutes that have been adopted by the enforcing jurisdiction. [72:23.3.1]

5.3.2 Nonrequired Systems. The features for a nonrequired system shall be established by the system designer on the basis of the goals and objectives intended by the system owner. [72:23.3.2]

5.3.3 Required Features. Protected premises carbon monoxide detection systems that serve the general carbon monoxide alarm needs of a building or buildings shall include one or more of the following systems or functions:

- (1) Automatic alarm signal initiation
- (2) Activation of carbon monoxide safety functions
- (3) Activation of alarm notification appliances
- (4) Emergency voice/alarm communications
- (5) Activation of off-premises signals
- (6) Combination carbon monoxide detection systems
- (7) Integrated systems

5.4 System Performance and Integrity.

5.4.1 General. The performance and integrity of carbon monoxide detection systems shall comply with the applicable requirements of 5.4.2 through Section 5.7.

5.4.2 Circuits and Pathways.

5.4.2.1 Performance [] characteristics of signaling pathways (interconnections) shall comply with the defined designations of 5.4.2 and 5.4.3. [72:12.2.1]

5.4.2.2 A pathway (interconnection) class designation shall be dependent on the pathway (interconnection) capability to continue to operate during abnormal conditions. [72:12.2.2]

5.4.2.3* The installation of all pathway wiring, cable, and equipment shall be in accordance with *NFPA 70, National Electrical Code*, and the applicable requirements of 5.4.2.3.1 through 5.4.2.3.4. [72:12.2.4]

5.4.2.3.1 Optical fiber cables installed as part of the [carbon monoxide detection] system shall meet the requirements of *NFPA 70, National Electrical Code*, Article 770, and be protected against physical damage in accordance with *NFPA 70, National Electrical Code*, Article 760. [72:12.2.4.1]

5.4.2.3.2* Where [carbon monoxide detection system] circuits enter or exit buildings, the circuits and equipment shall be installed in accordance with the requirements of Article 760 of *NFPA 70, National Electrical Code*. [72:12.2.4.2]

5.4.2.3.3 [Carbon monoxide detection] system wiring and equipment, including all circuits controlled and powered by the [carbon monoxide detection] system, shall be installed in accordance with the requirements of this standard and of *NFPA 70, National Electrical Code*, Article 760. [72:12.2.4.3]

5.4.2.3.4 All [carbon monoxide detection] systems shall test free of grounds.

Exception: Parts of circuits or equipment that are intentionally and permanently grounded to provide ground-fault detection, noise suppression, emergency ground signaling, and circuit protection grounding shall be permitted. [72:12.2.4.4]

5.4.3* Pathway Class Designations. Pathways shall be designated as Class A, Class B, Class C, Class D, Class E, or Class X, depending on their performance. [72:12.3]

5.4.3.1* Class A. A pathway shall be designated as Class A when it performs as follows:

- (1) It includes a redundant path.
- (2) Operational capability continues past a single open.
- (3) Conditions that affect the intended operation of the path are annunciated.

[72:12.3.1]

5.4.3.2* Class B. A pathway shall be designated as Class B when it performs as follows:

- (1) It does not include a redundant path.
- (2) Operational capability stops at a single open.
- (3) Conditions that affect the intended operation of the path are annunciated.

[72:12.3.2]

5.4.3.3* Class C. A pathway shall be designated as Class C when it performs as follows:

- (1) It includes one or more pathways where operational capability is verified via end-to-end communication, but the integrity of individual paths is not monitored.
- (2) A loss of end-to-end communication is annunciated.

[72:12.3.3]

5.4.3.4* Class D. A pathway shall be designated as Class D when it has fail-safe operation, where no fault is annunciated, but the intended operation is performed in the event of a pathway failure. [72:12.3.4]

5.4.3.5* Class E. A pathway shall be designated as Class E when it is not monitored for integrity. [72:12.3.5]

5.4.3.6* Class X. A pathway shall be designated as Class X when it performs as follows:

- (1) It includes a redundant path.
- (2) Operational capability continues past a single open or short-circuit.
- (3) Conditions that affect the intended operation of the path are annunciated.

[72:12.3.6]

5.4.4 Circuit Designations. Initiating device circuits, notification appliance circuits, and signaling line circuits shall be designated by class, depending on the circuit's capability to continue to operate during specified fault conditions as indicated in Sections 23.5 through 23.7 of *NFPA 72*. [72:23.4.2]

5.4.4.1 Specified fault conditions shall result in the annunciation of a trouble signal at the protected premises within 200 seconds as required in Section 4.13. [72:23.4.2.1]

5.4.4.2* Class A and Class X circuits using physical conductors (e.g., metallic, optical fiber) shall be installed such that the outgoing and return conductors, exiting from and returning to the control unit, respectively, are routed separately. The outgoing and return (redundant) circuit conductors shall be permitted in the same cable assembly (i.e., multi-conductor cable), enclosure, or raceway only under the following conditions:

- (1) For a distance not to exceed 10 ft (3.0 m) where the outgoing and return conductors enter or exit the initiating device, notification appliance, or control unit enclosures
- (2) For single raceway drops to individual devices or appliances
- (3) For single conduit/raceway drops to multiple devices or appliances installed within a single room not exceeding 1000 ft² (93 m²) in area

[72:23.4.2.2]

5.4.4.3 Where the power to a device is supplied over a separate circuit from the signaling line circuit or initiating device circuit, the operation of the power circuit shall meet the performance requirements of the initiating device circuit or signaling line circuit, unless different performance requirements

are established in accordance with the evaluation in 5.4.5 and approved by the authority having jurisdiction. [72:23.4.2.3]

5.4.5 Pathway Classification.

5.4.5.1 The class of pathways shall be determined from an evaluation based on the path performance as required by governing laws, codes, standards, and a site-specific engineering analysis. [72:23.4.3.1]

5.4.5.2 When determining the integrity and reliability of the interconnecting signaling paths (circuits) installed within the protected premises, the following influences shall be considered:

- (1) Transmission media used
- (2) Length of the circuit conductors
- (3) Total building area covered by, and the quantity of initiating devices and notification appliances connected to, a single circuit
- (4) Effect of a fault in the [carbon monoxide detection] system that would hinder the performance objectives of the system that protects the occupants and mission of the protected premises
- (5) Nature of hazards present within the protected premises
- (6) Functional requirements of the system necessary to provide the level of protection required for the system
- (7) Size and nature of the population of the protected premises

[72:23.4.3.2]

5.4.5.3 Results of the evaluation required by 5.4.5.1 shall be included with the documentation required by 4.14.1.1. [72:23.4.3.3]

5.5 Performance of Initiating Device Circuits (IDCs).

5.5.1 The assignment of class designations to initiating device circuits shall be based on their performance capabilities under abnormal (fault) conditions in accordance with the requirements for Class A or Class B pathways specified in 5.4.3, as well as the requirements specified in 5.5.2 and 5.5.3. [72:23.5.1]

5.5.2 An open or ground condition shall result in the annunciation of a trouble signal. [72:23.5.2]

5.5.3 The circuit shall maintain alarm receipt capability during the application of a single ground fault. [72:23.5.3]

5.6 Performance of Signaling Line Circuits (SLCs).

5.6.1 The assignment of class designations to signaling line circuits shall be based on their performance capabilities under abnormal (fault) conditions in accordance with the requirements for Class A, Class B, or Class X pathways specified in 5.4.3 and the requirements of 5.6.2 through 5.6.5. [72:23.6.1]

5.6.2 An open, short circuit, or ground fault shall result in the annunciation of a trouble signal. [72:23.6.2]

5.6.3 Class B pathways shall maintain alarm capability during the application of a single ground fault. [72:23.6.3]

5.6.4 Class A and Class X pathways shall maintain alarm capability during the application of a single ground fault, and also during the combination of a single open and a single ground fault. [72:23.6.4]

5.6.5* Where digital communications are used, inability to send or receive digital signals over a signaling line circuit shall be indicated by a trouble signal. [72:23.6.5]

5.7 Performance of Notification Appliance Circuits (NACs).

5.7.1 The assignment of class designations to notification appliance circuits shall be based on their performance capabilities under abnormal (fault) conditions in accordance with the requirements for Class A or Class B pathways specified in 5.4.3, as well as the requirements specified in 5.7.2 and 5.7.3. [72:23.7.1]

5.7.2 An open or ground condition shall result in the annunciation of a trouble signal. [72:23.7.2]

5.7.3 The circuit shall maintain alarm capability during the application of a single ground fault. [72:23.7.3]

5.8 System Requirements.

5.8.1* Actuation Time. Actuation of alarm notification appliances or emergency voice communications, [carbon monoxide] safety functions, and annunciation at the protected premises shall occur within 10 seconds after the activation of an initiating device. [72:23.8.1.1]

5.8.2* Carbon Monoxide Detection Control Units.

5.8.2.1 [Carbon monoxide detection] systems shall be permitted to be either integrated systems combining all detection, notification, and auxiliary functions in a single system or a combination of component subsystems. [72:23.8.2.1]

5.8.2.2 Carbon monoxide detection system components shall be permitted to share control equipment or shall be able to operate as stand-alone subsystems, but, in any case, they shall be arranged to function as a single system.

5.8.2.3 All component subsystems shall be capable of simultaneous, full-load operation without degradation of the required overall system performance. [72:23.8.2.4]

5.8.2.4 The method of interconnection of [carbon monoxide detection] control units shall meet the monitoring requirements of Section 4.13 and *NFPA 70, National Electrical Code*, Article 725, and shall be achieved by the following recognized means:

- (1) Electrical contacts listed for the connected load
- (2) Data communications over signaling line circuit(s) dedicated to the [carbon monoxide detection system] or shared with other premises operating systems
- (3) Other listed methods

[72:23.8.2.5]

5.8.2.5 Where the signaling line circuit is shared by other premises operating systems, operation shall be in accordance with 5.8.4. [72:23.8.2.6]

5.8.2.5.1 All signal control and transport equipment (such as routers, servers) located in a critical [carbon monoxide detection system] or [carbon monoxide] safety function signaling path shall be listed for [carbon monoxide] alarm service, unless the following conditions are met:

- (1) The equipment meets the performance requirements of 4.11.1.
- (2) The equipment is provided with primary and secondary power and monitored for integrity as required in Section 4.5.
- (3) All programming and configuration ensure a [carbon monoxide detection] system actuation time as required in 5.8.1.

(4) System bandwidth is monitored to confirm that all communications between equipment that is critical to the operation of the [carbon monoxide detection] system or [carbon monoxide] safety functions take place within 10 seconds; failure shall be indicated within 200 seconds.

(5) Failure of any equipment that is critical to the operation of the [carbon monoxide detection] system or [carbon monoxide] safety functions is indicated at the master [carbon monoxide detection] control unit within 200 seconds.

[72:23.8.2.6.1]

5.8.2.5.2 A listed barrier gateway, integral with or attached to each control unit or group of control units, as appropriate, shall be provided to prevent the other systems from interfering with or controlling the [carbon monoxide detection] system. [72:23.8.2.6.2]

5.8.2.6 Each interconnected [carbon monoxide detection] control unit shall be separately monitored for alarm, supervisory, and trouble conditions. [72:23.8.2.7]

5.8.2.7 Interconnected [carbon monoxide detection] control unit alarm signals shall be permitted to be monitored by zone or by combined common signals. [72:23.8.2.8]

5.8.2.8 Protected premises carbon monoxide detection control units shall be capable of silencing building-wide notification from the alarm control unit at the protected premises unless otherwise permitted by 5.8.2.9.

5.8.2.9 An initiating device with integral sounder shall be permitted to be silenced locally, provided the control panel continues to indicate an alarm function. If the carbon monoxide dissipates, the initiating device shall return to normal mode.

5.8.3 Protected Premises Carbon Monoxide Detection Systems Interconnected with Household Carbon Monoxide Detection System.

5.8.3.1 A protected premises [carbon monoxide detection] system shall be permitted to be interconnected to a household [carbon monoxide detection] system(s) for the purpose of activating the notification appliances connected to the household [carbon monoxide detection] system(s). [72:23.8.3.1]

5.8.3.2 The status of dwelling unit carbon monoxide detectors shall be permitted to be displayed at the protected premises carbon monoxide detection system control unit and annunciators.

5.8.3.3 If interconnected, an alarm condition at the protected premises carbon monoxide detection system shall cause the alarm notification appliance(s) of the dwelling unit household carbon monoxide detection system to become energized. The notification appliances shall remain energized until the protected premises carbon monoxide detection system is silenced or reset.

5.8.3.4 The interconnection circuit or path from the protected premises carbon monoxide detection system to the dwelling unit household carbon monoxide detection system shall be monitored for integrity by the protected premises carbon monoxide detection system in accordance with Section 4.13.

5.8.3.5 An alarm condition occurring at the dwelling unit household carbon monoxide detection system or the operation of any test switches provided as part of the dwelling unit household carbon monoxide equipment shall not cause an alarm condition at the protected premises carbon monoxide detection system.

5.8.4 Combination Carbon Monoxide Detection Systems.

5.8.4.1* [Carbon monoxide detection] systems shall be permitted to share components, equipment, circuitry, and installation wiring with [non-carbon monoxide detection] systems. [72:23.8.4.1]

5.8.4.2 Operation of non-carbon monoxide detection system function(s) originating within a connected non-carbon monoxide detection system shall not interfere with the required operation of the carbon monoxide detection system, unless otherwise required by applicable codes or standards.

5.8.4.3 Non-[Carbon Monoxide Detection System] Equipment.

5.8.4.3.1 For non-[carbon monoxide detection system] equipment listed to the performance requirements specified in 4.11.1, the requirements of 5.8.4.3.1.1 through 5.8.4.3.1.3 shall apply. [72:23.8.4.3.1]

5.8.4.3.1.1 The equipment shall be permitted to be attached to a [carbon monoxide detection system] circuit, either among the [carbon monoxide detection system] devices or as a branch or extension of the [carbon monoxide detection system] pathways, when the following requirements are met:

- (1) All the equipment and pathways shall meet the monitoring for integrity requirements of Section 4.13.
- (2) All the equipment and pathways shall be maintained by a single service organization.
- (3) All the equipment and pathways shall be installed in accordance with the requirements of this standard.
- (4) All the equipment shall be listed as compatible with the [carbon monoxide detection system] equipment or shall have a contact closure interface listed for the connected load.

[72:23.8.4.3.1.1]

5.8.4.3.1.2 If the equipment is attached to the [carbon monoxide detection] system via separate pathways, then short circuits or open circuits in this equipment, or between this equipment and the [carbon monoxide detection] system pathways, shall not impede or impair the monitoring for integrity of the [carbon monoxide detection] system or prevent alarm, supervisory, or [] safety control signal transmissions. [72:23.8.4.3.1.2]

5.8.4.3.1.3 Grounds in this equipment, or between this equipment and the [carbon monoxide detection] system pathways, shall be reported, annunciated, and corrected in the same manner as grounds in the rest of the [carbon monoxide detection] system. [72:23.8.4.3.1.3]

5.8.4.3.2 For non-[carbon monoxide detection system] equipment not listed to the performance requirements specified in 4.11.1, the requirements of 5.8.4.3.2.1 through 5.8.4.3.2.3 shall apply. [72:23.8.4.3.2]

5.8.4.3.2.1 Short circuits or open circuits in the equipment, or between the equipment and the [carbon monoxide detection] system pathways, shall not impede or impair the monitoring for integrity of the [carbon monoxide detection] system or prevent alarm, supervisory, or [] safety control signal transmissions. [72:23.8.4.3.2.1]

5.8.4.3.2.2 Grounds in this equipment, or between this equipment and the [carbon monoxide detection] system pathways, shall be reported, annunciated, and corrected in the same manner as grounds in the rest of the [carbon monoxide detection] system. [72:23.8.4.3.2.2]

5.8.4.3.2.3 Removal, replacement, failure, maintenance procedures, or ground on this hardware, software, or circuits shall not impair the required operation of the [carbon monoxide detection] system. [72:23.8.4.3.2.3]

5.8.4.4 Speakers used as mass notification or emergency communications systems installed in accordance with the requirements of *NFPA 72, National Fire Alarm and Signaling Code*, shall also be permitted to be used as alarm notification appliances for carbon monoxide detection systems.

5.8.4.5* In combination carbon monoxide detection systems, carbon monoxide alarm signals shall be distinctive, be clearly recognizable, and take priority over signals associated with property protection.

5.8.4.6 Signals from carbon monoxide detectors and carbon monoxide detection systems transmitted to another alarm system shall be as a distinct carbon monoxide alarm signal unless otherwise required by the authority having jurisdiction.

5.8.5 Carbon Monoxide Detection System Inputs.

5.8.5.1 General. All initiating devices shall be installed in accordance with 5.8.5 and tested in accordance with Chapter 8.

5.8.5.1.1 Where subject to mechanical damage, an initiating device shall be protected. A mechanical guard used to protect a detector shall be listed for use with the detector.

5.8.5.1.2 Initiating devices shall be supported independently of their attachment to the circuit conductors. [72:17.4.4]

5.8.5.1.3 Initiating devices shall be installed in a manner that provides accessibility for periodic inspection, testing, and maintenance.

5.8.5.1.4* Duplicate terminals, leads, or connectors that provide for the connection of installation wiring shall be provided on each initiating device for the express purpose of connecting into the [carbon monoxide detection] system to monitor the integrity of the signaling and power wiring.

Exception: Initiating devices connected to a system that provides the required monitoring. [72:17.4.7]

5.8.5.1.5 Initiating devices shall not be located in areas where environmental conditions cause an adverse effect on the initiating devices' ability to detect the targeted hazardous gas.

5.8.5.2 Alarm Signal Initiation — Initiating Devices with Separate Power and Signaling Wiring.

5.8.5.2.1 Automatic [carbon monoxide] alarm signal initiating devices that have integral trouble signal contacts shall be connected to the initiating device circuit so that a trouble condition within a device does not impair alarm transmission from any other initiating device.

Exception: Where the trouble condition is caused by electrical disconnection of the device or by removing the initiating device from its plug-in base. [72:23.8.5.3.1]

5.8.5.2.2* Automatic [carbon monoxide] alarm signal initiating devices that use a nonintegral device to monitor the integrity of the power supply wiring to the individual initiating devices shall have the nonintegral device connected to the initiating device circuit so that a fault on the power supply wiring does not impair alarm transmission from any operational initiating device. [72:23.8.5.3.2]



5.8.5.3 Requirements for Carbon Monoxide Detectors.

5.8.5.3.1 Carbon monoxide detectors shall be installed as specified in the manufacturer's published instructions in accordance with 5.8.5.3.1(1) and 5.8.5.3.1(2), or 5.8.5.3.1(3):

- (1)*On the ceiling in the same room as permanently installed fuel-burning appliances
- (2)*Centrally located on every habitable level and in every HVAC zone of the building
- (3) A performance-based design in accordance with 5.8.5.3.2

5.8.5.3.2 Performance-Based Design. [72:17.3]

5.8.5.3.2.1 Performance-based designs submitted to the authority having jurisdiction for review and approval shall include documentation, in an approved format, of each performance objective and applicable scenario, together with any calculations, modeling, or other technical substantiation used in establishing the proposed design's [] life safety performance. [72:17.3.1]

5.8.5.3.2.2 The authority having jurisdiction shall determine whether such identified performance objectives are appropriate and have been met. [72:17.3.2]

5.8.5.3.2.3 The authority having jurisdiction shall approve modifications to or variations from the approved design or design basis in advance. [72:17.3.3]

5.8.5.3.3 Carbon monoxide detectors shall be marked in accordance with their listing. Detector thresholds shall be set to respond at the levels specified by ANSI/UL 2034, *Standard for Single and Multiple Station Carbon Monoxide Alarms*.

5.8.5.3.4 All carbon monoxide detectors shall be located and mounted so that accidental operation will not be caused by jarring or vibration.

5.8.5.3.5 The location of carbon monoxide detectors shall be based on an evaluation of potential ambient sources and flows of carbon monoxide, moisture, temperature, dust, or fumes and of electrical or mechanical influences to minimize nuisance alarms.

5.8.5.3.6 The selection and placement of [carbon monoxide] detectors shall take into account both the performance characteristics of the detector and the areas into which the detectors are to be installed to prevent nuisance alarms or improper operation after installation. [72:17.7.1.7]

5.8.5.3.7 Unless specifically designed and listed for the expected conditions, carbon monoxide detectors shall not be installed where any of the following ambient conditions exist:

- (1) Temperature below 32°F (0°C)
- (2) Temperature above 100°F (38°C)
- (3) Relative humidity outside the range of 10 percent to 95 percent

5.8.5.3.8 Unless tested and listed for recessed mounting, carbon monoxide detectors shall not be recessed into the mounting surface.

5.8.5.3.9 Protection During Construction.

5.8.5.3.9.1 Where detectors are installed for signal initiation during construction, they shall be replaced prior to the final commissioning of the system.

5.8.5.3.9.2 Where detection is not required during construction, detectors shall not be installed until after all other construction trades have completed cleanup. [72:17.7.1.11.3]

5.8.5.4 Carbon Monoxide Detectors for Control of Carbon Monoxide Spread.

5.8.5.4.1 System designers shall consider the spread of carbon monoxide through an occupancy through the HVAC system.

5.8.5.4.2 Interaction with smoke control systems, if such is provided, shall be coordinated.

5.8.6 Carbon Monoxide Alarm Notification System Notification Outputs.

5.8.6.1 General. The performance, location, and mounting of notification appliances used to initiate or direct [action], evacuation or relocation of the occupants, or for providing information to occupants or staff, shall comply with the requirements of Chapter 6. [72:18.1.3]

5.8.6.2 Occupant Notification.

5.8.6.2.1 Except as permitted in 5.8.6.2.2, occupant notification shall be throughout the protected premises.

5.8.6.2.2 Where carbon monoxide alarm signals are transmitted to a constantly attended on-site location or off-premises location in accordance with Chapter 7, selective public mode occupant notification shall be permitted to be limited to the notification zone encompassing the area where the carbon monoxide alarm signal was initiated.

5.8.6.3 Notification Zones.

5.8.6.3.1 Notification zones shall be consistent with the emergency response plan for the protected premises.

5.8.6.3.2* The boundaries of notification zones shall be coincident with the area where the alarm initiation originated and other signaling zones in accordance with the building's emergency response plan.

5.8.6.4 Circuits for Addressable Notification Appliances.

5.8.6.4.1 Circuit configuration for addressable notification appliances shall comply with the applicable performance requirements for notification zones. [72:23.8.6.4.1]

5.8.6.4.2 Where there are addressable notification appliances on a signaling line circuit that serves different notification zones, a single open, short-circuit, or ground on that signaling line circuit shall not affect operation of more than one notification zone. [72:23.8.6.4.2]

5.8.6.5 Distinctive Signal.

5.8.6.5.1 The audible carbon monoxide alarm signal shall comply with the following:

- (1) Signals shall be a single tone pattern consisting of four cycles of 100 milliseconds \pm 10 percent "on" and 100 milliseconds \pm 10 percent "off," followed by 5 seconds \pm 10 percent "off."
- (2) After the initial 4 minutes of alarm, the 5-second "off" time shall be permitted to be changed to 60 seconds \pm 10 percent.
- (3) The alarm signal shall be repeated in compliance with 5.8.6.5.1(1) and 5.8.6.5.1(2) until the alarm resets or the alarm signal is manually silenced.

5.8.6.5.2* The audible alarm signal shall be synchronized within a notification zone.

5.8.7 Emergency Voice/Alarm Communications. Where an emergency voice/alarm communications system is installed for the purpose of occupant notification related to carbon monoxide detection, it shall comply with the requirements of

24.4.1 of *NFPA 72, National Fire Alarm and Signaling Code*, excluding the requirements in 24.4.1.8.4.

5.9 Signal Annunciation.

5.9.1 Protected premises [carbon monoxide detection] systems shall be arranged to annunciate [carbon monoxide] alarm, supervisory, and trouble signals in accordance with Section 4.12. [72:23.12.1]

5.9.2* If a remote alarm indicator is provided for an automatic [carbon monoxide] detector in a concealed location, the location of the detector and the area protected by the detector shall be prominently indicated at the remote alarm indicator by a permanently attached placard or by other approved means. [72:23.12.2]

5.10 Off-Premises Signals.

5.10.1 Systems requiring transmission of signals to continuously attended locations providing supervising station service (e.g., central station, proprietary supervising station, remote supervising station) shall also comply with the applicable requirements of Chapter 7. [72:23.14.1]

5.10.2 Relays or modules providing transmission of trouble signals to a supervising station shall be arranged to provide fail-safe operation. [72:23.14.2]

5.10.3 Means provided to transmit trouble signals to supervising stations shall be arranged so as to transmit a trouble signal to the supervising station for any trouble condition received at the protected premises control unit, including loss of primary or secondary power. [72:23.14.3]

5.11 Protected Premises Carbon Monoxide Safety Functions. Where provided, the interconnection of safety functions shall comply with the requirements of 5.11.1 through 5.11.10.

5.11.1 Carbon monoxide safety functions shall be permitted to be performed automatically. The performance of automatic carbon monoxide safety control functions shall not preclude the combination of carbon monoxide detection services with other services requiring monitoring of operations.

5.11.2* A listed relay or other listed appliance connected to the [carbon monoxide detection] system used to initiate control of protected premises [carbon monoxide safety] functions shall be located within 3 ft (1 m) of the controlled circuit or appliance. [72:21.2.4]

5.11.3 The relay or other appliance shall function within the voltage and current limitations of the [carbon monoxide detection] control unit. [72:21.2.5]

5.11.4 The installation wiring between the [carbon monoxide detection] control unit and the relay or other appliance shall be Class A, Class B, Class D, or Class X in accordance with [5.4.3]. [72:21.2.6]

5.11.5 [Carbon monoxide safety] functions shall not interfere with other operations of the [carbon monoxide detection system]. [72:21.2.7]

5.11.6 The method(s) of interconnection between the [carbon monoxide detection] system and controlled electrical and mechanical systems shall be monitored for integrity in accordance with Section 4.13. [72:21.2.8]

5.11.7 The method(s) of interconnection between the [carbon monoxide detection] system and controlled electrical and me-

chanical systems shall comply with the applicable provisions of *NFPA 70, National Electrical Code*. [72:21.2.9]

5.11.8 The method(s) of interconnection between the [carbon monoxide detection] system and controlled electrical and mechanical systems shall be achieved by one of the following recognized means:

- (1) Electrical contacts listed for the connected load
- (2) Data communications over a signaling line circuit(s) dedicated to the [carbon monoxide detection] or shared with other premises operating systems
- (3) Other listed methods

[72:21.2.10]

5.11.9 If a [carbon monoxide detection] system is a component of a life safety network and it communicates data to other systems providing life safety functions, or it receives data from such systems, the following shall apply:

- (1) The path used for communicating data shall be monitored for integrity. This shall include monitoring the physical communication media and the ability to maintain intelligible communications.
- (2) Data received from the network shall not affect the operation of the [carbon monoxide detection] system in any way other than to display the status of life safety network components.
- (3) Where [non-carbon monoxide detection] systems are interconnected to the [carbon monoxide detection] system using a network or other digital communication technique, a signal (e.g., heartbeat, poll, ping, query) shall be generated between the [carbon monoxide detection] system and the [non-carbon monoxide detection] system. Failure of the [carbon monoxide detection] system to receive confirmation of the transmission shall cause a trouble signal to indicate within 200 seconds.

[72:21.2.11]

5.11.10 The operation of all [carbon monoxide] safety functions shall be verified by an operational test at the time of system acceptance. [72:21.2.12]

5.12* Special Requirements for Low-Power Radio (Wireless) Systems.

5.12.1* Listing Requirements. Compliance with Section 5.12 shall require the use of low-power radio equipment specifically listed for the purpose. [72:23.18.1]

5.12.2 Power Supplies. A primary battery (dry cell) shall be permitted to be used as the sole power source of a low-power radio transmitter where all of the following conditions are met:

- (1) Each transmitter shall serve only one device and shall be individually identified at the receiver/[carbon monoxide detection] control unit.
- (2) The battery shall be capable of operating the low-power radio transmitter for not less than 1 year before the battery depletion threshold is reached.
- (3) A battery depletion signal shall be transmitted before the battery has been depleted to a level below that required to support [carbon monoxide] alarm transmission after 7 additional days of nonalarm operation. This signal shall be distinctive from [carbon monoxide] alarm, supervisory, tamper, and trouble signals; shall visibly identify the affected low-power radio transmitter; and, when silenced, shall automatically re-sound at least once every 4 hours.



- (4) Catastrophic (open or short) battery failure shall cause a trouble signal identifying the affected low-power radio transmitter at its receiver/[carbon monoxide detection] control unit. When silenced, the trouble signal shall automatically re-sound at least once every 4 hours.
- (5) Any mode of failure of a primary battery in a low-power radio transmitter shall not affect any other low-power radio transmitter.

[72:23.18.2]

5.12.3 Carbon Monoxide Alarm Signals.

5.12.3.1* When actuated, each low-power radio transmitter shall automatically transmit a [carbon monoxide] alarm signal. [72:23.18.3.1]

5.12.3.2 Each low-power radio transmitter shall automatically repeat [carbon monoxide] alarm transmission at intervals not exceeding 60 seconds until the initiating device is returned to its nonalarm condition. [72:23.18.3.2]

5.12.3.3 [Carbon monoxide] alarm signals shall have priority over all other signals. [72:23.18.3.3]

5.12.3.4 The maximum allowable response delay from activation of an initiating device to receipt and display by the receiver/[carbon monoxide detection] control unit shall be 10 seconds. [72:23.18.3.4]

5.12.3.5 A [carbon monoxide] alarm signal from a low-power radio transmitter shall latch at its receiver/[carbon monoxide detection] control unit until manually reset and shall identify the particular initiating device in alarm. [72:23.18.3.5]

5.12.4 Monitoring for Integrity.

5.12.4.1 The low-power radio transmitter shall be specifically listed as using a transmission method that is highly resistant to misinterpretation of simultaneous transmissions and to interference (e.g., impulse noise and adjacent channel interference). [72:23.18.4.1]

5.12.4.2 The occurrence of any single fault that disables transmission between any low-power radio transmitter and the receiver/[carbon monoxide detection] control unit shall cause a latching trouble signal within 200 seconds.

Exception: Until the expiration date for this exception of June 30, 2015, the time period for a low-power radio transmitter with only a single, connected alarm-initiating device shall be permitted to be increased to four times the minimum time interval permitted for a 1-second transmission up to the following:

- (1) 4 hours maximum for a transmitter serving a single initiating device
- (2) 4 hours maximum for a retransmission device (repeater), where disabling of the repeater or its transmission does not prevent the receipt of signals at the receiver/[carbon monoxide detection] control unit from any initiating device transmitter.

[72:23.18.4.2]

5.12.4.3 A single fault on the signaling channel shall not cause a [carbon monoxide] alarm signal. [72:23.18.4.3]

5.12.4.4 The periodic transmission required to comply with 5.12.4.2 from a low-power radio transmitter shall ensure successful [carbon monoxide] alarm transmission capability. [72:23.18.4.4]

5.12.4.5 Removal of a low-power radio transmitter from its installed location shall cause immediate transmission of a dis-

tinctive supervisory signal that indicates its removal and individually identifies the affected device. [72:23.18.4.5]

5.12.4.6 Reception of any unwanted (interfering) transmission by a retransmission device (repeater) or by the main receiver/control unit, for a continuous period of 20 seconds or more, shall cause an audible and visible trouble indication at the main receiver/control unit. This indication shall identify the specific trouble condition as an interfering signal. [72:23.18.4.6]

5.12.5 Output Signals from the Receiver/Control. When the receiver/control is used to actuate remote appliances, such as notification appliances and relays, by wireless means, the remote appliances shall meet the following requirements:

- (1) Power supplies shall comply with Chapter 4 or the requirements of 5.12.2.
- (2) All supervision requirements of Chapter 4, Chapter 5, or 5.12.4 shall apply.
- (3) The maximum allowable response delay from activation of an initiating device to activation of required carbon monoxide detection functions shall be 10 seconds.
- (4) Each receiver/control shall automatically repeat carbon monoxide alarm signal transmission at intervals not exceeding 60 seconds or until confirmation that the output appliance has received the carbon monoxide alarm signal.

Chapter 6 Notification Appliances for Carbon Monoxide Detection Systems

6.1* Application.

6.1.1 The requirements of this chapter shall apply where required by the enforcing authority; governing laws, codes, or standards; or other parts of this standard. [72:18.1.1]

6.1.2 The requirements of this chapter shall address the reception of a notification signal and not the signal's information content. [72:18.1.2]

6.1.3 The performance, location, and mounting of notification appliances used to initiate or direct evacuation or relocation of the occupants, or for providing information to occupants or staff, shall comply with this chapter. [72:18.1.3]

6.1.4 The performance, location, and mounting of annunciators, displays, and printers used to display or record information for use by occupants, staff, responding emergency personnel, or supervising station personnel shall comply with this chapter. [72:18.1.4]

6.1.5* The requirements of this chapter shall apply to the areas, spaces, or system functions where required by the enforcing authority; governing laws, codes, or standards; or other parts of this standard requiring compliance with this chapter. [72:18.1.5]

6.1.6 The requirements of Chapter 4 and Chapter 5 shall apply to the interconnection of notification appliances, the control configurations, the power supplies, and the use of the information provided by notification appliances. [72:18.1.6]

6.1.7 Notification appliances shall be permitted to be used within buildings or outdoors and to target the general building, area, or space, or only specific parts of a building, area, or space designated in specific zones and sub-zones. [72:18.1.7]

6.2 Purpose. Notification appliances shall provide stimuli for initiating emergency action and provide information to users, emergency response personnel, and occupants. [72:18.2]

6.3 General.

6.3.1 Listing. All notification appliances installed in conformity with Chapter 6 shall be listed for the purpose for which they are used. [72:18.3.1]

6.3.2 Nameplates.

6.3.2.1 Notification appliances shall include on their nameplates reference to electrical requirements and rated audible or visible performance, or both, as defined by the listing authority. [72:18.3.2.1]

6.3.2.2 Audible appliances shall include on their nameplates reference to their parameters or reference to installation documents (supplied with the appliance) that include the parameters in accordance with 6.4.2 or 6.4.3. [72:18.3.2.2]

6.3.2.3 Visible appliances shall include on their nameplates reference to their parameters or reference to installation documents (supplied with the appliance) that include the parameters in accordance with 6.5.2.1 or Section 6.6. [72:18.3.2.3]

6.3.3 Physical Construction.

6.3.3.1 Appliances intended for use in special environments, such as outdoors versus indoors, high or low temperatures, high humidity, dusty conditions, and hazardous locations, or where subject to tampering, shall be listed for the intended application. [72:18.3.3.1]

6.3.3.2* Notification appliances used for [carbon monoxide] signaling [] shall not have the word FIRE, or any fire symbol, in any form (i.e., stamped, imprinted, etc.) on the appliance visible to the public. Notification appliances with multiple visible elements shall be permitted to have fire markings only on those visible elements used for fire signaling. [72:18.3.3.2]

6.3.4* Mechanical Protection.

6.3.4.1 Appliances subject to mechanical damage shall be suitably protected. [72:18.3.4.1]

6.3.4.2 If guards, covers, or lenses are employed, they shall be listed for use with the appliance. [72:18.3.4.2]

6.3.4.3 The effect of guards, covers, or lenses on the appliance's field performance shall be in accordance with the listing requirements. [72:18.3.4.3]

6.3.5 Mounting.

6.3.5.1 Appliances shall be supported independently of their attachments to the circuit conductors. [72:18.3.5.1]

6.3.5.2 Appliances shall be mounted in accordance with the manufacturer's published instructions. [72:18.3.5.2]

6.3.6* Connections. Terminals, leads, or addressable communication that provide for monitoring the integrity of the notification appliance connections shall be provided. [72:18.3.6]

6.4 Audible Characteristics.

6.4.1 General Requirements.

6.4.1.1 An average ambient sound level greater than 105 dBA shall require the use of a visible notification appliance(s) in accordance with Section 6.5 where the application is public mode or Section 6.6 where the application is private mode. [72:18.4.1.1]

6.4.1.2 The total sound pressure level produced by combining the ambient sound pressure level with all audible notification appliances operating shall not exceed 110 dBA at the minimum hearing distance. [72:18.4.1.2]

6.4.1.3* Sound from normal or permanent sources, having a duration greater than 60 seconds, shall be included when measuring maximum ambient sound level. Sound from temporary or abnormal sources shall not be required to be included when measuring maximum ambient sound level. [72:18.4.1.3]

6.4.1.4 Audible notification appliances for alert and evacuation signal tones shall meet the requirements of 6.4.2 (Public Mode Audible Requirements), 6.4.3 (Private Mode Audible Requirements), 6.4.4 (Sleeping Area Requirements), or 6.4.5 (Narrow Band Tone Signaling for Exceeding Masked Thresholds), as applicable. [72:18.4.1.4]

6.4.1.5 Voice messages shall not be required to meet the audibility requirements of 6.4.2 (Public Mode Audible Requirements), 6.4.3 (Private Mode Audible Requirements), 6.4.4 (Sleeping Area Requirements), or 6.4.5 (Narrow Band Tone Signaling for Exceeding Masked Thresholds), but shall meet the intelligibility requirements of 6.4.8 where voice intelligibility is required. [72:18.4.1.5]

6.4.2* Public Mode Audible Requirements.

6.4.2.1 To ensure that audible public mode signals are clearly heard, unless otherwise permitted by 6.4.2.2 through 6.4.2.5, they shall have a sound level at least 15 dB above the average ambient sound level or 5 dB above the maximum sound level having a duration of at least 60 seconds, whichever is greater, measured 5 ft (1.5 m) above the floor in the area required to be served by the system using the A-weighted scale (dBA). [72:18.4.3.1]

6.4.2.2 Where approved by the authority having jurisdiction or other governing codes or standards, the requirements for audible signaling shall be permitted to be reduced or eliminated when visible signaling is provided in accordance with Section 6.5. [72:18.4.3.2]

6.4.2.3 Audible alarm notification appliances installed in elevator cars shall be permitted to use the audibility criteria for private mode appliances detailed in 6.4.3.1. [72:18.4.3.3]

6.4.2.4 If approved by the authority having jurisdiction, audible alarm notification appliances installed in restrooms shall be permitted to use the audibility criteria for private mode appliances detailed in 6.4.3.1. [72:18.4.3.4]

6.4.2.5 A [carbon monoxide detection] system arranged to stop or reduce ambient noise shall comply with 6.4.2.5.1 through 6.4.2.5.3. [72:18.4.3.5]

6.4.2.5.1 A [carbon monoxide detection] system arranged to stop or reduce ambient noise shall produce a sound level at least 15 dB above the reduced average ambient sound level or 5 dB above the maximum sound level having a duration of at least 60 seconds after reduction of the ambient noise level, whichever is greater, measured 5 ft (1.5 m) above the floor in the area required to be served by the system using the A-weighted scale (dBA). [72:18.4.3.5.1]

6.4.2.5.2 Visible notification appliances shall be installed in the affected areas in accordance with Section 6.5 or Section 6.6. [72:18.4.3.5.2]

6.4.2.5.3 Relays, circuits, or interfaces necessary to stop or reduce ambient noise shall meet the requirements of Chapter 4 and Chapter 5. [72:18.4.3.5.3]

6.4.3 Private Mode Audible Requirements.

6.4.3.1 To ensure that audible private mode signals are clearly heard, they shall have a sound level at least 10 dB above the average ambient sound level or 5 dB above the maximum sound level having a duration of at least 60 seconds, whichever is greater, measured 5 ft (1.5 m) above the floor in the area required to be served by the system using the A-weighted scale (dBA). [72:18.4.4.1]

6.4.3.2* Where approved by the authority having jurisdiction or other governing codes or standards, the requirements for audible signaling shall be permitted to be reduced or eliminated when visible signaling is provided in accordance with Section 6.5. [72:18.4.4.2]

6.4.3.3 A system arranged to stop or reduce ambient noise shall comply with 6.4.3.3.1 through 6.4.3.3.3. [72:18.4.4.3]

6.4.3.3.1 A system arranged to stop or reduce ambient noise shall be permitted to produce a sound level at least 10 dB above the reduced average ambient sound level or 5 dB above the maximum sound level having a duration of at least 60 seconds after reduction of the ambient noise level, whichever is greater, measured 5 ft (1.5 m) above the floor, using the A-weighted scale (dBA). [72:18.4.4.3.1]

6.4.3.3.2 Visible notification appliances shall be installed in the affected areas in accordance with Section 6.5 or Section 6.6. [72:18.4.4.3.2]

6.4.3.3.3 Relays, circuits, or interfaces necessary to stop or reduce ambient noise shall meet the requirements of Chapter 4 and Chapter 5. [72:18.4.4.3.3]

6.4.4 Sleeping Area Requirements.

6.4.4.1 Where audible appliances are installed to provide signals for sleeping areas, they shall have a sound level of at least 15 dB above the average ambient sound level or 5 dB above the maximum sound level having a duration of at least 60 seconds or a sound level of at least 75 dBA, whichever is greater, measured at the pillow level in the area required to be served by the system using the A-weighted scale (dBA). [72:18.4.5.1]

6.4.4.2 If any barrier, such as a door, curtain, or retractable partition, is located between the notification appliance and the pillow, the sound pressure level shall be measured with the barrier placed between the appliance and the pillow. [72:18.4.5.2]

6.4.4.3* Effective January 1, 2015, where audible appliances are provided to produce signals for sleeping areas, they shall produce a low frequency alarm signal that complies with the following:

- (1) The alarm signal shall be a square wave or provide equivalent awakening ability.
- (2) The wave shall have a fundamental frequency of 520 Hz \pm 10 percent.

[72:18.4.5.3]

6.4.5* Narrow Band Tone Signaling for Exceeding Masked Thresholds.

6.4.5.1 Masked Threshold Allowance. Audible tone signaling shall be permitted to comply with the masked threshold requirements in this subsection in lieu of the A-weighted signaling requirements in 6.4.2 and 6.4.3. [72:18.4.6.1]

6.4.5.2* Calculation Method. The effective masked threshold shall be calculated in accordance with ISO 7731, *Danger signals for work places — Auditory danger signals*. [72:18.4.6.2]

6.4.5.3 Noise Data. Noise data for calculating the effective masked threshold shall be the peak value of noise lasting 60 seconds or more for each octave or one-third octave band. [72:18.4.6.3]

6.4.5.4 Documentation. Analysis and design documentation shall be submitted to the authority having jurisdiction and shall contain the following information:

- (1) Frequency data for the ambient noise, including the date, time, and location where measurements were taken for existing environments, or projected data for environments not yet constructed
- (2) Frequency data of the audible notification appliance
- (3) Calculations of the effective masked threshold for each set of noise data
- (4) A statement of the sound pressure level that would be required by 6.4.2 or 6.4.3 if masked threshold signaling had not been done

[72:18.4.6.4]

6.4.5.5 Sound Pressure Level. For masked threshold signaling, the audible signal tone shall meet the requirements of either 6.4.5.5.1 or 6.4.5.5.2 but not for the reproduction of prerecorded, synthesized, or live messages. [72:18.4.6.5]

6.4.5.5.1 The sound pressure level of the audible tone signal shall exceed the masked threshold in one or more octave bands by at least 10 dB in the octave band under consideration. [72:18.4.6.5.1]

6.4.5.5.2 The sound pressure level of the audible tone signal shall exceed the masked threshold in one or more one-third octave bands by at least 13 dB in the one-third octave band under consideration. [72:18.4.6.5.2]

6.4.6 Location of Audible Notification Appliances for a Building or Structure.

6.4.6.1 If ceiling heights allow, and unless otherwise permitted by 6.4.6.2 through 6.4.6.5, wall-mounted appliances shall have their tops above the finished floors at heights of not less than 90 in. (2.29 m) and below the finished ceilings at distances of not less than 6 in. (150 mm). [72:18.4.8.1]

6.4.6.2 Ceiling-mounted or recessed appliances shall be permitted. [72:18.4.8.2]

6.4.6.3 If combination audible/visible appliances are installed, the location of the installed appliance shall be determined by the requirements of 6.5.4. [72:18.4.8.3]

6.4.6.4 Appliances that are an integral part of a [carbon monoxide] detector, [carbon monoxide] alarm, or other initiating device shall be located in accordance with the requirements for that device. [72:18.4.8.4]

6.4.6.5 Mounting heights other than required by 6.4.6.1 and 6.4.6.2 shall be permitted, provided that the sound pressure level requirements of 6.4.2 for public mode or 6.4.3 for private mode, or 6.4.4 for sleeping areas, based on the application, are met. [72:18.4.8.5]

6.4.7 Location of Audible Notification Appliances for Wide Area Signaling. Audible notification appliances for wide area signaling shall be installed in accordance with the requirements of the authority having jurisdiction, approved design documents, and the manufacturer's installation instruction to achieve the required performance. [72:18.4.9]

6.4.8* Voice Intelligibility. Within the acoustically distinguishable spaces (ADS) where voice intelligibility is required, voice communications systems shall reproduce prerecorded, synthesized, or live (e.g., microphone, telephone handset, and radio) messages with voice intelligibility. [72:18.4.10]

6.4.8.1* ADSs shall be determined by the system designer during the planning and design of all emergency communications systems. [72:18.4.10.1]

6.4.8.2 Each ADS shall be identified as requiring or not requiring voice intelligibility. [72:18.4.10.2]

6.4.8.3* Where required by the authority having jurisdiction, ADS assignments shall be submitted for review and approval. [72:18.4.10.3]

6.5* Visible Characteristics — Public Mode.

6.5.1* Visible Signaling. Public mode visible signaling shall meet the requirements of Section 6.5 using visible notification appliances. [72:18.5.1]

6.5.2 Light, Color, and Pulse Characteristics.

6.5.2.1 The flash rate shall not exceed two flashes per second (2 Hz) nor be less than one flash every second (1 Hz) throughout the listed voltage range of the appliance. [72:18.5.2.1]

6.5.2.2 A maximum pulse duration shall be 0.2 second with a maximum duty cycle of 40 percent. [72:18.5.2.2]

6.5.2.3 The pulse duration shall be defined as the time interval between initial and final points of 10 percent of maximum signal. [72:18.5.2.3]

6.5.2.4 Lights used for carbon monoxide alarm signaling shall be clear or nominal white or other color as required by the emergency plan and the authority having jurisdiction for the area or building, and shall not exceed 1000 cd (effective intensity).

6.5.2.5 The strobe synchronization requirements of this chapter shall not apply where the visible notification appliances located inside the building are viewed from outside of the building. [72:18.5.2.6]

6.5.3 Appliance Photometrics. The light output shall comply with the polar dispersion requirements of ANSI/UL 1971, *Standard for Signaling Devices for the Hearing Impaired*, or equivalent. [72:18.5.3]

6.5.4 Appliance Location.

6.5.4.1 Wall-mounted appliances shall be mounted such that the entire lens is not less than 80 in. (2.03 m) and not greater than 96 in. (2.44 m) above the finished floor or at the mounting height specified using the performance-based alternative of 6.5.4.5. [72:18.5.4.1]

6.5.4.2 Where low ceiling heights do not permit mounting at a minimum of 80 in. (2.03 m), visible appliances shall be mounted within 6 in. (150 mm) of the ceiling. The room size covered by a strobe of a given value shall be reduced by twice the difference between the minimum mounting height of 80 in. (2.03 m) and the actual, lower mounting height. [72:18.5.4.2]

6.5.4.3* Spacing in Rooms.

6.5.4.3.1 Spacing shall be in accordance with either Table 6.5.4.3.1(a) and Figure 6.5.4.3.1 or Table 6.5.4.3.1(b). [72:18.5.4.3.1]

Table 6.5.4.3.1(a) Room Spacing for Wall-Mounted Visible Appliances

Maximum Room Size		Minimum Required Light Output [Effective Intensity (cd)]		
ft	m	One Light per Room	Two Lights per Room (Located on Opposite Walls)	Four Lights per Room (One Light per Wall)
20 × 20	6.10 × 6.10	15	NA	NA
28 × 28	8.53 × 8.53	30	Unknown	NA
30 × 30	9.14 × 9.14	34	15	NA
40 × 40	12.2 × 12.2	60	30	15
45 × 45	13.7 × 13.7	75	Unknown	19
50 × 50	15.2 × 15.2	94	60	30
54 × 54	16.5 × 16.5	110	Unknown	30
55 × 55	16.8 × 16.8	115	Unknown	28
60 × 60	18.3 × 18.3	135	95	30
63 × 63	19.2 × 19.2	150	Unknown	37
68 × 68	20.7 × 20.7	177	Unknown	43
70 × 70	21.3 × 21.3	184	95	60
80 × 80	24.4 × 24.4	240	135	60
90 × 90	27.4 × 27.4	304	185	95
100 × 100	30.5 × 30.5	375	240	95
110 × 110	33.5 × 33.5	455	240	135
120 × 120	36.6 × 36.6	540	305	135
130 × 130	39.6 × 39.6	635	375	185

NA: Not allowable.

[72: Table 18.5.4.3.1(a)]



Table 6.5.4.3.1(b) Room Spacing for Ceiling-Mounted Visible Appliances

Maximum Room Size		Maximum Lens Height		Minimum Required Light Output (Effective Intensity); One Light (cd)
ft	m	ft	m	
20 × 20	6.1 × 6.1	10	3.0	15
30 × 30	9.1 × 9.1	10	3.0	30
40 × 40	12.2 × 12.2	10	3.0	60
44 × 44	13.4 × 13.4	10	3.0	75
50 × 50	15.2 × 15.2	10	3.0	95
53 × 53	16.2 × 16.2	10	3.0	110
55 × 55	16.8 × 16.8	10	3.0	115
59 × 59	18.0 × 18.0	10	3.0	135
63 × 63	19.2 × 19.2	10	3.0	150
68 × 68	20.7 × 20.7	10	3.0	177
70 × 70	21.3 × 21.3	10	3.0	185
20 × 20	6.1 × 6.1	20	6.1	30
30 × 30	9.1 × 9.1	20	6.1	45
44 × 44	13.4 × 13.4	20	6.1	75
46 × 46	14.0 × 14.0	20	6.1	80
50 × 50	15.2 × 15.2	20	6.1	95
53 × 53	16.2 × 16.2	20	6.1	110
55 × 55	16.8 × 16.8	20	6.1	115
59 × 59	18.0 × 18.0	20	6.1	135
63 × 63	19.2 × 19.2	20	6.1	150
68 × 68	20.7 × 20.7	20	6.1	177
70 × 70	21.3 × 21.3	20	6.1	185
20 × 20	6.1 × 6.1	30	9.1	55
30 × 30	9.1 × 9.1	30	9.1	75
50 × 50	15.2 × 15.2	30	9.1	95
53 × 53	16.2 × 16.2	30	9.1	110
55 × 55	16.8 × 16.8	30	9.1	115
59 × 59	18.0 × 18.0	30	9.1	135
63 × 63	19.2 × 19.2	30	9.1	150
68 × 68	20.7 × 20.7	30	9.1	177
70 × 70	21.3 × 21.3	30	9.1	185

[72: Table 18.5.4.3.1(b)]

6.5.4.3.2 Visible notification appliances shall be installed in accordance with Table 6.5.4.3.1(a) or Table 6.5.4.3.1(b) using one of the following:

- (1) A single visible notification appliance
- (2) Two visible notification appliances located on opposite walls
- (3) Two groups of visible notification appliances, where visual appliances of each group are synchronized, in the same room or adjacent space within the field of view. This shall include synchronization of strobes operated by separate systems
- (4) More than two visible notification appliances or groups of synchronized appliances in the same room or adjacent space within the field of view that flash in synchronization

[72:18.5.4.3.2]

6.5.4.3.3 Room spacing in accordance with Table 6.5.4.3.1(a) and Figure 6.5.4.3.1 for wall-mounted appliances shall be based on locating the visible notification appliance at the half-way distance of the wall. [72:18.5.4.3.3]

6.5.4.3.4 In square rooms with appliances not centered or in nonsquare rooms, the effective intensity (cd) from one visible wall-mounted notification appliance shall be determined by maximum room size dimensions obtained either by measuring the distance to the farthest wall or by doubling the distance to the farthest adjacent wall, whichever is greater, as required by Table 6.5.4.3.1(a) and Figure 6.5.4.3.1. [72:18.5.4.3.4]

6.5.4.3.5 If a room configuration is not square, the square room size that allows the entire room to be encompassed or allows the room to be subdivided into multiple squares shall be used. [72:18.5.4.3.5]

6.5.4.3.6* If ceiling heights exceed 30 ft (9.14 m), ceiling-mounted visible notification appliances shall be suspended at or below 30 ft (9.14 m) or at the mounting height determined using the performance-based alternative of 6.5.4.5, or wall-mounted visible notification appliances shall be installed in accordance with Table 6.5.4.3.1(a). [72:18.5.4.3.6]

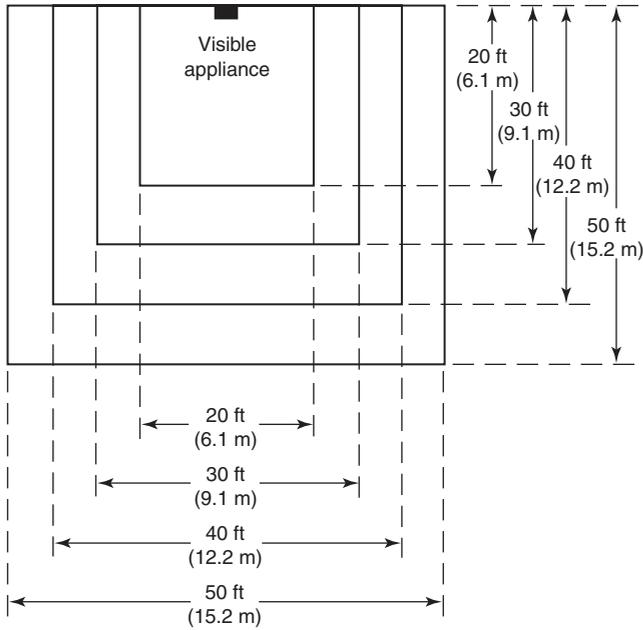


FIGURE 6.5.4.3.1 Room Spacing for Wall-Mounted Visible Appliances. [72:Figure 18.5.4.3.1]

6.5.4.3.7 Table 6.5.4.3.1(b) shall be used if the ceiling-mounted visible notification appliance is at the center of the room. If the ceiling-mounted visible notification appliance is not located at the center of the room, the effective intensity (cd) shall be determined by doubling the distance from the appliance to the farthest wall to obtain the maximum room size. [72:18.5.4.3.7]

6.5.4.4* Spacing in Corridors.

6.5.4.4.1 The installation of visible notification appliances in corridors 20 ft (6.1 m) or less in width shall be in accordance with the requirements of either 6.5.4.3 or 6.5.4.4. [72:18.5.4.4.1]

6.5.4.4.2 Paragraph 6.5.4.4 shall apply to corridors not exceeding 20 ft (6.1 m) in width. [72:18.5.4.4.2]

6.5.4.4.3 In a corridor application, visible appliances shall be rated not less than 15 cd. [72:18.5.4.4.3]

6.5.4.4.4 Corridors greater than 20 ft (6.1 m) wide shall comply with the spacing requirements for rooms in accordance with 6.5.4.3. [72:18.5.4.4.4]

6.5.4.4.5* Visible notification appliances shall be located not more than 15 ft (4.57 m) from the end of the corridor with a separation not greater than 100 ft (30.5 m) between appliances. [72:18.5.4.4.5]

6.5.4.4.6 If there is an interruption of the concentrated viewing path, such as a fire door, an elevation change, or any other obstruction, the area shall be treated as a separate corridor. [72:18.5.4.4.6]

6.5.4.4.7 In corridors where more than two visible notification appliances are in any field of view, they shall flash in synchronization. [72:18.5.4.4.7]

6.5.4.4.8 Wall-mounted visible notification appliances in corridors shall be permitted to be mounted on either the end wall

or the side wall of the corridor in accordance with spacing requirements of 6.5.4.4.5. [72:18.5.4.4.8]

6.5.4.5 Performance-Based Alternative.

6.5.4.5.1 Any design that provides a minimum of 0.0375 lumens/ft² (0.4036 lumens/m²) of illumination at any point within the covered area at all angles specified by the polar dispersion planes for wall- or ceiling-mounted visual appliances in ANSI/UL 1971, *Standard for Signaling Devices for the Hearing Impaired*, or equivalent, as calculated for the maximum distance from the nearest visual notification appliance, shall be permitted in lieu of the requirements of 6.5.4, excluding 6.5.4.6. [72:18.5.4.5.1]

6.5.4.5.2 Documentation provided to the authority having jurisdiction shall include the following:

- (1) Inverse Square Law calculations using each of the vertical and horizontal polar distribution angles in ANSI/UL 1971, *Standard for Signaling Devices for the Hearing Impaired*, or equivalent.
- (2) The calculations shall account for the effects of polar distribution using one of the following:
 - (a) The percentages from the applicable table(s) in ANSI/UL 1971, *Standard for Signaling Devices for the Hearing Impaired*, or equivalent
 - (b) The actual results of laboratory tests of the specific appliance to be used as recorded by the listing organization

[72:18.5.4.5.2]

6.5.4.6 Sleeping Areas.

6.5.4.6.1 Combination carbon monoxide detectors and visible notification appliances or combination carbon monoxide alarms and visible notification appliances shall be installed in accordance with the applicable requirements of Chapter 5, Chapter 6, and Chapter 9.

6.5.4.6.2 Table 6.5.4.6.2 shall apply to sleeping areas. [72:18.5.4.6.2]

Exception: Where the visible appliance is not used for fire alarm signaling, the effective intensity shall not be required to be greater than 110 cd.

6.5.4.6.3 For rooms with a linear dimension greater than 16 ft (4.87 m), the visible notification appliance shall be located within 16 ft (4.87 m) of the pillow. [72:18.5.4.6.3]

6.5.5 Location of Visible Notification Appliances for Wide Area Signaling. Visible notification appliances for wide area signaling shall be installed in accordance with the requirements of the authority having jurisdiction, approved design

Table 6.5.4.6.2 Effective Intensity Requirements for Sleeping Area Visible Notification Appliances

Distance from Ceiling to Top of Lens		
in.	mm	Intensity(cd)
≥24	≥610	110
<24	<610	177

[72: Table 18.5.4.6.2]

documents, and the manufacturer's instructions to achieve the required performance. [72:18.5.5]

6.6* Visible Characteristics — Private Mode. Visible notification appliances used in the private mode shall be of a sufficient quantity and intensity and located so as to meet the intent of the user and the authority having jurisdiction. [72:18.6]

6.7 Supplementary Visible and Audible Signaling Methods. A supplementary visible or audible notification appliance shall be intended to augment an audible or visible signal. [72:18.7]

6.7.1 A supplementary visible or audible notification appliance shall comply with its marked rated performance. [72:18.7.1]

6.7.2 Supplementary visible or audible notification appliances shall be permitted to be located less than 80 in. (2.03 m) above the floor. [72:18.7.2]

6.8 Textual Audible Appliances.

6.8.1 Speaker appliances shall comply with Section 6.4. [72:18.8.1.1]

6.8.2* The sound pressure level, in dBA, of the speaker appliance evacuation tone signals of the particular mode installed (public or private) shall comply with all the requirements in 6.4.2 (public) or 6.4.3 (private). [72:18.8.1.2]

6.9* Textual Visible Appliances.

6.9.1 Application. Textual visible appliances shall be permitted for [] signaling if used in addition to audible or visible, or both, notification appliances. [72:18.9.1]

6.9.2 Performance. The information produced by textual visible appliances shall be legible. [72:18.9.2]

6.9.3 Location.

6.9.3.1 Private Mode. Unless otherwise permitted by the authority having jurisdiction, all textual visible notification appliances in the private mode shall be located in rooms that are accessible only to those persons directly concerned with the implementation and direction of emergency action initiation and procedure in the areas protected by the system. [72:18.9.3.1]

6.9.3.2 Public Mode. Textual visible notification appliances used in the public mode shall be located to ensure readability by the occupants or inhabitants of the protected area. [72:18.9.3.2]

6.10 Tactile Appliances.

6.10.1 Application. Tactile appliances shall be permitted if used in addition to audible or visible, or both, notification appliances. [72:18.10.1]

6.10.2* Performance. Tactile appliances shall meet the performance requirements of ANSI/UL 1971, *Standard for Signaling Devices for Hearing Impaired*, or equivalent. [72:18.10.2]

6.11* Standard Emergency Service Interface. Where required by the enforcing authority; governing laws, codes, or standards; or other parts of this standard, annunciators, information display systems, and controls for portions of a system provided for use by emergency service personnel shall be designed, arranged, and located in accordance with the requirements of the organizations intended to use the equipment. [72:18.11]

Chapter 7 Off-Premises Signal Transmission

7.1 Application.

7.1.1 The performance, installation, and operation of carbon monoxide detection systems at a continuously attended supervising station or a communications center and between the protected premises and the receiving station shall comply with the requirements of this chapter.

7.1.2 The requirements of Chapters 4, 5, and 8 shall also apply unless they are in conflict with this chapter.

7.2* General. Connections to supervising stations or communications centers shall be in accordance with *NFPA 72, National Fire Alarm and Signaling Code*.

7.2.1 Signals.

7.2.1.1 Priority of Signals. A carbon monoxide alarm signal shall take precedence over supervisory or trouble signals.

7.2.1.2 Carbon Monoxide Alarm Signal Disposition.

7.2.1.2.1 The actuation of a carbon monoxide detector or system shall be distinctively indicated as a carbon monoxide alarm signal.

7.2.1.2.2* Servicing of a system in alarm that cannot be reset shall be in accordance with Chapter 8 and shall occur within 4 hours of the carbon monoxide alarm signal.

7.2.1.3 Carbon Monoxide Trouble Signal Disposition.

7.2.1.3.1 Upon receipt of a carbon monoxide trouble signal, the responsible party(s) shall be notified.

7.2.1.3.2 Servicing of a system in trouble shall be in accordance with Chapter 8 and shall occur within 4 hours of the trouble indication.

7.2.2* Supervising Station. Upon receipt of a carbon monoxide alarm signal, supervising station personnel shall perform the following actions in the order listed:

- (1) Where required by the emergency response agency, immediately retransmit indication of the carbon monoxide alarm signal to the communications center
- (2) Contact the responsible party(s) in accordance with the notification plan

7.2.3* Emergency Response Agency (ERA). Where a carbon monoxide alarm signal is transmitted directly to a communications center, communications center personnel shall perform the following actions in the order listed:

- (1) Follow standard operating procedures
- (2) Contact the responsible party(s) in accordance with the notification plan

7.3 Prearranged Testing. When the signal results from a prearranged test, the action required by 7.2.2 and 7.2.3 shall not be required.

7.4 Operation and Record Keeping.

7.4.1 The operation, staffing, and record keeping for a supervising station shall be in accordance with *NFPA 72, National Fire Alarm and Signaling Code*.

7.4.2 The operation, staffing, and record keeping for a communications center shall be in accordance with *NFPA 1221, Standard for the Installation, Maintenance, and Use of Emergency Services Communications Systems*.

Chapter 8 Inspection, Testing, and Maintenance

8.1 Application. This chapter covers the requirements for the inspection, testing, and maintenance of carbon monoxide alarms, detectors, systems, and their components.

8.1.1 More stringent inspection, testing, or maintenance procedures shall be permitted.

8.1.2 Inspection testing and maintenance programs shall comply with the requirements of this chapter, conform to the equipment manufacturers' published instructions, and verify proper operation of the carbon monoxide alarms, detectors, systems, and their components.

8.1.3 Nothing in this chapter is intended to prevent the use of alternative test methods or testing devices, provided such methods or devices are equivalent in effectiveness and safety and meet the intent of the requirements of this chapter.

8.2 General.

8.2.1 Responsibilities.

8.2.1.1 The property or building or system owner or the owner's designated representative shall be responsible for inspection, testing, and maintenance of the system and for alterations or additions to this system. [72:14.2.2.1]

8.2.1.2 The delegation of responsibility shall be in writing, with a copy of such delegation provided to the authority having jurisdiction upon request. [72:14.2.2.2]

8.2.1.3 Inspection, testing, or maintenance shall be permitted to be done by the building or system owner or a person or organization other than the building or system owner if conducted under a written contract. [72:14.2.2.3]

8.2.1.4* Service Personnel Qualifications and Experience. Service personnel shall be qualified and experienced in accordance with the requirements of 4.4.3. [72:14.2.2.5]

8.2.2* Notification.

8.2.2.1 Before proceeding with any testing, all persons and facilities receiving alarm, supervisory, or trouble signals and all building occupants shall be notified of the testing to prevent unnecessary response. [72:14.2.3.1]

8.2.2.2 At the conclusion of testing, those previously notified (and others, as necessary) shall be notified that testing has been concluded. [72:14.2.3.2]

8.2.2.3 The owner or the owner's designated representative and service personnel shall coordinate system testing to prevent interruption of critical building systems or equipment. [72:14.2.3.3]

8.2.3 System Documentation. Prior to system maintenance or testing, the system certificate of completion and the information regarding the system and system alterations, including specifications, wiring diagrams, and floor plans, shall be made available by the owner to a designated representative to the service personnel.

8.3 Inspection.

8.3.1* Unless otherwise permitted by 8.3.2 visual inspections shall be performed in accordance with the schedules in Table

8.3.1 or more often if required by the authority having jurisdiction. [72:14.3.1]

8.3.2 Devices or equipment that is inaccessible for safety considerations (e.g., continuous process operations, energized electrical equipment, radiation, and excessive height) shall be permitted to be inspected during scheduled shutdowns if approved by the authority having jurisdiction. [72:14.3.2]

8.3.3 Extended intervals shall not exceed 18 months. [72:14.3.3]

8.3.4 The visual inspection shall be made to ensure that there are no changes that affect equipment performance. [72:14.3.4]

8.4 Testing.

8.4.1 System Testing of Carbon Monoxide Detection Systems.

8.4.1.1 Initial Acceptance Testing.

8.4.1.1.1 All new systems shall be inspected and tested in accordance with the requirements of Chapter 8. [72:14.4.1.1.1.1]

8.4.1.1.2 The authority having jurisdiction shall be notified prior to the initial acceptance test. [72:14.4.1.1.1.2]

8.4.1.2* Reacceptance Testing.

8.4.1.2.1 Reacceptance testing shall be performed as required in 8.4.1.2.1.1 through 8.4.1.2.1.4. [72:14.4.1.2.1]

8.4.1.2.1.1 When an initiating device, notification appliance, or control relay is added, it shall be functionally tested. [72:14.4.1.2.1.1]

8.4.1.2.1.2 When an initiating device, notification appliance, or control relay is deleted, another device, appliance, or control relay on the circuit shall be operated. [72:14.4.1.2.1.2]

8.4.1.2.1.3 When modifications or repairs to control equipment hardware are made, the control equipment shall be tested in accordance with Table 8.4.2, items 1(a) and 1(d). [72:14.4.1.2.1.3]

8.4.1.2.1.4 When changes are made to site-specific software, the following shall apply:

- (1) All functions known to be affected by the change, or identified by a means that indicates changes, shall be 100 percent tested.
- (2) In addition, 10 percent of initiating devices that are not directly affected by the change, up to a maximum of 50 devices, also shall be tested and correct system operation shall be verified.
- (3) A revised record of completion in accordance with 4.14.2.1 shall be prepared to reflect these changes.

[72:14.4.1.2.1.4]

8.4.1.2.2 Changes to all control units connected or controlled by the system executive software shall require a 10 percent functional test of the system, including a test of at least one device on each input and output circuit to verify critical system functions such as notification appliances, control functions, and off-premises reporting. [72:14.4.1.2.2]

8.4.2 Test Methods. [Carbon monoxide detection] systems and associated equipment shall be tested according to Table 8.4.2. [72:14.4.2.2]



Table 8.3.1 Visual Inspection Frequencies

Component	Initial/ Reacceptance	Monthly	Quarterly	Semi-Annually	Annually
1. Control equipment: Carbon monoxide detection systems monitored for carbon monoxide alarm, supervisory, and trouble signals					
(a) Fuses	X	—	—	—	X
(b) Interfaced equipment	X	—	—	—	X
(c) Lamps and LEDs	X	—	—	—	X
(d) Primary (main) power supply	X	—	—	—	X
2. Control equipment: Carbon monoxide detection systems unmonitored for carbon monoxide alarm, supervisory, and trouble signals					
(a) Fuses	X (weekly)	—	—	—	—
(b) Interfaced equipment	X (weekly)	—	—	—	—
(c) Lamps and LEDs	X (weekly)	—	—	—	—
(d) Primary (main) power supply	X (weekly)	—	—	—	—
3. Batteries					
(a) Lead-acid	X	X	—	—	—
(b) Nickel-cadmium	X	—	—	X	—
(c) Primary (dry cell)	X	X	—	—	—
(d) Sealed lead-acid	X	—	—	X	—
4. Transient suppressors	X	—	—	X	—
5. Carbon monoxide detection control unit Trouble signals	X (weekly)	—	—	X	—
6. Fiber-optic cable connections	X	—	—	—	X
7. Emergency voice/alarm communications equipment	X	—	—	X	—
8. Remote annunciators	X	—	—	X	—
9. Initiating devices					
(a) Carbon monoxide detectors (excluding one- and two-family dwellings)	X	—	—	X	—
(b) Air sampling	X	—	—	X	—
(c) Duct detectors	X	—	—	X	—
(d) Electromechanical releasing devices	X	—	—	X	—
(e) Supervisory signal devices	X	—	X	—	—
10. Interface equipment	X	—	—	X	—
11. Alarm notification appliances — supervised	X	—	—	X	—
12. Special procedures	X	—	—	X	—

Table 8.4.2 Test Methods

Device	Test Method
1. Control equipment	
(a) Functions	At a minimum, control equipment shall be tested to verify correct receipt of carbon monoxide alarm, supervisory, and trouble signals (inputs), operation of notification circuits and auxiliary functions (outputs), circuit supervision including detection of open circuits and ground faults, and power supply supervision for detection of loss of ac power and disconnection of secondary batteries.
(b) Fuses	The rating and supervision shall be verified.
(c) Interfaced equipment	Integrity of single or multiple circuits providing interface between two or more control units shall be verified. Interfaced equipment connections shall be tested by operating or simulating operation of the equipment being supervised. Signals required to be transmitted shall be verified at the control unit.
(d) Lamps and LEDs	Lamps and LEDs shall be illuminated.
(e) Primary (main) power supply	All secondary (standby) power shall be disconnected and tested under maximum load, including all alarm appliances requiring simultaneous operation. All secondary (standby) power shall be reconnected at end of test. For redundant power supplies, each shall be tested separately.
2. Engine-driven generator	If an engine-driven generator dedicated to the carbon monoxide detection system is used as a required power source, operation of the generator shall be verified in accordance with NFPA 110, <i>Standard for Emergency and Standby Power Systems</i> , by the building owner.
3. Secondary (standby) power supply	All primary (main) power supplies shall be disconnected and the occurrence of required trouble indication for loss of primary power shall be verified. The system's standby and alarm current demand shall be measured or verified and, using manufacturer's data, the ability of batteries to meet standby and alarm requirements shall be verified. Carbon monoxide notification appliances shall be operated for a minimum of 5 minutes. Primary (main) power supply shall be reconnected at end of test.
4. Uninterruptible power supply (UPS)	If a UPS system dedicated to the carbon monoxide detection system is used as a required power source, operation of the UPS system shall be verified by the building owner in accordance with NFPA 111, <i>Standard on Stored Electrical Energy Emergency and Standby Power Systems</i> .
5. Batteries — general tests	Prior to conducting any battery testing, the person conducting the test shall ensure that all system software stored in volatile memory is protected from loss.
(a) Visual inspection	Batteries shall be inspected for corrosion or leakage. Tightness of connections shall be checked and ensured. If necessary, battery terminals or connections shall be cleaned and coated. Electrolyte level in lead-acid batteries shall be visually inspected.
(b) Battery replacement	Batteries shall be replaced in accordance with the recommendations of the alarm equipment manufacturer or when the recharged battery voltage or current falls below the manufacturer's recommendations.
(c) Charger test	Operation of battery charger shall be checked in accordance with charger test for the specific type of battery.
(d) Discharge test	With the battery charger disconnected, the batteries shall be load tested following the manufacturer's recommendations. The voltage level shall not fall below the levels specified. <i>Exception: An artificial load equal to the full carbon monoxide detection system load connected to the battery shall be permitted to be used in conducting this test.</i>
(e) Load voltage test	With the battery charger disconnected, the terminal voltage shall be measured while supplying the maximum load required by its application. The voltage level shall not fall below the levels specified for the specific type of battery. If the voltage falls below the level specified, corrective action shall be taken and the batteries shall be retested. <i>Exception: An artificial load equal to the full carbon monoxide detection system load connected to the battery shall be permitted to be used in conducting this test.</i>

Table 8.4.2 Continued

Device	Test Method
6. Battery tests (specific types)	
(a) Lead-acid type	
(i) Charger test	With the batteries fully charged and connected to the charger, the voltage across the batteries shall be measured with a voltmeter. The voltage shall be 2.30 volts per cell ± 0.02 volts at 77°F (25°C) or as specified by the equipment manufacturer.
(ii) Load voltage test	Under load, the battery shall not fall below 2.05 volts per cell.
(iii) Specific gravity	The specific gravity of the liquid in the pilot cell or all of the cells shall be measured as required. The specific gravity shall be within the range specified by the manufacturer. Although the specified specific gravity varies from manufacturer to manufacturer, a range of 1.205–1.220 is typical for regular lead-acid batteries, while 1.240–1.260 is typical for high-performance batteries. A hydrometer that shows only a pass or fail condition of the battery and does not indicate the specific gravity shall not be used, because such a reading does not give a true indication of the battery condition.
(b) Nickel-cadmium type	
(i) Charger test*	With the batteries fully charged and connected to the charger, an ampere meter shall be placed in series with the battery under charge. The charging current shall be in accordance with the manufacturer's recommendations for the type of battery used. In the absence of specific information, $\frac{1}{50}$ to $\frac{1}{25}$ of the battery rating shall be used.
(ii) Load voltage test	Under load, the float voltage for the entire battery shall be 1.42 volts per cell, nominal. If possible, cells shall be measured individually.
(c) Sealed lead-acid type	
(i) Charger test*	With the batteries fully charged and connected to the charger, the voltage across the batteries shall be measured with a voltmeter. The voltage shall be 2.30 volts per cell ± 0.02 volts at 77°F (25°C) or as specified by the equipment manufacturer.
(ii) Load voltage test	Under load, the battery shall perform in accordance with the battery manufacturer's specifications.
7. Transient suppressors	Lightning protection equipment shall be inspected and maintained per the manufacturer's published instructions. Additional inspections shall be required after any lightning strikes. Equipment located in moderate to severe areas outlined in NFPA 780, <i>Standard for the Installation of Lightning Protection Systems</i> , Annex L, shall be inspected semiannually and after any lightning strikes.
8. Carbon monoxide detection control unit trouble signals	
(a) Audible and visual	Operation of control unit trouble signals shall be verified as well as ring-back feature for systems using a trouble-silencing switch that requires resetting.
(b) Disconnect switches	If control unit has disconnect or isolating switches, performance of intended function of each switch shall be verified and receipt of trouble signal when a supervised function is disconnected shall also be verified.
(c) Ground-fault monitoring circuit	If the system has a ground detection feature, the occurrence of ground-fault indication shall be verified whenever any installation conductor is grounded.
(d) Transmission of signals to off-premises location	An initiating device shall be actuated and receipt of alarm signal at the off-premises location shall be verified. A trouble condition shall be created and receipt of a trouble signal at the off-premises location shall be verified. A supervisory device shall be actuated and receipt of a supervisory signal at the off-premises location shall be verified. If a transmission carrier is capable of operation under a single- or multiple-fault condition, an initiating device shall be activated during such fault condition and receipt of a trouble signal at the off-premises location shall be verified, in addition to the alarm signal.
9. Remote annunciators	The correct operation and identification of annunciators shall be verified. If provided, the correct operation of annunciator under a fault condition shall be verified.

(continues)

Table 8.4.2 *Continued*

Device	Test Method
10. Conductors — metallic	
(a) Stray voltage	All installation conductors shall be tested with a volt/ohmmeter to verify that there are no stray (unwanted) voltages between installation conductors or between installation conductors and ground. Unless a different threshold is specified in the published manufacturer's instructions for the installed equipment, the maximum allowable stray voltage shall not exceed 1 volt ac/dc.
(b) Ground faults	All installation conductors other than those intentionally and permanently grounded shall be tested for isolation from ground per the installed equipment manufacturer's published instructions.
(c) Short-circuit faults	All installation conductors other than those intentionally connected together shall be tested for conductor-to-conductor isolation per the published manufacturer's instructions for the installed equipment. These same circuits also shall be tested conductor-to-ground.
(d) Loop resistance	With each initiating and indicating circuit installation conductor pair short-circuited at the far end, the resistance of each circuit shall be measured and recorded. It shall be verified that the loop resistance does not exceed the limits specified in the published manufacturer's instructions for the installed equipment.
(e) Supervision	Introduction of a fault in any circuit monitored for integrity shall result in a trouble indication at the carbon monoxide detection control unit. One connection shall be opened at not less than 10 percent of the initiating devices, notification appliances and controlled devices on every initiating device circuit, notification appliance circuit, and signaling line circuit.
11. Conductors — nonmetallic	
(a) Circuit integrity	Each initiating device, notification appliance, and signaling line circuit shall be tested to confirm that the installation conductors are monitored for integrity in accordance with the requirements of Chapter 4 and Chapter 5.
(b) Fiber optics	The fiber-optic transmission line shall be tested in accordance with the manufacturer's published instructions by the use of an optical power meter or by an optical time domain reflectometer used to measure the relative power loss of the line. This relative figure for each fiber-optic line shall be recorded in the fire alarm control unit. If the power level drops 2 percent or more from the value recorded during the initial acceptance test, the transmission line, section thereof, or connectors shall be repaired or replaced by a qualified technician to bring the line back into compliance with the accepted transmission level per the manufacturer's published instructions.
(c) Supervision	Introduction of a fault in any supervised circuit shall result in a trouble indication at the control unit. One connection shall be opened at not less than 10 percent of the initiating device, notification appliance, and signaling line circuit. Each initiating device, notification appliance, and signaling line circuit shall be tested for correct indication at the control unit. All circuits shall perform as indicated in 5.5.2, 5.5.3, 5.6.3, 5.6.4, 5.6.5, 5.7.2 and 5.7.3.
12. Initiating devices	
(a) Electromechanical releasing device	(Reserved)
(b) Carbon monoxide detectors	Carbon monoxide detection system detectors shall be functionally tested in accordance with 8.4.4.
(i) Air sampling	Per test methods documented in the manufacturer's published instructions, detector alarm response shall be verified through the end sampling port on each pipe run; airflow through all other ports shall be verified as well.
(ii) Duct type	Air duct detectors shall be tested or inspected to ensure that the device will sample the airstream. The test shall be made in accordance with the manufacturer's published instructions.
(iii) Carbon monoxide detectors with control output functions	It shall be verified that the control capability shall remain operable even if all of the initiating devices connected to the same initiating device circuit or signaling line circuit are in an alarm state.
(c) Initiating devices, supervisory	(Reserved)

Table 8.4.2 Continued

Device	Test Method
13. Alarm notification appliances (a) Audible	Sound pressure level shall be measured with sound level meter meeting ANSI S1.4A, <i>Specification for Sound Level Meters</i> , Type 2 requirements. Levels throughout protected area shall be measured and recorded. The sound level meter shall be set in accordance with ANSI S3.41, <i>Audible Emergency Evacuation Signal</i> , using the time-weighted characteristic F (FAST). Record the maximum output when the audible emergency evacuation signal is on.
(b) Audible textual notification appliances (speakers and other appliances to convey voice messages)	Sound pressure level shall be measured with sound level meter meeting ANSI S1.4A, <i>Specification for Sound Level Meters</i> , Type 2 requirements. Levels throughout protected area shall be measured and recorded. The sound level meter shall be set in accordance with ANSI S3.41, <i>Audible Emergency Evacuation Signal</i> , using the time-weighted characteristic F (FAST). The maximum output shall be recorded when the audible emergency evacuation signal is on. Audible information shall be verified to be distinguishable and understandable. In locations where voice intelligibility is required, it shall be verified by one of the following methods: (1) Use of subject-based test methods as described in ANSI S3.2, <i>Method for Measuring the Intelligibility of Speech over Communications Systems</i> (2) Use of methods and instruments that measure certain physical parameters and provide a common intelligibility scale score as described in IEC 60849, <i>Sound Systems for Emergency Purposes</i> (3) Use of other methods acceptable to the authority having jurisdiction
(c) Visible	Test shall be performed in accordance with the manufacturer's published instructions. Appliance locations shall be verified to be per approved layout, and it shall be confirmed that no floor plan changes affect the approved layout. It shall be verified that the candela rating marking agrees with the approved drawing. It shall be confirmed that each appliance flashes.
14. Interface equipment	Interface equipment connections shall be tested by operating or simulating the equipment being supervised. Signals required to be transmitted shall be verified at the control unit. Test frequency for interface equipment shall be the same as the frequency required by the applicable NFPA standard(s) for the equipment being supervised.
15. Carbon monoxide safety functions	Carbon monoxide safety functions (fan control, smoke damper operation, door holder release, door unlocking, etc.) shall be tested by operating or simulating carbon monoxide alarm signals. Testing frequency for carbon monoxide safety functions shall be the same as the frequency required for the initiating device that activates the carbon monoxide safety function.
16. Special procedures — multiplex systems	Communications between sending and receiving units under both primary and secondary power shall be verified. Communications between sending and receiving units under open circuit and short circuit trouble conditions shall be verified. Communications between sending and receiving units in all directions where multiple communications pathways are provided shall be verified. All system functions and features shall be verified in accordance with manufacturer's published instructions.
17. Low-power radio (wireless systems)	The following procedures describe additional acceptance and reacceptance test methods to verify wireless protection system operation: (1) The manufacturer's published instructions and the as-built drawings provided by the system supplier shall be used to verify correct operation after the initial testing phase has been performed by the supplier or by the supplier's designated representative. (2) Starting from the functionalized operating condition, the system shall be initialized in accordance with the manufacturer's published instructions. A test shall be conducted to verify the alternative path, or paths, by turning off or disconnecting the primary wireless repeater. The alternative communications path shall exist between the wireless control unit and peripheral devices used to establish initiation, indication, control, and annunciation. The system shall be tested for both alarm and trouble conditions. (3) Batteries for all components in the system shall be checked monthly. If the control unit checks all batteries and all components daily, the system shall not require monthly testing of the batteries.

*Example: 4000 mAh \times $\frac{1}{25}$ = 160 mA charging current at 77°F (25°C).

8.4.3* Testing Frequency. Unless otherwise permitted by other sections of this standard, testing shall be performed in accordance with the schedules in Table 8.4.3, or more often if required by the authority having jurisdiction. [72:14.4.5]

8.4.3.1 Devices or equipment that are inaccessible for safety considerations (e.g., continuous process operations, energized electrical equipment, radiation, and excessive height) shall be permitted to be tested during scheduled shutdowns if approved by the authority having jurisdiction. Extended intervals shall not exceed 18 months. [72:14.4.5.1]

8.4.3.2 If automatic testing is performed at least weekly by a remotely monitored [carbon monoxide detection] control unit specifically listed for the application, the manual testing frequency shall be permitted to be extended to annually. Table 8.4.3 shall apply. [72:14.4.5.2]

8.4.4 Functional Test of Carbon Monoxide Detectors.

8.4.4.1 For all system detectors installed after January 1, 2012, carbon monoxide tests shall be performed at initial acceptance and annually by the introduction of carbon monoxide into the sensing chamber or element. An electronic check (magnets, analog values, etc.) is not sufficient to comply with this requirement.

8.4.4.2 The functional test shall be performed in accordance with the manufacturer's published instructions.

8.4.4.3* The result of each carbon monoxide detector test shall be confirmed through indication at the detector and the control unit.

8.4.4.4 All tests and results shall be recorded.

8.5 Maintenance.

8.5.1 [Carbon monoxide detection] system equipment shall be maintained in accordance with the manufacturer's published instructions. [72:14.5.1]

8.5.2 All apparatus that require resetting to maintain normal operation shall be restored to normal as promptly as possible after each test and alarm and kept in normal condition for operation. All test signal received shall be recorded to indicate date and time.

8.6 Records.

8.6.1 Permanent Records.

8.6.1.1 After successful completion of acceptance tests satisfactory to the authority having jurisdiction, a set of reproducible as-built installation drawings, operation and maintenance manuals, and a written sequence of operation shall be provided to the building owner or the owner's designated representative.

8.6.1.2 It shall be the responsibility of the owner to maintain these records for the life of the system and to keep them available for examination by any authority having jurisdiction.

8.6.1.3 Paper or electronic media shall be permitted.

8.6.2 Maintenance, Inspection, and Testing Records.

8.6.2.1 Records shall be retained until the next test and for 1 year thereafter. [72:14.6.2.1]

8.6.2.2 System shall be clearly identified by a placard, sticker, or other means to indicate the next regularly scheduled inspection period in accordance with Figure 8.6.2.2.

Exception: If the devices have been tested as part of the normal carbon monoxide alarm testing, the existing means of indicating the next regularly scheduled inspection period shall be permitted.

8.6.2.3 If off-premises monitoring is provided, records of signals, tests, and operations recorded at the monitoring center shall be maintained for not less than 12 months.

8.6.2.4 Upon request, a hard copy record shall be available for examination by the authority having jurisdiction.

8.6.2.5 Paper or electronic media shall be permitted.

8.7 Single- and Multiple-Station Carbon Monoxide Alarms.

8.7.1 Single- and multiple-station carbon monoxide alarms and all connected appliances shall be inspected and tested in accordance with the manufacturer's published instructions at least monthly.

8.7.2 Alarms shall be replaced when either the end-of-life signal is activated or the manufacturer's replacement date is reached. Alarms shall also be replaced when they fail to respond to operability tests.

8.7.3 Where batteries are used as a source of energy, they shall be replaced in accordance with the alarm equipment manufacturer's published instructions. [72:14.4.9]

8.7.4 Combination smoke/carbon monoxide alarms shall be replaced when the end-of-life signal activates or 10 years from the date of manufacture, whichever comes first. [72:14.4.8.2]

8.8 Household Carbon Monoxide Detection Systems.

8.8.1 Testing of Household Carbon Monoxide Detection Systems.

8.8.1.1 Household carbon monoxide detection systems shall be tested by a qualified service technician at least every 3 years according to the methods in Table 8.4.2.

8.8.1.2 Carbon monoxide detectors used in household carbon monoxide detection systems shall be tested in accordance with manufacturer's published instructions.

8.8.1.3 Detectors shall be replaced when the end-of-life signal is activated, the manufacturer's replacement date is reached, or when they fail to respond to operability tests.

8.8.2 Maintenance of Household Carbon Monoxide Detection Systems. Maintenance of household [carbon monoxide detection] systems shall be conducted according to the manufacturer's published instructions. [72:14.4.7.2]

Table 8.4.3 Testing Frequencies

Component	Initial/ Reacceptance	Monthly	Quarterly	Semi- Annually	Annually	Table 8.4.2 Reference
1. Control equipment — building systems connected to supervising station						1
(a) Functions	X	—	—	—	X	—
(b) Fuses	X	—	—	—	X	—
(c) Interfaced equipment	X	—	—	—	X	—
(d) Lamps and LEDs	X	—	—	—	X	—
(e) Primary (main) power supply	X	—	—	—	X	—
(f) Transponders	X	—	—	—	X	—
2. Control equipment — building systems not connected to a supervising station						1
(a) Functions	X	—	X	—	—	—
(b) Fuses	X	—	X	—	—	—
(c) Interfaced equipment	X	—	X	—	—	—
(d) Lamps and LEDs	X	—	X	—	—	—
(e) Primary (main) power supply	X	—	X	—	—	—
(f) Transponders	X	—	X	—	—	—
3. Batteries — carbon monoxide detection systems						
(a) Lead-acid type	—	—	—	—	—	6a
(i) Charger test (Replace battery as needed.)	X	—	—	—	X	—
(ii) Discharge test (30 minutes)	X	—	—	X	—	—
(iii) Load voltage test	X	—	—	X	—	—
(iv) Specific gravity	X	—	—	X	—	—
(b) Nickel-cadmium type	—	—	—	—	—	6b
(i) Charger test (Replace battery as needed.)	X	—	—	—	X	—
(ii) Discharge test (30 minutes)	X	—	—	—	X	—
(iii) Load voltage test	X	—	—	X	—	—
(c) Sealed lead-acid type	—	—	—	—	—	6c
(i) Charger test after manufacture (or more frequently as needed.)	X	—	—	—	X	—
(ii) Discharge test (30 minutes)	X	—	—	—	X	—
(iii) Load voltage test	X	—	—	X	—	—
4. Fiber-optic cable power	X	—	—	—	X	11b
5. Control unit trouble signals	X	—	—	—	X	8
6. Conductors — metallic	X	—	—	—	—	10
7. Conductors — nonmetallic	X	—	—	—	—	11
8. Remote annunciators	X	—	—	—	X	9
9. Initiating devices	X	—	—	—	—	12
(a) Duct detectors	X	—	—	—	X	—
(b) Electromechanical releasing device (Reserved)						
(c) Carbon monoxide detection system detectors — functional test (<i>see 8.4.4</i>)						
(d) Single- and multiple-station carbon monoxide alarms (<i>see 8.7.1</i>)	—	—	—	—	—	—
(e) Supervisory signal devices (Reserved)	—	—	—	—	—	—
10. Interface equipment and carbon monoxide safety functions	X	—	—	—	X	15, 16
11. Alarm notification appliances	—	—	—	—	—	13
(a) Audible devices	X	—	—	—	X	—
(b) Audible textual notification appliances	X	—	—	—	X	—
(c) Visible devices	X	—	—	—	X	—
12. Special procedures	X	—	—	—	X	17

CARBON MONOXIDE SYSTEM INSPECTION AND TESTING FORM

*To be completed by the system inspector or tester at the time of the inspection or test.
It shall be permitted to modify this form as needed to provide a more complete and/or clear record.
Insert N/A in all unused lines.*

Attach additional sheets, data, or calculations as necessary to provide a complete record.

Date of this inspection or test: _____ Time of inspection or test: _____

1. PROPERTY INFORMATION

Name of property: _____

Address: _____

Description of property: _____

Occupancy type: _____

Name of property representative: _____

Address: _____

Phone: _____ Fax: _____ E-mail: _____

Authority having jurisdiction over this property: _____

Phone: _____ Fax: _____ E-mail: _____

2. INSTALLATION, SERVICE, AND TESTING CONTRACTOR INFORMATION

Service and/or testing organization for this equipment: _____

Address: _____

Phone: _____ Fax: _____ E-mail: _____

Service technician or tester: _____

Qualifications of technician or tester: _____

A contract for test and inspection in accordance with NFPA standards is in effect as of: _____

The contract expires: _____ Contract number: _____ Frequency of tests and inspections: _____

Monitoring organization for this equipment: _____

Address: _____

Phone: _____ Fax: _____ E-mail: _____

Entity to which alarms are retransmitted: _____ Phone: _____

3. TYPE OF SYSTEM OR SERVICE

Carbon monoxide system (nonvoice)

Carbon monoxide with emergency voice alarm communication system (EVACS)

Combination carbon monoxide detection system, with the following components, describe: _____

NFPA 720 edition: _____ Additional description of system(s): _____

FIGURE 8.6.2.2 Example of an Inspection and Testing Form.



3. TYPE OF SYSTEM OR SERVICE (continued)**3.1 Control Unit**

Manufacturer: _____ Model number: _____

3.2 System Documentation

An owner's manual, a copy of the manufacturer's instructions, a written sequence of operation, and a copy of the record drawings are stored on site. Location: _____

3.3 System Software

This system does not have alterable site-specific software.

Software revision number: _____ Software last updated on: _____

A copy of the site-specific software is stored on site. Location: _____

4. SYSTEM POWER**4.1 Control Unit****4.1.1 Primary Power**

Input voltage of control panel: _____ Control panel amps: _____

4.1.2 Engine-Driven Generator

This system does not have a generator.

Location of generator: _____

Location of fuel storage: _____ Type of fuel: _____

4.1.3 Uninterruptible Power System

This system does not have a UPS.

Equipment powered by a UPS system: _____

Location of UPS system: _____

Calculated capacity of UPS batteries to drive the system components connected to it:

In standby mode (hours): _____ In alarm mode (minutes): _____

4.1.4 Batteries

Location: _____ Type: _____ Nominal voltage: _____ Amp/hour rating: _____

Calculated capacity of batteries to drive the system:

In standby mode (hours): _____ In alarm mode (minutes): _____

Batteries are marked with date of manufacture.

4.2 Emergency Voice Alarm Communication System

This system does not have an EVACS.

4.2.1 Primary Power

Input voltage of EVACS panel: _____ EVACS panel amps: _____

4.2.2 Engine-Driven Generator

This system does not have a generator.

Location of generator: _____

Location of fuel storage: _____ Type of fuel: _____

FIGURE 8.6.2.2 *Continued*

4. SYSTEM POWER (continued)**4.2.3 Uninterruptible Power System** This system does not have a UPS.

Equipment powered by a UPS system: _____

Location of UPS system: _____

Calculated capacity of UPS batteries to drive the system components connected to it:

In standby mode (hours): _____ In alarm mode (minutes): _____

4.2.4 Batteries

Location: _____ Type: _____ Nominal voltage: _____ Amp/hour rating: _____

Calculated capacity of batteries to drive the system:

In standby mode (hours): _____ In alarm mode (minutes): _____

 Batteries are marked with date of manufacture.**4.3 Notification Appliance Power Extender Panels** This system does not have power extender panels.**4.3.1 Primary Power**

Input voltage of power extender panel(s): _____ Power extender panel amps: _____

4.3.2 Engine-Driven Generator This system does not have a generator.

Location of generator: _____

Location of fuel storage: _____ Type of fuel: _____

4.3.3 Uninterruptible Power System This system does not have a UPS.

Equipment powered by a UPS system: _____

Location of UPS system: _____

Calculated capacity of UPS batteries to drive the system components connected to it:

In standby mode (hours): _____ In alarm mode (minutes): _____

4.3.4 Batteries

Location: _____ Type: _____ Nominal voltage: _____ Amp/hour rating: _____

Calculated capacity of batteries to drive the system:

In standby mode (hours): _____ In alarm mode (minutes): _____

 Batteries are marked with date of manufacture.**5. ANNUNCIATORS** This system does not have annunciators.**5.1 Location and Description of Annunciators**

Annunciator 1: _____

Annunciator 2: _____

Annunciator 3: _____

FIGURE 8.6.2.2 *Continued*

6. NOTIFICATIONS MADE PRIOR TO TESTING

Monitoring organization Contact: _____ Time: _____
 Building management Contact: _____ Time: _____
 Building occupants Contact: _____ Time: _____
 Authority having jurisdiction Contact: _____ Time: _____
 Other, if required Contact: _____ Time: _____

7. TESTING RESULTS**7.1 Control Unit and Related Equipment**

Description	Visual Inspection	Functional Test	Comments
Control unit	<input type="checkbox"/>	<input type="checkbox"/>	
Lamps/LEDs/LCDs	<input type="checkbox"/>	<input type="checkbox"/>	
Fuses	<input type="checkbox"/>	<input type="checkbox"/>	
Trouble signals	<input type="checkbox"/>	<input type="checkbox"/>	
Disconnect switches	<input type="checkbox"/>	<input type="checkbox"/>	
Ground-fault monitoring	<input type="checkbox"/>	<input type="checkbox"/>	
Supervision	<input type="checkbox"/>	<input type="checkbox"/>	
Local annunciator	<input type="checkbox"/>	<input type="checkbox"/>	
Remote annunciators	<input type="checkbox"/>	<input type="checkbox"/>	
Power extender panels	<input type="checkbox"/>	<input type="checkbox"/>	
Isolation modules	<input type="checkbox"/>	<input type="checkbox"/>	
Other (specify)	<input type="checkbox"/>	<input type="checkbox"/>	

7.2 Control Unit Power Supplies

Description	Visual Inspection	Functional Test	Comments
120-volt power	<input type="checkbox"/>	<input type="checkbox"/>	
Generator or UPS	<input type="checkbox"/>	<input type="checkbox"/>	
Battery condition	<input type="checkbox"/>	<input type="checkbox"/>	
Load voltage	<input type="checkbox"/>	<input type="checkbox"/>	
Discharge test	<input type="checkbox"/>	<input type="checkbox"/>	
Charger test	<input type="checkbox"/>	<input type="checkbox"/>	
Other (specify)	<input type="checkbox"/>	<input type="checkbox"/>	

FIGURE 8.6.2.2 *Continued*

7. TESTING RESULTS (continued)**7.3 Emergency Voice Alarm Communications Equipment**

Description	Visual Inspection	Functional Test	Comments
Control unit	<input type="checkbox"/>	<input type="checkbox"/>	
Lamps/LEDs/LCDs	<input type="checkbox"/>	<input type="checkbox"/>	
Fuses	<input type="checkbox"/>	<input type="checkbox"/>	
Primary power supply	<input type="checkbox"/>	<input type="checkbox"/>	
Secondary power supply	<input type="checkbox"/>	<input type="checkbox"/>	
Trouble signals	<input type="checkbox"/>	<input type="checkbox"/>	
Disconnect switches	<input type="checkbox"/>	<input type="checkbox"/>	
Ground-fault monitoring	<input type="checkbox"/>	<input type="checkbox"/>	
Panel supervision	<input type="checkbox"/>	<input type="checkbox"/>	
System performance	<input type="checkbox"/>	<input type="checkbox"/>	
Sound pressure levels Occupied <input type="checkbox"/> Yes <input type="checkbox"/> No Ambient _____ dBA Alarm _____ dBA (attach report with locations, values, and weather conditions)	<input type="checkbox"/>	<input type="checkbox"/>	
System intelligibility <input type="checkbox"/> CSI <input type="checkbox"/> STI (attach report with locations, values, and weather conditions)	<input type="checkbox"/>	<input type="checkbox"/>	
Other (specify)	<input type="checkbox"/>	<input type="checkbox"/>	

7.4 Notification Appliance Power Extender Panels

Description	Visual Inspection	Functional Test	Comments
Lamps/LEDs/LCDs	<input type="checkbox"/>	<input type="checkbox"/>	
Fuses	<input type="checkbox"/>	<input type="checkbox"/>	
Primary power supply	<input type="checkbox"/>	<input type="checkbox"/>	
Secondary power supply	<input type="checkbox"/>	<input type="checkbox"/>	
Trouble signals	<input type="checkbox"/>	<input type="checkbox"/>	
Ground-fault monitoring	<input type="checkbox"/>	<input type="checkbox"/>	
Panel supervision	<input type="checkbox"/>	<input type="checkbox"/>	
Other (specify)	<input type="checkbox"/>	<input type="checkbox"/>	

FIGURE 8.6.2.2 *Continued*

7. TESTING RESULTS (continued)**7.5 Combination Carbon Monoxide Detection Systems**

Description	Visual Inspection	Functional Test	Comments
Combination CO/ security system	<input type="checkbox"/>	<input type="checkbox"/>	
Other (specify)	<input type="checkbox"/>	<input type="checkbox"/>	

7.6 Monitored Systems

Description (specify)	Visual Inspection	Functional Test	Comments
Specify	<input type="checkbox"/>	<input type="checkbox"/>	

7.7 Auxiliary Functions

Description	Visual Inspection	Functional Test	Comments
Describe	<input type="checkbox"/>	<input type="checkbox"/>	

7.8 Alarm Initiating Device

Device test results sheet attached listing all devices tested and the results of the testing

7.9 Supervisory Alarm Initiating Device

Device test results sheet attached listing all devices tested and the results of the testing

7.10 Alarm Notification Appliances

Appliance test results sheet attached listing all appliances tested and the results of the testing

7.11 Supervisory Station Monitoring

Description	Yes	No	Time	Comments
Alarm signal	<input type="checkbox"/>	<input type="checkbox"/>		
Alarm restoration	<input type="checkbox"/>	<input type="checkbox"/>		
Trouble signal	<input type="checkbox"/>	<input type="checkbox"/>		
Trouble restoration	<input type="checkbox"/>	<input type="checkbox"/>		
Supervisory signal	<input type="checkbox"/>	<input type="checkbox"/>		
Supervisory restoration	<input type="checkbox"/>	<input type="checkbox"/>		

FIGURE 8.6.2.2 *Continued*

Chapter 9 Single- and Multiple-Station Alarms and Household Carbon Monoxide Detection Systems

9.1 Application.

9.1.1 The performance, selection, installation, operation, and use of single- and multiple-station alarms and household carbon monoxide detection systems shall comply with the requirements of this chapter.

9.1.2 Carbon monoxide alarms shall be installed in all occupancies where required by applicable laws, codes, or standards.

9.1.3 The requirements of Chapter 4 through Chapter 6 shall not apply unless otherwise indicated.

9.2 Purpose. Carbon monoxide warning equipment for residential occupancies shall provide a reliable means to notify the occupants of the presence of levels of carbon monoxide that constitute a potential life safety risk and the need for action as a consequence of those levels.

9.3 Basic Requirements.

9.3.1 All devices, combinations of devices, and equipment to be installed in conformity with this chapter shall be listed for the purposes for which they are intended.

9.3.2 [Carbon monoxide] warning equipment shall be installed in accordance with the listing and manufacturer's published instructions. [72:29.3.2]

9.3.3* The installation of [carbon monoxide] alarms or [carbon monoxide detection] systems, or combinations of these, shall comply with the requirements of this chapter and shall satisfy the minimum requirements for number and location of [carbon monoxide] alarms or [carbon monoxide] detectors by one of the following arrangements:

- (1) The required minimum number and location of [carbon monoxide] detection devices shall be satisfied (independently) through the installation of [carbon monoxide] alarms. The installation of additional [carbon monoxide] alarms shall be permitted. The installation of additional system-based [carbon monoxide] detectors, including partial or complete duplication of the [carbon monoxide] alarms satisfying the required minimum, shall be permitted.
- (2) The required minimum number and location of [carbon monoxide] detection devices shall be satisfied (independently) through the installation of system [carbon monoxide] detectors. The installation of additional [carbon monoxide] detectors shall be permitted. The installation of additional [carbon monoxide] alarms, including partial or complete duplication of the [carbon monoxide] detectors satisfying the required minimum, shall be permitted.

[72:29.3.3]

9.3.4 Supplementary functions, including the extension of an alarm beyond the residential occupancy, shall be permitted and shall not interfere with the performance requirements of this chapter. [72:29.3.4]

9.4 Required Protection.

9.4.1* **Carbon Monoxide Alarms and Detectors.** The warning functions intended in this standard shall be performed by single- or multiple-station alarms or by detectors connected to a control unit and associated equipment, in accordance with 9.3.3.

9.4.1.1* Carbon monoxide alarms or detectors shall be installed as follows:

- (1) Outside of each separate dwelling unit sleeping area in the immediate vicinity of the bedrooms
- (2) On every occupiable level of a dwelling unit, including basements, excluding attics and crawl spaces
- (3) Other locations where required by applicable laws, codes, or standards

9.4.1.2* Each alarm or detector shall be located on the wall, ceiling, or other location as specified in the manufacturer's published instructions that accompany the unit.

9.4.2 Alarm Notification Appliances.

9.4.2.1 General. Each alarm or detector shall cause the operation of an alarm notification appliance that shall meet the performance requirements of 6.4.2 and 6.4.4.

9.4.2.2* Alarm Notification Appliances for the Hearing Impaired.

9.4.2.2.1 Notification appliances provided in sleeping rooms and guest rooms for those with hearing loss shall comply with 9.4.2.2.1.1 and 9.4.2.2.1.2, as applicable. [72:29.3.8]

9.4.2.2.1.1 Mild to Severe Hearing Loss. Notification appliances provided for those with mild to severe hearing loss shall comply with the following:

- (1) An audible notification appliance producing a low frequency alarm signal shall be installed in the following situations:
 - (a)*Where required by governing laws, codes, or standards for people with hearing loss
 - (b) Where provided voluntarily for those with hearing loss
- (2)*The low frequency alarm signal output shall comply with the following:
 - (a) The alarm signal shall be a square wave or provide equivalent awakening ability.
 - (b)*The wave shall have a fundamental frequency of 520 Hz + / -10 percent.
 - (c) The minimum sound level at the pillow shall be 75 dBA, or 15 dB above the average ambient sound level, or 5 dB above the maximum sound level having a duration of at least 60 seconds, whichever is greater.

[72:29.3.8.1]

9.4.2.2.1.2* Profound Hearing Loss. Visible notification appliances in accordance with the requirements of 6.5.4.6 and tactile notification appliances in accordance with the requirements of Section 6.10 shall be required for those with profound hearing loss in the following situations:

- (1)*Where required by governing laws, codes, or standards for people with hearing loss
- (2) Where provided voluntarily for those with hearing loss

[72:29.3.8.2]

9.4.2.2.2 Signals from notification appliances shall not be required to be synchronized. [72:29.3.9]

9.4.2.2.3 When visible appliances are provided, they shall meet the requirements of Section 6.5. Since hearing deficits are often not apparent, the responsibility for advising the appropriate person(s) of the existence of this deficit shall be that of the party with hearing loss. [72:29.3.7]

9.4.2.2.4 Visible notification appliances used with single- or multiple-station carbon monoxide alarms shall be permitted to operate in accordance with 9.5.5.

9.5 Power Supplies.

9.5.1 General.

9.5.1.1 All power supplies shall have sufficient capacity to operate the alarm signal(s) for at least 12 continuous hours.

9.5.1.2 For electrically powered carbon monoxide warning equipment, the primary (main) power source shall be ac along with a secondary power source meeting the specifications of 9.5.4, unless otherwise permitted by the following:

- (1) Detectors and alarms shall be permitted to be powered by a monitored dc circuit of a control unit when power for the control unit meets the requirements of Section 9.5 and the circuit remains operable upon loss of primary (main) ac power.
- (2) A detector and a wireless transmitter that serves only that detector shall be permitted to be powered from a monitored battery primary (main) source where part of a listed, monitored, low-power radio (wireless) system.
- (3) In existing construction, a monitored battery primary (main) power source, as described in 9.5.3, shall be permitted.

9.5.2 Primary Power Supply — ac.

9.5.2.1 An ac primary (main) power source shall be a commercial light and power supply or other dependable source.

9.5.2.2 A visible “power on” indicator shall be provided.

9.5.2.3 Primary (main) ac power shall be supplied from either a dedicated branch circuit or the unswitched portion of a branch circuit also used for power and lighting.

9.5.2.4 All electrical systems designed to be installed by other than a qualified electrician shall be powered from a source not in excess of 30 volts that meets the requirements for Class 2 circuits as defined in Article 725 of *NFPA 70, National Electrical Code*.

9.5.2.5* A restraining means shall be used at the plug-in of any cord-connected installation.

9.5.2.6 Operation of a switch (other than a circuit breaker) or a ground fault circuit interrupter shall not cause loss of primary (main) ac power.

9.5.2.7 The requirement of 9.5.2.6 shall not apply where a ground fault circuit interrupter serves all electrical circuits within the dwelling unit.

9.5.2.8 Neither loss nor restoration of primary (main) ac power shall cause an alarm signal exceeding 2 seconds.

9.5.2.9 The primary (main) ac power supply shall be of sufficient capacity to operate the system under all conditions of loading with any secondary (standby) battery disconnected or fully discharged.

9.5.3 Primary Power Supply — Monitored Battery.

9.5.3.1 Carbon monoxide warning equipment shall be permitted to be powered by a battery, provided that the battery is monitored to ensure that the following conditions are met:

- (1) All power requirements are met for at least 1 year of battery life, including monthly testing.
- (2) A distinctive audible trouble signal sounds before the battery is incapable of operating the device(s) (from causes such as aging or terminal corrosion) for alarm purposes.
- (3) Automatic transfer is provided from alarm to a trouble condition for a unit employing a lock-in alarm feature.

(4) The unit is capable of producing an alarm signal for at least 12 hours at the battery voltage at which a trouble signal is normally obtained, followed by not less than 7 days of trouble signal operation.

(5) After the initial 4 minutes of alarm, the 5-second “off” time of the alarm signal shall be permitted to be changed to 60 seconds \pm 10 percent.

(6) The audible trouble signal is produced at least once every minute for 7 consecutive days.

(7) Acceptable replacement batteries are identified by the manufacturer’s name and model number on the unit near the battery compartment.

(8) A visible indication is displayed when a primary battery is removed from the unit.

- (9) A visible “power on” indicator is provided.

9.5.3.2 If an alarm uses a nonrechargeable, nonreplaceable battery as a primary power supply, the battery shall be capable of powering the unit for its service life, including testing, and shall meet the requirements of 9.5.3.1.

9.5.4 Secondary (Standby) Power Supply.

9.5.4.1 A secondary (standby) power supply shall have sufficient capacity to power the unit for 8 hours, followed by not less than 12 hours of alarm, followed by not less than 7 consecutive days of trouble signals.

9.5.4.2 After the initial 4 minutes of alarm, the 5-second “off” time of the alarm signal shall be permitted to be changed to 60 seconds \pm 10 percent.

9.5.4.3 Removal or disconnection of a battery used as a secondary (standby) power source shall cause an audible or visible trouble signal.

9.5.4.4 Permitted replacement batteries shall be identified by manufacturer’s name and model number on the unit near the battery compartment.

9.5.4.5 Where required by law for disposal reasons, rechargeable batteries shall be removable.

9.5.4.6 An audible trouble signal shall sound before the battery is incapable of operating the device(s) (from causes such as aging, discharge, or terminal corrosion) for alarm purposes.

9.5.4.7 Automatic recharging shall be provided when a rechargeable battery is used as a secondary (standby) supply.

9.5.4.8 Where automatic recharging is provided, the battery shall be recharged within one of the following time periods:

- (1) Within 4 hours where power is provided from a circuit that can be switched on or off by means other than a circuit breaker
- (2) Within 48 hours where power is provided from a circuit that cannot be switched on or off by means other than a circuit breaker

9.5.5* Visible notification appliances used with single- or multiple-station carbon monoxide alarms shall not be required to operate without primary ac power.

9.6 Equipment Performance.

9.6.1 Carbon Monoxide Alarms and Detectors.

9.6.1.1* Each carbon monoxide alarm shall be in compliance with ANSI/UL 2034, *Standard for Single and Multiple Station Carbon Monoxide Alarms*.



9.6.1.2 Each carbon monoxide detector shall be in compliance with ANSI/UL 2075, *Gas and Vapor Detectors and Sensors*, and shall meet the sensitivity testing and alarm thresholds of ANSI/UL 2034, *Standard for Single and Multiple Station Carbon Monoxide Alarms*.

9.6.1.3 All signals produced from periodic testing of carbon monoxide alarms or detectors (*see 9.8.2*) shall be identical to the signal produced when the unit is in alarm.

9.6.1.4 Trouble signals shall be distinctive from alarm signals.

9.6.1.5 Unless otherwise recommended by the manufacturer's published instructions, carbon monoxide alarms and detectors shall be replaced when they fail to respond to tests.

9.6.1.6 Alarms and detectors shall be replaced when either the end-of-life signal is activated or the manufacturer's replacement date is reached.

9.6.1.7 Combination smoke/carbon monoxide alarms shall be replaced when the end-of-life signal activates or 10 years from the date of manufacture, whichever comes first.

9.6.1.8 Combination smoke/carbon monoxide detectors shall be replaced when the end-of-life signal activates or when the manufacturer's replacement date is reached.

9.6.2 Audible Alarm Signals.

9.6.2.1 All alarm-sounding appliances shall have a minimum rating of 85 dBA at 3 m (10 ft).

9.6.2.2 The audible alarm signal for carbon monoxide alarms shall be a single tone pattern consisting of four cycles of 100 milliseconds \pm 10 percent "on" and 100 milliseconds \pm 10 percent "off," followed by 5 seconds \pm 10 percent "off."

9.6.2.3 After the initial 4 minutes of alarm, the 5-second "off" time shall be permitted to be changed to 60 seconds \pm 10 percent.

9.6.2.4 The alarm signal shall be repeated in compliance with 9.6.2.2 and 9.6.2.3 until the alarm resets or the alarm signal is manually silenced.

9.6.3 Multiple-Purpose Alarms.

9.6.3.1 A fire alarm signal shall take precedence and be distinctively recognizable over any other signal, even when the nonfire signal is initiated first.

9.6.3.2 There shall be a means for distinguishing the carbon monoxide alarm signal from all other signals.

9.6.4 Interconnection of Alarms. When two or more alarms are installed within a dwelling unit, suite of rooms, or similar area, they shall be arranged so that the operation of any alarm causes all alarms within these locations to sound.

Exception: Alarms installed in existing construction shall not be required to cause all alarms to sound.

9.6.4.1 When alarms of different types are interconnected, all interconnected alarms shall produce the appropriate audible response for the phenomena being detected or remain silent. [72:29.8.2.2(5)]

9.6.4.2 Auxiliary components, such as, but not limited to, relay modules or notification appliances, listed for use with carbon monoxide alarms shall be permitted, provided that an open or short circuit of the wiring leading to these components does not prevent normal operation of the interconnected alarm.

9.6.4.3 Carbon monoxide alarms shall not be interconnected with alarms from other manufacturers unless listed as being compatible with those specific models.

9.6.4.4 A single fault on the wiring connecting the alarms shall not prevent the independent operation of any of the interconnected alarms.

9.6.4.5 The test feature on any alarm device shall cause all interconnected alarms to activate the appropriate alarm signal.

9.6.5 Control Equipment.

9.6.5.1 Control equipment shall be automatically restored upon restoration of electrical power.

9.6.5.2 The control equipment shall be of a type that latches on an alarm condition.

9.6.5.3 When a reset switch is provided, it shall be of a self-restoring type.

9.6.5.4 An alarm-silencing switch shall not be provided unless one of the following criteria applies:

- (1) The silenced position is indicated by a distinctive signal.
- (2) The switch is a momentary or self-restoring switch.

9.6.5.5 Each electrical carbon monoxide detection system shall have an integral test means to allow testing of the system operation.

9.6.6 Combination Systems.

9.6.6.1 Where common wiring is employed for a combination system, the equipment for other than a fire warning signaling system shall be permitted to be connected to the common wiring of the system provided that the following conditions are met:

- (1) Short circuits, open circuits, or any other ground fault in equipment or interconnection between this equipment and the fire warning system does not interfere with the monitoring for integrity of the fire warning system.
- (2) Short circuits, open circuits, or any other ground fault in this equipment or interconnection between this equipment and the fire warning system does not prevent alarm or trouble signal transmissions.

9.6.6.2 In a combination system, the operation shall be as follows:

- (1) A fire alarm signal shall take precedence or be distinctively annunciated over any other signal, even when the nonfire or carbon monoxide signal is initiated first.
- (2) Distinctive alarm signals shall be obtained between fire alarms and all other functions.
- (3) The use of a common audible notification appliance shall be permitted if distinctive signals are obtained.

9.6.7 Interconnection to Fire Alarm or Combination Control Units.

9.6.7.1 Operation of carbon monoxide alarms or detectors shall not cause fire alarm or combination control units to activate either protected premises or supervising station fire alarm signals.

9.6.7.2 Where carbon monoxide warning equipment is connected to a protected premises fire alarm system, receipt of signals shall initiate the signal required by 9.6.2.

9.6.8 Supervising Station Systems.

9.6.8.1* Carbon monoxide warning equipment signals that are transmitted off-premises shall comply with the requirements of Chapter 7 and the following:

- (1) Where required, immediately retransmit indication of the carbon monoxide alarm signal to the communications center

Exception: The immediate retransmission shall be permitted to be delayed by not more than 90 seconds where the jurisdiction permits the supervising station to first contact the protected premises to determine if the alarm was initiated by the activation of a test.

- (2) Contact the responsible party(s) in accordance with the notification plan.

9.6.8.2 Once contacted, the subscriber shall be informed to take action in accordance with the manufacturer's published instructions, or where manufacturer's published instructions are not available, the subscriber shall be advised to take the following actions:

- (1) Immediately move to fresh air, either outdoors or by an open door or window.
- (2) Verify that all occupants are accounted for.
- (3) Do not reenter the premises or move away from an open door or window until the emergency service responders have arrived, the premises have been aired out, and the alarm remains in its normal condition.

9.6.8.3 Supervising Stations.

9.6.8.3.1 Where a digital alarm communicator transmitter (DACT) is used, the DACT serving the protected premises shall only require a single telephone line and shall only require a call to a single digital alarm communicator transmitter (DACR) number. [72:29.7.8.1.1]

9.6.8.3.2 Where a DACT is used, the DACT test signals shall be transmitted at least monthly. [72:29.7.8.1.2]

9.6.8.3.3* Requirements for indication of central station service shall not be required.

9.6.8.3.4 A dedicated cellular telephone connection shall be permitted to be used as a single means to transmit alarms to a constantly attended remote monitoring location. [72:29.7.8.1.4]

9.6.8.4 Household [] alarm systems shall be programmed by the manufacturer to generate at least a monthly test of the communication or transmission means. [72:29.7.8.3]

9.6.9 Low-Power Wireless Systems. Low-power radio (wireless) systems shall comply with the requirements of Section 5.12.

Exception: The requirements of 5.12.4.5 shall not apply to dwelling units.

9.6.10 Nonsupervised Wireless Interconnected Alarms. [72:29.7.7.2]

9.6.10.1* To ensure adequate transmission and reception capability, nonsupervised, low-power wireless alarms shall be capable of reliably communicating at a distance of 100 ft (30.5 m) indoors as tested to an equivalent open area test distance, D_{EOAT} , between two devices in accordance with the following equations:

$$D_{EOAT} = 30.5 \times \left(10^{\frac{L_b}{40}} \right)$$

where L_b is the building attenuation factor, a value dependent on the frequency of the wireless transmission. The building attenuation factor, L_b , represents the maximum attenuation

value of typical floors and walls within a majority of structures the factor. L_b shall assume four walls and two floors and be calculated as follows:

$$L_b = 4 \times L_w + 2 \times L_f$$

where:

L_w = attenuation value of a wall = $2 \times L_1 + L_2$

L_f = attenuation value of a floor = $L_1 + L_2 + L_3 + L_4$

L_1 = frequency-dependent attenuation value for ½ in. (13 mm) drywall

L_2 = frequency-dependent attenuation value for 1½ in. (38 mm) structural lumber

L_3 = frequency-dependent attenuation value for ¾ in. (19 mm) plywood

L_4 = frequency-dependent attenuation value for ½ in. (13 mm) glass/tile floor

[72:29.7.7.2.1]

9.6.10.2 Fire alarm signals shall have priority over all other signals. [72:29.7.7.2.2]

9.6.10.3 The maximum allowable response delay from activation of an initiating device to receipt of and alarm/display by the receiver/control unit shall be 20 seconds. [72:29.7.7.2.3]

9.6.10.4* Wireless interconnected [] alarms (in receive mode) shall remain in alarm as long as the originating unit (transmitter) remains in alarm. [72:29.7.7.2.4]

9.6.10.5 The occurrence of any single fault that disables a transceiver shall not prevent other transceivers in the system from operating. [72:29.7.7.2.5]

9.7 Installation.

9.7.1 General Provisions.

9.7.1.1 All carbon monoxide alarms or detectors shall be installed in accordance with the manufacturer's published instructions.

9.7.1.2 All carbon monoxide alarms or detectors shall be located and mounted so that accidental operation will not be caused by jarring or vibration.

9.7.1.3 All carbon monoxide alarms or detectors shall be supported independently of their attachment to wires.

9.7.1.4 All carbon monoxide alarms or detectors shall be tested in accordance with the instructions provided by the supplier or installing contractor (*see 9.9.2 and 9.9.3*) to ensure operation after installation.

9.7.1.5 All carbon monoxide alarms or detectors shall be restored to their normal mode of operation after each alarm or test.

9.7.1.6 The supplier or installing contractor shall provide the owner with the instructions required in 9.9.3.

9.7.2 Multiple-Station Alarms.

9.7.2.1* Interconnection that causes the other multiple-station alarms or the appropriate notification signal of multiple-purpose alarms within an individual dwelling unit to produce an alarm signal shall be permitted.

9.7.2.2 Remote annunciation from single- and multiple-station alarms shall be permitted provided the devices comply with 9.4.2.1 and 9.6.4.



9.7.2.3 Remote annunciation shall be permitted provided the signal is identifiable for the hazard it annunciates.

9.8 Maintenance and Testing.

9.8.1 Single- and multiple-station carbon monoxide alarms shall be maintained and tested in accordance with Section 8.7.

9.8.2 Household carbon monoxide detection systems shall be maintained and tested in accordance with Section 8.8.

9.9 Markings and Instructions.

9.9.1 General. Carbon monoxide alarms or detectors shall be provided with the information specified in 9.9.2 and 9.9.3.

9.9.2 Markings. The following information shall be marked on the alarms and detectors and shall be provided in the instructions:

- (1) Identification of the sensitivity level at which the unit is designed to sense carbon monoxide
- (2) Statement that indicates the unit is not suitable as a fire detector
- (3) Name and address of the manufacturer or listee
- (4) Model number
- (5) Mark or certification that the unit has been listed by a nationally recognized testing laboratory
- (6) Electrical rating (if applicable)
- (7) Explanation of signal indicators
- (8) Warning that carbon monoxide is odorless, colorless, and tasteless
- (9) Emergency actions to be taken
- (10) Manufacturing date or date code
- (11) Recommended replacement date

9.9.3 Instructions. The following information shall be included in the printed instructions provided with carbon monoxide alarms and detectors:

- (1) Installation instructions
- (2) Operating instructions
- (3) Testing instructions
- (4) Maintenance instructions
- (5) Replacement and service instructions
- (6) Statement indicating that smoke might not be present during a carbon monoxide alarm condition
- (7)*Information on the actions to be taken in case of an alarm
- (8) Minimum and recommended distances from fuel-burning appliances

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.1 This document does not attempt to cover all equipment, methods, and requirements that might be necessary or advantageous for the protection of lives from carbon monoxide exposure.

The effects of exposure to carbon monoxide vary significantly among different people. Infants, pregnant women, and people with physical conditions that limit their bodies' ability to use oxygen can be affected by low concentrations of carbon monoxide. These conditions include, but are not limited to,

emphysema, asthma, and heart disease, all of which are usually indicated by a shortness of breath upon mild exercise.

People in need of warning about low levels of carbon monoxide should explore the use of specially calibrated units or other alternatives.

A.1.1.2 See NFPA 1192, *Standard on Recreational Vehicles*, for equipment for use in recreational vehicles.

A.1.2 Carbon monoxide alarms and detectors are intended to alarm at carbon monoxide levels below those that are known to cause a loss of ability to react to the dangers of carbon monoxide. (See also Table B.1 and Figure B.1.)

A.1.3.2 Although carbon monoxide detection and warning equipment might respond to gases produced by unwanted fires, it is not fire detection or warning equipment.

A.1.5.6 Where dimensions are expressed in inches, it is intended that the precision of the measurement be 1 in., thus plus or minus ½ in. The conversion and presentation of dimensions in millimeters would then have a precision of 25 mm, thus plus or minus 13 mm.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase "authority having jurisdiction," or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A.3.2.4 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A.3.3.1 Acoustically Distinguishable Space (ADS). All parts of a building or area intended to have occupant notification are subdivided into ADSs as defined. Some ADSs might be designated to have voice communication capability and require that those communications be intelligible. Other spaces might not require voice intelligibility or might not be capable of reliable

voice intelligibility. An ADS might have acoustical design features that are conducive for voice intelligibility, or it might be a space where voice intelligibility could be difficult or impossible to achieve. Each is still referred to as an ADS. [72, 2010]

In smaller areas, such as those under 400 ft² (40 m²), walls alone will define the ADS. In larger areas, other factors might have to be considered. In spaces that might be subdivided by temporary or movable partitions, such as ballrooms and meeting rooms, each individual configuration should be considered a separate ADS. Physical characteristics, such as a change in ceiling height of more than 20 percent, or a change in acoustical finish, such as carpet in one area and tile in another, would require those areas to be treated as separate ADSs. In larger areas, there might be noise sources that require a section to be treated as a separate ADS. Any significant change in ambient noise level or frequency might necessitate an area be considered a separate ADS. [72, 2010]

In areas of 85 dBA or greater ambient sound pressure level, meeting the pass/fail criteria for intelligibility might not be possible, and other means of communication might be necessary. So, for example, the space immediately surrounding a printing press or other high-noise machine might be designated as a separate ADS, and the design might call for some form of effective notification but not necessarily require the ability to have intelligible voice communication. The aisles or operator's control stations might be separate ADSs where intelligible voice communication might be desired. [72, 2010]

Significant differences in furnishings, for example, an area with tables, desks, or low dividers, adjacent to an area with high shelving, would require separate consideration. The entire desk area could be a single acoustic zone, whereas each area between shelving could be a unique zone. Essentially, any noteworthy change in the acoustical environment within an area will mandate consideration of that portion of the area to be treated as an acoustic zone. Hallways and stairwells will typically be considered as individual acoustic zones. [72, 2010]

Spaces confined by walls with carpeting and acoustical ceilings can be deemed to be one ADS. An ADS should be an area of consistent size and material. A change of materials from carpet to hard tile, the existence of sound sources, such as decorative waterfalls, large expanses of glass, and changes in ceiling height, are all factors that might separate one ADS from another. [72, 2010]

Each ADS might require different components and design features to achieve intelligible voice communication. For example, two ADSs with similar acoustical treatments and noise levels might have different ceiling heights. The ADS with the lower ceiling height might require more ceiling-mounted

speakers to ensure that all listeners are in a direct sound field (see Figure A.3.3.1). Other ADSs might benefit from the use of alternate speaker technologies, such as line arrays, to achieve intelligibility. [72, 2010]

An ADS that differs from another because of the frequency and level of ambient noise might require the use of speakers and system components that have a wider frequency bandwidth than conventional emergency communications equipment. However, designers should not use higher bandwidth speakers in all locations, unless needed to overcome certain acoustic and ambient conditions. This is because the higher bandwidth appliance will require more energy to perform properly. This increases amplifier and wire size and power supply requirements. [72, 2010]

In some spaces, it might be impractical to achieve intelligibility, and, in such a case, alternatives to voice evacuation might be required within such areas. [72, 2010]

There might be some areas of a facility where there are several spaces of the same approximate size and the same acoustic properties. For example, there might be an office space with multiple individual offices, each with one speaker. If one or two are satisfactorily tested, there is no need to test all of them for speech intelligibility. [72, 2010]

A.3.3.8 Communications Center. Examples of functions of a communications center are as follows:

- (1) Communications between the public and the communications center
- (2) Communications between the communications centers, the emergency response agency (ERA), and emergency response facilities (ERFs)
- (3) Communications within the ERA and between different ERAs

[1221, 2010]

A.3.3.10 Emergency Response Agency (ERA). An ERA includes any public, governmental, private, industrial, or military organization that engages in the operations specified in the definition. [1221, 2010]

A.3.3.13 Fuel-Burning Appliance. Fuel-burning appliances include, but are not limited to, devices used for cooking, heating, lighting, or decorative purposes. Examples are wood stoves, portable space heaters, ranges, furnaces, water heaters, clothes dryers, gas refrigerators, and gas lamps.

A.3.3.19 Separate Sleeping Area. Bedrooms or sleeping rooms separated by other use areas, such as kitchens or living

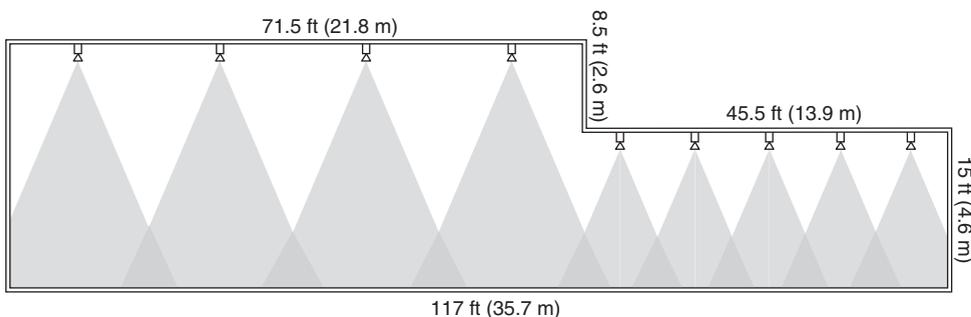


FIGURE A.3.3.1 Illustration Demonstrating the Effect of Ceiling Height. (Source: R. P. Schifiliti Associates, Inc.) [72, 2010]

rooms, but not bathrooms, are considered as separate sleeping areas for the purposes of this standard.

A.3.3.22.3 Combination System. Examples of non-fire systems are security, card access control, closed circuit television, sound reinforcement, background music, paging, sound masking, building automation, time, and attendance. [72: 2010]

A.4.3.3 This requirement does not apply to notification appliance circuits. [72: A.10.3.3]

A.4.3.4 A relay used for carbon monoxide safety functions is one possible example of such a situation.

A.4.4.3.1 It is not the intent to require personnel performing simple inspections or operational tests of initiating devices to require factory training or special certification provided such personnel can demonstrate knowledge in these areas. [72: A.10.4.3.1]

A.4.4.3.1(1) Factory training and certification is intended to allow an individual to service equipment only for which he or she has specific brand and model training. [72: A.10.4.3.1(1)]

A.4.4.3.1(2) Nationally recognized fire alarm certification programs might include those programs offered by the International Municipal Signal Association (IMSA) and National Institute for Certification in Engineering Technologies (NICET). NOTE: These organizations and the products or services offered by them have not been independently verified by the NFPA, nor have the products or services been endorsed or certified by the NFPA or any of its technical committees. [72: A.10.4.3.1(2)]

A.4.4.3.1(3) Licenses and certifications offered at a state or local level are intended to recognize those individuals who have demonstrated a minimum level of technical competency in the area of fire alarm servicing. [72: A.10.4.3.1(3)]

A.4.4.4.1(2) An example of an organization providing alarm monitoring operator training is the Central Station Alarm Association (CSAA). Note that this reference is for information purposes only, information concerning the product or service has been provided by the manufacturer or other outside sources, and the information concerning the product or service has not been independently verified nor has the product or service been endorsed or certified by the NFPA or any of its technical committees. [72: A.10.4.4.1(2)]

A.4.5.6.1 The secondary power supply is not required to supply power to the [carbon monoxide detection] system through parallel distribution paths. Automatic transfer switches are commonly used to allow secondary power to be supplied over the same distribution system as the primary power. [72: A.10.5.6.1]

The generator does not need to be dedicated to the [carbon monoxide detection] system. [72: A.10.5.6.1]

A.4.5.6.2.1 A combination system is a fire alarm system and is required to comply with *NFPA 72, National Fire Alarm and Signaling Code*.

A.4.5.6.2.2 An example of another standard is *NFPA 731, Standard for the Installation of Electronic Premises Security Systems*.

A.4.5.7 Where a computer system of any kind is used to receive and process alarm or supervisory signals, an uninterruptible power supply (UPS) with sufficient capacity to operate the system until the secondary supply is capable of operating the [carbon monoxide detection] system might be required in order to prevent signal loss or a greater than 10-second signal delay. [72: A.10.5.7]

UPS equipment often contains an internal bypass arrangement to supply the load directly from the line. These internal bypass arrangements are a potential source of failure. UPS equipment also requires periodic maintenance. It is, therefore, necessary to provide a means of promptly and safely bypassing and isolating the UPS equipment from all power sources while maintaining continuity of power supply to the equipment normally supplied by the UPS. [72: A.10.5.7]

A.4.6.3 Control unit signals can be audible, visible, or both for any particular function. Some older systems used only audible indicators that had to be coded in order for users to know what the signal meant. Where a control unit uses both audible and visible indicators, the purpose of the audible signal is to get someone's attention. In large system configurations, there might be multiple control units with audible signals. Also, there might be several different functions requiring an audible alert as a part of the whole signal. Thus, there could be several different audible signals. It is not the intent of the code to have separate and distinct audible signals where there is clear visual distinction that provides the user with the needed information. Visible signals, whether a lamp with a text label, an LCD screen, or a computer monitor, are a better form of human interface. [72: A.10.7.3]

A.4.6.4 A valve supervisory, a low-pressure switch, or another device intended to cause a supervisory signal when actuated should not be connected in series with the end-of-line supervisory device of initiating device circuits, unless a distinctive signal, different from a trouble signal, is indicated. [72: A.10.7.4]

A.4.7.2.7 Resetting of alarm signals should not require the simultaneous operation of multiple reset switches or the disconnection of any wiring or equipment to reset the alarm condition. [72: A.10.10.7]

A.4.9.7.2 The purpose of automatic trouble re-sound is to remind owners, or those responsible for the system, that the system remains in a fault condition. A secondary benefit is to possibly alert occupants of the building that the [carbon monoxide detection] system is in a fault condition. [72: A.10.12.8.3]

A.4.10.2 The operability of controlled mechanical equipment [] should be verified by periodic testing. Failure to test and properly maintain controlled mechanical equipment can result in operational failure during an emergency, with potential consequences up to and including loss of life. [72: A.10.13.2]

A.4.11.1(1) The requirement of 4.11.1(1) does not preclude transfer to secondary supply at less than 85 percent of nominal primary voltage, provided the requirements of 4.5.6 are met. [72: A.10.14.1(1)]

A.4.11.2.1 [Carbon monoxide] alarm specifications can include some or all of the following:

- (1) Address of the protected premises
- (2) Owner of the protected premises
- (3) Authority having jurisdiction
- (4) Applicable codes, standards, and other design criteria to which the system is required to comply
- (5) Type of building construction and occupancy
- (6) [Emergency forces] response point(s) and annunciator location(s)
- (7) Type of [carbon monoxide detection] system to be provided
- (8) Calculations (e.g., secondary supply and voltage drop calculations)
- (9) Type(s) of [carbon monoxide] alarm-initiating devices, supervisory alarm-initiating devices, and [] notification appliances to be provided

- (10) Intended area(s) of coverage
- (11) Complete list of detection, [] signaling, and annunciator zones
- (12) Complete list of [carbon monoxide safety] control functions
- (13) Complete sequence of operations detailing all inputs and outputs

[72: A.10.14.2.1]

A.4.12.3 The primary purpose of [carbon monoxide detection] system annunciation is to enable responding personnel to identify the location of [the carbon monoxide] quickly and accurately and to indicate the status of emergency equipment or [carbon monoxide] safety functions that might affect the safety of occupants in a [carbon monoxide] situation. [72: A.10.16.3]

A.4.13.1 The provision of a double loop or other multiple path conductor or circuit to avoid electrical monitoring is not acceptable. [72: A.10.17.1]

A.4.13.1.7 This standard does not have jurisdiction over the monitoring integrity of conductors within equipment, devices, or appliances. [72: A.10.17.1.8]

A.4.13.2.2 Because digital alarm communicator systems establish communications channels between the protected premises and the central station via the public switched telephone network, the requirement to supervise circuits between the protected premises and the central station (see 4.13.1) is considered to be met if the communications channel is periodically tested in accordance with 26.6.3.2.1.5 of *NFPA 72, National Fire Alarm and Signaling Code*. [72: A.10.17.3.2]

A.4.13.2.3 This requirement is intended to prevent all of the supervising stations in a given geographic area from transmitting simultaneous trouble signals (and overwhelming the associated supervising stations) in the event of a widespread power failure. A trouble signal is not intended to be transmitted if primary power is restored within the time delay.

A.4.14.1.2 Shop Drawing.

General. Shop drawings for [carbon monoxide detection] systems should provide basic information and should provide the basis for the record drawings required elsewhere in this standard. [72: A.10.18.1.2]

Content. Shop drawings should include, to an extent commensurate with the extent of the work being performed, floor plan drawings, riser diagrams, control panel wiring diagrams, point-to-point wiring diagrams, conduit, conductor routing, typical wiring diagrams, and other information as described herein. [72: A.10.18.1.2]

All shop drawings should be drawn on sheets of uniform size and should include the following information:

- (1) Name of protected premises, owner, and occupant (where applicable)
- (2) Name of installer or contractor
- (3) Location of protected premises
- (4) Device legend in accordance with NFPA 170, *Standard for Fire Safety and Emergency Symbols*
- (5) Date of issue and any revisions

[72: A.10.18.1.2]

Floor plan drawings should be drawn to an indicated scale and should include the following information:

- (1) Floor identification
- (2) Point of compass (indication of north)

- (3) Graphic scale
- (4) All walls and doors
- (5) Room descriptions
- (6) [Carbon monoxide] alarm device/component locations
- (7) Locations of [carbon monoxide] alarm primary power connection(s)
- (8) Locations of monitor/control interfaces to other systems
- (9) Riser locations
- (10) Type and number of [carbon monoxide detection] system components/devices on each circuit, on each floor or level
- (11) Type and quantity of conductors and conduit (if used) used for each circuit
- (12) Location of all supply and return air diffusers (where automatic detection is used)

[72: A.10.18.1.2]

[Carbon monoxide detection] system riser diagrams should include the following information:

- (1) General arrangement of the system in building cross-section
- (2) Number of risers
- (3) Type and number of circuits in each riser
- (4) Type and number of [carbon monoxide detection] system components/devices on each circuit, on each floor or level
- (5) Type and quantity of conductors and conduit (if used) for each circuit

[72: A.10.18.1.2]

Control unit wiring diagrams should be provided for all control equipment (i.e., equipment listed as either a control unit or control unit accessory), power supplies, battery chargers, and annunciators and should include the following information:

- (1) Identification of the control equipment depicted
- (2) Location(s)
- (3) All field wiring terminals and terminal identifications
- (4) All circuits connected to field wiring terminals and circuit identifications
- (5) All indicators and manual controls, including the full text of all labels
- (6) All field connections to supervising station signaling equipment, releasing equipment, and [carbon monoxide] safety control interfaces

[72: A.10.18.1.2]

Typical wiring diagrams should be provided for all initiating devices, notification appliances, remote indicators, annunciators, remote test stations, and end-of-line and power supervisory devices. [72: A.10.18.1.2]

A.4.14.1.4 Carbon monoxide detection systems are often installed under construction or remodeling contracts. All contractors should complete the portions of the record of completion form for the portions of the connected systems for which they are responsible. Several partially completed forms might be accepted by the authority having jurisdiction provided that all portions of the connected systems are covered in the set of forms.

A.4.14.2.1.1 The requirements of Chapter 8 should be used to perform the installation wiring and operational acceptance tests required when completing the record of completion. [72: A.10.18.2.1.1]

The record of completion form shall be permitted to be used to record decisions reached prior to installation regarding intended system type(s), circuit designations, device types, notification appliance type, power sources, and the means of transmission to the supervising station. [72: A.10.18.2.1.1]



A.4.14.2.3(1) The owner's manual should include the following:

- (1) A detailed narrative description of the system inputs, [] signaling, ancillary functions, annunciation, intended sequence of operations, expansion capability, application considerations, and limitations
- (2) Operator instructions for basic system operations, including alarm acknowledgment, system reset, interpretation of system output (LEDs, CRT display, and printout), and [] ancillary function controls, and change of printer paper
- (3) A detailed description of routine maintenance and testing as required and recommended and as would be provided under a maintenance contract, including testing and maintenance instructions for each type of device installed. This information should include the following:
 - (a) Listing of the individual system components that require periodic testing and maintenance
 - (b) Step-by-step instructions detailing the requisite testing and maintenance procedures, and the intervals at which these procedures shall be performed, for each type of device installed
 - (c) A schedule that correlates the testing and maintenance procedures that are recommended by A.4.14.2.3(1)(1)(3)(b) with the listing recommended by A.4.14.2.3(1)(1)(3)(a)
- (4) Detailed troubleshooting instructions for each trouble condition generated from the monitored field wiring, including opens, grounds, and loop failures [These instructions should include a list of all trouble signals annunciated by the system, a description of the condition(s) that causes such trouble signals, and step-by-step instructions describing how to isolate such problems and correct them (or how to call for service, as appropriate).]
- (5) A service directory, including a list of names and telephone numbers of those who provide service for the system

[72: A.10.18.2.3(1)]

A.5.2.1 Carbon monoxide detection for health and worker safety is not addressed in this standard. These systems are intended for ventilating spaces such as underground garages with detection levels lower than those addressed by this standard. Where carbon monoxide levels monitored and controlled by these systems reach life safety thresholds, the requirements of this standard should apply. Dual-purpose systems that include life safety thresholds would need to comply with this standard.

A.5.2.2.1.1 Compatibility between software systems is necessary to ensure that the systems can communicate correctly and that the overall system can function as intended. Unfortunately, software that is compatible can become incompatible when the software is updated. Newer revisions of software might not maintain compatibility with older revisions. This paragraph requires that the [carbon monoxide detection] software or firmware that interfaces with software or firmware in another system is compatible. [] The term "required" indicates that this compatibility requirement is intended for required functions [] and not for supplemental functions that are not part of the required operation of the [] system. An example of a supplemental function might be an RS-232 port that connects to a terminal emulator program used for maintenance purposes. The term "functionally" is intended to ensure that the intended functionality is maintained by the software. It is trying to avoid a situation where a change in software revision might still be compatible but changes the available functionality so that the two systems no longer perform the intended functions, even though the software communicates correctly. [72: A.23.2.2.1.1]

A.5.2.2.1.2 Compatibility between systems will be documented in one or the other (or both) of the manufacturer's installation documents for the compatible products and controlled by the listings agencies. This documentation will be referenced in the marking on the product. The documentation might be paper copy or electronic media (disk, web site, etc.). When a software revision changes, the documentation can be consulted to ensure that it is still compatible with the software or firmware on the other side of the interface. [72: A.23.2.2.1.2]

A.5.2.2.2 A commonly used method of protecting against unauthorized changes can be described as follows (in ascending levels of access):

- (1) *Access Level 1.* Access by persons who have a general responsibility for safety supervision, and who might be expected to investigate and initially respond to a [carbon monoxide] alarm or trouble signal
- (2) *Access Level 2.* Access by persons who have a specific responsibility for safety, and who are trained to operate the control unit
- (3) *Access Level 3.* Access by persons who are trained and authorized to do the following:
 - (a) Reconfigure the site-specific data held within the control unit, or controlled by it
 - (b) Maintain the control unit in accordance with the manufacturer's published instructions and data
- (4) *Access Level 4.* Access by persons who are trained and authorized either to repair the control unit or to alter its site-specific data or operating system program, thereby changing its basic mode of operation

[72: A.23.2.2.2]

A.5.2.4 Nonrequired carbon monoxide detection systems and components are those that are not required by building or fire codes and are installed voluntarily by a building owner to meet site-specific safety objectives. There is a need to properly document the nonrequired system and components. Nonrequired components must be operationally compatible in harmony with other required components and should not be detrimental to the overall system performance. It is for this reason that 5.2.4.1 mandates that nonrequired (voluntary) systems and components meet the applicable installation, testing, and maintenance requirements of this standard.

A.5.4.2.3 The installation of all system wiring should take into account the system manufacturer's published installation instructions, the limitations of the applicable product listings or approvals, and communications circuit protection as required by 5.4.2.3. [72: A.12.2.4]

A.5.4.2.3.2 Interbuilding circuits are considered to have a lightning exposure unless one or more of the following conditions exist:

- (1) Circuits in large metropolitan areas where buildings are close together and sufficiently high to intercept lightning.
- (2) Interbuilding cable runs of 140 ft (42 m) or less, directly buried or in underground conduit, where a continuous metallic cable shield or a continuous metallic conduit containing the cable is connected to each building grounding electrode system.
- (3) Areas having an average of five or fewer thunderstorm days per year and earth resistivity of less than 100 ohm-meters. Such areas are found along the Pacific coast. [70:800.90(A), FPN No. 2]

[72: A.12.2.4.2]