

REV.
A


AS22759/184

RATIONALE

SPECIFICATION UPDATED TO INCLUDE AS29606 CONDUCTOR REQUIREMENTS, ROHS RESTRICTIONS AND AS22759 MODIFICATIONS.

NOTICE

THE COMPLETE REQUIREMENTS FOR PROCURING THE PRODUCT DESCRIBED HEREIN SHALL CONSIST OF THIS DOCUMENT AND THE LATEST ISSUE OF AS22759.

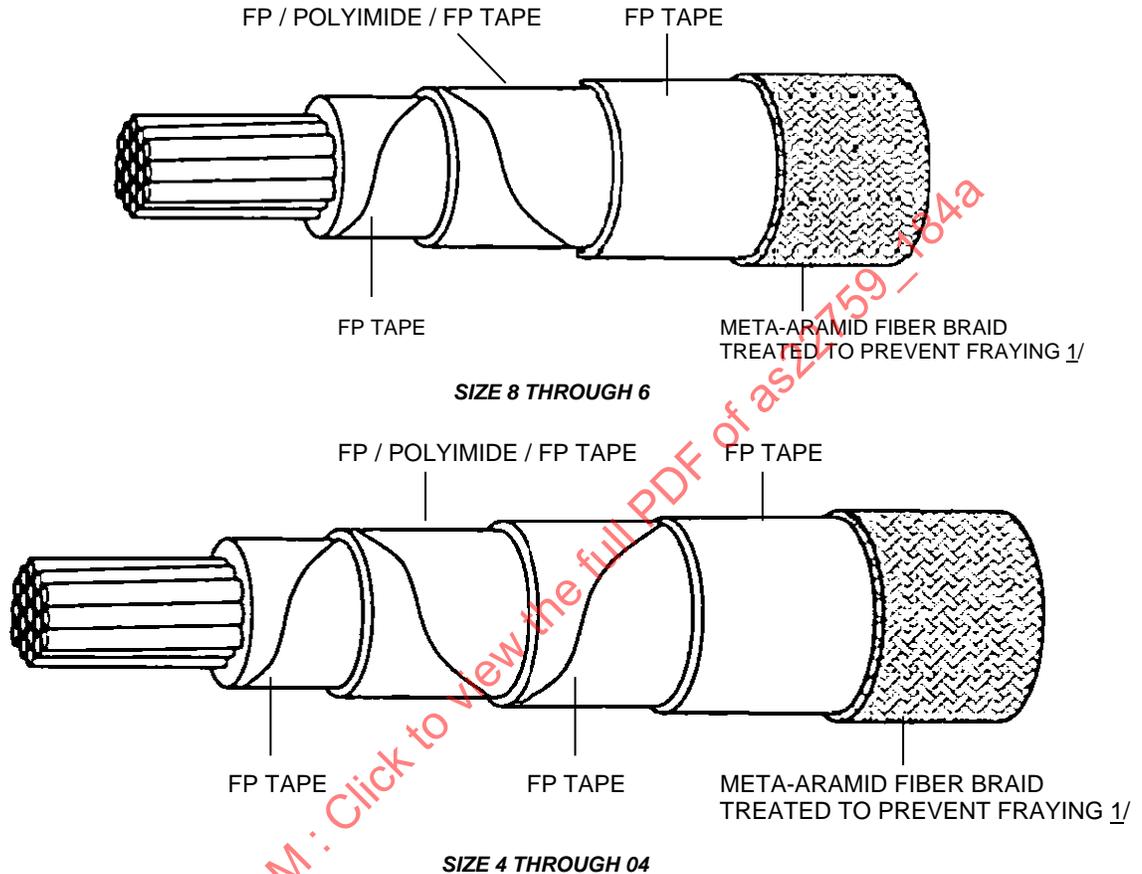


FP – FLUOROCARBON POLYMER MODIFIED POLYTETRAFLUOROETHYLENE (PTFE)
CONDUCTOR – STRANDED NICKEL COATED COPPER

^{1/} BRAID: BRIGHT AROMATIC POLYAMIDE YARN, 200 DENIER, 100 FILAMENTS, TIGHTLY FORMED, UNIFORM IN APPEARANCE, TREATED WITH A CLEAR FINISHER COATING. THE FINISHER COATING SHALL BE COMPATIBLE WITH THE TEMPERATURE RATING AND PERFORMANCE REQUIREMENTS OF THE INSULATED WIRE. BRAID SHALL GRIP THE UNDERLYING INSULATION SUFFICIENTLY AS TO NOT SLIDE ALONG THE TAPE SURFACE DURING NORMAL HANDLING.

FIGURE 1 - AS22759/184 CONFIGURATION

SAE values your input. To provide feedback on this Technical Report, please visit http://www.sae.org/technical/standards/AS22759_184a

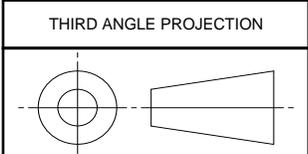

CUSTODIAN: AE-8/AE-8D

PROCUREMENT SPECIFICATION: NONE



AEROSPACE STANDARD

(R) WIRE, ELECTRICAL, POLYTETRAFLUOROETHYLENE/ POLYIMIDE INSULATED, SMOOTH SURFACE, NORMAL WEIGHT, NICKEL-COATED COPPER CONDUCTOR, 260 °C, 600 VOLTS ROHS

AS22759/184
SHEET 1 OF 4

REV. A

SAE Technical Standards Board Rules provide that: "This report is published by SAE to advance the state of technical and engineering sciences. The use of this report is entirely voluntary, and its applicability and suitability for any particular use, including any patent infringement arising therefrom, is the sole responsibility of the user." SAE reviews each technical report at least every five years at which time it may be revised, reaffirmed, stabilized, or cancelled. SAE invites your written comments and suggestions.

ISSUED 2010-02 REVISED 2014-12

TABLE 1 - CONSTRUCTION DETAILS

PART NO. 1/	WIRE SIZE	CONDUCTOR 4/				FINISHED WIRE 3/				
		STRANDING (NUMBER OF STRANDS X AWG GAUGE OF STRANDS)	DIAMETER (IN)		RESISTANCE AT 20 °C (68 °F) (OHMS/1000 FT MAX)	DIAMETER (IN)		WEIGHT (LB/1000 FT) 2/		
			MIN	MAX		MIN	MAX	MIN	TARGET	MAX
M22759/184-8-*	8	133 X 29	.158	.169	.694	.192	.213	58.4	60.5	62.6
M22759/184-6-*	6	133 X 27	.198	.212	.436	.231	.254	88.2	90.6	93.0
M22759/184-4-*	4	133 X 25	.250	.268	.275	.288	.313	142	146	150
M22759/184-2-*	2	665 X 30	.320	.340	.177	.356	.389	213	222	231
M22759/184-1-*	1	817 X 30	.360	.380	.144	.400	.433	280	289	298
M22759/184-01-*	0	1045 X 30	.395	.425	.113	.432	.475	331	344	357
M22759/184-02-*	00	1330 X 30	.440	.475	.089	.487	.530	414	434	454
M22759/184-03-*	000	1665 X 30	.500	.540	.071	.542	.585	524	537	550
M22759/184-04-*	0000	2109 X 30	.565	.605	.056	.602	.655	654	675	696

- 1/ PART NUMBER: THE PREFERRED COLOR IS DARK GREEN WITH A COLOR DESIGNATOR OF 5D. EXAMPLE: SIZE 2 DARK GREEN – AS22759/184-2-5D. WHITE IS AN ACCEPTABLE ALTERNATIVE WITH A COLOR DESIGNATOR OF 9.
- 2/ THE ACCEPTABLE VALUE FOR THE CPK FOR THE FINISHED WIRE WEIGHT LISTED SHALL BE 1.3, USING A NORMAL (GAUSSIAN) DISTRIBUTION TO OBTAIN THOSE CPK VALUES.
- 3/ THE WIRE CONSTRUCTION SHALL HAVE A SMOOTH POLYTETRAFLUOROETHYLENE (PTFE) OUTER LAYER WITH COMPLETE BONDING BETWEEN THE HOMOGENEOUS LAYERS.
- 4/ CONDUCTOR SHALL CONFORM TO AS29606 TYPE NCC SMALL DIAMETER NICKEL COATED COPPER CONDUCTOR FOR WIRE SIZES 8 THROUGH 4 AND GENERAL PURPOSE FOR WIRE SIZES 2 THROUGH 0000.

REQUIREMENT: ALL REQUIREMENTS SHALL CONSIST OF THIS DOCUMENT AND THE LATEST ISSUE OF AS22759.

1. WIRE CONSTRUCTION

WIRE CONSTRUCTION SHALL BE IN ACCORDANCE WITH FIGURE 1, TABLE 1, 2, 3, AND 4.

TABLE 2 - WIRE INSULATION MATERIAL

TAPE CODE	THICKNESS (NOM)	MATERIAL
1	.0020	.0005 (FP)/.0010 (POLYIMIDE)/.0005 (FP)
2	.0020	FP (SKIVED)
3	.0030	FP (UNSINTERED)
4	.0010	FP (SKIVED)

TABLE 3 - TAPE OVERLAP REQUIREMENTS 1/

WIRE SIZE	WRAP 1		WRAP 2		WRAP 3		WRAP 4		NOMINAL WALL THICKNESS (MILS) 2/	
	TAPE CODE	PERCENT OVERLAP		TAPE CODE	PERCENT OVERLAP		TAPE CODE	PERCENT OVERLAP		
		MIN	MAX		MIN	MAX		MIN		MAX
8	4	20.5	35.0	1	50.5	55.0	3	67.0	71.0	13.2
6	4	20.5	35.0	1	50.5	55.0	3	67.0	71.0	13.2
4	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	16.2
2	2	20.5	35.0	1	50.5	55.9	3	50.5	54.0	16.2
1	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	16.2
1/0	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	16.2
2/0	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	16.2
3/0	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	16.2
4/0	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	16.2

- 1/ WRAP 1 IS THE INNERMOST TAPE WHICH IS IN CONTACT WITH THE CONDUCTOR. WRAPS 2, 3, AND 4 ARE PROGRESSIVELY FURTHER AWAY FROM THE CONDUCTOR CORE.
- 2/ NOMINAL WALL THICKNESS DOES NOT INCLUDE THE POLYAMIDE BRAID THICKNESS.

	AEROSPACE STANDARD	AS22759/184 SHEET 2 OF 4	REV. A
	(R) WIRE, ELECTRICAL, POLYTETRAFLUOROETHYLENE/ POLYIMIDE INSULATED, SMOOTH SURFACE, NORMAL WEIGHT, NICKEL-COATED COPPER CONDUCTOR, 260 °C, 600 VOLTS ROHS		

2. WIRE PERFORMANCE RATING

TEMPERATURE RATING: 260 °C (500 °F) MAXIMUM CONDUCTOR CONTINUOUS TEMPERATURE

VOLTAGE RATING: 600 VOLTS (RMS) AT SEA LEVEL. THIS INSULATION SYSTEM HAS BEEN USED IN AEROSPACE APPLICATIONS USING 115 VOLTS (PHASE TO NEUTRAL), 400 HERTZ AC AND 28 VOLTS DC. VERIFICATION OF THE SUITABILITY OF THIS PRODUCT FOR USE IN OTHER ELECTRICAL SYSTEM CONFIGURATIONS IS THE RESPONSIBILITY OF THE USER.

3. MATERIALS AND PHYSICAL PROPERTIES

SEE AS22759 FOR MATERIAL REQUIREMENT. MATERIALS USED IN THE MANUFACTURE OF THESE PRODUCTS SHALL COMPLY WITH THE RESTRICTION OF HAZARDOUS SUBSTANCES DIRECTIVE 2002/95/EC.

4. FINISH WIRE INSULATION PROPERTIES

FINISH WIRE INSULATION PROPERTIES SHALL BE IN ACCORDANCE WITH TABLE 4.

TABLE 4 - FINISHED WIRE INSULATION PROPERTIES REQUIREMENTS

INSULATION PROPERTIES	
IMPULSE TEST VOLTAGE	8.0 KILOVOLTS (PEAK)
HIGH FREQUENCY TEST VOLTAGE	5.7 KILOVOLTS (RMS)
TAPE OVERLAP	TABLE 3
LAMINATION SEALING	260 °C ± 2 °C (500 °F ± 3.6 °F), 6 HOURS
INSULATION BLOCKING	260 °C ± 2 °C (500 °F ± 3.6 °F)
SHRINKAGE	290 °C ± 2 °C (554 °F ± 3.6 °F) MAXIMUM CHANGE .125 INCHES
ELECTRICAL RESISTANCE (IR)	3000 MEGOHMS (MIN)-1000 FEET
WET DIELECTRIC VOLTAGE	2500 VOLTS (RMS), 60 HERTZ
CONTINUOUS LENGTH SCHEDULE	B

5. FINISH WIRE IDENTIFICATION

WIRE IDENTIFICATION EXCEPTIONS: NONE

WIRE IDENTIFICATION DURABILITY: NOT REQUIRED

STRIPE AND BAND DURABILITY: NOT REQUIRED

6. FINISH WIRE PERFORMANCE

FINISH WIRE FIXTURES APPLICABLE TO EACH WIRE SIZE SHALL BE IN ACCORDANCE WITH TABLE 5.

TABLE 5 - TEST MANDREL AND TEST LOAD REQUIREMENTS

WIRE SIZE (AWG)	TEST MANDREL DIAMETER ^{1/} (INCHES)			TEST LOAD (LB)	
	COLD BEND	LIFE CYCLE/ BEND TEST	WRAP	COLD BEND	LIFE CYCLE/ BEND TEST
8	4.00	3.00	.750	10.00	4.00
6	5.00	4.00	1.00	10.00	4.00
4	6.00	5.00	1.25	15.00	4.50
2	8.00	6.00	2.00	15.00	6.00
1	10.00	8.00	2.50	15.00	6.00
0	10.00	8.00	3.00	15.00	6.00
00	12.00	10.00	4.00	20.00	8.00
000	18.00	10.00	5.00	30.00	10.00
0000	18.00	10.00	6.00	30.00	10.00

^{1/} TOLERANCE SHALL BE ±3 PERCENT OF THE GIVEN VALUES.

	AEROSPACE STANDARD	AS22759/184 SHEET 3 OF 4	REV. A
	(R) WIRE, ELECTRICAL, POLYTETRAFLUOROETHYLENE/ POLYIMIDE INSULATED, SMOOTH SURFACE, NORMAL WEIGHT, NICKEL-COATED COPPER CONDUCTOR, 260 °C, 600 VOLTS ROHS		