

REV.
E

AS22759™/84


FEDERAL SUPPLY CLASS
6145

RATIONALE

REMOVAL OF THE INTENDED USE LIMITATION FOR NAVAL AIRCRAFT AND NAVAL AIR SYSTEMS APPLICATION IS REQUIRED TO SYNCHRONIZE THIS DOCUMENT WITH THE REQUIREMENT OF AS50881.

NOTICE

THE COMPLETE REQUIREMENTS FOR PROCURING THE PRODUCT DESCRIBED HEREIN SHALL CONSIST OF THIS DOCUMENT AND THE LATEST ISSUE OF AS22759.

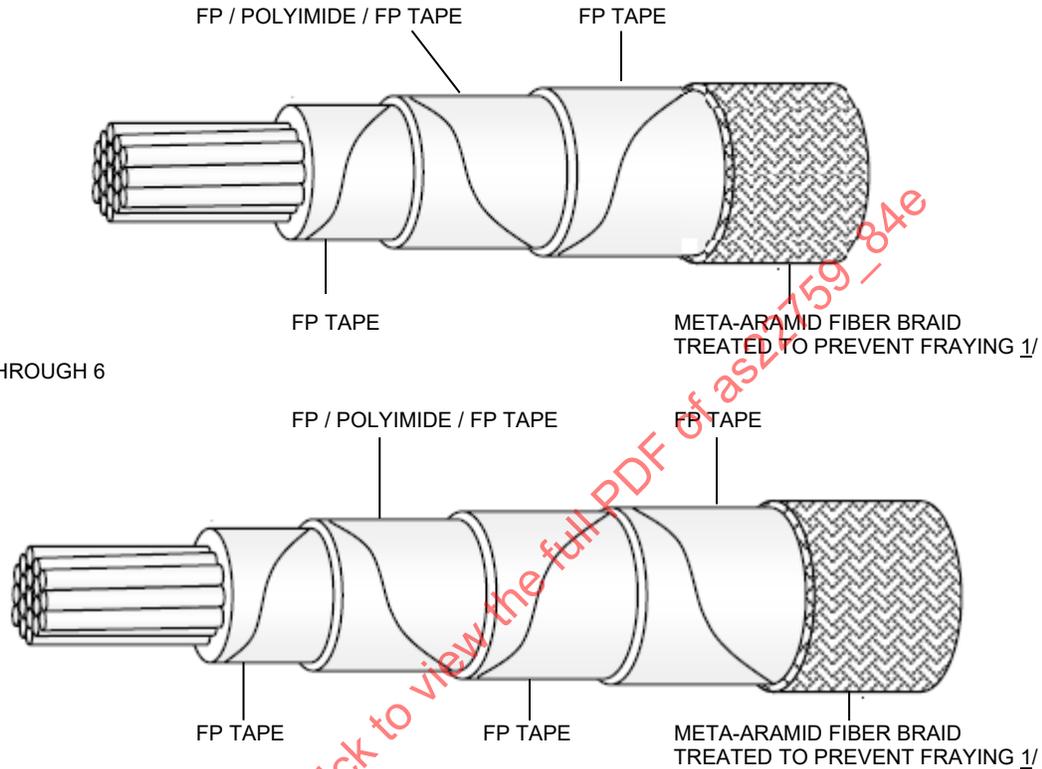


SIZE 8 THROUGH 6
FP – FLUOROCARBON POLYMER MODIFIED POLYTETRAFLUOROETHYLENE (PTFE)
CONDUCTOR – STRANDED NICKEL COATED COPPER

1/ BRAID: BRIGHT AROMATIC POLYAMIDE YARN, 200 DENIER, 100 FILAMENTS, TIGHTLY FORMED, UNIFORM IN APPEARANCE, TREATED WITH A CLEAR FINISHER COATING. THE FINISHER COATING SHALL BE COMPATIBLE WITH THE TEMPERATURE RATING AND PERFORMANCE REQUIREMENTS OF THE INSULATED WIRE. BRAID SHALL GRIP THE UNDERLYING INSULATION SUFFICIENTLY AS TO NOT SLIDE ALONG THE TAPE SURFACE DURING NORMAL HANDLING.

FIGURE 1 - AS22759/84 CONFIGURATION

For more information on this standard, visit
<https://www.sae.org/standards/content/AS22759/84E/>

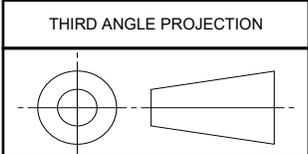

CUSTODIAN: AE-8/AE-8D

PROCUREMENT SPECIFICATION: NONE



AEROSPACE STANDARD

WIRE, ELECTRICAL, POLYTETRAFLUOROETHYLENE/
POLYIMIDE INSULATED, NORMAL WEIGHT, NICKEL COATED,
COPPER CONDUCTOR, 260 °C, 600 VOLT, ROHS

AS22759™/84
SHEET 1 OF 4

REV.
E

SAE Executive Standards Committee Rules provide that: " This report is published by SAE to advance the state of technical and engineering sciences. The use of this report is entirely voluntary, and its applicability and suitability for any particular use, including any patent infringement arising therefrom, is the sole responsibility of the user." SAE reviews each technical report at least every five years at which time it may be revised, reaffirmed, stabilized, or cancelled. SAE invites your written comments and suggestions.

ISSUED 2000-06 REVISED 2022-03

TABLE 1 - CONSTRUCTION DETAILS FOR FINISHED WIRE

PART NO. <u>1/</u>	WIRE SIZE	CONDUCTOR <u>3/</u>			FINISHED WIRE					
		STRANDING (NUMBER OF STRANDS X SIZE GAUGE OF STRANDS)	DIAMETER (INCH)		RESISTANCE AT 20 °C (68 °F) (OHMS/1000 FT MAX)	DIAMETER (INCH)		WEIGHT (LB/1000 FT.) <u>2/</u>		
			MIN	MAX		MIN	MAX	MIN	TARGET	MAX
M22759/84-8	8	133 X 29	.158	.169	.694	.192	.213	59.6	61.7	63.8
M22759/84-6	6	133 X 27	.198	.212	.436	.231	.254	91.1	93.5	95.9
M22759/84-4	4	133 X 25	.250	.268	.275	.288	.313	147	151	155
M22759/84-2-*	2	665 X 30	.320	.340	.177	.356	.389	220	229	238
M22759/84-1-*	1	817 X 30	.360	.380	.144	.400	.433	271	280	289
M22759/84-01-*	0	1045 X 30	.395	.425	.113	.432	.475	342	355	368
M22759/84-02-*	00	1330 X 30	.440	.475	.089	.487	.530	422	442	462
M22759/84-03-*	000	1665 X 30	.500	.540	.071	.542	.585	534	554	574
M22759/84-04-*	0000	2109 X 30	.565	.605	.056	.602	.655	684	706	728

1/ PART NUMBER: THE PREFERRED COLOR IS DARK GREEN WITH THE COLOR DESIGNATOR 5D. EXAMPLE: SIZE 2 DARK GREEN - AS22759/84-2-5D. WHITE IS AN ACCEPTABLE ALTERNATE WITH A COLOR DESIGNATOR 9.

2/ THE ACCEPTABLE VALUE FOR THE CPK FOR THE FINISHED WIRE WEIGHT LISTED SHALL BE 1.3, USING A NORMAL (GAUSSIAN) DISTRIBUTION TO OBTAIN THOSE CPK VALUES.

3/ CONDUCTOR SHALL CONFORM TO AS29606 TYPE NCC SMALL DIAMETER NICKEL COATED COPPER CONDUCTOR FOR WIRE SIZES 8 THROUGH 4 AND GENERAL PURPOSE FOR WIRE SIZES 2 THROUGH 0000.

REQUIREMENTS: ALL REQUIREMENTS SHALL CONSIST OF THIS DOCUMENT AND THE LATEST ISSUE OF AS22759.

1. WIRE CONSTRUCTION:

WIRE CONSTRUCTION SHALL BE IN ACCORDANCE WITH FIGURE 1 AND TABLES 1, 2, 3, AND 4.

TABLE 2 - WIRE INSULATION MATERIALS

TAPE CODE	THICKNESS NOMINAL	MATERIAL
1	.0020	.0005 (FP)/.0010 (POLYIMIDE)/.0005 (FP)
2	.0020	EP (SKIVED)
3	.0030	FP (UNSINTERED OR PRESINTERED BONDABLE)
4	.0010	FP (SKIVED)

TABLE 3 - TAPE OVERLAP REQUIREMENTS 1/

WIRE SIZE	WRAP 1		WRAP 2		WRAP 3		WRAP 4		NOMINAL WALL THICKNESS (MILS) <u>2/</u>				
	TAPE CODE	PERCENT OVERLAP		TAPE CODE	PERCENT OVERLAP		TAPE CODE	PERCENT OVERLAP					
		MIN	MAX		MIN	MAX		MIN		MAX	MIN	MAX	
8	4	20.5	35.0	1	50.5	55.0	3	67.0	71.0			13.2	
6	4	20.5	35.0	1	50.5	55.0	3	67.0	71.0			13.2	
4	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	3	50.5	54.0	16.2
2	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	3	50.5	54.0	16.2
1	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	3	50.5	54.0	16.2
1/0	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	3	50.5	54.0	16.2
2/0	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	3	50.5	54.0	16.2
3/0	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	3	50.5	54.0	16.2
4/0	2	20.5	35.0	1	50.5	55.0	3	50.5	54.0	3	50.5	54.0	16.2

1/ WRAP 1 IS INNERMOST TAPE WHICH IS IN CONTACT WITH THE CONDUCTOR. WRAPS 2, 3, AND 4 ARE PROGRESSIVELY FURTHER AWAY FROM THE CONDUCTOR CORE.

2/ NOMINAL WALL THICKNESS DOES NOT INCLUDE THE POLYAMIDE BRAID THICKNESS.

	AEROSPACE STANDARD		AS22759™/84 SHEET 2 OF 4	REV. E
	WIRE, ELECTRICAL, POLYTETRAFLUOROETHYLENE/ POLYIMIDE INSULATED, NORMAL WEIGHT, NICKEL COATED, COPPER CONDUCTOR, 260 °C, 600 VOLT, ROHS			

2. WIRE PERFORMANCE RATING:

TEMPERATURE RATING: 260 °C (500 °F) MAXIMUM CONDUCTOR CONTINUOUS TEMPERATURE.

VOLTAGE RATING: 600 VOLTS (RMS) AT SEA LEVEL. THIS INSULATION SYSTEM HAS BEEN USED IN AEROSPACE APPLICATIONS USING 115 VOLTS (PHASE TO NEUTRAL), 400 HERTZ AC AND 28 VOLTS DC. VERIFICATION OF THE SUITABILITY OF THIS PRODUCT FOR USE IN OTHER ELECTRICAL SYSTEM CONFIGURATIONS IS THE RESPONSIBILITY OF THE USER.

3. MATERIALS AND PHYSICAL PROPERTIES:

REFER TO AS22759 FOR MATERIAL REQUIREMENT. MATERIALS USED IN THE MANUFACTURE OF THESE PRODUCTS SHALL COMPLY WITH THE RESTRICTION OF HAZARDOUS SUBSTANCES DIRECTIVE 2002/95/EC.

4. FINISH WIRE INSULATION PROPERTIES:

FINISH WIRE INSULATION PROPERTIES SHALL BE IN ACCORDANCE WITH TABLE 4.

TABLE 4 - FINISHED WIRE INSULATION PROPERTIES REQUIREMENTS

INSULATION PROPERTIES	
IMPULSE TEST VOLTAGE	8.0 KILOVOLTS (PEAK)
HIGH FREQUENCY TEST VOLTAGE	5.7 KILOVOLTS (RMS)
TAPE OVERLAP	TABLE 3
LAMINATION SEALING	260 °C ± 2 °C (500 °F ± 3.6 °F), 6 HOURS
INSULATION BLOCKING	260 °C ± 2 °C (500 °F ± 3.6 °F)
SHRINKAGE	290 °C ± 2 °C (554 °F ± 3.6 °F)
	MAXIMUM CHANGE .125 INCHES
ELECTRICAL RESISTANCE (IR)	3000 MEGOHMS (MIN) - 1000 FEET
WET DIELECTRIC VOLTAGE	2500 VOLTS (RMS), 60 HERTZ
CONTINUOUS LENGTH SCHEDULE	B

5. FINISH WIRE IDENTIFICATION:

WIRE IDENTIFICATION EXCEPTIONS: NONE

WIRE IDENTIFICATION DURABILITY: NOT REQUIRED

STRIPE AND BAND DURABILITY: NOT REQUIRED

6. FINISH WIRE PERFORMANCE:

FINISH WIRE FIXTURES APPLICABLE TO EACH WIRE SIZE SHALL BE IN ACCORDANCE WITH TABLE 5.

TABLE 5 - TEST MANDREL AND TEST LOAD REQUIREMENTS

WIRE SIZE (AWG)	TEST MANDREL DIAMETER ^{1/} (INCH)			TEST LOAD ^{1/} (LB)	
	COLD BEND	LIFE CYCLE/ BEND TEST	WRAP	COLD BEND	LIFE CYCLE/ BEND TEST
8	4.00	3.00	.750	10.00	4.00
6	5.00	4.00	1.00	10.00	4.00
4	6.00	5.00	1.25	15.00	4.50
2	8.00	6.00	2.00	15.00	6.00
1	10.00	8.00	2.50	15.00	6.00
0	10.00	8.00	3.00	15.00	6.00
00	12.00	10.00	4.00	20.00	8.00
000	18.00	10.00	5.00	30.00	10.00
0000	18.00	10.00	6.00	30.00	10.00

^{1/} TOLERANCE SHALL BE ±3% OF THE GIVEN VALUES.

	AEROSPACE STANDARD	AS22759™/84 SHEET 3 OF 4	REV. E
	WIRE, ELECTRICAL, POLYTETRAFLUOROETHYLENE/ POLYIMIDE INSULATED, NORMAL WEIGHT, NICKEL COATED, COPPER CONDUCTOR, 260 °C, 600 VOLT, ROHS		