



UL 2017

STANDARD FOR SAFETY

General-Purpose Signaling Devices and Systems

ULNORM.COM : Click to view the full PDF of UL 2017 2024

ULNORM.COM : Click to view the full PDF of UL 2017 2024

UL Standard for Safety for General-Purpose Signaling Devices and Systems, UL 2017

Second Edition, Dated December 23, 2008

Summary of Topics

This revision of ANSI/UL 2017 dated January 17, 2024 is being issued to update the title page to reflect the most recent designation as a Reaffirmed American National Standard (ANS). No technical changes have been made.

Text that has been changed in any manner or impacted by ULSE's electronic publishing system is marked with a vertical line in the margin.

The requirements are substantially in accordance with Proposal(s) on this subject dated December 1, 2023.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of ULSE Inc. (ULSE).

ULSE provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will ULSE be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if ULSE or an authorized ULSE representative has been advised of the possibility of such damage. In no event shall ULSE's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

Users of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold ULSE harmless from and against any loss, expense, liability, damage, claim, or judgment (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 2017 2024

DECEMBER 23, 2008
(Title Page Reprinted: January 17, 2024)



ANSI/UL 2017-2018 (R2024)

1

UL 2017

Standard for General-Purpose Signaling Devices and Systems

First Edition – January, 2000

Second Edition

December 23, 2008

This ANSI/UL Standard for Safety consists of the Second Edition including revisions through January 17, 2024.

The most recent designation of ANSI/UL 2017 as a Reaffirmed American National Standard (ANS) occurred on January 17, 2024. ANSI approval for a standard does not include the Cover Page, Transmittal Pages, and Title Page.

Comments or proposals for revisions on any part of the Standard may be submitted to ULSE at any time. Proposals should be submitted via a Proposal Request in the Collaborative Standards Development System (CSDS) at <https://csds.ul.com>.

Our Standards for Safety are copyrighted by ULSE Inc. Neither a printed nor electronic copy of a Standard should be altered in any way. All of our Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of ULSE Inc.

COPYRIGHT © 2024 ULSE INC.

ULNORM.COM - Click to view the full PDF of UL 2017 2024

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 2017 2024

CONTENTS

INTRODUCTION

1	Scope	7
2	General	8
	2.1 Components	8
	2.2 Units of measurement	8
	2.3 Undated references	8
3	Glossary	8
4	Equipment Types	13
5	Installation and Operating Instructions	13
6	Compatibility	13

CONSTRUCTION

ALL PRODUCTS

7	General	14
8	Enclosure	14
	8.1 General	14
	8.2 Metallic material	14
	8.3 Polymeric materials	17
	8.4 Covers	18
	8.5 Battery compartments	19
	8.6 Enclosure openings – general	19
	8.7 Enclosure top openings	19
	8.8 Enclosure side openings	20
	8.9 Enclosure bottom openings	23
	8.10 Gaskets	23
9	Internal Materials	24
10	Accessibility of Uninsulated Live Parts, Film-Coated Wire, and Moving Parts	24
11	Mechanical Assembly	26
12	Protection Against Corrosion	27
13	Branch-Circuit Connection	27
	13.1 General	27
	13.2 Permanently connected	28
	13.3 Cord-connected product	29
14	Other Field-Wiring Connections	32
	14.1 General	32
	14.2 Field-wiring compartment	32
	14.3 Power-limited circuits	32
	14.4 Field-wiring terminals (general application)	33
	14.5 Field-wiring terminals (qualified application)	34
	14.6 Field-wiring leads	35
	14.7 Cords and plugs	35
15	Internal Wiring	36
	15.1 General	36
	15.2 Splices and connections	36
	15.3 Connectors and receptacles	37
16	Polarization	37
17	Current-Carrying Parts	37
18	Spacings	37
19	Insulating Material	39
20	Printed-Wiring Boards	39

21	End-of-Line Devices	39
22	Components	40
	22.1 Dropping resistors	40
	22.2 Coil windings	40
	22.3 Switches	40
23	Batteries	40
	23.1 Rechargeable, storage-type used as standby power source	40
	23.2 Primary, dry-cell batteries	40
	23.3 Lithium batteries	41
24	Grounding for Products Containing High-Voltage Circuits	41
25	Servicing Protection	47
	25.1 General	47
	25.2 Trained service personnel	47
	25.3 Antenna terminal discharge assembly	48

PROTECTION AGAINST INJURY TO PERSONS

26	General	48
27	Handles	49
28	Wall- or Ceiling-Mounted Equipment	49
29	Telescoping Antenna	49
30	Sharp Edges	49
31	Enclosures and Guards for Moving Parts	49
32	Switches and Controls – Injury to Persons	50
33	Stability	51

PERFORMANCE

ALL PRODUCTS

34	General	52
35	Maximum Rated Load	52
36	Electrical Measurement Test – Input and Output Current and Voltage Test	52
37	Leakage Current Test	52
38	Temperature Test	55
39	Dielectric Voltage-Withstand Test	58
40	Electric Shock Current Test	59
41	Abnormal Operation Test	62
	41.1 General	62
	41.2 Field-wiring circuits	63
	41.3 Electronic components	63
	41.4 Transformer burnout	64
	41.5 Communications circuits	65
42	Class 2 and Class 3 Power-Limited Circuits Test	65
	42.1 General	65
	42.2 Maximum voltage	67
	42.3 Maximum current	67
43	Jarring Test	68
44	Strain-Relief Test – Cord-Connected Products	69
45	Strain-Relief Test – Field Connection Leads	69
46	Handle Strength Test	69
47	Antenna End-Piece Secureness Test	69
48	Mechanical Strength Test for Metal Enclosures and Guards and Enclosure Parts Secured with Adhesive	69
49	Wall- or Ceiling-Mount Test	72

50	Ignition Test through Bottom-Panel Openings	72
51	Rain Test	73
52	Drop Test.....	76
53	Immersion Test.....	76
54	Gasket Accelerated Aging Test.....	76
55	Gasket Low Temperature Test – Outdoor Use.....	77
56	Tests on Special Terminal Assemblies.....	77
	56.1 General.....	77
	56.2 Mechanical secureness.....	78
	56.3 Flexing test	78
	56.4 Millivolt drop test.....	78
	56.5 Temperature test	78

TESTS – EMERGENCY-SIGNALING USE EQUIPMENT

57	General	79
58	General System Functions.....	79
	58.1 General.....	79
	58.2 Power sources	80
	58.3 Program-controlled products and systems.....	80
59	Type AM (Attendant-Monitored) Emergency-Signaling Products	82
	59.1 General.....	82
	59.2 Annunciation, display, and recording	83
	59.3 Power sources	86
	59.4 Installation conductors and other signaling paths.....	87
	59.5 Emergency audio announcement and paging system	95
	59.6 Two-way telephone and intercom systems.....	96
60	Type SM (Self-Monitored) Emergency-Signaling Devices	97
	60.1 General.....	97
	60.2 Display information	98
61	Type UM (User-Monitored) Emergency-Signaling Devices.....	100
62	Variable Voltage Operation Test.....	100
	62.1 General.....	100
	62.2 Power output circuits providing regulated power.....	101
	62.3 Power output circuits supplying specific application devices.....	101
	62.4 Battery trouble voltage determination	101
63	Variable Ambient Temperature and Humidity Tests.....	103
64	Overload Test.....	103
65	Endurance Test.....	104
	65.1 General.....	104
	65.2 Audible signaling appliance	105
66	Polarity Reversal Test.....	105
67	Battery Replacement Test.....	106
68	Battery Tests.....	106
69	Charging Current Test.....	107
	69.1 General.....	107
	69.2 Discharge battery	107
	69.3 Charged battery.....	107
	69.4 Discharged battery – second trial	107
70	Transient Tests.....	108
	70.1 General.....	108
	70.2 Supply-line transients.....	108
	70.3 Internally-induced transients.....	108
	70.4 Signaling-circuit transients.....	108
71	Component Temperature Test	109
72	Audibility Test.....	110

72.1	General.....	110
72.2	Sound output measurement	110
73	Corrosion Tests – Outdoor-Use	111
73.1	General.....	111
73.2	Salt-spray test	111
73.3	Hydrogen-sulfide (H ₂ S) test	112
73.4	Sulfur-dioxide/carbon-dioxide (SO ₂ /CO ₂) test.....	112
74	Dust Test – Outdoor-Use.....	112
75	Short-Range Radio-Frequency (RF) Devices.....	113
75.1	General.....	113
75.2	Reference level determination	113
75.3	Interference immunity	113
75.4	Frequency selectivity	114
75.5	Clash.....	114
75.6	Clash error	115
75.7	Error (falsing) rate	116
75.8	Throughput rate.....	116
75.9	Transmitter stability tests.....	117
75.10	Transmitter accelerated aging test.....	117
76	Long-Range Radio-Frequency (RF) Devices	118
76.1	General.....	118
76.2	Reference signal level.....	118
76.3	Throughput rate test.....	118
76.4	Error (falsing) rate test.....	119
76.5	Adjacent channel rejection test	119
76.6	Intermodulation rejection test.....	120
76.7	Spurious response rejection test.....	120
76.8	Clash.....	121

TESTS – RESIDENTIAL WATER-HAZARD ENTRANCE ALARM EQUIPMENT

77	General	122
78	Operation Test	122
79	Audibility Test.....	123
80	Static Discharge Test.....	123

MANUFACTURING AND PRODUCTION-LINE TESTS

81	Production-Line Dielectric Voltage-Withstand Test	123
82	Production-Line Grounding Continuity Test.....	124

MARKING AND INSTRUCTION

83	Marking	124
83.1	General.....	124
83.2	Permanence of marking	127
84	Installation Wiring Diagram	127

APPENDIX A

Standards for Components	130
--------------------------------	-----

INTRODUCTION

1 Scope

1.1 These requirements cover signaling devices intended for emergency or non-emergency use, used in indoor and/or outdoor locations, and where applicable, installed and used in accordance with the National Electrical Code, NFPA 70.

1.2 Emergency-signaling products covered by these requirements are categorized as indicated below, are associated with property and/or life safety and are of a non-fire/non-security alarm nature. These products are evaluated with regard to product safety and to appropriateness of signaling.

a) Type UM (User-Monitored) devices or systems are intended to be monitored and tested by the user. These devices are intended for household use or are personal signaling devices carried by the user.

b) Type SM (Self-Monitored) devices or systems are intended to be self-monitoring. These devices are intended for, but not restricted to, commercial use.

c) Type AM (Attendant-Monitored) devices or systems are intended to be constantly operated and maintained by competent and experienced personnel, either locally or at a remote station.

d) Residential Water Hazard entrance alarms are devices or systems intended to be installed on gates, doors, or access barriers surrounding residential swimming pools, spas, or hot tubs for the purpose of sounding an audible alarm due to unauthorized entry into these areas.

1.3 Non-emergency-signaling products covered by these requirements are categorized as Type NM (Non-Monitored), are not associated with property and/or life safety, and are only evaluated relative to product safety.

1.4 A product as covered by these requirements consists of a unit assembly of electrical parts having provision for the connection of power supply circuits routed through the equipment by a prescribed scheme of circuiting. Circuits extending from the products connect to separate devices by which the operating part of the product is actuated for signals, and to separate and/or integral devices by which the signals are indicated so as to form a coordinated system combination for definitive signaling services. An installation wiring diagram attached to the product, or referenced in the product marking, indicates the devices and circuits which have been determined to be capable of being used with the product in the field.

1.5 These requirements do not cover the following:

a) Visual signaling appliances as covered by the Standard for Visual Signaling Appliances – Private Mode Emergency and General Utility Signaling, UL 1638;

b) Audible signaling devices not provided as part of the product and covered by the Standard for Audible Signal Appliances, UL 464;

c) Equipment intended for use in fire-protective signaling systems used to detect, monitor, signal, or control a fire condition;

d) Equipment intended for use in security alarm systems used to protect against burglary;

e) Home health-care signaling equipment as covered by the Standard for Home Health-Care Signaling Equipment, UL 1637.

2 General

2.1 Components

2.1.1 Except as indicated in [2.1.2](#), a component of a product covered by this standard shall comply with the requirements for that component. See Appendix [A](#) for a list of standards covering components used in the products covered by this standard.

2.1.2 A component is not required to comply with a specific requirement that:

- a) Involves a feature or characteristic not required in the application of the component in the product covered by this standard, or
- b) Is superseded by a requirement in this standard.

2.1.3 A component shall be used in accordance with its rating established for the intended conditions of use.

2.1.4 Specific components are incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions.

2.2 Units of measurement

2.2.1 Values stated without parentheses are the requirement. Values in parentheses are explanatory or approximate information.

2.2.2 Unless otherwise indicated, all voltage and current values mentioned in this standard are root-mean-square (rms).

2.3 Undated references

2.3.1 Any undated reference to a code or standard appearing in the requirements of this standard shall be interpreted as referring to the latest edition of that code or standard.

3 Glossary

3.1 For the purpose of this Standard, the following definitions apply.

3.2 **ACKNOWLEDGE** – To confirm that a message or signal has been received, such as pressing a button or the selection of a software command.

3.3 **ACTIVE MULTIPLEX SYSTEM** – A system using a signaling method characterized by simultaneous or sequential transmission, or both, and reception of multiple signals, including a means for positively identifying each signal. Uses signaling devices such as transponders to transmit status signals of each initiating device within a prescribed time interval so that lack of receipt of such signal is to be interpreted as a trouble signal.

3.4 **ADVERSE CONDITION** – Any condition that interferes with the proper transmission or interpretation, or both, of status change signals.

3.5 **ALARM SIGNAL** – A signal indicating an emergency condition requiring immediate action.

3.6 ANNUNCIATOR – An electrically operated visual indicating device containing identified targets or indicator lamps, alphanumeric displays or other means determined to be the equivalent in which each indication provides status information about a circuit, condition, and/or location.

3.7 CHANNEL – A path for voice or signal transmission utilizing modulation of light or alternating current within a frequency band.

3.8 CIRCUIT CLASSIFICATION:

a) HIGH-VOLTAGE CIRCUIT – A circuit involving a potential of not more than 600 volts and having characteristics in excess of those of a low-voltage circuit.

b) LOW-VOLTAGE CIRCUIT – A circuit involving a potential of not more than 30 volts alternating current (AC) rms, 42.4 volts direct current (DC) or peak.

c) POWER-LIMITED CIRCUIT – A circuit wherein the power is limited as specified in [Table 42.1](#) and [Table 42.2](#).

3.9 COMBINATION SYSTEM – An emergency system whose components might be used, in whole or in part in common with a non-emergency signaling system such as non-critical process monitoring, paging, or building automation.

3.10 CONTIGUOUS PROPERTY – A single owner or single user on a continuous plot of ground, including any buildings thereon, that is not separated by a public thoroughfare, transportation right-of-way, property owned or used by others, or body of water not under the same ownership.

3.11 DERIVED CHANNEL – A circuit that uses the local leg of the public switched network as an active multiplex channel while simultaneously allowing that leg's use for normal telephone communications.

3.12 DIGITAL-ALARM COMMUNICATOR RECEIVER (DACR) – A system component that receives and displays signals from digital-alarm communicator transmitters (DACT's) sent over the public switched telephone network.

3.13 DIGITAL-ALARM COMMUNICATOR SYSTEM (DACS) – A system in which signals are transmitted from a digital-alarm communicator transmitter (DACT), located remote from the supervising station, through the public switched telephone network to a digital-alarm communicator receiver (DACR).

3.14 DIGITAL-ALARM COMMUNICATOR TRANSMITTER (DACT) – A system component to which initiating devices or groups of devices are connected. The DACT seizes the connected telephone line, dials a preselected number to connect to a digital-alarm communicator receiver (DACR), and transmits signals indicating a status change.

3.15 DIGITAL-ALARM RADIO RECEIVER (DARR) – A system component that receives and decodes radio signals.

3.16 DIGITAL-ALARM RADIO SYSTEM (DARS) – A system in which signals are transmitted from a digital-alarm radio transmitter (DART) located remote from the supervising station through a radio channel to a digital-alarm radio receiver (DARR).

3.17 DIGITAL-ALARM RADIO TRANSMITTER (DART) – A system component to which initiating devices or a group of devices are connected.

3.18 EMERGENCY – Associated with property and/or life safety and are of a non-fire/non-security alarm nature.

- 3.19 EMERGENCY VOICE/ALARM COMMUNICATIONS – Dedicated manual or automatic facilities for originating and distributing voice instructions, as well as evacuation signals pertaining to an emergency, to the occupants of a building.
- 3.20 END-OF-LINE DEVICE – A device installed at the end of a circuit for the purpose of monitoring the circuit for fault conditions.
- 3.21 EVACUATION – The withdrawal of occupants from a building.
- 3.22 FAULT – An open or ground condition singularly applied on any line extending from a product.
- 3.23 FIXED EQUIPMENT – Any equipment or product that is intended to be permanently connected electrically to the wiring system.
- 3.24 HOUSEHOLD – The family living unit in single-family detached dwelling, single-family attached dwellings, multi-family buildings, and mobile homes.
- 3.25 INITIATING CIRCUIT – Circuit to which automatic or manual initiating devices are connected.
- 3.26 INITIATING DEVICE – A manually or automatically operated device, the normal intended operation of which results in signal indication from the product/system.
- 3.27 INTERCOM – Two-way voice communication equipment intended for emergency use.
- 3.28 KEYPAD – A means of manually controlling the product. Provided with a visual indicating device containing identified targets or indicator lamps, alpha-numeric displays, or other means determined to be the equivalent in which each indication provides status information about a circuit, condition, and/or location.
- 3.29 LEG FACILITY – That part of a communication channel that connects not more than one remote unit to a primary or secondary trunk facility.
- 3.30 LOCAL MONITORING UNIT – A product located at the protected property which connects to initiating and indicating devices for alerting occupants at the premises or transmits signals to a constantly attended supervising station.
- 3.31 NON-EMERGENCY FUNCTION – Not associated with property and/or life safety.
- 3.32 NOTIFICATION APPLIANCE – A component that provides audible, tactile, or visible outputs, or any combination thereof.
- 3.33 NOTIFICATION APPLIANCE CIRCUIT – A circuit or path directly connected to a notification appliance.
- 3.34 NOTIFICATION ZONE – An area covered by notification appliances that are activated simultaneously.
- 3.35 OFF-HOOK – To make connection with the public switched telephone network in preparing to dial a telephone number.
- 3.36 ON-HOOK – To disconnect from the public switched telephone network.

- 3.37 OPERATING PROGRAM – The basic operating software that is alterable only to the equipment manufacturer. This software is sometimes referred to as firmware, BIOS, or executive program.
- 3.38 PATH – Any conductor, optic fiber, radio carrier, or other means for transmitting information between two or more units and/or locations.
- 3.39 PORTABLE EQUIPMENT – Any conductor, optic fiber, radio carrier, or other means for transmitting information between two or more units and/or locations.
- 3.40 POWER SUPPLY – A source of electrical operating power including the circuits and terminations connecting it to the dependant product/system components.
- 3.41 PRE-RECORDED MESSAGE DEVICE – An automatically- or manually-actuated device intended to translate a prerecorded message stored on a tape or other medium into an electronic signal that, when amplified and introduced into speakers, produces vocal or tonal information.
- 3.42 PRIMARY BATTERY – Any battery which by design or construction is not intended to be recharged.
- 3.43 PRIMARY OPERATOR INTERFACE – Intended to be the main means of interfacing the controls for manually operating the product/system.
- 3.44 PRIMARY TONE GENERATOR – A device intended to generate an electronic signal that, when amplified and introduced into speakers, produces a non-prerecorded, nonvocal audible signal recognizable as indicating an evacuation condition.
- 3.45 PRIVATE RADIO FREQUENCY SYSTEM – A radio system under the control of the supervising station or other company where only private access to the system is permitted.
- 3.46 PROGRAM-CONTROLLED UNIT – A unit for which the intended operation is controlled or influenced by a stored program. The word "program," as used here, refers to a set of instructions that is carried out in a sequential and repetitive manner and that determines the system output signal resulting from a specific system input signal. The word "stored" refers to the action provided by memory devices in which the memory is either transient or permanent and that are used for retaining information, instruction, status, and similar information.
- 3.47 REMOTE MONITORING UNIT – A unit that monitors inputs and controls outputs through various types of circuits and that serves a local location.
- 3.48 REPEATER – Equipment used to relay signals between a remote unit, initiating device or similar device and the receiving unit.
- 3.49 RESIDENTIAL WATER HAZARD ENTRANCE ALARM – A product intended to monitor moveable accesses (doors, screens, or similar structures) that give direct access to residential aquatic areas such as swimming pools, spas or hot tubs.
- 3.50 RISK OF ELECTRICAL SHOCK – A risk of electrical shock is determined to exist within a circuit unless that circuit meets one of the following criteria:
- a) The circuit is supplied by an isolating source such that the maximum open circuit voltage potential available to the circuit is not more than 30 V AC rms, 42.4 V DC, or 42.4 V peak or
 - b) The circuit is supplied by an isolating source such that the current available through a 1500-ohm resistor connected across any potential in the circuit (including to ground) does not exceed 5 mA.

3.51 RISK OF FIRE – A risk of fire is determined to exist within a circuit unless that circuit meets both of the following criteria:

- a) The circuit is supplied by a power source such that the maximum open-circuit voltage potential available to the circuit is not more than 30 V AC or 42.4 V peak and
- b) The circuit in which the power available to the circuit is limited to a value less than 15 watts.

3.52 SIGNALING CIRCUIT – A circuit over which signals are transmitted between separately enclosed equipment.

3.53 SITE-SPECIFIC SOFTWARE – Software that defines the specific operation and configuration of a particular system. Typically it defines the type and quantity of hardware modules, customized labels, and specific operating features of a system.

3.54 STANDBY POWER SOURCE – Provides power when the primary power source fails. An alternative is another electrical power source, a rechargeable battery, or a non-rechargeable battery.

3.55 STATIONARY EQUIPMENT – Any product that is intended to be fastened in place or located in a dedicated space, and is provided with a power-supply cord for connection to the supply circuit.

3.56 STORAGE BATTERY – Any battery which, by design or construction, is intended to be recharged.

3.57 SUPERVISING STATION – The operator interface of a Type AM system to which alarm and trouble signals are directly monitored or are received from remote monitoring units. Intended to be constantly attended and maintained by competent and experienced personnel.

3.58 SUPPLEMENTARY – Refers to equipment or operations not required by this standard.

3.59 SUPPLEMENTARY DEVICE – A device intended to be connected to a supplementary-device circuit.

3.60 SUPPLEMENTARY-DEVICE CIRCUIT – A circuit provided by the product for controlling a device, the operation of which is supplementary to the primary initiating alarm and alerting devices of the product.

3.61 SWITCHED TELEPHONE NETWORK – An assembly of communication facilities and central office equipment operated jointly by authorized service providers that provides the general public with the ability to establish transmission channels via discrete dialing.

3.62 TRANSMISSION FAULT – A condition which interrupts communication on a signaling circuit.

3.63 TRANSMITTER – A system component that provides an interface between signaling circuits, initiating circuits/devices, or other units and the transmission channel.

3.64 TRANSPONDER – A multiplex alarm transmission system functional assembly located remote from the supervising station.

3.65 TROUBLE SIGNAL – A signal indicating a fault condition of any nature, such as a circuit break or ground or other trouble condition occurring in the device or wiring associated with the product.

3.66 TRUNK FACILITY – That part of the communication channel that connects two or more leg facilities to a supervising station.

a) PRIMARY TRUNK FACILITY – That part of a communication channel that connects all leg facilities to a supervising station.

b) SECONDARY TRUNK FACILITY – That part of a communication channel that connects all leg facilities to a supervising station.

3.67 WIRE-TO-WIRE FAULT – A wire-to-wire (short-circuit) fault is determined to be a resistance of 0.1 ohm or less across the circuit.

4 Equipment Types

4.1 Signaling systems and devices covered by this standard are categorized by the following types to facilitate determining the applicable requirements. See [Table 4.1](#) for references to the sections applicable to each type.

Table 4.1
Sections of standard applicable to equipment types

Equipment types	Construction requirements, sections	Performance requirements, sections
NM	5–33	34–56, 62, 64–66, 81–84
UM, SM, AM	5–33	34–76, 81–84
Residential water hazard entrance alarm	5–33	34–84

5 Installation and Operating Instructions

5.1 A copy of the installation and operating instructions and related schematic wiring diagrams and installation drawings shall be used as a guide in the examination and test of the product. For this purpose, a printed edition is not required.

5.2 The instructions and drawings shall include directions and information for proper and safe installation, testing, maintenance, operation, and use of the product.

6 Compatibility

6.1 The interconnection of the product with other products shall be evaluated for the purpose of operating as a coordinated system relative to the intended emergency signaling and without risk of fire, shock, or injury to persons.

6.2 The requirements of [6.1](#) apply to:

a) Separate products connected to any circuit and by which the operating parts of the product are actuated for signaling and/or action and

b) Separate or incorporated appliances or units by which signals are indicated or actions carried out.

6.3 Power circuits interconnecting products shall have compatible voltage and current ratings.

6.4 All equipment directly connected to the product shall be evaluated for the application.

CONSTRUCTION

ALL PRODUCTS

7 General

7.1 A product shall use materials that have been determined to comply with the requirements for the particular use, as indicated by the performance requirements of this standard.

7.2 Metals, when required to meet the requirements of this standard, shall not be used in such combination as to cause galvanic action that increases the risk of fire, electric shock, injury to persons, or impair the operation of a product associated with the safety of life and/or property protection.

7.3 When breakage or deterioration of a part such as an enclosure, a frame, a guard results in a risk of injury to persons, then the part shall be constructed to meet the demand or expected loading conditions.

7.4 The requirement in [7.3](#) applies also to those positions of a part adjacent to a moving part identified to involve a risk of injury to persons.

8 Enclosure

8.1 General

8.1.1 All electrical parts of a product shall be enclosed to provide protection of internal components and prevent contact with uninsulated live parts.

8.1.2 Enclosures shall have the strength and rigidity to resist the abuses to which the product is likely to be subjected during intended use without increasing the risk of fire, electrical shock, or injury to persons

8.1.3 Enclosure parts fastened with adhesive meeting [11.5](#) – [11.8](#) shall comply with the test requirements in Mechanical Strength Tests for Metal Enclosures and Guards and Enclosure Parts Fastened with Adhesive, Section [48](#).

8.2 Metallic material

8.2.1 An enclosure of metal shall have a minimum thickness as specified in [Table 8.1](#), [Table 8.2](#), or [Table 8.3](#) or shall comply with the test requirements in Mechanical Strength Tests for Metal Enclosures and Guards, and Enclosure Parts Fastened with Adhesive Section [48](#).

Table 8.1
Cast-metal electrical enclosures

Use, or dimensions of area involved ^a	Minimum thickness			
	Die-cast metal,		Cast metal other than die-cast,	
	inch	(mm)	inch	(mm)
Area of 24 square inches (155 cm ²) or less and having no dimension greater than 6 inches (152 mm)	1/16	1.6	1/8	3.2
Area greater than 24 square inches (155 cm ²) or having any dimension greater than 6 inches (152 mm)	3/32	2.4	1/8	3.2

Table 8.1 Continued on Next Page

Table 8.1 Continued

Use, or dimensions of area involved ^a	Minimum thickness			
	Die-cast metal,		Cast metal other than die-cast,	
	inch	(mm)	inch	(mm)
At a threaded conduit hole	1/4	6.4	1/4	6.4
At an unthreaded conduit hole	1/8	3.2	1/8	3.2

^a The area limitation for metal 1/16 inch (1.6 mm) thick may be obtained by the provision of reinforcing ribs subdividing a larger area.

**Table 8.2
Minimum thickness of sheet metal for electrical enclosures of carbon steel or stainless steel**

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness							
Maximum width, ^b		Maximum length, ^c		Maximum width, ^b		Maximum length, ^c		Uncoated,		Metal coated,	
inches	(cm)	inches	(cm)	inches	(cm)	inches	(cm)	inches	(mm)	inches	(mm)
								[MSG]		[GSG]	
4.0	10.2	Not limited		6.25	15.9	Not limited		0.020	(0.51)	0.023	(0.58)
4.75	12.1	5.75	14.6	6.75	17.1	8.25	21.0	[24]	[24]		
6.0	15.2	Not limited		9.5	24.1	Not limited		0.026	(0.66)	0.029	(0.74)
7.0	17.8	8.75	22.2	10.0	25.4	12.5	31.8	[22]	[22]		
8.0	20.3	Not limited		12.0	30.5	Not limited		0.032	(0.81)	0.034	(0.86)
9.0	22.9	11.5	29.2	13.0	33.0	16.0	40.6	[20]	[20]		
12.5	31.8	Not limited		19.5	49.5	Not limited		0.042	(1.07)	0.045	(1.14)
14.0	35.6	18.0	45.7	21.0	53.3	25.0	63.5	[18]	[18]		
18.0	45.7	Not limited		27.0	68.6	Not limited		0.053	(1.35)	0.056	(1.42)
20.0	50.8	25.0	63.5	29.0	73.7	36.0	91.4	[16]	[16]		
22.0	55.9	Not limited		33.0	83.8	Not limited		0.060	(1.52)	0.063	(1.60)
25.0	63.5	31.0	78.7	35.0	88.9	43.0	109.2	[15]	[15]		
25.0	63.5	Not limited		39.0	99.1	Not limited		0.067	(1.70)	0.070	(1.78)
29.0	73.7	36.0	91.4	41.0	104.1	51.0	129.5	[14]	[14]		
33.0	83.8	Not limited		51.0	129.5	Not limited		0.080	(2.03)	0.084	(2.13)
38.0	96.5	47.0	119.4	54.0	137.2	66.0	167.6	[13]	[13]		
42.0	106.7	Not limited		64.0	162.6	Not limited		0.093	(2.36)	0.097	(2.46)
47.0	119.4	59.0	149.9	68.0	172.7	84.0	213.4	[12]	[12]		
52.0	132.1	Not limited		80.0	203.2	Not limited		0.108	(2.74)	0.111	(2.82)
60.0	152.4	74.0	188.0	84.0	213.4	103.0	261.6	[11]	[11]		
63.0	160.0	Not limited		97.0	246.4	Not limited		0.123	(3.12)	0.126	(3.20)
73.0	185.4	90.0	228.6	103.0	261.6	127.0	322.6	[10]	[10]		

^a A supporting frame is a structure of angle or channel or a folded rigid section of sheet metal that is rigidly attached to and has essentially the same outside dimensions as the enclosure surface and that has sufficient torsional rigidity to resist the bending moments which may be applied via the enclosure surface when it is deflected. Construction that is considered to have equivalent reinforcing may be accomplished by designs that will produce a structure that is as rigid as one built with a frame of angles or channels. Construction considered to be without supporting frame includes:

Table 8.2 Continued on Next Page

Table 8.2 Continued

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness			
Maximum width, ^b		Maximum length, ^c		Uncoated,		Metal coated,	
inches	(cm)	inches	(cm)	inches	(mm)	inches	(mm)
				[MSG]		[GSG]	
1) A single sheet with single formed flanges (formed edges), 2) A single sheet which is corrugated or ribbed, and 3) An enclosure surface loosely attached to a frame, for example, with spring clips.							
^b The width is the smaller dimension of a rectangular sheet metal piece which is part of an enclosure. Adjacent surfaces of an enclosure may have supports in common and be made of a single sheet.							
^c For panels which are not supported along one side, for example, side panels of boxes, the length of the unsupported side shall be limited to the dimensions specified unless the side in question is provided with a flange at least 1/2 inch (12.7 mm) wide.							

Table 8.3
Minimum thickness of sheet metal for electrical enclosures of aluminum, copper, or brass

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness,			
Maximum width, ^b		Maximum length, ^c		inches		(mm)	
inches	(cm)	inches	(cm)	inches	(mm)	inches	(mm)
3.0	7.6	Not limited		7.0	17.8	Not limited	
3.5	8.9	4.0	10.2	8.5	21.6	9.5	24.1
4.0	10.2	Not limited		10.0	25.4	Not limited	
5.0	12.7	6.0	15.2	10.5	26.7	13.5	34.3
6.0	15.2	Not limited		14.0	35.6	Not limited	
6.5	16.5	8.0	20.3	15.0	38.1	18.0	45.7
8.0	20.3	Not limited		19.0	48.3	Not limited	
9.5	24.1	11.5	29.2	21.0	53.3	25.0	63.5
12.0	30.5	Not limited		28.0	71.1	Not limited	
14.0	35.6	16.0	40.6	30.0	76.2	37.0	94.0
18.0	45.7	Not limited		42.0	106.7	Not limited	
20.0	50.8	25.0	63.5	45.0	114.3	55.0	139.7
25.0	63.5	Not limited		60.0	152.4	Not limited	
29.0	73.7	36.0	91.4	64.0	162.6	78.0	198.1
37.0	94.0	Not limited		87.0	221.0	Not limited	
42.0	106.7	53.0	134.6	93.0	236.2	114.0	289.6
52.0	132.1	Not limited		123.0	312.4	Not limited	
60.0	152.4	74.0	188.0	130.0	330.2	160.0	406.4
^a A supporting frame is a structure of angle or channel or a folded rigid section of sheet metal which is rigidly attached to and has essentially the same outside dimensions as the enclosure surface and which has sufficient torsional rigidity to resist the bending moments which may be applied via the enclosure surface when it is deflected. Construction that is considered to have equivalent reinforcing may be accomplished by designs that will produce a structure which is as rigid as one built with a frame of angles or channels. Construction considered to be without supporting frame includes:							
1) A single sheet with single formed flanges (formed edges),							

Table 8.3 Continued on Next Page

Table 8.3 Continued

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness, inches (mm)
Maximum width, ^b inches (cm)	Maximum length, ^c inches (cm)	Maximum width, ^b inches (cm)	Maximum length, inches (cm)	
2) A single sheet which is corrugated or ribbed, and 3) An enclosure surface loosely attached to a frame, for example, with spring clips. ^b The width is the smaller dimension of a rectangular sheet metal piece which is part of an enclosure. Adjacent surfaces of an enclosure may have supports in common and be made of a single sheet. ^c For panels which are not supported along one side, for example, side panels of boxes, the length of the unsupported side shall be limited to the dimensions specified unless the side in question is provided with a flange at least 1/2 inch (12.7 mm) wide.				

8.2.2 When threads for the connection of conduit are tapped all the way through a hole in an enclosure wall, or when a construction that is determined to be the equivalent is used, there shall not be less than 3-1/2 nor more than 5 threads in the metal, and the construction shall be such that a standard conduit bushing is capable of being attached.

8.2.3 When threads for the connection of conduit are tapped only part of the way through a hole in an enclosure wall, there shall not be less than five full threads in the metal. There shall be a smooth, rounded inlet hole for the conductors which shall afford protection to the conductors determined to be the equivalent to that provided by a standard conduit bushing.

8.2.4 At any point where conduit or metal-clad cable shall be attached to the enclosure, sheet metal shall be minimum 0.032 inch (0.81 mm) thick or shall be formed or reinforced so that it shall have the stiffness minimum to an uncoated flat sheet of steel.

8.3 Polymeric materials

8.3.1 Polymeric materials used as an enclosure shall comply with the applicable portion of the Standard for Polymeric Materials – Use in Electrical Equipment Evaluations, UL 746C, and also with the additional requirements specified in this Standard.

8.3.2 Polymeric material that is not used as an enclosure, but that is attached to or exposed on the outside of a product such as a viewing window, shall have flammability characteristics as shown in [Table 8.4](#).

**Table 8.4
Flammability characteristics of polymeric material**

Polymeric material area/dimensions	Flammability rating
0.24 inches ³ (4 cm ³) maximum and 2.4 inches (61 mm) maximum length	None
Greater than 0.24 inches ³ (4 cm ³) and less than 2 square feet (0.19 m ²), 6 feet (1.83 m) maximum length	HB, V-2, V-1, V-0, or 5V
Greater than 2 square feet (0.19 m ²) and less than 10 square feet (0.93 m ²), 6 feet (1.83 m) maximum length	V-1, V-0, or 5V
Greater than 10 square feet (0.93 m ²), or longer than 6 feet (1.83 m)	Maximum flame spread rating of 200 as specified in the Standard for Test for Surface Burning Characteristics of Building Materials, UL 723, or radiant panel as specified in the Standard for Tests for Flammability of Plastic Materials for Parts in Devices and Appliances, UL 94

8.3.3 Conductive coatings applied to nonmetallic surfaces such as the inside surface of an enclosure, shall comply with the appropriate requirements in the Standard for Polymeric Materials – Use in Electrical Equipment Evaluations, UL 746C, unless flaking or peeling of the coating cannot result in the reduction of spacings or the bridging of live parts.

8.3.4 A polymeric enclosure intended for connection to a rigid metallic conduit system shall comply with the requirements for polymeric enclosure rigid metallic conduit connections in the Standard for Enclosures for Electrical Equipment, UL 50.

8.3.5 The continuity of a conduit system shall be provided by metal-to-metal contact and not rely on a polymeric material and shall comply with the requirements for polymeric enclosure bonding in the Standard for Enclosures for Electrical Equipment, UL 50.

8.4 Covers

8.4.1 An enclosure cover shall be hinged, sliding, pivoted or similarly attached to provide access:

- a) To fuses or any other over current-protective device, the intended protective functioning of which requires renewal or
- b) When it is necessary to open the cover in connection with the normal operation of the unit.

Exception: In lieu of providing a hinged, sliding, or pivoted cover, supervision of the enclosure cover by means of a tamper feature is suitable when its operation results in either a trouble or alarm signal. This applies only to over current devices such as fuses or circuit breakers or other indicators that are not used on a continuing basis.

8.4.2 Normal operation, referenced in [8.4.1](#), is determined to be operation of a switch for testing or for silencing an audible signal appliance or operation of any other component of a unit which requires such action in connection with its intended performance.

8.4.3 A hinged cover is not required when the only fuse(s) enclosed is intended to provide protection to portions of internal circuits used on a separate printed-wiring board or circuit subassembly, to prevent circuit damage resulting from a fault. The use of such a fuse(s) is suitable when the following (or other wording that has been determined to be equivalent) is indicated as a marking on the outside of the cover: "Circuit Fuse(s) Inside – Disconnect Power Prior To Servicing."

8.4.4 Glass covering an observation opening shall be tempered and secured in place so that it cannot be displaced and shall provide mechanical protection for the enclosed parts. The thickness of a glass cover shall not be less than that indicated in [Table 8.5](#).

Table 8.5
Thickness of glass covers

Maximum size of opening				Minimum thickness,	
Length or width,		Area,			
inches	(mm)	inches ²	(cm ²)	inch	(mm)
4	102	16	103	1/16	1.6
12	305	144	929	1/8	3.2
over 12	over 305	over 144	over 929	see note a	

^a 1/8 inch (3.2 mm) or more, depending upon the size, shape, and mounting of the glass panel.

8.4.5 A glass panel for an opening having an area of more than 144 square inches (929 cm²), or having any dimension greater than 12 inches (305 mm), shall be supported by a continuous groove not less than 3/16 inch (4.8 mm) deep along all four edges of the panel, or other means that have been determined to be an equivalent arrangement.

8.4.6 A transparent material other than glass used for the cover of an observation opening shall not introduce a risk of fire, distort, nor become less transparent at the temperature to which it is intended to be subjected under either normal or abnormal service conditions. See [8.3.2](#).

8.5 Battery compartments

8.5.1 A compartment for vented storage batteries shall have a total volume at least twice the volume occupied by the batteries. Ventilating openings shall be provided and so located as to permit circulation of air for dispersion of gas while the battery is being charged at the highest rate permitted by the means incorporated in the control unit.

8.5.2 The interior of a storage battery compartment shall be protected so that it will be resistant to detrimental action by the electrolyte.

8.6 Enclosure openings – general

8.6.1 An enclosure intended for recessed mounting and whose front panel is to be flush with the surface of the wall shall have no openings that vent into concealed spaces of a building structure, such as into hollow spaces in the wall, when the product is mounted as intended.

8.6.2 The requirement in [8.6.1](#) does not apply to an opening for a mounting screw or nail or for a manufacturing operation (such as paint drainage) when:


- a) The opening does not have a dimension greater than 17/64 inch (6.75 mm) or an area greater than 0.055 square inch (35.5 mm²) and
- b) There are no more mounting screw holes than are needed to mount the product.

8.7 Enclosure top openings


8.7.1 An opening directly over an uninsulated live part involving a risk of fire, electric shock, or electrical-energy/high-current levels, shall not exceed 0.20 inch (5.0 mm) in any dimension unless the configuration is such that a vertically falling object cannot fall into the unit and contact an uninsulated live part. See [Figure 8.1](#) for examples of top-cover designs complying with the intent of the requirement.

Figure 8.1

Cross-sections of top-cover designs

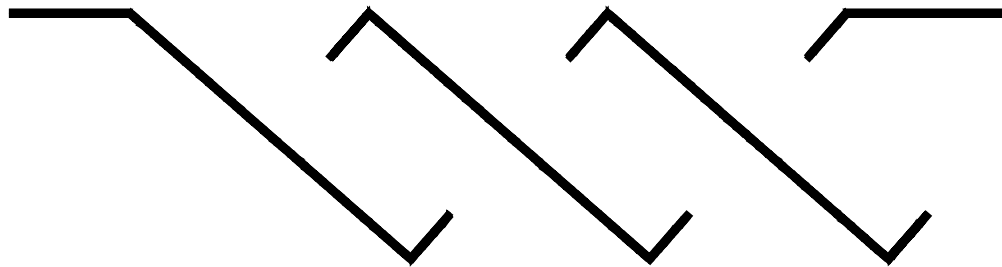

SLANTED OPENINGS

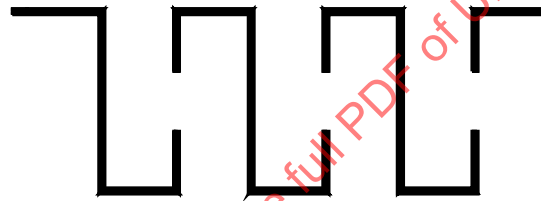

EC500


VERTICAL OPENINGS

8.8 Enclosure side openings

8.8.1 An opening in the side of the enclosure shall:

- a) Not exceed 0.19 inch (4.8 mm) in any dimension;
- b) Be provided with louvers shaped to deflect an external falling object outward. See [Figure 8.2](#) for examples of louver designs complying with the requirement; or
- c) Be located and of such size so that objects which are to be present cannot fall into the unit and drop (with no horizontal velocity) onto uninsulated live parts involving a risk of fire, electric shock, or electrical energy/high-current levels, or parts involving injury to persons.


Figure 8.2
Louvers

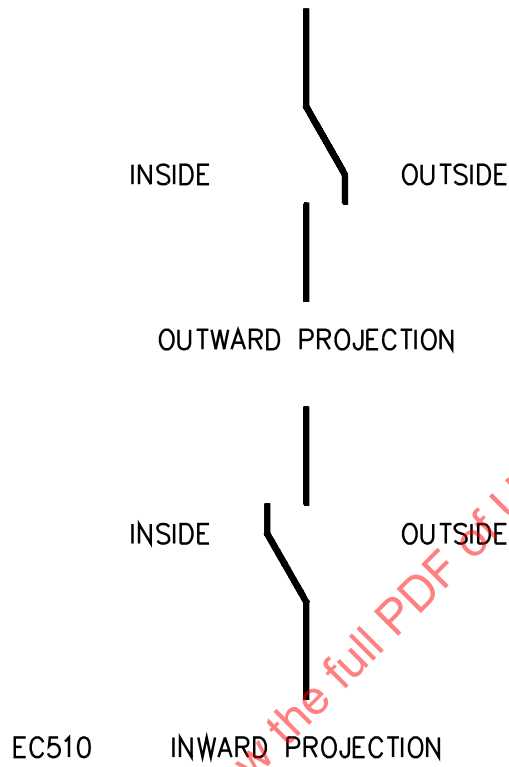

8.8.2 When a portion of a side panel falls within the area traced out by the 5 degree angle in [Figure 8.3](#), that portion of the side panel shall be investigated as a bottom enclosure in accordance with [8.9.1](#) – [8.9.3](#).

ULNORM.COM : Click to view the full PDF of UL 2017 2024

Figure 8.3
Enclosure bottom

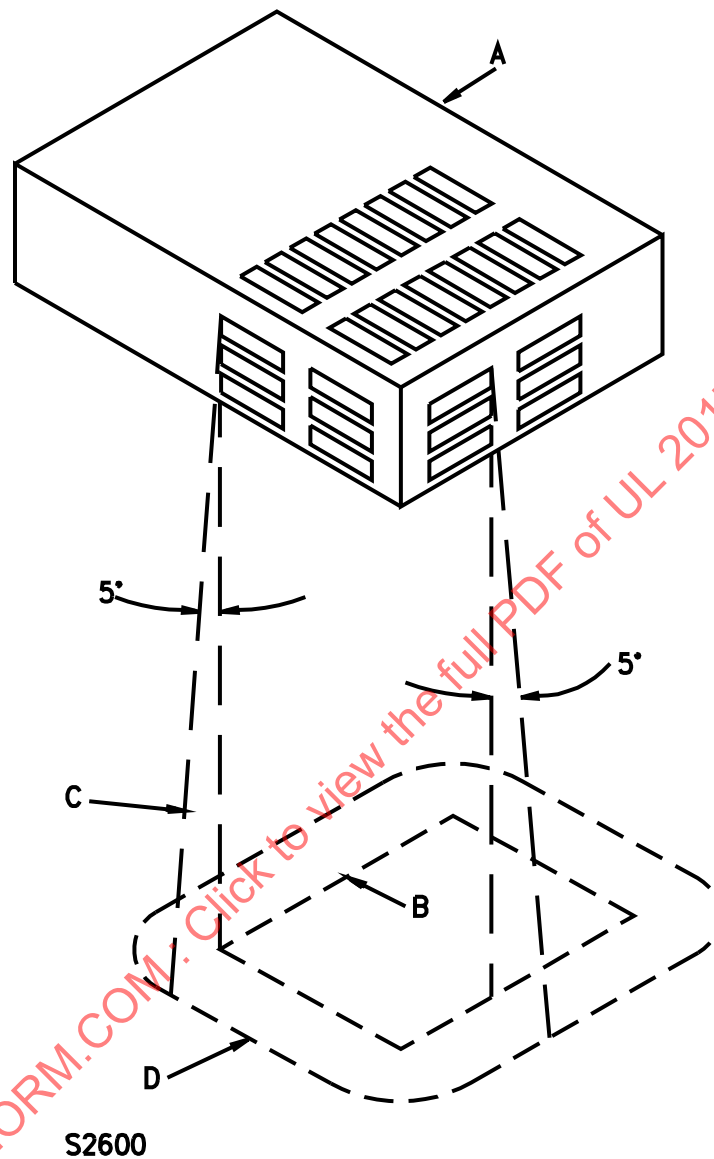

A – The entire component under which an enclosure (flat or dished with or without a lip or other raised edge) of noncombustible material is to be provided. The sketch is of an enclosed component with ventilation openings showing that the enclosure is required only for those openings through which flaming parts are to be emitted. When the component or assembly does not have its own noncombustible enclosure, the area to be protected is the entire area occupied by the component or assembly.

B – Projection of the outline of the area of A that requires a bottom enclosure vertically downward onto the horizontal plane of the lowest point on the outer edge D of the enclosure.

C – Inclined line that traces out an area D on the horizontal plane of the enclosure. Moving around the perimeter of the area B that requires a bottom enclosure, this line projects at a 5 degree angle from the line extending vertically at every point around the perimeter of A and is oriented to trace out the largest area; except that the angle shall be less than 5 degrees when the enclosure bottom contacts a vertical enclosure or side panel, or when the horizontal extension of the enclosure B to D exceeds 6 inches (152 mm).

D – Minimum outline of the enclosure, except that the extension B to D is not required to exceed 6 inches (152 mm), flat or dished with or without a tip or other raised edge. The bottom shall either be flat or formed in any manner when every point of area D is at or below the lowest point on the outer edge of the enclosure.

8.9 Enclosure bottom openings

8.9.1 The bottom of an enclosure shall consist of a complete or partial bottom enclosure under a component, groups of components, or assemblies, as shown in [Figure 8.3](#), that complies with the ventilation opening requirements in [8.9.2](#) and [8.9.3](#) unless a test demonstrates that the bottom enclosure provided contains flames, glowing particles or similar burning debris when all combustible material in the interior is ignited.

Exception: Openings without limitation on their size and number are permitted in areas that contain only wires, cables, plugs, receptacles, and impedance-protected and thermally protected motors.

8.9.2 Ventilation openings provided in the bottom of an enclosure under materials that are not rated V-1 or less flammable meet the intent of the requirements when the openings are constructed so that materials do not fall directly from the interior of the unit. Other bottom-opening constructions that comply with the intent of the requirements are those that incorporate a perforated metal plate as described in [Table 8.6](#), or a galvanized or stainless-steel screen having a 14 by 14 mesh per 1 inch (25.4 mm) constructed of wire with a minimum diameter of 1/64 inch (0.4 mm). Other constructions are to be used only when they comply with the Ignition Test Through Bottom-Panel Openings, Section [50](#).

Table 8.6
Perforated metal plates

Minimum thickness,		Maximum diameter of holes,		Minimum spacing of holes center-to-center,	
inch	(mm)	inch	(mm)	inch	(mm)
0.026	0.66	0.045	1.14	0.67	1.70
				[233 holes per inch ²]	[36 holes per cm ²]
0.026	0.66	0.047	1.19	0.093	2.36
0.032	0.81	0.075	1.91	0.125	3.18
				[72 holes per inch ²]	[11 holes per cm ²]
0.036	0.91	0.063	1.60	0.109	2.77
0.036	0.91	0.078	1.98	0.125	3.18

8.9.3 The bottom of the enclosure under areas containing only materials rated V-1 or less flammable shall have openings no larger than 1/16 inch² (40 mm²).

8.10 Gaskets

8.10.1 A gasket shall be of a material suitable for the temperature and use to which it will be subjected. The gasket material shall be resistant to aging. A gasket that will be disturbed during routine servicing, such as during battery replacement, shall be formed of resilient material such as neoprene or silicone rubber.

8.10.2 A gasket of neoprene, rubber, neoprene composition, or rubber composition used to prevent the entry of water into a fixture shall be subjected to the Gasket Accelerated Aging Test, Section [54](#), and when intended for outdoor use, Gasket Low Temperature Test – Outdoor Use, Section [55](#).

8.10.3 A gasket material other than those specified in [8.10.2](#) meets the intent of the requirements when the characteristics are determined to be the equivalent, including resistance to aging. Such material is determined resistant to aging when there is no visible evidence of deterioration (such as cracking after flexing, softening, or hardening) after these characteristics are investigated.